



# ***Service Manual***

## **Multi Variable Air Conditioners Indoor Units**

(GC202011-XIV)

Capacity: 5800Btu/h~96000Btu/h

Rated Frequency: 60 Hz



# CONTENTS

<b>PRODUCT .....</b>	<b>1</b>
<b>CHAPTER 1 PRODUCT.....</b>	<b>2</b>
<b>1 Product List.....</b>	<b>2</b>
1.1 Low Static Pressure Duct Type Indoor Unit .....	2
1.2 Slim Duct Type Indoor Unit.....	2
1.3 Four-way Cassette Type Indoor Unit .....	3
1.4 Wall Mounted Type Indoor Unit .....	3
1.5 Console Type Indoor Unit .....	4
1.6 High Static Pressure Duct Type Indoor Unit .....	4
1.7 Two-way Cassette Type Indoor Unit .....	5
1.8 Floor Ceiling Type Indoor Unit .....	5
1.9 Fresh Air Processing Type Indoor Unit .....	5
1.10 Compact Four-way Cassette Type Indoor Unit.....	6
1.11 Super High Static Pressure Duct Type Indoor Unit .....	6
1.12 Air Handler type Indoor Unit .....	7
1.13 AHU-KIT .....	7
1.14 1-way Cassette Type Indoor Unit .....	8
1.15 General Static Pressure Duct Type Indoor Unit.....	8
1.16 360° Air Discharge Compact Cassette Type Indoor Unit.....	8
1.17 360° Air Discharge Cassette Type Indoor Unit.....	9
<b>2 Nomenclature .....</b>	<b>10</b>
<b>3 Product Features .....</b>	<b>11</b>
3.1 Features of Low Static Pressure Duct Type Indoor Unit .....	11
3.2 Features of Slim Duct Type Indoor Unit.....	11
3.3 Features of Four-way Cassette Type Indoor Unit.....	12
3.4 Features of Wall Mounted Type Indoor Unit .....	12
3.5 Features of Console Type Indoor Unit.....	13
3.6 Features of High Static Pressure Duct Type Indoor Unit .....	13
3.7 Features of Two-way Cassette Type Indoor Unit.....	13
3.8 Features of Floor Ceiling Type Indoor Unit.....	13
3.9 Features of Fresh air Processing Type Indoor Unit .....	14
3.10 Features of Compact Four-way Cassette Type Indoor Unit.....	14
3.11 Features of Super High Static Pressure Duct Type Indoor Unit.....	15
3.12 Features of Air Handler Type Indoor Unit .....	15
3.13 Features of AHU-KIT .....	15
3.14 Features of 1-way Cassette Type Indoor Unit .....	16
3.15 Features of General Static Pressure Duct Type Indoor Unit.....	16

3.16 Features of 360° Air Discharge Compact Cassette Type Indoor Unit .....	16
3.17 Features of 360° Air Discharge Cassette Type Indoor Unit.....	17
<b>4 Specifications.....</b>	<b>18</b>
4.1 Low Static Pressure Duct Type Indoor Unit .....	18
4.2 Slim Duct Type Indoor Unit.....	22
4.3 Four-way Cassette Type Indoor Unit.....	24
4.4 Wall Mounted Type Indoor Unit .....	26
4.5 Console Type Indoor Unit.....	29
4.6 High Static Pressure Duct Type Indoor Unit .....	30
4.7 Two-way Cassette Type Indoor Unit.....	32
4.8 Floor Ceiling Type Indoor Unit.....	33
4.9 Fresh air Processing Type Indoor Unit .....	35
4.10 Compact Four-way Cassette Type Indoor Unit.....	37
4.11 Super High Static Pressure Duct Type Indoor Unit .....	38
4.12 Air Handler Type Indoor Unit .....	42
4.13 AHU-KIT .....	44
4.14 1-way Cassette Type Indoor Unit .....	47
4.15 General Static Pressure Duct Type Indoor Unit.....	48
4.16 360° Air Discharge Compact Cassette Type Indoor Unit.....	49
4.17 360° Air Discharge Cassette Type Indoor Unit.....	51
<b>CONTROL.....</b>	<b>54</b>
<b>CHAPTER 2 CONTROL.....</b>	<b>55</b>
<b>1 Operation Flowchart.....</b>	<b>55</b>
<b>2 Wired Controller.....</b>	<b>56</b>
2.1 Control Panel.....	56
2.2 Installation and Removal .....	63
<b>3 Remote Controller .....</b>	<b>68</b>
3.1 Remote Controller YAP1F .....	68
3.2 Remote Controller YV1L1.....	69
<b>4 Introduction to Unit Functions .....</b>	<b>70</b>
4.1 Engineering Application Functions Operated through the XK46 Wired Controller .....	71
4.2 Engineering Application Functions Operated through the XK49 Wired Controller .....	87
4.3 Engineering Application Functions Operated through the XK79 Wired Controller .....	89
4.4 Engineering Application Functions Operated through the YV1L1 Remote Controller .....	92
4.5 Engineering Application Functions Operated through the YAP1F Remote Controller .....	98
<b>INSTALLATION .....</b>	<b>100</b>
<b>CHAPTER 3 INSTALLATION.....</b>	<b>101</b>
<b>1 Engineering Installation Preparation and Notice .....</b>	<b>101</b>

1.1 Installation Notice .....	101
1.2 Installation Key Points and Importance .....	101
<b>2 Installation Materials Selection.....</b>	<b>102</b>
2.1 Refrigerant Piping.....	103
2.2 Condensate Water Pipe.....	103
2.3 Insulation Material .....	103
2.4 Communication Cable and Control Cable .....	104
2.5 Power Cable .....	104
2.6 Hanger Rod and Support.....	104
<b>3 Installation of Indoor Unit.....</b>	<b>105</b>
3.1 Installation of Low Static Pressure Duct Type Indoor Unit.....	105
3.2 Installation of Slim Duct Type Indoor Unit.....	107
3.3 Installation of Four-way Cassette Type Indoor Unit.....	110
3.4 Installation of Wall-mounted Indoor Unit.....	112
3.5 Installation of Console Type Indoor Unit.....	114
3.6 Installation of High Static Pressure Duct Type Indoor Unit .....	116
3.7 Installation of Two-way Cassette Type Indoor Unit.....	120
3.8 Installation of Floor Ceiling Type Indoor Unit.....	121
3.9 Installation of Fresh Air Processing Indoor Unit.....	123
3.10 Installation of Compact Four-way Cassette Type Indoor Unit.....	125
3.11 Installation of Super High Static Pressure Duct Type Indoor Unit.....	127
3.12 Installation of Air Handler type Indoor Unit .....	130
3.13 Installation of AHU-KIT .....	132
3.14 Installation of 1-way Cassette Type Indoor Unit .....	139
3.15 Installation of General Static Pressure Duct Type Indoor Unit.....	141
3.16 Installation of 360° Air Discharge Compact Cassette Type Indoor Unit .....	142
3.17 Installation of 360° Air Discharge Cassette Type Indoor Unit.....	144
<b>4 Installation of Connection Pipe .....</b>	<b>145</b>
4.1 Flaring Process.....	145
4.2 Pipe Bending .....	146
4.3 Indoor Pipe Connection.....	146
<b>5 Installation of Drain Pipe .....</b>	<b>147</b>
5.1 Precautions When Doing the Piping Work .....	147
5.2 Installing the Drain Pipes .....	148
5.3 Precautions When Doing Riser Piping Work .....	150
5.4 Testing of Drain Piping.....	150
<b>6 Electrical Installation .....</b>	<b>150</b>
<b>MAINTENANCE .....</b>	<b>152</b>

<b>CHAPTER 4 MAINTENANCE .....</b>	<b>153</b>
<b>1 Malfunction List .....</b>	<b>153</b>
1.1 Malfunction List for the Wired Controller .....	153
1.2 Display of Light Board (Only for Two-way Cassette Type Indoor Unit).....	153
1.3 Exception Analyzing and Troubleshooting.....	154
<b>2 After-sales Emergency Measures.....</b>	<b>167</b>
<b>3 Wiring Diagram .....</b>	<b>168</b>
3.1 Low Static Pressure Duct Type Indoor Unit.....	168
3.2 Slim Duct Type Indoor Unit.....	170
3.3 Four-way Cassette Type Indoor Unit.....	170
3.4 Wall Mounted Type Indoor Unit .....	171
3.5 Console Type Indoor Unit.....	172
3.6 High Static Pressure Duct Type Indoor Unit .....	173
3.7 Two-way Cassette Type Indoor Unit.....	174
3.8 Floor Ceiling Type Indoor Unit .....	174
3.9 Fresh Air Processing Indoor Unit.....	175
3.10 Compact Four-way Cassette Type Indoor Unit.....	176
3.11 Super High Static Pressure Duct Type Indoor Unit .....	176
3.12 Air Handler type Indoor Unit .....	178
3.13 AHU-KIT .....	179
3.14 1-way Cassette Type Indoor Unit .....	180
3.15 General Static Pressure Duct Type Indoor Unit .....	181
3.16 360° Air Discharge Compact Cassette Type Indoor Unit.....	181
3.17 360° Air Discharge Cassette Type Indoor Unit .....	182
<b>4 Disassembly And Assembly Procedure of Main Parts .....</b>	<b>183</b>
4.1 Low Static Pressure Duct Type Indoor Unit .....	183
4.2 Slim Duct Type Indoor Unit.....	185
4.3 Four-way Cassette Type Indoor Unit .....	186
4.4 Wall Mounted Type Indoor Unit .....	188
4.5 Console Type Indoor Unit .....	191
4.6 High Static Pressure Duct Type Indoor Unit .....	192
4.7 Two-way Cassette Type Indoor Unit .....	194
4.8 Floor Ceiling Type Indoor Unit .....	195
4.9 Fresh Air Processing Indoor Unit.....	196
4.10 Compact Four-way Cassette Type Indoor Unit.....	198
4.11 Super High Static Pressure Duct Type Indoor Unit .....	201
4.12 Air Handler type Indoor Unit .....	203
4.13 1-way Cassette Type Indoor Unit .....	204

4.14 General Static Pressure Duct Type Indoor Unit.....	207
4.15 360° Air Discharge Compact Cassette Type Indoor Unit.....	208
4.17 360° Air Discharge Cassette Type Indoor Unit.....	210
<b>5 Exploded Views and Part List.....</b>	<b>213</b>
5.1 Low Static Pressure Duct Type Indoor Unit.....	213
5.2 Slim Duct Type Indoor Unit.....	227
5.3 Four-way Cassette Type Indoor Unit.....	234
5.4 High Static Pressure Duct Type Indoor Unit .....	239
5.5 Two-way Cassette Type Indoor Unit .....	245
5.6 Floor Ceiling Type Indoor Unit .....	248
5.7 Fresh Air Processing Type Indoor Unit .....	258
5.8 Console Type Indoor Unit .....	262
5.9 Wall Mounted type Indoor Unit .....	264
5.10 Compact Four-way Cassette Type Indoor Unit.....	277
5.11 Super High Static Pressure Duct Type Indoor Unit.....	279
5.12 Air Handler type Indoor Unit .....	290
5.13 AHU-KIT .....	295
5.14 1-way Cassette Type Indoor Unit .....	303
5.15 General Static Pressure Duct Type Indoor Unit.....	305
5.16 360° Air Discharge Compact Cassette Type Indoor Unit.....	307
5.17 360° Air Discharge Cassette Type Indoor Unit .....	309

## PRODUCT

## CHAPTER 1 PRODUCT

### 1 Product List

#### 1.1 Low Static Pressure Duct Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW(Btu/h)	kW(Btu/h)			
GMV-ND07PLS/A-T(U)	CM810N0080	2.2 (7500)	2.5 (8500)	208/230V ~60Hz	R410A	
GMV-ND09PLS/A-T(U)	CM810N0090	2.8 (9500)	3.1 (10500)			
GMV-ND12PLS/A-T(U)	CM810N0100	3.5 (12000)	4.0 (13500)			
GMV-ND14PLS/A-T(U)	CM810N0120	4.4 (15000)	5.0 (17000)			
GMV-ND18PLS/A-T(U)	CM810N0070	5.3 (18000)	5.9 (20000)			
GMV-ND22PLS/A-T(U)	CM810N0110	7.0 (24000)	7.9 (27000)			
GMV-ND05 PLS/B1-T(U)	CM810N2170	1.7 (5800)	1.8 (6200)	208/230V ~60Hz	R410A	
GMV-ND07 PLS/B1-T(U)	CM810N2190	2.2 (7500)	2.8 (9500)			
GMV-ND09 PLS/B1-T(U)	CM810N2180	2.8 (9500)	3.2 (10500)			
GMV-ND12 PLS/B1-T(U)	CM810N2220	3.6 (12000)	4.0 (13500)			
GMV-ND14 PLS/B1-T(U)	CM810N2200	4.0 (15000)	4.5 (17000)			
GMV-ND18 PLS/B1-T(U)	CM810N2210	5.6 (18000)	6.3 (20000)			
GMV-ND24 PLS/B1-T(U)	CM810N2230	7.1 (24000)	8.0 (27000)			

#### 1.2 Slim Duct Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW(Btu/h)	kW(Btu/h)			
GMV-ND06PLS/B-T(U)	CM810N1980	1.8 (6000)	1.8 (6000)	208/230V ~60Hz	R410A	
GMV-ND07PLS/B-T(U)	CM810N1720	2.2 (7500)	2.8 (8500)			
GMV-ND09PLS/B-T(U)	CM810N1710	2.8 (9500)	3.2 (10500)			
GMV-ND12PLS/B-T(U)	CM810N1700	3.6 (12000)	4.0 (13500)			
GMV-ND14PLS/B-T(U)	CM810N1690	4.0 (15000)	4.5 (17000)			
GMV-ND18PLS/B-T(U)	CM810N1680	5.6 (18000)	6.3 (20000)			
GMV-ND24PLS/B-T(U)	CM810N1670	7.1 (24000)	8.0 (27000)			

## 1.3 Four-way Cassette Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-ND07T/A-T(U)	CM500N0520	2.2 (7500)	2.5 (8500)	208/230V ~60Hz	R410A	
GMV-ND09T/A-T(U)	CM500N0530	2.8 (9500)	3.1 (10500)			
GMV-ND12T/A-T(U)	CM500N0540	3.5 (12000)	4.0 (13500)			
GMV-ND15T/A-T(U)	CM500N0670	4.4 (15000)	5 (17000)			
GMV-ND18T/A-T(U)	CM500N0510	5.3 (18000)	5.9 (20000)			
GMV-ND24T/A-T(U)	CM500N0550	7.0 (24000)	7.9 (27000)			
GMV-ND30T/A-T(U)	CM500N0560	8.8 (30000)	10 (34000)			
GMV-ND36T/A-T(U)	CM500N0570	10.6 (36000)	11.7 (40000)			
GMV-ND42T/A-T(U)	CM500N0580	12.3 (42000)	13.8 (47000)			
GMV-ND48T/A-T(U)	CM500N0590	14.1 (48000)	15.8 (54000)			

## 1.4 Wall Mounted Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-N07G/A3A-D(U)	CM100N1480	2.2 (7500)	2.5 (8500)	208/230V ~60Hz	R410A	
GMV-N09G/A3A-D(U)	CM100N1490	2.8 (9500)	3.2 (11000)			
GMV-N12G/A3A-D(U)	CM100N1500	3.5 (12000)	4.0 (13500)			
GMV-N18G/A3A-D(U)	CM100N1510	5.2 (18000)	5.8 (20000)			
GMV-N24G/A3A-D(U)	CM100N1520	7.0 (24000)	7.5 (25500)			
GMV-N07G/E3A-D(U)	CM100N2330	2.2 (7500)	2.5 (8500)			
GMV-N09G/E3A-D(U)	CM100N2340	2.8 (9500)	3.2 (11000)			
GMV-N12G/E3A-D(U)	CM100N2350	3.5 (12000)	4.0 (13500)			
GMV-N18G/E3A-D(U)	CM100N2360	5.2 (18000)	5.8 (20000)			
GMV-N24G/E3A-D(U)	CM100N2370	7.0 (24000)	7.5 (25500)			
GMV-ND06G/B4B-T(U)	CM100N2950	1.8 (6000)	1.8 (6000)	208/230V ~60Hz	R410A	
GMV-ND07G/B4B-T(U)	CM100N2960	2.2 (7500)	2.5 (8500)			
GMV-ND09G/B4B-T(U)	CM100N2970	2.8 (9500)	3.2 (10500)			
GMV-ND12G/B4B-T(U)	CM100N2980	3.5 (12000)	4.0 (13500)			
GMV-ND14G/B4B-T(U)	CM100N2990	4.4 (15000)	5.0 (17000)			

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-ND18G/B4B-T(U)	CM100N3000	5.2 (18000)	5.8 (20000)	208/230V ~60Hz	R410A	
GMV-ND24G/B4B-T(U)	CM100N3010	7.0 (24000)	7.5 (25500)			
GMV-ND30G/B4B-T(U)	CM100N3020	8.8 (30000)	10.0 (34000)			
GMV-ND36G/B4B-T(U)	CM100N3030	9.5 (32500)	10.5 (36000)			

## 1.5 Console Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-ND07C/A-T(U)	CM400N0110	2.2 (7500)	2.5 (8500)	208/230V ~60Hz	R410A	
GMV-ND09C/A-T(U)	CM400N0120	2.8 (9500)	3.2 (11000)			
GMV-ND12C/A-T(U)	CM400N0100	3.5 (12000)	4.0 (13500)			
GMV-ND18C/A-T(U)	CM400N0130	5.3 (18000)	5.8 (20000)			

## 1.6 High Static Pressure Duct Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-ND18PHS/A-T(U)	CM810N0140	5.3 (18000)	5.9 (20000)	208/230V ~60Hz	R410A	
GMV-ND24PHS/A-T(U)	CM810N0150	7.0 (24000)	7.9 (27000)			
GMV-ND30PHS/A-T(U)	CM810N0160	8.8 (30000)	10.0 (34000)			
GMV-ND36PHS/A-T(U)	CM810N0170	10.6 (36000)	11.7 (40000)			
GMV-ND42PHS/A-T(U)	CM810N0180	12.3 (42000)	13.8 (47000)			
GMV-ND48PHS/A-T(U)	CM810N0190	14.1 (48000)	15.8 (54000)			
GMV-ND72PH/A-T(U)	CM810N0280	20.2 (72000)	22.6 (77000)			
GMV-ND96PH/A-T(U)	CM810N0290	27.0 (92000)	30.2 (103000)			

## 1.7 Two-way Cassette Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-ND09TS/A-T(U)	CM500N0890	2.8 (9500)	3.1 (10500)	208/230V ~60Hz	R410A	
GMV-ND12TS/A-T(U)	CM500N0900	3.5 (12000)	4.0 (13500)			
GMV-ND15TS/A-T(U)	CM500N0910	4.4 (15000)	5.0 (17000)			
GMV-ND18TS/A-T(U)	CM500N0920	5.3 (18000)	5.9 (20000)			
GMV-ND24TS/A-T(U)	CM500N0930	7.0 (24000)	7.9 (27000)			

## 1.8 Floor Ceiling Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-ND09ZD/A-T(U)	CM600N0420	2.8 (9500)	3.1 (10500)	208/230V ~60Hz	R410A	
GMV-ND12ZD/A-T(U)	CM600N0430	3.5 (12000)	4.0 (13500)			
GMV-ND18ZD/A-T(U)	CM600N0440	5.3 (18000)	5.9 (20000)			
GMV-ND24ZD/A-T(U)	CM600N0450	7.0 (24000)	7.9 (27000)			
GMV-ND30ZD/A-T(U)	CM600N0460	8.8 (30000)	10.0 (33000)			
GMV-ND36ZD/A-T(U)	CM600N0470	10.6 (36000)	11.7 (40000)			
GMV-ND42ZD/A-T(U)	CM600N0480	12.3 (42000)	13.8 (47000)			
GMV-ND48ZD/A-T(U)	CM600N0490	14.1 (48000)	15.8 (54000)			

## 1.9 Fresh Air Processing Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-NDX42P/A-T(U)	CM810N1250	12.3 (42000)	8.5 (29000)	208/230V ~60Hz	R410A	
GMV-NDX48P/A-T(U)	CM810N1030	14.1 (48000)	10.0 (34000)			
GMV-NDX54P/A-T(U)	CM810N1240	15.8 (54000)	13.2 (45000)			
GMV-NDX72P/A-T(U)	CM810N0480	21.1 (72000)	16.1 (55000)			
GMV-NDX96P/A-T(U)	CM810N0470	28.1 (96000)	20.0 (68000)			

## 1.10 Compact Four-way Cassette Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-ND07T/B-T(U)	CM500N0940	2.2 (7500)	2.5 (8500)	208/230V ~60Hz	R410A	
GMV-ND09T/B-T(U)	CM500N0950	2.8 (9500)	3.1 (10500)			
GMV-ND12T/B-T(U)	CM500N0960	3.5 (12000)	4.0 (13500)			
GMV-ND15T/B-T(U)	CM500N0970	4.4 (15000)	5.0 (17000)			
GMV-ND18T/B-T(U)	CM500N0980	5.3 (18000)	5.9 (20000)			

## 1.11 Super High Static Pressure Duct Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-ND07PHS/B-T(U)	CM810N0830	2.2 (7500)	2.5 (8500)	208/230V ~60Hz	R410A	
GMV-ND09PHS/B-T(U)	CM810N0790	2.8 (9500)	3.1 (10500)			
GMV-ND12PHS/B-T(U)	CM810N0800	3.5 (12000)	4.0 (13500)			
GMV-ND15PHS/B-T(U)	CM810N0770	4.4 (15000)	5.0 (17000)			
GMV-ND18PHS/B-T(U)	CM810N0810	5.3 (18000)	5.9 (20000)			
GMV-ND22PHS/B-T(U)	CM810N0720	6.4 (22000)	7.0 (24000)	208/230V ~60Hz	R410A	
GMV-ND24PHS/B-T(U)	CM810N0730	7.0 (24000)	7.9 (27000)			
GMV-ND30PHS/B-T(U)	CM810N0780	8.8 (30000)	10.0 (34000)			
GMV-ND36PHS/B-T(U)	CM810N0740	10.6 (36000)	11.7 (40000)			
GMV-ND42PHS/B-T(U)	CM810N0750	12.3 (42000)	13.8 (47000)			
GMV-ND48PHS/B-T(U)	CM810N0820	14.1 (48000)	15.0 (54000)	208/230V ~60Hz	R410A	
GMV-ND54PHS/B-T(U)	CM810N0760	15.8 (54000)	17.6 (60000)			
GMV-ND72PH/B-T(U)	CM810N1600	21.1 (72000)	23.7 (81000)			
GMV-ND96PH/B-T(U)	CM810N1590	28.1 (96000)	31.7 (108000)			

## 1.12 Air Handler type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-ND09A/A-T(U)	CM810N1900	2.8 (9500)	3.1 (10500)	208/230V ~60Hz	R410A	
GMV-ND12A/A-T(U)	CM810N1910	3.5 (12000)	4.0 (13500)			
GMV-ND18A/A-T(U)	CM810N1890	5.3 (18000)	5.9 (20000)			
GMV-ND24A/A-T(U)	CM810N0660	7.0 (24000)	7.9 (27000)			
GMV-ND30A/A-T(U)	CM810N0670	8.8 (30000)	10.0 (34000)			
GMV-ND36A/A-T(U)	CM810N0700	10.6 (36000)	11.7 (40000)			
GMV-ND42A/A-T(U)	CM810N0690	12.3 (42000)	13.8 (47000)			
GMV-ND48A/A-T(U)	CM810N0680	14.1 (48000)	15.8 (54000)			
GMV-ND54A/A-T(U)	CM810N0710	15.8 (54000)	17.6 (60000)			

## 1.13 AHU-KIT

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-N12U/A-T(U)	CN750N0101	3.5 (12000)	4.0 (13500)	208/230V ~60Hz	R410A	
GMV-N24U/A-T(U)	CN750N0061	7.0 (24000)	7.9 (27000)			
GMV-N48U/A-T(U)	CN750N0071	14.1 (48000)	15.8 (54000)			
GMV-N96U/A-T(U)	CN750N0081	28.1 (96000)	31.7 (108000)			
GMV-N192U/A-T(U)	CN750N0091	56.3 (192000)	63.3 (216000)			
GMV-N12U/C-T(U)	CN750N0250	3.5 (12000)	4.0 (13500)	208/230V ~60Hz	R410A	
GMV-N24U/C-T(U)	CN750N0230	7.0 (24000)	7.9 (27000)			
GMV-N48U/C-T(U)	CN750N0240	14.1 (48000)	15.8 (54000)			
GMV-N96U/C-T(U)	CN750N0210	28.1 (96000)	31.7 (108000)			
GMV-N192U/C-T(U)	CN750N0220	56.3 (192000)	63.3 (216000)			

## 1.14 1-way Cassette Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-ND07TD/A-T(U)	CM502N0151	2.2 (7500)	2.5 (8500)	208/230V ~60Hz	R410A	
GMV-ND09TD/A-T(U)	CM502N0161	2.8 (9500)	3.2 (10500)			
GMV-ND12TD/A-T(U)	CM502N0181	3.6 (12000)	4.0 (13500)			

## 1.15 General Static Pressure Duct Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW(Btu/h)	kW(Btu/h)			
GMV-ND30PLS/C-T(U)	CM810N2020	8.8 (30000)	10.0 (34000)	208/230V ~60Hz	R410A	
GMV-ND36PLS/C-T(U)	CM810N2010	10.6 (36000)	11.7 (40000)			
GMV-ND42PLS/C-T(U)	CM810N2000	12.3 (42000)	13.8 (47000)			
GMV-ND48PLS/C-T(U)	CM810N1990	14.1 (48000)	15.8 (54000)			

## 1.16 360°Air Discharge Compact Cassette Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-ND05T/E-T(U)	CM500N1600	1.7 (5800)	1.8 (6200)	208/230V ~60Hz	R410A	
GMV-ND07T/E-T(U)	CM500N1590	2.2 (7500)	2.5 (8500)			
GMV-ND09T/E-T(U)	CM500N1620	2.8 (9500)	3.1 (10500)			
GMV-ND12T/E-T(U)	CM500N1580	3.5 (12000)	4.0 (13500)			
GMV-ND15T/E-T(U)	CM500N1610	4.4 (15000)	5.0 (17000)			
GMV-ND18T/E-T(U)	CM500N1570	5.3 (18000)	5.9 (20000)			

## 1.17 360°Air Discharge Cassette Type Indoor Unit

Model	Product Code	Cooling Capacity	Heating Capacity	Power Supply	Refrigerant	Appearance
		kW (Btu/h)	kW (Btu/h)			
GMV-ND07T/C-T(U)	CM500N1560	2.2 (7500)	2.5 (8500)	208/230V ~60Hz	R410A	
GMV-ND09T/C-T(U)	CM500N1480	2.8 (9500)	3.1 (10500)			
GMV-ND12T/C-T(U)	CM500N1530	3.5 (12000)	4.0 (13500)			
GMV-ND15T/C-T(U)	CM500N1460	4.4 (15000)	5.0 (17000)			
GMV-ND18T/C-T(U)	CM500N1470	5.3 (18000)	5.9 (20000)			
GMV-ND22T/C-T(U)	CM500N1520	6.4 (22000)	7.0 (24000)			
GMV-ND24T/C-T(U)	CM500N1490	7.0 (24000)	7.9 (27000)			
GMV-ND30T/C-T(U)	CM500N1550	8.8 (30000)	10 (34000)			
GMV-ND36T/C-T(U)	CM500N1500	10.6 (36000)	11.7 (40000)			
GMV-ND42T/C-T(U)	CM500N1450	12.3 (42000)	13.8 (47000)			
GMV-ND48T/C-T(U)	CM500N1540	14.1 (48000)	15.8 (54000)			

## 2 Nomenclature

Nomenclature of Indoor Unit:

GMV	-	N	<input type="checkbox"/>	/	<input type="checkbox"/>	-	<input type="checkbox"/>	<input type="checkbox"/>				
1		2	3	4	5	6	7		8		9	10

No.	Description	Options
1	Product code	GMV-Gree Multi VRF Units
2	indoor unit code	indoor unit-N
3	Motor type	D-DC motor NULL-AC motor
4	Function code	X-fresh air W-double thermal source
5	Cooling capacity/air volume code	Indoor unit: nominal cooling capacity /1000(Btu/h) All heat exchanger: air volume /100(m <sup>3</sup> /h)
6	Unit type	PL-low static pressure duct type indoor unit P-standard static pressure duct type indoor unit PH-high static pressure duct type indoor unit PB-slim type duct type indoor unit T-Four-way Cassette type indoor unit A-Air handler type indoor unit TD-one-way cassette type indoor unit TS-two-way cassette type indoor unit ZD-floor ceiling type indoor unit ZK-combine type indoor unit C-console type indoor unit G-wall-mounted type indoor unit L-Floor Standing type indoor unit U-AHU-KIT type indoor unit
7	With water pump or not	With water pump-S (S is not displayed for the cassette unit with water pump)
8	Design serial No.	Nominate by A, B, C or expand it by 1, 2, 3...
9	Power	T-208/230V~,60Hz
10	Sale Area code	(U)-North America

## 3 Product Features

### 3.1 Features of Low Static Pressure Duct Type Indoor Unit

- Low static pressure, low noise

Especially suitable for rooms of compact structure or small installation space. Also it provides you with a comfortable and quiet living environment.

- Convenient installation

Tab type plastic filter, detachable fan motor, independent water pump assembly, all for convenient maintenance.

- Intelligent drainage device

Water height difference up to 3.3ft. which can effectively drain out condensing water and save space.

- Protection function

Water overflow protection, anti-freezing protection, fan motor overload protection, temperature sensor malfunction protection.

### 3.2 Features of Slim Duct Type Indoor Unit

- High-efficiency DC brushless motor is used. Its efficiency is improved by over 30% compared with common motor. Evaporator flow path adopts simulating optimized design via the refrigeration system simulation software, which has greatly increased the heat exchange capacity of evaporator.

- Slim & Small.

- The unit is only 200mm's thick and 450 mm's deep. Suspended ceiling doesn't have to be very high. It is suitable for ordinary rooms.

- Wiring of Electric Control Box.

- Mounting board of electric control box elements are arranged at both sides of the mounting board of fan motor. There is a wire-cross notch on each side so that wiring at both sides of the mounting board of fan motor is convenient and efficient. Strong and weak current are also separated to ensure the effectiveness of week current signal transmission.

- Protection Functions.

- Anti - freezing protection, fan motor built-in overload protection, temperature sensor protection.

- Ultra-quiet.

- High-efficiency centrifugal fan and ultralow noise volute are developed with ANSYS and Fluent. They have also gained national patents. Meanwhile, inlet mute valve is adopted so that noise of the complete unit is greatly reduced.

- Fast & Strong.

- Intelligent temperature control technology is adopted. Cooling/ Heating function is fast and strong so that room temperature can quickly reach set temperature.

- Flexible Installation.

- Based on the requirements of building and utilization, different ways of air return and different air supply static pressure can be selected.

- CAN Bus Communication Technology.

- System response speed is faster and communication is more reliable. Auto addressing, non-polar communication, free wire matching.
- Convenient Operation & Maintenance.
- Electric control box is attached independently so that it can be detached as a whole, which is convenient for fan and motor is also convenient.

### 3.3 Features of Four-way Cassette Type Indoor Unit

- Strong and balanced airflow.

Unit features auto operation, 4-way airflow, 7 fan speeds and strong circulating airflow.

- DC inverter motor.

With good speed regulation performance, motor efficiency improved by 30% vs. normal motor.

- Ultra-low noise operation.

DC inverter motor can realize stepless speed regulation to lower noise. Indoor unit can be set to work under auto quiet mode via wired controller.

- Protection function.

Water overflow protection, anti-freezing protection, temperature sensor malfunction protection, fan motor overload protection.

- Intelligent drainage device.

Water height difference up to 1.0m, which can effectively drain out condensing water and save space.

### 3.4 Features of Wall Mounted Type Indoor Unit

- Filter can be cleaned.

The filter is removable and can be cleaned for easy maintenance.

- Quiet design.

High-efficiency cross flow blade and imported silence valve are adopted, which greatly reduce the noise of entire unit.

- One IDU with several wired controller and several IDUs with one wired controller.

One IDU can be connected with several wired controllers in order to control one IDU from different location; meanwhile, several IDUs can be connected with one wired controller in order to achieve centralized control of 16 IDUs in maximum.

- Wide air supply range.

The air supply range is wide, so that the wind can be delivered to each corner of the room naturally and evenly.

- Super cooling and heating function.

Intelligent temperature control technology is adopted with super cooling and heating function, so that the room temperature can reach set temperature rapidly.

- I-feel function.

When I-feel function is activated, the unit can detect the temperature around the user and adjust the temperature, so that the comfort of user is improved (Remote controller shall be equipped).

- Panel is removable.

The panel of indoor unit can be removed easily for convenient maintenance.

The response of the system is quicker with more reliable communication; auto addressing, non-polar communication and free wiring are available.

- Multiple protections.

Anti-freezing protection, temperature sensor malfunction protection, fan motor overload protection.

### 3.5 Features of Console Type Indoor Unit

- Multiple fan speed.

The fan can operate in multiple speed and satisfy different air flow volume requirements.

- Detachable grille and long life filter.

Grille is detachable for easy cleaning. With long life filter, cleaning cycle is 20 times longer.

- Protection function.

Anti-freezing protection, fan motor overload protection, temperature sensor malfunction protection, auxiliary electric heating overheat protection (This function is not included in pure heat pump unit).

### 3.6 Features of High Static Pressure Duct Type Indoor Unit

- High static pressure design.

Static pressure can be up to 150Pa, especially suitable for places in need of long distance airflow.

- Convenient installation

You can choose circular air duct or rectangular air duct according to actual needs. Or you can choose different ways of air return.

- Easy maintenance.

The system has maintenance port for easy maintenance.

- Protection function.

Anti-freezing protection, fan motor overload protection, temperature sensor malfunction protection.

### 3.7 Features of Two-way Cassette Type Indoor Unit

- Beautiful Appearance.

With beautiful and elegant front panel, it is congenial to the indoor surroundings.

- Two-way air flow design.

Two-way air outlet, to stretch air outlet distance and solve air supply problem of elongated room.

- Intelligent drainage device.

Water height difference up to 1.0m, which can effectively drain out condensing water and save space.

- Multiple protections.

Anti-freezing protection, temperature malfunction protection, fan motor overload and humidity sensor protection.

### 3.8 Features of Floor Ceiling Type Indoor Unit

- Hoisted or seated, flexible installation.

Unit can be hoisted or seated. When seated, suspended ceiling is not needed.

- Protection function.

Anti-freezing protection, temperature sensor malfunction protection, fan motor overload protection.

- Beautiful appearance

With beautiful and elegant front panel, it is congenial to the indoor surroundings.

- Horizontal and vertical air swing.

Wider air swing range for your comfortable working and living environment.

### 3.9 Features of Fresh air Processing Type Indoor Unit

- Fresh Air Processing Indoor Unit

Airflow volume: 589CFM~2060CFM.

Applicable range: Residential houses, villas, business buildings, hotels, apartments, etc...

- One system, two functions.

Adopted with DC inverter technology, Fresh Air DC Inverter Multi VRF System features air conditioning function and fresh air function.

- Enjoy fresh air.

- Airflow volume: 589CFM~2060CFM, cooling capacity: 42/48/54/72/96kBtu/h.

- Applicable for all kinds of structure.

- Direct evaporative cooling adopted, air conditioning fresh air can be realized accurately and precisely.

- DC inverter technology adopted, constant humidity is enabled with less power consumption.

- Integrated system control with Gree GMV Multi VRF System.

- Air conditioning and fresh air, two in one.

- Less investment.

Fresh Air DC Inverter Multi VRF System can be combined with Gree GMV5. For a same room, if the same amount of fresh air is to be taken, then the cost of GMV5+Fresh air unit is equivalent to the cost of GMV+Air exchange fan.

- Less operation cost.

Unit can control refrigerant output according to actual needs to ensure constant airflow temperature. By adjusting power output, light-load but high power operation can be avoided. Thus, operation cost can be greatly reduced.

- Less installation space.

Save installation space for outdoor units. Especially suitable for places that have restricted installation space.

### 3.10 Features of Compact Four-way Cassette Type Indoor Unit

- Compact design for easy installation

Units maintain the uniform length and width with consistent ceiling opening and panel dimension, convenient for design and installation.

- Ultra-low noise operation

DC inverter motor can realize stepless speed regulation to lower noise. Indoor unit can be set to

work under auto quiet mode via wired controller.

- Intelligent drainage device

Water height difference up to 3.3ft. Which can effectively drain out condensing water and save space.

### 3.11 Features of Super High Static Pressure Duct Type Indoor Unit

- High static pressure design.

Static pressure can be up to 275Pa(1.1 In.W.G), especially suitable for places in need of long distance airflow.

- Convenient installation.

You can choose circular air duct or rectangular air duct according to actual needs. Or you can choose different ways of air return.

- Easy maintenance.

The system has maintenance port for easy maintenance.

- Protection function.

Anti-freezing protection, fan motor overload protection, temperature sensor malfunction protection.

### 3.12 Features of Air Handler Type Indoor Unit

- Multiple fan speed.

The fan can operate in multiple speed and satisfy different air flow volume requirements.

- DC inverter motor.

With good speed regulation performance, motor efficiency improved by 30% vs. normal motor.

- Ultra-low noise operation.

DC inverter motor can realize stepless speed regulation to lower noise. Indoor unit can be set to work under auto quiet mode via wired controller.

- Protection function.

Anti-freezing protection, fan motor overload protection, temperature sensor malfunction protection.

### 3.13 Features of AHU-KIT

- Make the air handling unit is with functions and advantages of VRF products.

Connected to VRF system of air handling unit and retained the original user function and project application function of VRF system. Installation, debugging, operation and maintenance are more convenient.

- Multiple installation method for convenient project design.

The air handling unit equipped with AHU-KIT has multiple methods for connecting VRF system. It can independently connect to VRF system to compose a one-to-one proposal; it can also match with other air handling unit or general VRF indoor units to connect to the same VRF system for composing a one-to-more proposal. In this case, it is convenient for project design.

- Independent design, convenient installation.

AHU-KIT is composed by two independent boxes(electronic expansion valve and control box) and designed independently, which is convenient for installation and application.

- Error signal is connected for reliable installation and operation.

Error signal of air handling unit is connected to AHU-KIT. Where there's malfunction, the unit will stop operation, same and reliable.

### 3.14 Features of 1-way Cassette Type Indoor Unit

- Beautiful Appearance

With beautiful and elegant front panel, it is congenial to the indoor surroundings.

- One-way air flow design

One-way air outlet, to stretch air outlet distance and solve air supply problem of elongated room.

- Intelligent drainage device

Water height difference up to 1.0m, which can effectively drain out condensing water and save space.

- Multiple protections

Anti-freezing protection, temperature malfunction protection, fan motor overload and humidity sensor protection.

### 3.15 Features of General Static Pressure Duct Type Indoor Unit

- Low static pressure, low noise

Especially suitable for rooms of compact structure or small installation space. Also it provides you with a comfortable and quiet living environment.

- Convenient installation

Tab type plastic filter, detachable fan motor, independent water pump assembly, all for convenient maintenance.

- Intelligent drainage device

Water height difference up to 3.3ft. which can effectively drain out condensing water and save space.

- Protection function

Water overflow protection, anti-freezing protection, fan motor overload protection, temperature sensor malfunction protection.

### 3.16 Features of 360°Air Discharge Compact Cassette Type Indoor Unit

- 360° Air Supply.

360°air supply design for wide air supply range and balanced temperature distribution, more comfortable.

- Independent Swing Control.

4 swing blades can be controlled independently; multiple air supply angle combinations is available for free and humanized control, avoiding direct air blow to people.

- New Air Duct and Blade Design for Low Noise

Adopt new air duct and blade with fluid simulation design for lower noise; noise is as low as 25dB.

- DC Quiet Drainage Pump

Water height difference up to 1.2m, which can effectively drain out condensing water and save space. Adopting high-lift DC quiet type drainage pump for lower power consumption and better sound quality; the maximum lifting height is 1200mm; installation is more flexible and the drainage pipe layout is more convenient.

### 3.17 Features of 360°Air Discharge Cassette Type Indoor Unit

- 360° Air Supply.

360°air supply design for wide air supply range and balanced temperature distribution, more comfortable.

- Independent Swing Control.

4 swing blades can be controlled independently; multiple air supply angle combinations is available for free and humanized control, avoiding direct air blow to people.

- Ultra-low noise operation.

DC inverter motor can realize stepless speed regulation to lower noise. Indoor unit can be set to work under auto quiet mode via wired controller.

- DC Quiet Drainage Pump

Water height difference up to 1.2m, which can effectively drain out condensing water and save space. Adopting high-lift DC quiet type drainage pump for lower power consumption and better sound quality; the maximum lifting height is 1200mm; installation is more flexible and the drainage pipe layout is more convenient.

## 4 Specifications

### 4.1 Low Static Pressure Duct Type Indoor Unit

Model			GMV-ND07PLS/A-T(U)	GMV-ND09PLS/A-T(U)	GMV-ND12PLS/A-T(U)	
Product Code			CM810N0080	CM810N0090	CM810N0100	
Cooling Capacity	Btu/h	7500	9500	12000		
	kW	2.2	2.8	3.5		
Heating Capacity	Btu/h	9500	10500	13500		
	kW	2.8	3.1	4		
Casing Finish			Galvanized Steel plate			
Dimensions (W×D×H)	Outline	Mm	700×615×200	700×615×200	700×615×200	
		inch	27-9/16×24-3/16×7-7/8	27-9/16×24-3/16×7-7/8	27-9/16×24-3/16×7-7/8	
	Packaging	Mm	893×743×305	893×743×305	893×743×305	
		inch	35-3/16×29-1/4×12	35-3/16×29-1/4×12	35-3/16×29-1/4×12	
Net Weight		LBS	51	51	51	
		Kg	23	23	23	
Gross Weight		LBS	64	64	64	
		kg	29	29	29	
Pipe Connection	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35	
		inch	Φ1/4	Φ1/4	Φ1/4	
	Gas Side	mm	Φ9.52	Φ9.52	Φ12.7	
		inch	Φ3/8	Φ3/8	Φ1/2	
	Drain Pipe	mm	Φ25	Φ25	Φ25	
		inch	Φ1	Φ1	Φ1	
Power supply			1-phase 208/230V 60Hz			
Fan	Type × Quantity		Centrifugal×2	Centrifugal×2	Centrifugal×2	
	Driving Mechanism		Direct-driven			
	Motor Type		BLDC			
	Motor Power Input	W	43	43	43	
	Motor Running Current	A	0.3	0.3	0.3	
	Airflow Rate(H/M/L)	CFM	265/235/147	265/235/147	324/265/206	
		m <sup>3</sup> /h	450/400/250	450/400/250	550/450/350	
	External Static Pressure	Default	In.W.G	0.06	0.06	
			Pa	15	15	
		Range	In.W.G	0~0.12	0~0.12	
			Pa	0~30	0~30	
Sound Pressure Level(H/M/L)		dB(A)	31/29/25	31/29/25	32/30/27	
Heat Exchanger			Fenestrate plain film --hydrophilic film			
Air Filter			PP			
Refrigeration Control Device			EXV			
Protection Device			Fuse			

Model			GMV-ND14PLS/A-T(U)	GMV-ND18PLS/A-T(U)	GMV-ND22PLS/A-T(U)		
Product Code			CM810N0120	CM810N0070	CM810N0110		
Cooling Capacity	Btu/h	15000	18000	24000			
	kW	4.4	5.3	7			
Heating Capacity	Btu/h	17000	20000	27000			
	kW	5	5.9	7.9			
Casing Finish			Galvanized Steel plate				
Dimensions (W×D×H)	Outline	mm	900×615×200	1100×615×200	1100×615×200		
		inch	35-7/16×24-3/16×7-7/8	43-5/16×24-3/16×7-7/8	43-5/16×24-3/16×7-7/8		
	Packaging	mm	1123×743×305	1323×743×305	1323×743×305		
		inch	44-3/16×29-1/4×12	52-1/16×29-1/4×12	52-1/16×29-1/4×12		
Net Weight	LBS	60	69	69			
	kg	27	31	31			
Gross Weight	LBS	73	86	86			
	kg	33	39	39			
Pipe Connection	Liquid Side	mm	Φ6.35	Φ9.52	Φ9.52		
		inch	Φ1/4	Φ3/8	Φ3/8		
	Gas Side	mm	Φ12.7	Φ15.9	Φ15.9		
		inch	Φ1/2	Φ5/8	Φ5/8		
	Drain Pipe	mm	Φ25	Φ25	Φ25		
		inch	Φ1	Φ1	Φ1		
Power Supply			1-phase 208/230V 60Hz				
Fan	Type × Quantity		Centrifugal×3	Centrifugal×4	Centrifugal×4		
	Driving Mechanism		Direct-driven				
	Motor Type		BLDC				
	Motor Power Input		W	52	99		
	Motor Running Current		A	0.5	0.7		
	Airflow Rate(H/M/L)	CFM	412/353/265		589/471/353		
		m³/h	700/600/450		1000/800/600		
	External Static Pressure	Default	In.W.G	0.06	0.06		
			Pa	15	15		
		Range	In.W.G	0~0.12	0~0.12		
			Pa	0~30	0~30		
Sound Pressure Level(H/M/L)			dB(A)	33/31/28	35/33/30		
Heat Exchanger			Fenestrate plain film --hydrophilic film				
Air Filter			PP				
Refrigeration Control Device			EXV				
Protection Device			Fuse				

Model			GMV-ND05 PLS/B1-T(U)	GMV-ND07 PLS/B1-T(U)	GMV-ND09 PLS/B1-T(U)
Product Code			CM810N2170	CM810N2190	CM810N2180
Cooling Capacity	Btu/h	5800	7500	9500	
	kW	1.7	2.2	2.8	
Heating Capacity	Btu/h	6200	8500	10500	
	kW	1.8	2.8	3.2	
Casing Finish			Galvanized Steel plate		
Dimensions (W×D×H)	Outline	mm	710×462×200	710×462×200	710×462×200
		in.	28×18-3/16×7-7/8	28×18-3/16×7-7/8	28×18-3/16×7-7/8

Model			GMV-ND05 PLS/B1-T(U)	GMV-ND07 PLS/B1-T(U)	GMV-ND09 PLS/B1-T(U)	
Dimensions (W×D×H)	Packaging	mm	1025×570×285	1025×570×285	1025×570×285	
		in.	40-1/4×22-1/3×10-5/ 8	40-1/4×22-1/3×10-5/ 8	40-1/4×22-1/3×10-5/ 8	
Net Weight		lbs.	41	41	41	
		kg	18.5	18.5	18.5	
Gross Weight		lbs.	52	52	52	
		kg	23.5	23.5	23.5	
Pipe Connection	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35	
		in.	Φ1/4	Φ1/4	Φ1/4	
	Gas Side	mm	Φ9.52	Φ9.52	Φ9.52	
		in.	Φ3/8	Φ3/8	Φ3/8	
	Drain Pipe	mm	Φ25	Φ25	Φ25	
		in.	Φ1	Φ1	Φ1	
Power supply			1-phase 208/230V 60Hz			
Fan	Type * Quantity		Centrifugal*2	Centrifugal*2	Centrifugal*2	
	Driving Mechanism		Direct-driven			
	Motor Type		BLDC			
	Motor Power Input	W	30	30	30	
	Motor Running Current	A	0.16	0.16	0.16	
	Airflow Rate(H/M/L)	CFM	265/206/118	265/206/118	265/206/118	
		m³/h	450/350/200	450/350/200	450/350/200	
	External Static Pressure	Default	in.W.G.	0.06	0.06	
			Pa	15	15	
		Range	in.W.G.	0~0.12	0~0.12	
			Pa	0~30	0~30	
Sound Pressure Level(H/M/L)		dB(A)	30/25/22	30/25/22	30/25/22	
Heat Exchanger			Fenestrate plain film --hydrophilic film			
Air Filter			PP			
Refrigeration Control Device			EXV			
Protection Device			Fuse			

Model			GMV-ND12 PLS/B1-T(U)	GMV-ND14 PLS/B1-T(U)	GMV-ND18 PLS/B1-T(U)	GMV-ND24 PLS/B1-T(U)	
Product Code			CM810N2220	CM810N2200	CM810N2210	CM810N2230	
Cooling Capacity	Btu/h	12000	15000	18000	24000		
	kW	3.6	4	5.6	7.1		
Heating Capacity	Btu/h	13500	17500	20000	27000		
	kW	4	4.5	6.3	8		
Casing Finish			Galvanized Steel plate				
Dimensions (W×D×H)	Outline	mm	710×462×200	1010×462×200	1010×462×200	1310×462×200	
		in.	28×18-3/16×7-7/8	39-3/4×18-3/16×7-7/8	39-3/4×18-3/16×7-7/8	51-4/7×18-3/16×7-7/8	
	Packaging	mm	1025×570×285	1322×570×285	1625×570×285	1625×570×285	
		in.	40-1/4×22-1/3×10-5/8	52×22-1/3×10-5/8	52×22-1/3×10-5/8	64×22-1/3×10-5/8	
Net Weight			lbs.	42	55	55	
			kg	19	25	25	
						31	

Model			GMV-ND12 PLS/B1-T(U)	GMV-ND14 PLS/B1-T(U)	GMV-ND18 PLS/B1-T(U)	GMV-ND24 PLS/B1-T(U)	
Gross Weight		lbs.	53	68	68	83	
		kg	24	31	31	37.5	
Pipe Connection	Liquid Side	mm	Φ6.35	Φ6.35	Φ9.52	Φ9.52	
		in.	Φ1/4	Φ1/4	Φ3/8	Φ3/8	
	Gas Side	mm	Φ12.7	Φ12.7	Φ15.9	Φ15.9	
		in.	Φ1/2	Φ1/2	Φ5/8	Φ5/8	
	Drain Pipe	mm	Φ25	Φ25	Φ25	Φ25	
		in.	Φ1	Φ1	Φ1	Φ1	
Power supply			1-phase 208/230V 60Hz				
Fan	Type * Quantity		Centrifugal*2	Centrifugal*2	Centrifugal*2	Centrifugal*2	
	Driving Mechanism		Direct-driven BLDC				
	Motor Type						
	Motor Power Input	W	30	30	60	80	
	Motor Running Current	A	0.16	0.16	0.29	0.3	
	Airflow Rate(H/M/L)	CFM	324/235/177	441/324/235	500/412/324	647/500/383	
		m³/h	550/400/300	750/550/400	850/700/550	1100/850/650	
	External Static Pressure	Default	in.W.G.	0.06	0.06	0.06	
			Pa	15	15	15	
		Range	in.W.G.	0~0.12	0~0.12	0~0.12	
			Pa	0~30	0~30	0~30	
Sound Pressure Level(H/M/L)		dB(A)	31/27/25	33/29/27	35/31/29	37/32/30	
Heat Exchanger			Fenestrate plain film --hydrophilic film				
Air Filter			PP				
Refrigeration Control Device			EXV				
Protection Device			Fuse				

## 4.2 Slim Duct Type Indoor Unit

Model		GMV-ND06PLS/B-T(U)	GMV-ND07PLS/B-T(U)	GMV-ND09PLS/B-T(U)	GMV-ND12PLS/B-T(U)	
Product Code		CM810N1980	CM810N1720	CM810N1710	CM810N1700	
Cooling Capacity	Btu/h	6000	7500	9500	12000	
	kW	1.8	2.2	2.8	3.6	
Heating Capacity	Btu/h	6000	8500	10500	13500	
	kW	1.8	2.8	3.2	4	
Casing Finish		Galvanized Steel plate				
Dimensions (W×D×H)	Outline	mm	710×462×200	710×462×200	710×462×200	
		inch	27-15/16×18-3/16 ×7-14/16	27-15/16×18-3/16 ×7-14/16	27-15/16×18-3/16 ×7-14/16	
	Packaging	mm	1025×570×285	1025×570×285	1025×570×285	
		inch	40-4/16×22-5/16 ×10-10/16	40-4/16×22-5/16 ×10-10/16	40-4/16×22-5/16 ×10-10/16	
Net Weight		LBS	41	41	42	
		kg	18.5	18.5	19	
Gross Weight		LBS	52	52	53	
		kg	23.5	23.5	24	
Pipe Connection	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35	
		inch	Φ1/4	Φ1/4	Φ1/4	
	Gas Side	mm	Φ9.52	Φ9.52	Φ12.7	
	Gas Side	inch	Φ3/8	Φ3/8	Φ1/2	
	Drain Pipe	mm	Φ25	Φ25	Φ25	
		inch	Φ1	Φ1	Φ1	
Power supply		1-phase 208/230V 60Hz				
Fan	Type × Quantity		Centrifugal×2	Centrifugal×2	Centrifugal×2	
	Driving Mechanism		Direct-driven			
	Motor Type		BLDC			
	Motor Power Input	W	30	30	30	
	Motor Running Current	A	0.16	0.16	0.16	
	Airflow Rate(H/M/L)	CFM	265/206/118	265/206/118	265/206/118	
		m³/h	450/350/200	450/350/200	550/400/300	
	External Static Pressure	Default	In.W.G	0.06	0.06	
			Pa	15	15	
		Range	In.W.G	0~0.12	0~0.12	
			Pa	0~30	0~30	
Sound Pressure Level(H/M/L)		dB(A)	30/25/22	30/25/22	30/25/22	
Heat Exchanger		Fenestrate plain film --hydrophilic film				
Air Filter		PP				
Refrigeration Control Device		EXV				
Protection Device		Fuse				

Model		GMV-ND14PLS/B-T(U)	GMV-ND18PLS/B-T(U)	GMV-ND24PLS/A-T(U)	
Product Code		CM810N1690	CM810N1680	CM810N1670	
Cooling Capacity	Btu/h	15000	18000	24000	
	kW	4	5.6	7.1	
Heating Capacity	Btu/h	17000	20000	27000	
	kW	4.5	6.3	8	
Casing Finish		Galvanized Steel plate			
Dimensions (W×D×H)	Outline	mm	1010×462×200	1010×462×200	
		inch	39-12/16×18-3/16 ×7-14/16	39-12/16×18-3/16 ×7-14/16	
	Packaging	mm	1322×570×285	1625×570×285	
		inch	52-1/16×22-5/16 ×10-10/16	52-1/16×22-5/16 ×10-10/16	
Net Weight		LBS	55	55	
		kg	25	25	
Gross Weight		LBS	68	68	
		kg	31	31	
Pipe Connection	Liquid Side	mm	Φ6.35	Φ9.52	
		inch	Φ1/4	Φ3/8	
	Gas Side	mm	Φ12.7	Φ15.9	
		inch	Φ1/2	Φ5/8	
	Drain Pipe	mm	Φ25	Φ25	
		inch	Φ1	Φ1	
Power supply		1-phase 208/230V 60Hz			
Fan	Type × Quantity		Centrifugal×2	Centrifugal×2	
	Driving Mechanism		Direct-driven		
	Motor Type		BLDC		
	Motor Power Input	W	30	60	
	Motor Running Current	A	0.16	0.29	
	Airflow Rate(H/M/L)	CFM	441/324/235	500/412/324	
		m³/h	750/550/400	850/700/550	
	External Static Pressure	In.W.G	0.06	0.06	
		Pa	15	15	
		In.W.G	0~0.12	0~0.12	
		Pa	0~30	0~30	
Sound Pressure Level(H/M/L)		dB(A)	33/29/27	35/31/29	
Heat Exchanger		Fenestrate plain film --hydrophilic film			
Air Filter		PP			
Refrigeration Control Device		EXV			
Protection Device		Fuse			

### 4.3 Four-way Cassette Type Indoor Unit

Model		GMV-ND07T /A-T(U)	GMV-ND09T /A-T(U)	GMV-ND12T /A-T(U)	GMV-ND15T /A-T(U)	GMV-ND18T /A-T(U)	
Product Code		CM500N0520	CM500N0530	CM500N0540	CM500N0670	CM500N0510	
Cooling Capacity	Btu/h	7500	9500	12000	15000	18000	
	kW	2.2	2.8	3.5	4.4	5.3	
Heating Capacity	Btu/h	8500	10500	13500	17000	20000	
	kW	2.5	3.1	4.0	5	5.9	
Casing Finish		Galvanized Steel plate					
Dimensions (W×D×H)	Body Outline	mm	840×840×190	840×840×240	840×840×240	840×840×240	
		inch	33×33×7-1/2	33×33×9-1/2	33×33×9-1/2	33×33×9-1/2	
	Body Packaging	mm	963×963×272	963×963×325	963×963×325	963×963×325	
		inch	37-15/16 ×37-15/16 ×10-11/16	37-15/16 ×37-15/16 ×12-13/16	37-15/16 ×37-15/16 ×12-13/16	37-15/16 ×37-15/16 ×12-13/16	
	Panel Outline	mm	950×950×65	950×950×65	950×950×65	950×950×65	
		inch	37-3/8×37-3/8 ×2-1/2	37-3/8×37-3/8 ×2-1/2	37-3/8×37-3/8 ×2-1/2	37-3/8×37-3/8 ×2-1/2	
	Panel Packaging	mm	1033×1038 ×133	1033×1038 ×133	1033×1038 ×133	1033×1038 ×133	
		inch	40-11/16 ×40-7/8×5-1/4	40-11/16 ×40-7/8×5-1/4	40-11/16 ×40-7/8×5-1/4	40-11/16 ×40-7/8×5-1/4	
Net Weigh	Main Body	LBS	50	58	58	58	
		kg	22.5	26.5	26.5	26.5	
	Panel	LBS	15	15	15	15	
		kg	7	7	7	7	
Gross Weigh	Main Body	LBS	64	75	75	75	
		kg	29	34	34	34	
	Panel	LBS	24	24	24	24	
		kg	11	11	11	11	
Pipe Connections	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35	Φ6.35	
		inch	Φ1/4	Φ1/4	Φ1/4	Φ1/4	
	Gas Side	mm	Φ9.52	Φ9.52	Φ12.7	Φ12.7	
		inch	Φ3/8	Φ3/8	Φ1/2	Φ1/2	
	Drain Pipe	mm	Φ25	Φ25	Φ25	Φ25	
		inch	Φ1	Φ1	Φ1	Φ1	
Power supply		1-phase 208/230V 60Hz					
Fan	Type × Quantity		Centrifugal×1	Centrifugal×1	Centrifugal×1	Centrifugal×1	
	Driving Mechanism		Direct-driven	Direct-driven	Direct-driven	Direct-driven	
	Motor Type		BLDC	BLDC	BLDC	BLDC	
	Motor Power Input	W	48	59	59	59	
	Motor Running Current	A	0.3	0.5	0.5	0.5	
	Airflow Rate(H/M/L)	CFM	440/385/325	590/530/440	590/530/440	590/530/440	
		m <sup>3</sup> /h	750/650/550	1000/900/750	1000/900/750	1000/900/750	
Sound Pressure Level(H/M/L)		dB(A)	36/34/31	37/35/32	37/35/32	37/35/32	
Heat Exchanger		Fenestrate plain film --hydrophilic film					
Air Filter		PP	PP	PP	PP	PP	
Insulation Material		Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	

Model	GMV-ND07T /A-T(U)	GMV-ND09T /A-T(U)	GMV-ND12T /A-T(U)	GMV-ND15T /A-T(U)	GMV-ND18T /A-T(U)
Refrigeration Control Device	EXV	EXV	EXV	EXV	EXV
Protection Device	Fuse	Fuse	Fuse	Fuse	Fuse
Panel Name	TC01	TC01	TC01	TC01	TC01

Model	GMV-ND24T /A-T(U)	GMV-ND30T /A-T(U)	GMV-ND36T /A-T(U)	GMV-ND42T /A-T(U)	GMV-ND48T /A-T(U)
Product Code	CM500N0550	CM500N0560	CM500N0570	CM500N0580	CM500N0590
Cooling Capacity	Btu/h kW	24000 7	30000 8.8	36000 10.6	42000 12.3
Heating Capacity	Btu/h kW	27000 7.9	34000 10	40000 11.7	47000 13.8
Casing Finish					Galvanized Steel plate
Dimensions (W×D×H)	Body Outline	mm	840×840×240	840×840×320	840×840×320
		inch	33×33×9-1/2	33×33×12-5/8	33×33×12-5/8
	Body Packaging	mm	963×963×325	963×963×409	963×963×409
		inch	37-15/16 ×37-15/16 ×12-13/16	37-15/16 ×37-15/16 ×16-1/8	37-15/16 ×37-15/16 ×16-1/8
	Panel Outline	mm	950×950×65	950×950×65	950×950×65
		inch	37-3/8×37-3/8 ×2-1/2	37-3/8×37-3/8 ×2-1/2	37-3/8×37-3/8 ×2-1/2
	Panel Packaging	mm	1033×1038 ×133	1033×1038 ×133	1033×1038 ×133
		inch	40-11/16 ×40-7/8×5-1/4	40-11/16 ×40-7/8×5-1/4	40-11/16 ×40-7/8×5-1/4
Net Weight	Main Body	LBS	58	72	72
		kg	26.5	32.5	32.5
	Panel	LBS	15	15	15
		kg	7	7	7
Gross Weight	Main Body	LBS	75	88	88
		kg	34	40	40
	Panel	LBS	24	24	24
		kg	11	11	11
Pipe Connections	Liquid Side	mm	Φ9.52	Φ9.52	Φ9.52
		inch	Φ3/8	Φ3/8	Φ3/8
	Gas Side	mm	Φ15.9	Φ15.9	Φ15.9
		inch	Φ5/8	Φ5/8	Φ5/8
	Drain Pipe	mm	Φ25	Φ25	Φ25
		inch	Φ1	Φ1	Φ1
Power Supply		1-phase 208/230V 60Hz			
Fan	Type × Quantity	Centrifugal×1	Centrifugal×1	Centrifugal×1	Centrifugal×1
	Driving Mechanism	Direct-driven	Direct-driven	Direct-driven	Direct-driven
	Motor Type	BLDC	BLDC	BLDC	BLDC
	Motor Power Input	W	68	98	110
	Motor Running Current	A	0.5	0.8	0.9
	Airflow Rate(H/M/L)	CFM	695/590/470	885/795/650	1000/825/650
		m³/h	1180/1000/800	1500/1350 /1100	1700/1400 /1100
					1860/1500 /1150

Model		GMV-ND24T /A-T(U)	GMV-ND30T /A-T(U)	GMV-ND36T /A-T(U)	GMV-ND42T /A-T(U)	GMV-ND48T /A-T(U)
Sound Pressure Level(H/M/L)	dB(A)	38/36/33	40/38/35	41/38/36	43/41/38	43/41/38
Heat Exchanger		Fenestrate plain film --hydrophilic film				
Air Filter		PP	PP	PP	PP	PP
Insulation Material		Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	Foamed polystyrene
Refrigeration Control Device		EXV	EXV	EXV	EXV	EXV
Protection Device		Fuse	Fuse	Fuse	Fuse	Fuse
Panel Name		TC01	TC01	TC01	TC01	TC01

#### 4.4 Wall Mounted Type Indoor Unit

Model			GMV-N07G/A3A-D(U)	GMV-N09G/A3A-D(U)	GMV-N12G/A3A-D(U)	GMV-N18G/A3A-D(U)	GMV-N24G/A3A-D(U)	
Product Code			CM100N1480	CM100N1490	CM100N1500	CM100N1510	CM100N1520	
Cooling Capacity	Btu/h	7500	9500	12000	18000	24000		
	kW	2.2	2.8	3.5	5.2	7		
Heating Capacity	Btu/h	8500	11000	13500	20000	25500		
	kW	2.5	3.2	4	5.8	7.5		
Casing Finish			Galvanized Steel plate					
Dimensions (WxDxH)	Outline	mm	843×180×275	843×180×275	940×200×298	940×200×298	1008×221×319	
		inch	33-3/16×7-1/16 ×10-13/16	33-3/16×7-1/16 ×10-13/16	37×7-7/8 ×11-3/4	37×7-7/8 ×11-3/4	37×7-7/8 ×11-3/4	
	Packaging	mm	973×258×370	973×258×370	1068×288×395	1068×288×395	1131×398×328	
		inch	38-5/16 ×10-3/16 ×14-9/16	38-5/16 ×10-3/16 ×14-9/16	42-1/16 ×11-5/16 ×15-9/16	42-1/16 ×11-5/16 ×15-9/16	42-1/16 ×11-5/16 ×15-9/16	
Net Weight	LBS	22.1	22.1	27.6	27.6	33.1		
	kg	10	10	12.5	12.5	15		
Gross Weight	LBS	27.6	27.6	34.2	34.2	40.8		
	kg	12.5	12.5	15.5	15.5	18.5		
Pipe Connections	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35	Φ6.35	Φ9.52	
		inch	Φ1/4	Φ1/4	Φ1/4	Φ1/4	Φ3/8	
	Gas Side	mm	Φ9.52	Φ9.52	Φ12.7	Φ12.7	Φ15.9	
		inch	Φ3/8	Φ3/8	Φ1/2	Φ1/2	Φ5/8	
	Drain Pipe	mm	Φ20	Φ20	Φ20	Φ20	Φ30	
		inch	Φ4/5	Φ4/5	Φ4/5	Φ4/5	Φ1 1/6	
Power supply			1-phase 208/230V 60Hz					
Fan	Type × Quantity		Cross-flow×1	Cross-flow×1	Cross-flow×1	Cross-flow×1	Cross-flow×1	
	Driving Mechanism		Direct-driven					
	Motor Type		PG					
	Motor Power Input	W	50	50	60	60	70	
	Motor Running Current	A	0.2	0.2	0.21	0.21	0.31	
	Airflow Rate(H/M/L)	CFM	295/247/206	295/247/206	370/324/283	370/324/283	440/353/294	
		m <sup>3</sup> /h	500/420/350	500/420/350	630/550/480	630/550/480	750/600/500	
Sound Pressure Level(H/M/L)		dB(A)	38/34/30	38/34/30	44/41/38	44/41/38	44/41/38	
Heat Exchanger			Fenestrate plain film -- hydrophilic film					
Air Filter			PP+10%BCM+FP03					
Insulation Material			Foamed polystyrene					
Refrigeration Control Device			EXV					
Protection Device			Fuse					

Model		GMV-N07G/ E3A-D(U)	GMV-N09G/ E3A-D(U)	GMV-N12G/ E3A-D(U)	GMV-N18G/ E3A-D(U)	GMV-N24G/ E3A-D(U)	
Product Code		CM100N2330	CM100N2340	CM100N2350	CM100N2360	CM100N2370	
Cooling Capacity	Btu/h	7500	9500	12000	18000	24000	
	kW	2.2	2.8	3.5	5.2	7	
Heating Capacity	Btu/h	8500	11000	13500	20000	25500	
	kW	2.5	3.2	4	5.8	7.5	
Casing Finish		Galvanized Steel plate					
Dimensions (W×D×H)	Outline	mm	843×180×275	843×180×275	940×200×298	940×200×298	
		inch	33-3/16×7-1/16 ×10-13/16	33 3/16×7-1/16 ×10 3/16	37×7-7/8 ×11-3/4	37×7-7/8 ×11-3/4	
	Packaging	mm	973×258×370	973×258×370	1068×288×395	1068×288×395	
		inch	38-5/16 ×10-3/16 ×14-9/16	38-5/16 ×10-3/16 ×14-9/16	42-1/16 ×11-5/16 ×15-9/16	42-1/16 ×11-5/16 ×15-9/16	
Net Weight	LBS	22.1	22.1	27.6	27.6	33.1	
	kg	10	10	12.5	12.5	15	
Gross Weight	LBS	27.6	27.6	34.2	34.2	40.8	
	kg	12.5	12.5	15.5	15.5	18.5	
Pipe Connections	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35	Φ6.35	
		inch	Φ1/4	Φ1/4	Φ1/4	Φ1/4	
	Gas Side	mm	Φ9.52	Φ9.52	Φ12.7	Φ12.7	
		inch	Φ3/8	Φ3/8	Φ1/2	Φ1/2	
	Drain Pipe	mm	Φ20	Φ20	Φ20	Φ20	
		inch	Φ4/5	Φ4/5	Φ4/5	Φ1 1/6	
Power supply		1-phase 208/230V 60Hz					
Fan	Type × Quantity		Cross-flow×1	Cross-flow×1	Cross-flow×1	Cross-flow×1	
	Driving Mechanism		Direct-driven				
	Motor Type		PG				
	Motor Power Input	W	50	50	60	60	
	Motor Running Current	A	0.2	0.2	0.21	0.21	
	Airflow Rate(H/M/L)	CFM	295/247/206	295/247/206	370/324/283	370/324/283	
		m <sup>3</sup> /h	500/420/350	500/420/350	630/550/480	630/550/480	
Sound Pressure Level(H/M/L)		dB(A)	38/34/30	38/34/30	44/41/38	44/41/38	
Heat Exchanger		Fenestrate plain film -- hydrophilic film					
Air Filter		PP+10%BCM+FP03					
Insulation Material		Foamed polystyrene					
Refrigeration Control Device		EXV					
Protection Device		Fuse					

Model		GMV-ND06 G/B4B-T(U)	GMV-ND07 G/B4B-T(U)	GMV-ND09 G/B4B-T(U)	GMV-ND12 G/B4B-T(U)	GMV-ND14 G/B4B-T(U)
Product Code		CM100N2950	CM100N2960	CM100N2970	CM100N2980	CM100N2990
Cooling Capacity	Btu/h	6000	7500	9500	12000	15000
	kW	1.8	2.2	2.8	3.5	4.4
Heating Capacity	Btu/h	6000	8500	10500	13500	17000
	kW	1.8	2.5	3.2	4.0	5.0
Casing Finish		Galvanized Steel plate				

Model			GMV-ND06 G/B4B-T(U)	GMV-ND07 G/B4B-T(U)	GMV-ND09 G/B4B-T(U)	GMV-ND12 G/B4B-T(U)	GMV-ND14 G/B4B-T(U)		
Dimensions (W×D×H)	Outline	mm	845×209×289	845×209×289	845×209×289	845×209×289	970×300×224		
		inch	33-1/4×8-1/4 ×11-3/8	33-1/4×8-1/4 ×11-3/8	33-1/4×8-1/4 ×11-3/8	33-1/4×8-1/4 ×11-3/8	38-3/16 ×11-13/16 ×8-13/16		
	Packaging	mm	976×281×379	976×281×379	976×281×379	976×281×379	1096×383×320		
		inch	38-7/16 ×11-1/16 ×14-15/16	38-7/16 ×11-1/16 ×14-15/16	38-7/16 ×11-1/16 ×14-15/16	38-7/16 ×11-1/16 ×14-15/16	43-1/8 ×15-1/16 ×12-5/8		
	Net Weight	LBS	23.5	23.5	23.5	23.5	27.5		
		kg	10.5	10.5	10.5	10.5	12.5		
Gross Weight		LBS	27.5	27.5	27.5	27.5	34.5		
		kg	12.5	12.5	12.5	12.5	15.5		
Pipe Connections	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35	Φ6.35	Φ6.35		
		inch	Φ1/4	Φ1/4	Φ1/4	Φ1/4	Φ1/4		
	Gas Side	mm	Φ9.52	Φ9.52	Φ9.52	Φ12.7	Φ12.7		
		inch	Φ3/8	Φ3/8	Φ3/8	Φ1/2	Φ1/2		
	Drain Pipe	mm	Φ20	Φ20	Φ20	Φ20	Φ20		
		inch	Φ13/16	Φ13/16	Φ13/16	Φ13/16	Φ13/16		
Power supply			1-phase 208/230V 60Hz						
Fan	Type × Quantity		Cross-flow×1	Cross-flow×1	Cross-flow×1	Cross-flow×1	Cross-flow×1		
	Driving Mechanism		Direct-driven						
	Motor Type		BLDC						
	Motor Power Input	W	20	20	20	25	35		
	Motor Running Current	A	0.1	0.1	0.1	0.12	0.17		
	Airflow Rate(H/M/L)	CFM	294/259/177	294/259/177	294/259/177	371/271/188	500/341/294		
		m³/h	500/440/300	500/440/300	500/440/300	630/460/320	850/580/500		
Sound Pressure Level(H/M/L)			dB(A)	35/33/30	35/33/30	35/33/30	38/35/31	43/40/37	
Heat Exchanger			Fenestrate plain film -- hydrophilic film						
Air Filter			PP+PP MD10						
Insulation Material			Foamed polystyrene						
Refrigeration Control Device			EXV						
Protection Device			Fuse						

Model			GMV-ND18G/B4 B-T(U)	GMV-ND24G/B4 B-T(U)	GMV-ND30G/B4 B-T(U)	GMV-ND36G/B4 B-T(U)
Product Code			CM100N3000	CM100N3010	CM100N3020	CM100N3030
Cooling Capacity	Btu/h		18000	24000	30000	32500
	kW		5.2	7.0	8.8	9.5
Heating Capacity	Btu/h		20000	25500	34000	36000
	kW		5.8	7.5	10.0	10.5
Casing Finish			Galvanized Steel plate			
Dimensions (W×D×H)	Outline	mm	1078×325×246	1078×325×246	1350×258×326	1350×258×326
		inch	42-7/16×12-13/16 ×9-11/16	42-7/16×12-13/16 ×9-11/16	53-1/8×10-3/16 ×12-13/16	53-1/8×10-3/16 ×12-13/16
	Packaging	mm	1203×413×350	1203×413×350	1496×421×369	1496×421×369
		inch	47-3/8×16-1/4 ×13-3/4	47-3/8×16-1/4 ×13-3/4	58-7/8×16-9/16 ×14-1/2	58-7/8×16-9/16 ×14-1/2
Net Weight	LBS		35.5	35.5	41	41
	kg		16	16	18.5	18.5

Model		GMV-ND18G/B4 B-T(U)	GMV-ND24G/B4 B-T(U)	GMV-ND30G/B4 B-T(U)	GMV-ND36G/B4 B-T(U)	
Gross Weight	LBS	42	42	52	52	
	kg	19	19	23.5	23.5	
Pipe Connections	Liquid Side	mm	Φ9.52	Φ9.52	Φ9.52	
		inch	Φ3/8	Φ3/8	Φ3/8	
	Gas Side	mm	Φ15.9	Φ15.9	Φ15.9	
		inch	Φ5/8	Φ5/8	Φ5/8	
	Drain Pipe	mm	Φ20	Φ20	Φ20	
		inch	Φ13/16	Φ13/16	Φ13/16	
Power supply		1-phase 208/230V 60Hz				
Fan	Type × Quantity	Cross-flow×1	Cross-flow×1	Cross-flow×1	Cross-flow×1	
	Driving Mechanism	Direct-driven				
	Motor Type	BLDC				
	Motor Power Input	W	50	65	80	
	Motor Running Current	A	0.24	0.31	0.41	
	Airflow Rate(H/M/L)	CFM	647/500/383	706/500/383	912/618/471	
		m³/h	1100/850/650	1200/850/650	1550/1050/800	
Sound Pressure Level(H/M/L)		dB(A)	43/41/37	44/41/37	49/46/40	
Heat Exchanger		Fenestrate plain film -- hydrophilic film				
Air Filter		PP+PP MD10				
Insulation Material		Foamed polystyrene				
Refrigeration Control Device		EXV				
Protection Device		Fuse				

## 4.5 Console Type Indoor Unit

Model		GMV-ND07C/A-T(U)	GMV-ND09C/A-T(U)	GMV-ND12C/A-T(U)	GMV-ND18C/A-T(U)
Product Code		CM400N0110	CM400N0120	CM400N0100	CM400N0130
Cooling Capacity	Btu/h	7500	9500	12000	18000
	kW	2.2	2.8	3.5	5.3
Heating Capacity	Btu/h	8500	11000	13500	20000
	kW	2.5	3.2	4	5.8
Casing Finish		Galvanized Steel plate			
Dimensions (W×D×H)	Outline	mm	700×215×600	700×215×600	700×215×600
		inch	27-9/16×8-1/2 ×23-5/8	27-9/16×8-1/2 ×23-5/8	27-9/16×8-1/2 ×23-5/8
	Packaging	mm	785×280×762	785×280×762	785×280×762
		inch	31×11×30	31×11×30	31×11×30
Net Weight	LBS	35	35	35	35
	kg	16	16	16	16
Gross Weight	LBS	42	42	42	42
	kg	19	19	19	19
Pipe Connections	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35
		inch	Φ1/4	Φ1/4	Φ1/4
	Gas Side	mm	Φ9.52	Φ9.52	Φ12.7
		inch	Φ3/8	Φ3/8	Φ1/2
	Drain Pipe	mm	Φ28	Φ28	Φ28
		inch	Φ1-1/9	Φ1-1/9	Φ1-1/9
Power Supply		1-phase 208/230V 60Hz			

Model		GMV-ND07C/A-T(U)		GMV-ND09C/A-T(U)		GMV-ND12C/A-T(U)		GMV-ND18C/A-T(U)							
Fan	Type × Quantity	Centrifugal×1		Centrifugal×1		Centrifugal×1		Centrifugal×1							
	Driving Mechanism	Direct-driven													
	Motor Type	BLDC													
	Motor Power Input	W	38		38		38		38						
	MotorA Running Current	A	0.4		0.4		0.4		0.4						
	Airflow Rate(H/M/L)	CFM	235		235		282		400						
		m³/h	400		400		480		680						
Sound Pressure Level(H/M/L)		dB(A)	38		38		40		46						
Heat Exchanger			Fenestrate plain film -- hydrophilic film												
Air Filter			PP												
Insulation Material			Foamed polystyrene												
Refrigeration Control Device			EXV												
Protection Device			Fuse												

## 4.6 High Static Pressure Duct Type Indoor Unit

Model		GMV-ND18 PHS/A-T(U)	GMV-ND24 PHS/A-T(U)	GMV-ND30 PHS/A-T(U)	GMV-ND36 PHS/A-T(U)	GMV-ND42 PHS/A-T(U)	GMV-ND48 PHS/A-T(U)
Product Code		CM810N0140	CM810N0150	CM810N0160	CM810N0170	CM810N0180	CM810N0190
Cooling Capacity	Btu/h	18000	24000	30000	36000	42000	48000
	kW	5.3	7.0	8.8	10.6	12.3	14.1
Heating Capacity	Btu/h	20000	27000	34000	40000	47000	54000
	kW	5.9	7.9	10	11.7	13.8	15.8
Casing Finish		Galvanized Steel plate					
Dimensions (W×D×H)	Outline	mm	1271×558 ×268	1271×558 ×268	1229×775 ×290	1229×775 ×290	1229×775 ×290
		inch	50×22 ×10-1/2	50×22 ×10-1/2	48-3/8 ×30-1/2 ×11-3/8	48-3/8 ×30-1/2 ×11-3/8	48-3/8 ×30-1/2 ×11-3/8
	Packaging	mm	1348×597 ×283	1348×597 ×283	1338×877 ×305	1338×877 ×305	1338×877 ×305
		inch	53-1/16 ×23-3/8 ×11-1/8	53-1/16 ×23-3/8 ×11-1/8	52-11/16 ×34-1/2×12	52-11/16 ×34-1/2×12	52-11/16 ×34-1/2×12
Net Weight	LBS	77	77	104	104	104	104
	kg	35	35	47	47	47	47
Gross Weight	LBS	88	88	119	119	119	119
	kg	40	40	54	54	54	54
Pipe Connections	Liquid Side	mm	Φ9.52	Φ9.52	Φ9.52	Φ9.52	Φ9.52
		inch	Φ3/8	Φ3/8	Φ3/8	Φ3/8	Φ3/8
	Gas Side	mm	Φ15.9	Φ15.9	Φ15.9	Φ15.9	Φ15.9
		inch	Φ5/8	Φ5/8	Φ5/8	Φ5/8	Φ5/8
	Drain Pipe	mm	Φ25	Φ25	Φ25	Φ25	Φ25
		inch	Φ1	Φ1	Φ1	Φ1	Φ1
Power Supply			1-phase 208/230V 60Hz				

Model			GMV-ND18 PHS/A-T(U)	GMV-ND24 PHS/A-T(U)	GMV-ND30 PHS/A-T(U)	GMV-ND36 PHS/A-T(U)	GMV-ND42 PHS/A-T(U)	GMV-ND48 PHS/A-T(U)	
Fan	Type × Quantity	Centrifugal×2	Centrifugal×2	Centrifugal×2	Centrifugal×2	Centrifugal×2	Centrifugal×2	Centrifugal×2	
	Driving Mechanism	Direct-driven	Direct-driven	Direct-driven	Direct-driven	Direct-driven	Direct-driven	Direct-driven	
	Motor Type	BLDC	BLDC	BLDC	BLDC	BLDC	BLDC	BLDC	
	Motor Power Input	W	120	130	200	200	220	220	
	Motor Running Current	A	0.9	0.9	1.4	1.4	1.6	1.6	
	Airflow Rate(H/M/L)	CFM	590/470 /355	650/530 /410	1000/855 /650	1000/855 /650	1180/910 /705	1180/1000 /825	
		m³/h	1000/800 /600	1100/900 /700	1700/1450 /1100	1700/1450 /1100	2000/1550 /1200	2000/1700 /1400	
	External Static Pressure	Default	In.W.G	0.28	0.28	0.28	0.28	0.28	
		Range	Pa	70	70	70	70	70	
Sound Pressure Level(H/M/L)			dB(A)	44/40/36	45/41/37	46/44/42	46/44/42	48/45/42	
Heat Exchanger			Fenestrate plain film -- hydrophilic film						
Air Filter			PP	PP	PP	PP	PP	PP	
Insulation Material			Foamed polystyrene						
Refrigeration Control Device			EXV	EXV	EXV	EXV	EXV	EXV	
Protection Device			Fuse	Fuse	Fuse	Fuse	Fuse	Fuse	

Model			GMV-ND72PH/A-T(U)	GMV-ND96PH/A-T(U)	
Product Code			CM810N0280	CM810N0290	
Cooling Capacity	Btu/h	69000	92000		
	kW	20.2	27.0		
Heating Capacity	Btu/h	77000	103000		
	kW	22.6	30.2		
Casing Finish			Galvanized Steel plate		
Dimensions (W×D×H)	Outline	mm	1483×791×385	1686×870×450	
		inch	58-3/8×31-1/8×15-3/16	66-3/8×34-1/4×17-3/4	
	Packaging	mm	1578×883×472	1788×988×580	
		inch	62-1/8×34-3/4×18-5/8	70-3/8×38-7/8×22-7/8	
Net Weight		LBS	181	232	
		kg	82	105	
Gross Weight		LBS	229	309	
		kg	104	140	
Pipe Connection	Liquid Side	mm	9.52	9.52	
		inch	3/8	3/8	
	Gas Side	mm	19.05	22.2	
		inch	3/4	7/8	
	Drain Pipe	mm	Φ25	Φ25	
		inch	Φ1	Φ1	
Power Supply			1-phase 208/230V 60Hz		

Model			GMV-ND72PH/A-T(U)		GMV-ND96PH/A-T(U)			
Fan	Type × Quantity		Centrifugal×2		Centrifugal×2			
	Driving Mechanism		Direct-driven					
	Motor Type		BLDC					
	Motor Power Input	W	800		900			
	Motor Running Current	A	5		6			
	Airflow Rate(H/M/L)	CFM	2355/2120/1885		2590/2355/2120			
		m³/h	4000/3600/3200		4400/4000/3600			
	External Static Pressure	In.W.G	0.4		0.4			
		Pa	100		100			
		In.W.G	0.2~0.8		0.2~0.8			
		Pa	50~200		50~200			
Sound Pressure Level(H/M/L)		dB(A)	54/52/49		55/52/50			
Heat Exchanger			/					
Air Filter			PP					
Insulation Material			Foamed polystyrene					
Refrigeration Control Device			EXV					
Protection Device			Fuse					

## 4.7 Two-way Cassette Type Indoor Unit

Model			GMV-ND09T S/A-T(U)	GMV-ND12T S/A-T(U)	GMV-ND15T S/A-T(U)	GMV-ND18T S/A-T(U)	GMV-ND24T S/A-T(U)
Product Code			CM500N0890	CM500N0900	CM500N0910	CM500N0920	CM500N0930
Cooling Capacity	Btu/h	9500	12000	15000	18000	24000	
	kW	2.8	3.5	4.4	5.3	7	
Heating Capacity	Btu/h	10500	13500	17000	20000	27000	
	kW	3.1	4.0	5	5.9	7.9	
Casing Finish			Galvanized Steel plate				
Dimensions (W×D×H)	Body Outline	mm	1200×520×340	1200×520×340	1200×520×340	1200×520×340	1200×520×340
		inch	47-1/4×20-1/2 ×13-3/8	47-1/4×20-1/2 ×13-3/8	47-1/4×20-1/2 ×13-3/8	47-1/4×20-1/2 ×13-3/8	47-1/4×20-1/2 ×13-3/8
	Body Packaging	mm	1523×658×430	1523×658×430	1523×658×430	1523×658×430	1523×658×430
		inch	60×26×17	60×26×17	60×26×17	60×26×17	60×26×17
	Panel outline	mm	1443×630×33	1443×630×33	1443×630×33	1443×630×33	1443×630×33
		inch	55-3/4 ×24-13/16 ×1-1/4	55-3/4 ×24-13/16 ×1-1/4	55-3/4 ×24-13/16 ×1-1/4	55-3/4 ×24-13/16 ×1-1/4	55-3/4 ×24-13/16 ×1-1/4
	Panel Packaging	mm	1578×658×120	1578×658×120	1578×658×120	1578×658×120	1578×658×120
		inch	62-1/8×30-1/4 ×4-11/16	62-1/8×30-1/4 ×4-11/16	62-1/8×30-1/4 ×4-11/16	62-1/8×30-1/4 ×4-11/16	62-1/8×30-1/4 ×4-11/16
Net Weight	Body	LBS	95	95	95	95	101
		kg	43	43	43	43	46
	Panel	LBS	15	15	15	15	15
		kg	7	7	7	7	7
Gross Weight	Body	LBS	119	119	119	119	123
		kg	54	54	54	54	56
	Panel	LBS	24	24	24	24	24
		kg	11	11	11	11	11

Model			GMV-ND09T S/A-T(U)	GMV-ND12T S/A-T(U)	GMV-ND15T S/A-T(U)	GMV-ND18T S/A-T(U)	GMV-ND24T S/A-T(U)	
Pipe Connection	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35	Φ9.52	Φ9.52	
		inch	Φ1/4	Φ1/4	Φ1/4	Φ3/8	Φ3/8	
	Gas Side	mm	Φ9.52	Φ12.7	Φ12.7	Φ15.9	Φ15.9	
		inch	Φ3/8	Φ1/2	Φ1/2	Φ5/8	Φ5/8	
	Drain Pipe	mm	Φ25	Φ25	Φ25	Φ25	Φ25	
		inch	Φ1	Φ1	Φ1	Φ1	Φ1	
Power Supply		1-phase 208/230V 60Hz			1-phase 208/230V 60Hz			
Fan	Type × Quantity		Centrifugal×3	Centrifugal×3	Centrifugal×3	Centrifugal×3	Centrifugal×3	
	Driving Mechanism		Direct-driven					
	Motor Type		BLDC					
	Motor Power Input	W	55	55	55	55	91	
	Motor Running Current	A	0.6	0.6	0.6	0.6	0.7	
	Airflow Rate(H/M/L)	CFM	490/355/312	490/355/312	490/355/312	490/355/312	650/483/448	
		m³/h	830/600/530	830/600/530	830/600/530	830/600/530	1100/820/760	
Sound Pressure Level(H/M/L)		dB(A)	35/33/31	35/33/31	35/33/31	35/33/31	39/37/35	
Heat Exchanger			/					
Air Filter			PP					
Insulation Material			Foamed polystyrene					
Refrigeration Control Device			EXV					
Protection Device			Fuse					
Panel name			TE01	TE01	TE01	TE01	TE01	

## 4.8 Floor Ceiling Type Indoor Unit

Model			GMV-ND09ZD/A -T(U)	GMV-ND12ZD/A -T(U)	GMV-ND18ZD/A -T(U)	GMV-ND24ZD/A -T(U)	
Product Code			CM600N0420	CM600N0430	CM600N0440	CM600N0450	
Cooling Capacity	Btu/h		9500	12000	18000	24000	
	kW		2.8	3.5	5.3	7.0	
Heating Capacity	Btu/h		10500	13500	20000	27000	
	kW		3.1	4.0	5.9	7.9	
Casing Finish		Galvanized Steel plate					
Dimensions (W×D×H)	Outline	mm	1220×700×225	1220×700×225	1220×700×225	1420×700×245	
		inch	48×27-9/16 ×8-7/8	48×27-9/16 ×8-7/8	48×27-9/16 ×8-7/8	55-7/8×27-9/16 ×9-5/8	
	Packaging	mm	1343×823×315	1343×823×315	1343×823×315	1548×828×345	
		inch	52-7/8×32-3/8 ×12-3/8	52-7/8×32-3/8 ×12-3/8	52-7/8×32-3/8 ×12-3/8	60-15/16×32-5/8 ×13-9/16	
Net Weight		LBS	88	88	88	110	
		kg	40	40	40	50	
Gross Weight		LBS	108	108	108	128	
		kg	49	49	49	58	
Pipe Connection	Liquid Side	mm	Φ6.35	Φ6.35	Φ9.52	Φ9.52	
		inch	Φ1/4	Φ1/4	Φ3/8	Φ3/8	
	Gas Side	mm	Φ9.52	Φ12.7	Φ15.9	Φ15.9	
		inch	Φ3/8	Φ1/2	Φ5/8	Φ5/8	
	Drain Pipe	mm	Φ17	Φ17	Φ17	Φ17	
		inch	Φ11/16	Φ11/16	Φ11/16	Φ11/16	

Model		GMV-ND09ZD/A -T(U)	GMV-ND12ZD/A -T(U)	GMV-ND18ZD/A -T(U)	GMV-ND24ZD/A -T(U)
Power Supply		1-phase 208/230V 60Hz			1-phase 208/230V 60Hz
Fan	Type × Quantity	Centrifugal×4		Centrifugal×4	Centrifugal×3
	Driving Mechanism	Direct-driven		Direct-driven	
	Motor Type	BLDC		BLDC	
	Motor Power Input	W	40	40	50
	Motor Running Current	A	0.5	0.5	0.5
	Airflow Rate(H/M/L)	CFM m³/h	380/345/305 650/585/520	380/345/305 650/585/520	560/510/410 950/865/699 1400/1150/1085
Sound Pressure Level(H/M/L)		dB(A)	36/34/32	36/34/32	42/38/33
Heat Exchanger			/	/	/
Air Filter			PP	PP	PP
Insulation Material			Foamed polystyrene		
Refrigeration Control Device			EXV	EXV	EXV
Protection Device			Fuse	Fuse	Fuse

Model		GMV-ND30ZD/A -T(U)	GMV-ND36ZD/A -T(U)	GMV-ND42ZD/A -T(U)	GMV-ND48ZD/A -T(U)
Product Code		CM600N0460	CM600N0470	CM600N0480	CM600N0490
Cooling Capacity	Btu/h	30000	36000	42000	48000
	kW	8.8	10.6	12.3	14.1
Heating Capacity	Btu/h	33000	40000	47000	54000
	kW	10.0	11.7	13.8	15.8
Casing Finish		Galvanized Steel plate			
Dimensions (W×D×H)	Outline	mm	1420×700×245	1700×700×245	1700×700×245
		inch	55-7/8×27-9/16 ×9-5/8	66-15/16×27-9/16 ×9-5/8	66-15/16×27-9/16 ×9-5/8
	Packaging	mm	1548×828×345	1828×828×345	1828×828×345
		inch	60-15/16×32-5/8 ×13-9/16	71-15/16×32-5/8 ×13-9/16	71-15/16×32-5/8 ×13-9/16
Net Weight	LBS	110	132	132	132
	kg	50	60	60	60
Gross Weight	LBS	128	150	150	150
	kg	58	68	68	68
Pipe Connection	Liquid Side	mm	Φ9.52	Φ9.52	Φ9.52
		inch	Φ3/8	Φ3/8	Φ3/8
	Gas Side	mm	Φ15.9	Φ15.9	Φ15.9
		inch	Φ5/8	Φ5/8	Φ5/8
	Drain Pipe	mm	Φ17	Φ17	Φ17
		inch	Φ11/16	Φ11/16	Φ11/16
Power Supply		1-phase 208/230V 60Hz		1-phase 208/230V 60Hz	
Fan	Type × Quantity	Centrifugal×3		Centrifugal×4	Centrifugal×4
	Driving Mechanism	Direct-driven		Direct-driven	
	Motor Type	BLDC		BLDC	
	Motor Power Input	W	140	160	160
	Motor Running Current	A	0.6	0.7	0.7
	Airflow Rate(H/M/L)	CFM m³/h	940/850/695 1600/1445/1183	1180/904/755 2000/1600/1282	1180/1065/855 2000/1813/1452

Model		GMV-ND30ZD/A -T(U)	GMV-ND36ZD/A -T(U)	GMV-ND42ZD/A -T(U)	GMV-ND48ZD/A -T(U)
Sound Pressure Level(H/M/L)	dB(A)	50/47/43	51/47/42	52/49/45	52/49/45
Heat Exchanger		/	/	/	/
Air Filter		PP	PP	PP	PP
Insulation Material			Foamed polystyrene		
Refrigeration Control Device		EXV	EXV	EXV	EXV
Protection Device		Fuse	Fuse	Fuse	Fuse

## 4.9 Fresh air Processing Type Indoor Unit

Model			GMV-NDX42P/A-T(U)	GMV-NDX48P/A-T(U)	GMV-NDX54P/A-T(U)	
Product Code			CM810N1250	CM810N1030	CM810N1240	
Cooling Capacity	Btu/h	42000	48000	54000		
	kW	12.3	14.1	15.8		
Heating Capacity*1	Btu/h	29000	34000	45000		
	kW	8.5	10.0	13.2		
Heating Capacity*2	Btu/h	36000	41000	52000		
	kW	10.5	12.0	15.2		
Casing Finish			Galvanized Steel plate			
Dimensions (W×D×H)	Outline	mm	1400×700×300	1400×700×300	1483×791×385	
		inch	55-1/8×27-9/16×11-13/16	55-1/8×27-9/16×11-13/16	58-3/8×31-1/8×15-3/16	
	Packaging	mm	1601×813×365	1601×813×365	1578×883×472	
		inch	63×32×14-3/8	63×32×14-3/8	62-1/8×34-3/4×18-5/8	
Net Weight		LBS	119	119	181	
		kg	54	54	82	
Gross Weight		LBS	134	134	229	
		kg	61	61	104	
Pipe Connection	Liquid Side	mm	Φ9.52	Φ9.52	Φ9.52	
		inch	Φ3/8	Φ3/8	Φ3/8	
	Gas Side	mm	Φ15.9	Φ15.9	Φ19.05	
		inch	Φ5/8	Φ5/8	Φ3/4	
	Drain Pipe	mm	Φ25	Φ25	Φ25	
		inch	Φ1	Φ1	Φ1	
Power Supply			1-phase 208/230V 60Hz			
Fan	Type × Quantity		Centrifugal×3	Centrifugal×3	Centrifugal×2	
	Driving Mechanism		Direct-driven			
	Motor Type		BLDC			
	Motor Power Input	W	350	350	760	
	Motor Running Current	A	2.0	2.0	4.3	
	Airflow Rate(H/M/L)	CFM	706/589~1177	706/589~1177	1177/883~1766	
		m³/h	1200/1000~2000	1200/1000~2000	2000/1500~3000	
	External Static Pressure	Def ault	In.W. G	0.6	0.8	
			Pa	150	200	
		Ran ge	In.W. G	0.2~0.8	0.2~1.2	
			Pa	50~200	50~300	
Sound Pressure Level(H/M/L)		dB(A)	40~50	40~50	45~55	
Heat Exchanger			/			

Model	GMV-NDX42P/A-T(U)	GMV-NDX48P/A-T(U)	GMV-NDX54P/A-T(U)
Air Filter		PP	
Insulation Material		Foamed polystyrene	
Refrigeration Control Device		EXV	
Protection Device		Fuse	

Model	GMV-NDX72P/A-T(U)		GMV-NDX96P/A-T(U)
Product Code	CM810N0480		CM810N0470
Cooling Capacity	Btu/h	72000	96000
	kW	21.1	28.1
Heating Capacity*1	Btu/h	55000	68000
	kW	16.1	20.0
Heating Capacity*2	Btu/h	68000	75000
	kW	20.0	22.0
Casing Finish	Galvanized Steel plate		
Dimensions (W×D×H)	Outline	mm	1483×791×385
		inch	58-3/8×31-1/8×15-3/16
Dimensions (W×D×H)	Packaging	mm	1578×883×472
		inch	62-1/8×34-3/4×18-5/8
Net Weight	LBS	181	181
	kg	82	82
Gross Weight	LBS	229	229
	kg	104	104
Pipe Connection	Liquid Side	mm	Φ9.52
		inch	Φ3/8
Pipe Connection	Gas Side	mm	Φ19.05
		inch	Φ3/4
Pipe Connection	Drain Pipe	mm	Φ25
		inch	Φ1
Power Supply	1-phase 208/230V 60Hz		
Fan	Type × Quantity	Centrifugal×2	Centrifugal×2
	Driving Mechanism	Direct-driven	
	Motor Type	BLDC	
	Motor Power Input	W	750
	Motor Running Current	A	4.3
	Airflow Rate(H/M/L)	CFM	1177/883~1766
		m <sup>3</sup> /h	2000/1500~3000
	External Static Pressure	In.W.G	0.8
		Pa	200
		In.W.G	0.2~1.2
		Pa	50~300
Sound Pressure Level(H/M/L)	dB(A)	45~54	47~54
Heat Exchanger		/	
Air Filter		PP	
Insulation Material		Foamed polystyrene	
Refrigeration Control Device		EXV	
Protection Device		Fuse	

**NOTICE!**

- ① Rated cooling capacity test conditions: indoor 95.0°F DB/82.4°F WB, outdoor 95.0°F DB; connection pipe length: 24-5/8ft., without height drop between units. The default air outlet temperature of the unit is 64.4°F.
- ② Rated heating capacity test conditions: \*1. indoor 44.6°F DB, outdoor 44.6°F DB/42.8 °F WB, \*2 indoor 32°F DB, outdoor 32°F DB/26.8°F WB, connection pipe length: 24-5/8ft., without height drop between units. The default air outlet temperature of the unit is 71.6°F.
- ③ The Sound Pressure Level will change with the External Static Pressure.
- ④ This series can be matched with GMV5 only.

## 4.10 Compact Four-way Cassette Type Indoor Unit

Model			GMV-ND07T/ B-T(U)	GMV-ND09T/ B-T(U)	GMV-ND12T/ B-T(U)	GMV-ND15T/ B-T(U)	GMV-ND18T/ B-T(U)
Product Code			CM500N0940	CM500N0950	CM500N0960	CM500N0970	CM500N0980
Cooling Capacity	Btu/h	7500	9500	12000	15000	18000	
	kW	2.2	2.8	3.5	4.4	5.3	
Heating Capacity	Btu/h	8500	10500	13500	17000	20000	
	kW	2.5	3.1	4.0	5.0	5.9	
Casing Finish			Galvanized Steel plate				
Dimensions (W×D×H)	Body Outline	mm	596×596×240	596×596×240	596×596×240	596×596×240	596×596×240
		inch	23-1/2×23-1/2 ×9-1/2	23-1/2×23-1/2 ×9-1/2	23-1/2×23-1/2 ×9-1/2	23-1/2×23-1/2 ×9-1/2	23-1/2×23-1/2 ×9-1/2
	Body Packaging	mm	778×738×300	778×738×300	778×738×300	778×738×300	778×738×300
		inch	30-5/8×29 ×11-3/4	30-5/8×29 ×11-3/4	30-5/8×29 ×11-3/4	30-5/8×29 ×11-3/4	30-5/8×29 ×11-3/4
	Panel Outline	mm	670×670×50	670×670×50	670×670×50	670×670×50	670×670×50
		inch	26-3/8×26-3/8 ×2	26-3/8×26-3/8 ×2	26-3/8×26-3/8 ×2	26-3/8×26-3/8 ×2	26-3/8×26-3/8 ×2
	Panel Packaging	mm	763×763×105	763×763×105	763×763×105	763×763×105	763×763×105
		inch	30×30×4-1/8	30×30×4-1/8	30×30×4-1/8	30×30×4-1/8	30×30×4-1/8
Net Weigh	Main Body	LBS	49	49	49	49	49
		kg	22	22	22	22	22
	Panel	LBS	8	8	8	8	8
		kg	3.5	3.5	3.5	3.5	3.5
Gross Weigh	Main Body	LBS	60	60	60	60	60
		kg	27	27	27	27	27
	Panel	LBS	11	11	11	11	11
		kg	5	5	5	5	5
Pipe Connections	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35	Φ6.35	Φ9.52
		inch	Φ1/4	Φ1/4	Φ1/4	Φ1/4	Φ3/8
	Gas Side	mm	Φ9.52	Φ9.52	Φ12.7	Φ12.7	Φ15.9
		inch	Φ3/8	Φ3/8	Φ1/2	Φ1/2	Φ5/8
	Drain Pipe	mm	Φ25	Φ25	Φ25	Φ25	Φ25
		inch	Φ1	Φ1	Φ1	Φ1	Φ1
Power Supply			1-phase 208/230V 60Hz				

Model		GMV-ND07T/ B-T(U)	GMV-ND09T/ B-T(U)	GMV-ND12T/ B-T(U)	GMV-ND15T/ B-T(U)	GMV-ND18T/ B-T(U)
Fan	Type × Quantity	Centrifugal×1	Centrifugal×1	Centrifugal×1	Centrifugal×1	Centrifugal×1
	Driving Mechanism	Direct-driven	Direct-driven	Direct-driven	Direct-driven	Direct-driven
	Motor Type	BLDC	BLDC	BLDC	BLDC	BLDC
	Motor Power Input	W	35	35	45	45
	Motor Running Current	A	0.4	0.4	0.5	0.5
	Airflow Rate(H/M/L)	CFM m³/h	355/295/235 600/500/400	355/295/235 600/500/400	355/295/235 600/500/400	410/355/283 700/600/480
	Sound Pressure Level(H/M/L)	dB(A)	38/36/33	38/36/33	38/36/33	45/42/36
Heat Exchanger		Fenestrate plain film --hydrophilic film				
Air Filter		PP	PP	PP	PP	PP
Insulation Material		Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	Foamed polystyrene
Refrigeration Control Device		EXV	EXV	EXV	EXV	EXV
Protection Device		Fuse	Fuse	Fuse	Fuse	Fuse
Panel Name		TC03	TC03	TC03	TC03	TC03

#### 4.11 Super High Static Pressure Duct Type Indoor Unit

Model		GMV-ND07PHS/B - T(U)	GMV-ND09PHS/ B- T(U)	GMV-ND12PHS/B -T(U)	GMV-ND15PHS/B -T(U)	
Product code		CM810N0830	CM810N0790	CM810N0800	CM810N0770	
Cooling Capacity	Btu/h	7500	9500	12000	15000	
	kW	2.2	2.8	3.5	4.4	
Heating Capacity	Btu/h	8500	10500	13500	17000	
	kW	2.5	3.1	4	5	
Casing Finish		Galvanized Steel plate				
Dimensions (W×D×H)	Outline	mm	700x700x300	700x700x300	1000x700x300	
		inch	27-9/16×27-9/16 ×11-13/16	27-9/16×27-9/16 ×11-13/16	39-3/8×27-9/16 ×11-13/16	
	Packaging	mm	897×808×360	897×808×360	1205×813×360	
		inch	35-5/16×32 ×14-3/16	35-5/16×32 ×14-3/16	47-7/16×32 ×14-3/16	
Net Weight		LBS	73	94	94	
		kg	33	42.6	42.6	
Gross Weight		LBS	86	108	108	
		kg	39	49	49	
Pipe Connections	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35	
		inch	Φ1/4	Φ1/4	Φ1/4	
	Gas Side	mm	Φ9.52	Φ9.52	Φ12.7	
		inch	Φ3/8	Φ3/8	Φ1/2	
	Drain Pipe	mm	Φ25	Φ25	Φ25	
		inch	Φ1	Φ1	Φ1	
Power Supply		1-phase 208/230V 60Hz				
Fan	Type × Quantity	Centrifugal×1	Centrifugal×1	Centrifugal×2	Centrifugal×2	
	Driving Mechanism	Direct-driven	Direct-driven	Direct-driven	Direct-driven	
	Motor Type	BLDC	BLDC	BLDC	BLDC	
	Motor Power Input	W	/	/	/	
	Motor Running Current	A	0.3	0.3	0.3	
	Airflow Rate (H/M/L)	CFM	324/282/235	324/282/235	353/294/247	
		m³/h	550/480/400	550/480/400	600/500/420	
	External Static Pressure	Default	In.W.G	0.24	0.24	
			Pa	60	60	
		Range	In.W.G	0~0.6	0~0.6	
			Pa	0~150	0~150	

Model		GMV-ND07PHS/B - T(U)	GMV-ND09PHS/ B- T(U)	GMV-ND12PHS/B -T(U)	GMV-ND15PHS/B -T(U)	
Sound Pressure Level(H/M/L)	dB(A)	35/33/31	35/33/31	36/34/32	40/37/34	
Heat Exchanger		Fenestrate plain film -- hydrophilic film				
Air Filter		PP	PP	PP	PP	
Insulation Material		Foamed polystyrene				
Refrigeration Control Device		EXV	EXV	EXV	EXV	
Protection Device		Fuse	Fuse	Fuse	Fuse	
Model		GMV-ND18PHS/B -T(U)	GMV-ND22PHS/B -T(U)	GMV-ND24PHS/B -T(U)	GMV-ND30PHS/B -T(U)	
Product code		CM810N0810	CM810N0720	CM810N0730	CM810N0780	
Cooling Capacity	Btu/h	18000	22000	24000	30000	
	kW	5.3	6.4	7	8.8	
Heating Capacity	Btu/h	20000	24000	27000	34000	
	kW	5.9	7	7.9	10	
Casing Finish		Galvanized Steel plate				
Dimensions (W×D×H)	Outline	mm	1000×700×300	1000×700×300	1000×700×300	
		inch	39-3/8×27-9/16 ×11-13/16	39-3/8×27-9/16 ×11-13/16	39-3/8×27-9/16 ×11-13/16	
	Packaging	mm	1205×813×360	1205×813×360	1205×813×360	
		inch	47-7/16×32 ×14-3/16	47-7/16×32 ×14-3/16	47-7/16×32 ×14-3/16	
Net Weight		LBS	94	94	94	
		kg	42.6	42.6	42.6	
Gross Weight		LBS	108	108	108	
		kg	49	49	49	
Pipe Connections	Liquid Side	mm	Φ9.52	Φ9.52	Φ9.52	
		inch	Φ3/8	Φ3/8	Φ3/8	
	Gas Side	mm	Φ15.9	Φ15.9	Φ15.9	
		inch	Φ5/8	Φ5/8	Φ5/8	
	Drain Pipe	mm	Φ25	Φ25	Φ25	
		inch	Φ1	Φ1	Φ1	
Power supply		1-phase 208/230V 60Hz				
Fan	Type × Quantity		Centrifugal×2	Centrifugal×2	Centrifugal×2	
	Driving Mechanism		Direct-driven	Direct-driven	Direct-driven	
	Motor Type		BLDC	BLDC	BLDC	
	Motor Power Input	W	/	/	/	
	Motor Running Current	A	0.7	0.7	0.9	
	Airflow Rate(H/M/L)	CFM	589/471/412	589/471/412	736/618/559	
		m³/h	1000/800/700	1000/800/700	1250/1050/950	
	External Static Pressure	Default	In.W.G	0.36	0.36	
			Pa	90	90	
		Range	In.W.G	0~0.8	0~0.8	
			Pa	0~200	0~200	
Sound Pressure Level(H/M/L)		dB(A)	42/38/35	42/38/35	43/39/35	
Heat Exchanger		Fenestrate plain film -- hydrophilic film				
Air Filter		PP	PP	PP	PP	
Insulation Material		Foamed polystyrene				
Refrigeration Control Device		EXV	EXV	EXV	EXV	
Protection Device		Fuse	Fuse	Fuse	Fuse	

Model		GMV-ND36PHS/B -T(U)	GMV-ND42PHS/B -T(U)	GMV-ND48PHS/B -T(U)	GMV-ND54PHS/B -T(U)	
Product Code		CM810N0740	CM810N0750	CM810N0820	CM810N0760	
Cooling Capacity	Btu/h	36000	42000	48000	54000	
	kW	10.6	12.3	14.1	15.8	
Heating Capacity	Btu/h	40000	47000	54000	60000	
	kW	11.7	13.8	15	17.6	
Casing Finish		Galvanized Steel plate				
Dimensions (W×D×H)	Outline	mm	1400×700×300	1400×700×300	1400×700×300	
		inch	55-1/8×27-9/16 ×11-13/16	55-1/8×27-9/16 ×11-13/16	55-1/8×27-9/16 ×11-13/16	
	Packaging	mm	1601×813×365	1601×813×365	1678×808×365	
		inch	63-1/16×32×14-3/8	63-1/16×32×14-3/8	66-1/16×32×14-3/8	
Net Weight		LBS	121	121	128	
		kg	55	55	58	
Gross Weight		LBS	137	137	148	
		kg	62	62	67	
Pipe Connections	Liquid Side	mm	Φ9.52	Φ9.52	Φ9.52	
		inch	Φ3/8	Φ3/8	Φ3/8	
	Gas Side	mm	Φ15.9	Φ15.9	Φ15.9	
		inch	Φ5/8	Φ5/8	Φ3/4	
	Drain Pipe	mm	Φ25	Φ25	Φ25	
		inch	Φ1	Φ1	Φ1	
Power supply		1-phase 208/230V 60Hz				
Fan	Type × Quantity		Centrifugal×3	Centrifugal×3	Centrifugal×3	
	Driving Mechanism		Direct-driven	Direct-driven	Direct-driven	
	Motor Type		BLDC	BLDC	BLDC	
	Motor Power Input	W	/	/	/	
	Motor Running Current		A	1.2	1.2	
	Airflow Rate(H/M/L)	CFM	1177/942/824	1177/942/824	1383/1118/971	
		m³/h	2000/1600/1400	2000/1600/1400	2350/1900/1650	
	External Static Pressure	Default	In.W.G	0.36	0.36	
			Pa	90	90	
		Range	In.W.G	0~0.8	0~0.8	
			Pa	0~200	0~200	
Sound Pressure Level(H/M/L)		dB(A)	45/42/40	45/42/40	46/43/41	
Heat Exchanger		Fenestrate plain film -- hydrophilic film				
Air Filter		PP	PP	PP	PP	
Insulation Material		Foamed polystyrene				
Refrigeration Control Device		EXV	EXV	EXV	EXV	
Protection Device		Fuse	Fuse	Fuse	Fuse	

Model			GMV-ND72PH/B-T(U)	GMV-ND96PH/B-T(U)	
Product Code			CM810N1600	CM810N1590	
Cooling Capacity	Btu/h		72000	96000	
	kW		21.1	28.1	
Heating Capacity	Btu/h		81000	108000	
	kW		23.7	31.7	
Casing Finish			Galvanized Steel plate		
Dimensions (W×D×H)	Outline	mm	1240X1040X470	1240X1040X470	
		inch	48-3/4×41×18-1/2	48-3/4×41×18-1/2	
	Packaging	mm	1520x1153X605	1520x1153X605	
		inch	59-7/8×45-3/8×23-7/8	59-7/8×45-3/8×23-7/8	
Net Weight	LBS	223	236		
	kg	101	107		
Gross Weight	LBS	331	340		
	kg	150	154		
Pipe Connections	Liquid Side	mm	Φ9.52	Φ9.52	
		inch	Φ3/8	Φ3/8	
	Gas Side	mm	Φ19.05	Φ22.2	
		inch	Φ3/4	Φ7/8	
	Drain Pipe	mm	Φ25	Φ25	
		inch	Φ1	Φ1	
Power Supply			1-phase 208/230V 60Hz		
Fan	Type × Quantity		Centrifugal×2	Centrifugal×2	
	Driving Mechanism		Direct-driven	Direct-driven	
	Motor Type		BLDC	BLDC	
	Motor Power Input	W	750	750	
	Motor Running Current	A	4.5	5.4	
	Airflow Rate (H/M/L)	CFM	2355/1885/1650	2530/2120/1885	
		m³/h	4000/3200/2800	4300/3600/3200	
	External Static Pressure	In.W.G Default	0.52	0.6	
		Pa	130	150	
		In.W.G Range	0.2~0.98	0.2~1.1	
		Pa	50~245	50~275	
Sound Pressure Level(H/M/L)			46/45/44	48/46/45	
Heat Exchanger			Fenestrate plain film -- hydrophilic film		
Air Filter			PP	PP	
Insulation Material			Foamed polystyrene		
Refrigeration Control Device			EXV	EXV	
Protection Device			Fuse	Fuse	

## 4.12 Air Handler Type Indoor Unit

Model		GMV-ND09A/ A-T(U)	GMV-ND12A/ A-T(U)	GMV-ND18A/ A-T(U)	GMV-ND24A/ A-T(U)	GMV-ND30A/ A-T(U)	
Product Code		CM810N1900	CM810N1910	CM810N1890	CM810N0660	CM810N0670	
Cooling Capacity	Btu/h	9500	12000	18000	24000	30000	
	kW	2.8	3.5	5.3	7.0	8.8	
Heating Capacity	Btu/h	10500	13500	20000	27000	34000	
	kW	3.1	4.0	5.9	7.9	10.0	
Casing Finish		Galvanized Steel plate					
Dimensions (W×D×H)	Outline	mm	460x540x1105	460x540x1105	460x540x1105	460x540x1105	
		inch	18-1/8×21-1/4 ×43-1/2	18-1/8×21-1/4 ×43-1/2	18-1/8×21-1/4 ×43-1/2	18-1/8×21-1/4 ×43-1/2	
	Packaging	mm	517×620×1170	517×620×1170	517×620×1170	517×620×1170	
		inch	20-3/8×24-3/8 ×46-1/8	20-3/8×24-3/8 ×46-1/8	20-3/8×24-3/8 ×46-1/8	20-3/8×24-3/8 ×46-1/8	
Net Weight	LBS	119	119	124	124	124	
	kg	54	54	56	56	56	
Gross Weight	LBS	128	128	135	135	135	
	kg	58	58	61	61	61	
Pipe Connections	Liquid Side	mm	Φ6.35	Φ6.35	Φ9.52	Φ9.52	
		inch	Φ1/4	Φ1/4	Φ3/8	Φ3/8	
	Gas Side	mm	Φ9.52	Φ12.7	Φ15.9	Φ15.9	
		inch	Φ3/8	Φ1/2	Φ5/8	Φ5/8	
	Drain Pipe	/	G1	G1	G1	G1	
Power Supply		1-phase 208/230V 60Hz					
Fan	Type × Quantity		Centrifugal×1	Centrifugal×1	Centrifugal×1	Centrifugal×1	
	Driving Mechanism		Direct-driven	Direct-driven	Direct-driven	Direct-driven	
	Motor Type		BLDC	BLDC	BLDC	BLDC	
	Motor Power Input	W	55.0	55.0	122.5	122.5	
	Motor Running Current		A	1.1	1.1	1.1	
	Airflow Rate(H/M/L)	CFM	559/383/324	559/383/324	824/706/559	824/706/559	
		m <sup>3</sup> /h	950/650/550	950/650/550	1400/1200/950	1400/1200/950	
	External Static Pressure	Default	In.W.G	0.1	0.1	0.1	
			Pa	25	25	25	
		Range	In.W.G	0~0.3	0~0.3	0~0.3	
			Pa	0~75	0~75	0~75	
Sound Pressure Level(H/M/L)		dB(A)	36/34/32	36/34/32	45/43/41	45/43/41	
Heat Exchanger		Fenestrate plain film -- hydrophilic film					
Air Filter		PP	PP	PP	PP	PP	
Insulation Material		Foamed polystyrene					
Refrigeration Control Device		EXV	EXV	EXV	EXV	EXV	
Protection Device		Fuse	Fuse	Fuse	Fuse	Fuse	

Model		GMV-ND36A/A -T(U)	GMV-ND42A/A -T(U)	GMV-ND48A/A -T(U)	GMV-ND54A/A -T(U)	
Product Code		CM810N0700	CM810N0690	CM810N0680	CM810N0710	
Cooling Capacity	Btu/h	36000	42000	48000	54000	
	kW	10.6	12.3	14.1	15.8	
Heating Capacity	Btu/h	40000	47000	54000	60000	
	kW	11.7	13.8	15.8	17.6	
Casing Finish		Galvanized Steel plate				
Dimensions (W×D×H)	Outline	mm	540×540×1224	540×540×1224	630×540×1224	
		inch	21-1/4×21-1/4 ×48-1/4	21-1/4×21-1/4 ×48-1/4	24-7/8×21-1/4 ×48-1/4	
	Packaging	mm	597×620×1289	597×620×1289	687×621×1295	
		inch	23-1/2×24-3/8 ×50-3/4	23-1/2×24-3/8 ×50-3/4	27×24-1/2×51	
Net Weight		LBS	148	148	179	
		kg	67	67	81	
Gross Weight		LBS	159	159	192	
		kg	72	72	87	
Pipe Connections	Liquid Side	mm	Φ9.52	Φ9.52	Φ9.52	
		inch	Φ3/8	Φ3/8	Φ3/8	
	Gas Side	mm	Φ15.9	Φ15.9	Φ15.9	
		inch	Φ5/8	Φ5/8	Φ5/8	
	Drain Pipe	/	G1	G1	G1	
Power Supply		1-phase 208/230V 60Hz				
Fan	Type × Quantity		Centrifugal×1	Centrifugal×1	Centrifugal×1	
	Driving Mechanism		Direct-driven	Direct-driven	Direct-driven	
	Motor Type		BLDC	BLDC	BLDC	
	Motor Power Input	W	294	367.5	428.7	
	Motor Running Current	A	2.6	2.7	3.4	
	Airflow Rate(H/M/L)	CFM	1353/1176/1000	1441/1265/1118	1618/1500/1353	
		m³/h	2300/2000/1700	2450/2150/1900	2750/2550/2300	
	External Static Pressure	Default	In.W.G	0.15	0.2	
			Pa	37	50	
		Range	In.W.G	0~0.4	0~0.5	
			Pa	0~100	0~125	
Sound Pressure Level(H/M/L)		dB(A)	49/47/45	50/48/46	51/49/47	
Heat Exchanger		Fenestrate plain film -- hydrophilic film				
Air Filter		PP	PP	PP	PP	
Insulation Material		Foamed polystyrene				
Refrigeration Control Device		EXV	EXV	EXV	EXV	
Protection Device		Fuse	Fuse	Fuse	Fuse	

## 4.13 AHU-KIT

Model			GMV-N12U/A-T(U)		GMV-N24U/A-T(U)			GMV-N48U/A-T(U)		
Defaulted Capacity of ex-factory	Capacity		12		24			48		
	Cooling	kW	3.5		7.0			14.1		
	Cooling	kBtu/h	12.0		24.0			48.0		
	Heating	kW	4.0		7.9			15.8		
	Heating	kBtu/h	13.5		27.0			54.0		
Adjustable Capacity	Capacity		9	12	15	18	24	30	36	48
	Cooling	kW	2.6	3.5	4.4	5.3	7.0	8.8	10.55	14.1
	Cooling	kBtu/h	9.5	12.0	15.0	18.0	24.0	30.0	36.0	48.0
	Heating	kW	3.1	4.0	5.0	5.9	7.9	10.0	11.72	15.8
	Heating	kBtu/h	10.5	13.5	17.0	20.0	27.0	34.0	40.0	54.0
Power Input			W	5.0			5.0			5.0
Power Supply			—	208/230V ~60Hz			208/230V ~60Hz			208/230V ~60Hz
Size of Connection Pipe	AHU-KIT (ex-factory pipe size)		mm	Φ6.35	Φ6.35	Φ9.52	Φ9.52	Φ9.52	Φ9.52	Φ9.52
			inch	Φ1/4	Φ1/4	Φ3/8	Φ3/8	Φ3/8	Φ3/8	Φ3/8
	Air Handling Unit	Liquid Pipe	mm	Φ6.35	Φ6.35	Φ6.35	Φ9.52	Φ9.52	Φ9.52	Φ9.52
			inch	Φ1/4	Φ1/4	Φ1/4	Φ3/8	Φ3/8	Φ3/8	Φ3/8
		Gas Pipe	mm	Φ9.52	Φ12.7	Φ12.7	Φ15.9	Φ15.9	Φ15.9	Φ15.9
			inch	Φ3/8	Φ1/2	Φ1/2	Φ5/8	Φ5/8	Φ5/8	Φ5/8
Connection Method			Brazing Connection			Brazing Connection			Brazing Connection	
Outline Dimension (W×D×H)	EXV Box	mm	203×326×85			203×326×85			203×326×85	
		inch	8×12-7/8×3-3/8			8×12-7/8×3-3/8			8×12-7/8×3-3/8	
	Control Box	mm	334×284×111			334×284×111			334×284×111	
		inch	13-1/8×11-1/8×4-3/8			13-1/8×11-1/8×4-3/8			13-1/8×11-1/8×4-3/8	
Net weight	kg		9.5			9.5			9.5	
	LBS		21			21			21	

Model			GMV-N96U/A-T(U)				GMV-N192U/A-T(U)			
Defaulted Capacity of ex-factory	Capacity		96				192			
	Cooling	kW	28.1				56.3			
	Cooling	kBtu/h	96.0				192			
	Heating	kW	31.7				63.3			
	Heating	kBtu/h	108.0				216			
Adjustable Capacity	Capacity		72	96	120	144	168	192	288	
	Cooling	kW	21.1	28.1	35.2	42.2	49.2	56.3	84.4	
	Cooling	kBtu/h	72	96	120	144	168	192	288	
	Heating	kW	23.7	31.7	39.6	47.5	55.4	63.3	95.0	
	Heating	kBtu/h	81	108	135	162	189	216	324	
Power Input			W	5.0				5.0		
Power Supply			—	208/230V ~60Hz				208/230V ~60Hz		
Size of Connection Pipe	AHU-KIT (ex-factory pipe size)		mm	Φ9.52	Φ9.52	Φ9.52	Φ9.52	Φ15.9	Φ15.9	Φ15.9
			inch	Φ3/8	Φ3/8	Φ3/8	Φ3/8	Φ5/8	Φ5/8	Φ5/8
	Air Handling Unit	Liquid Pipe	mm	Φ9.52	Φ9.52	Φ12.7	Φ12.7	Φ15.9	Φ15.9	Φ19.05
			inch	Φ3/8	Φ3/8	Φ1/2	Φ1/2	Φ5/8	Φ5/8	Φ3/4
		Gas Pipe	mm	Φ19.05	Φ22.2	Φ28.6	Φ28.6	Φ28.6	Φ28.6	Φ34.9
			inch	Φ3/4	Φ7/8	Φ1-1/8	Φ1-1/8	Φ1-1/8	Φ1-1/8	Φ1-3/8
Connection method			Brazing Connection				Brazing Connection			

Model			GMV-N96U/A-T(U)			GMV-N192U/A-T(U)		
Outline Dimension (W×D×H)	EXV Box	mm	203×326×85			246×500×120		
		inch	8×12-7/8×3-3/8			9-5/8×19-5/8×4-3/4		
	Control Box	mm	334×284×111			334×284×111		
		inch	13-1/8×11-1/8×4-3/8			13-1/8×11-1/8×4-3/8		
Net Weight	kg		9.5			13		
	LBS		21			29		

Model(Combined)			GMV-N48U/A-T(U)+GMV-N192U/A-T(U)										
Capacity			48+288										
Cooling		kW				98.48							
Cooling		kBtu/h				336							
Heating		kW				110.79							
Heating		kBtu/h				378							
Power Input			W			5.0+5.0							
Power Supply			—	208/230V ~60Hz									
Size of Connection Pipe	Air Handling Unit	Liquid Pipe	mm	Φ19.05									
			inch	Φ3/4									
		Gas Pipe	mm	Φ34.9									
			inch	Φ1-3/8									
Outline Dimension (W×D×H)	Electronic Expansion Valve Box	mm	(203×326×85)+(246×500×120)										
		inch	(8×12-7/8×3-3/8)+(9-5/8×19-5/8×4-3/4)										
	Control Box	mm	(334×284×111)×2										
		inch	(13-1/8×11-1/8×4-3/8)×2										
Net Weight			kg	9.5+13									
			LBS	21+29									

Model			GMV-N12U/C-T(U)			GMV-N24U/C-T(U)			GMV-N48U/C-T(U)			
Defaulted capacity of ex-factory	Capacity		12			24			48			
	Cooling	kW	3.5			7.0			14.1			
	Cooling	kBtu/h	12.0			24.0			48.0			
	Heating	kW	4.0			7.9			15.8			
	Heating	kBtu/h	13.5			27.0			54.0			
Adjustable capacity	Capacity		9	12	15	18	24	30	36	48	60	
	Cooling	kW	2.6	3.5	4.4	5.3	7.0	8.8	10.6	14.1	17.6	
	Cooling	kBtu/h	9.5	12.0	15.0	18.0	24.0	30.0	36.0	48.0	60.0	
	Heating	kW	3.1	4.0	5.0	5.9	7.9	10.0	11.7	15.8	19.7	
	Heating	kBtu/h	10.5	13.5	17.0	20.0	27.0	34.0	40.0	54.0	67.0	
Power input			W	8.0			8.0			8.0		
Power Supply			—	208/230V ~60Hz			208/230V ~60Hz			208/230V ~60Hz		
Size of connection pipe	AHU-KIT (ex-factory pipe size)		mm	Φ6.35	Φ6.35	Φ9.52	Φ9.52	Φ9.52	Φ9.52	Φ9.52	Φ9.52	
			inch	Φ1/4	Φ1/4	Φ3/8	Φ3/8	Φ3/8	Φ3/8	Φ3/8	Φ3/8	
	Air handling unit	Liquid pipe	mm	Φ6.35	Φ6.35	Φ6.35	Φ9.52	Φ9.52	Φ9.52	Φ9.52	Φ9.52	
			inch	Φ1/4	Φ1/4	Φ1/4	Φ3/8	Φ3/8	Φ3/8	Φ3/8	Φ3/8	
		Gas pipe	mm	Φ9.52	Φ12.7	Φ12.7	Φ15.9	Φ15.9	Φ15.9	Φ15.9	Φ19.0 5	
			inch	Φ3/8	Φ1/2	Φ1/2	Φ5/8	Φ5/8	Φ5/8	Φ5/8	Φ3/4	
Connection method			Brazing Connection			Brazing Connection			Brazing Connection			
Outline dimension (W×D×H)	EXV box	mm	203×326×85			203×326×85			203×326×85			
		inch	8×12-7/8×3-3/8			8×12-7/8×3-3/8			8×12-7/8×3-3/8			
	Control box	mm	334×284×111			334×284×111			334×284×111			
		inch	13-1/8×11-1/8×4-3/8			13-1/8×11-1/8×4-3/8			13-1/8×11-1/8×4-3/8			
Net weight			kg	10.0			10.5			10.5		
			LBS	22			23			23		

Model			GMV-N96U/C-T(U)				GMV-N192U/C-T(U)				
Defaulted capacity of ex-factory	Capacity		96				192				
	Cooling	kW	28.1				56.3				
	Cooling	kBtu/h	96.0				192.0				
	Heating	kW	31.7				63.3				
	Heating	kBtu/h	108.0				216.0				
Adjustable capacity	Capacity		72	96	120	144	168	192	288		
	Cooling	kW	21.1	28.1	35.2	42.2	49.2	56.3	84.4		
	Cooling	kBtu/h	72	96	120	144	168	192	288		
	Heating	kW	23.7	31.7	39.6	47.5	55.4	63.3	95.0		
	Heating	kBtu/h	81	108	135	162	189	216	324		
Power input			W	8.0				8.0			
Power Supply			—	208/230V ~60Hz				208/230V ~60Hz			
Size of connection pipe	AHU-KIT (ex-factory pipe size)		mm	Φ9.52	Φ9.52	Φ9.52	Φ9.52	Φ15.9	Φ15.9		
			inch	Φ3/8	Φ3/8	Φ3/8	Φ3/8	Φ5/8	Φ5/8		
	Air handling unit	Liquid pipe	mm	Φ9.52	Φ9.52	Φ12.7	Φ12.7	Φ15.9	Φ15.9		
			inch	Φ3/8	Φ3/8	Φ1/2	Φ1/2	Φ5/8	Φ5/8		
		Gas pipe	mm	Φ19.05	Φ22.2	Φ28.6	Φ28.6	Φ28.6	Φ34.9		
			inch	Φ3/4	Φ7/8	Φ1-1/8	Φ1-1/8	Φ1-1/8	Φ1-3/8		
Connection method			Brazing Connection				Brazing Connection				
Outline dimension (W×D×H)	EXV box	mm	203×326×85				246×500×120				
		inch	8×12-7/8×3-3/8				9-5/8×19-5/8×4-3/4				
	Control box	mm	334×284×111				334×284×111				
Net weight			inch	13-1/8×11-1/8×4-3/8				13-1/8×11-1/8×4-3/8			
kg			10.5				13.0				
LBS			23				29				

Model(Combined)			GMV-N48U/C-T(U) +GMV-N192U/C-T(U)		GMV-N96U/C-T(U) +GMV-N192U/C-T(U)		GMV-N192U/C-T(U) +GMV-N192U/C-T(U)				
Capacity			48+288		96+288		192+288	288+288			
Cooling		kW	98.5		112.5		140.7	168.8			
Cooling		kBtu/h	336		384		480	576			
Heating		kW	110.8		126.6		158.3	189.9			
Heating		kBtu/h	378		432		540	648			
Power input			W	8.0+8.0		8.0+8.0		8.0+8.0			
Power supply			—	208/230V ~60Hz		208/230V ~60Hz		208/230V ~60Hz			
Size of connection pipe	Air handling unit	Liquid pipe	mm	Φ19.05		Φ19.05		Φ19.05	Φ19.05		
			inch	Φ3/4		Φ3/4		Φ3/4	Φ3/4		
	Gas pipe	mm	Φ34.9		Φ41.3		Φ41.3	Φ41.3			
		inch	Φ1-3/8		Φ1-5/8		Φ1-5/8	Φ1-5/8			
Outline dimension (W×D×H)	Electronic expansion valve box		mm	(203×326×85) +(246×500×120)		(203×326×85) +(246×500×120)		(246×500×120)×2			
			inch	(8×12-7/8×3-3/8) +(9-5/8×19-5/8×4-3/4)		(8×12-7/8×3-3/8) +(9-5/8×19-5/8×4-3/4)		(9-5/8×19-5/8×4-3/4)×2			
	Control box		mm	(334×284×111)×2		(334×284×111)×2		(334×284×111)×2			
			inch	(13-1/8×11-1/8×4-3/8)×2		(13-1/8×11-1/8×4-3/8)×2		(13-1/8×11-1/8×4-3/8)×2			
Net weight			kg	10.5+13.0		10.5+13.0		13.0+13.0			
			LBS	23+29		23+29		29+29			

## 4.14 1-way Cassette Type Indoor Unit

Model		GMV-ND07TD/A-T(U)		GMV-ND09TD/A-T(U)		
Product Code		CM502N0151		CM502N0161		
Cooling Capacity		Btu/h	7500	9500	12000	
		kW	2.2	2.8	3.6	
Heating Capacity		Btu/h	8500	10500	13500	
		kW	2.5	3.2	4	
Casing Finish			Galvanized Steel plate			
Dimensions (W×D×H)	Body Outline	mm	987×385×178	987×385×178	987×385×178	
		inch	38-7/8×15-3/16×7	38-7/8×15-3/16×7	38-7/8×15-3/16×7	
	Body Packaging	mm	1307×501×310	1307×501×310	1307×501×310	
		inch	51-1/2×19-3/4×12-3/16	51-1/2×19-3/4×12-3/16	51-1/2×19-3/4×12-3/16	
	Panel Outline	mm	1200×460×55	1200×460×55	1200×460×55	
		inch	47-1/4×18-1/8×2-3/16	47-1/4×18-1/8×2-3/16	47-1/4×18-1/8×2-3/16	
	Panel Packaging	mm	1265×536×118	1265×536×118	1265×536×118	
		inch	49-13/16×21-1/8×4-3/4	49-13/16×21-1/8×4-3/4	49-13/16×21-1/8×4-3/4	
Net Weigh	Main Body	LBS	44	44	44	
		kg	20	20	20	
	Panel	LBS	9.3	9.3	9.3	
		kg	4.2	4.2	4.2	
Gross Weigh	Main Body	LBS	60	60	60	
		kg	27	27	27	
	Panel	LBS	13.2	13.2	13.2	
		kg	6	6	6	
Pipe Connections	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35	
		inch	Φ1/4	Φ1/4	Φ1/4	
	Gas Side	mm	Φ9.52	Φ9.52	Φ12.7	
		inch	Φ3/8	Φ3/8	Φ1/2	
	Drain Pipe	mm	Φ25	Φ25	Φ25	
		inch	Φ1	Φ1	Φ1	
Power Supply			1-phase 208/230V 60Hz			
Fan	Type × Quantity		Cross-flow	Cross-flow	Cross-flow	
	Driving Mechanism		Direct-driven	Direct-driven	Direct-driven	
	Motor Type		BLDC	BLDC	BLDC	
	Motor Power Input	W	30	30	30	
	Motor Running Current	A	0.2	0.2	0.2	
	Airflow Rate(H/M/L)	CFM	353/294/265	353/294/265	353/294/265	
		m <sup>3</sup> /h	600/500/450	600/500/450	600/500/450	
Sound Pressure Level(H/M/L)		dB(A)	36/32/28	36/32/28	36/32/28	
Heat Exchanger			Fenestrate plain film --hydrophilic film			
Air Filter			PP	PP	PP	
Insulation Material			Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	
Refrigeration Control Device			EXV	EXV	EXV	
Protection Device			Fuse	Fuse	Fuse	
Panel Name			TD01	TD01	TD01	

## 4.15 General Static Pressure Duct Type Indoor Unit

Model			GMV-ND30 PLS/C-T(U)	GMV-ND36 PLS/C-T(U)	GMV-ND42 PLS/C-T(U)	GMV-ND48 PLS/C-T(U)		
Product Code			CM810N2020	CM810N2010	CM810N2000	CM810N1990		
Cooling Capacity	Btu/h	30000	36000	42000	48000			
	kW	8.8	10.6	12.3	14.1			
Heating Capacity	Btu/h	34000	40000	47000	54000			
	kW	10.0	11.7	13.8	15.8			
Casing Finish			Galvanized Steel plate					
Dimensions (W×D×H)	Outline	mm	1340×655×260	1340×655×260	1340×655×260	1340×655×260		
		inch	52-3/4×25-13/16 ×10-1/4	52-3/4×25-13/16 ×10-1/4	52-3/4×25-13/16 ×10-1/4	52-3/4×25-13/16 ×10-1/4		
	Packaging	mm	1588×858×315	1588×858×315	1588×858×315	1588×858×315		
		inch	62-1/2×33-3/4×1 2-3/8	62-1/2×33-3/4×1 2-3/8	62-1/2×33-3/4×1 2-3/8	62-1/2×33-3/4×1 2-3/8		
Net Weight			LBS	100	100	102		
			kg	45.5	45.5	46.5		
Gross Weight			LBS	120	120	122		
			kg	54.5	54.5	55.5		
Pipe Connection	Liquid Side	mm	Φ9.52	Φ9.52	Φ9.52	Φ9.52		
		inch	Φ3/8	Φ3/8	Φ3/8	Φ3/8		
	Gas Side	mm	Φ15.9	Φ15.9	Φ15.9	Φ15.9		
		inch	Φ5/8	Φ5/8	Φ5/8	Φ5/8		
	Drain Pipe	mm	Φ25	Φ25	Φ25	Φ25		
		inch	Φ2.5	Φ2.5	Φ2.5	Φ2.5		
Power supply			1-phase 208/230V 60Hz					
Fan	Type × Quantity		Centrifugal×3	Centrifugal×3	Centrifugal×3	Centrifugal×3		
	Driving Mechanism		Direct-driven					
	Motor Type		BLDC					
	Motor Power Input	W	130	130	170	170		
	Motor Running Current	A	2.4	2.4	2.4	2.4		
	Airflow Rate(H/M/L)	CFM	880/735/530	1000/880/650	1180/1000/825	1180/1000/825		
		m <sup>3</sup> /h	1500/1250/900	1700/1500/1100	2000/1700/1400	2000/1700/1400		
	External Static Pressure	Default	In.W.G	0.2	0.2	0.2		
			Pa	50	50	50		
		Range	In.W.G	0~0.32	0~0.32	0~0.32		
			Pa	0~80	0~80	0~80		
Sound Pressure Level(H/M/L)			dB(A)	40/36/32	40/36/32	42/40/37		
Heat Exchanger			Fenestrate plain film --hydrophilic film					
Air Filter			PP					
Refrigeration Control Device			EXV					
Protection Device			Fuse					

## 4.16 360°Air Discharge Compact Cassette Type Indoor Unit

Model		GMV-ND05T/E-T(U)		GMV-ND07T/E-T(U)		
Product Code		CM500N1600		CM500N1590		
Cooling Capacity		Btu/h	5800		7500	
		kW	1.7		2.2	
Heating Capacity		Btu/h	6200		8500	
		kW	1.8		2.5	
Casing Finish			Galvanized Steel plate			
Dimensions (W×D×H)	Body Outline	mm	570×570×265	570×570×265	570×570×265	
		inch	22-7/16×22-7/16×10-7/ 16	22-7/16×22-7/16×10-7/ 16	22-7/16×22-7/16×10-7/ 16	
	Body Packaging	mm	698×653×295	698×653×295	698×653×295	
		inch	27-1/2×25-11/16×11-5/ 8	27-1/2×25-11/16×11-5/ 8	27-1/2×25-11/16×11-5/ 8	
	Panel Outline	mm	620×620×47.5	620×620×47.5	620×620×47.5	
		inch	24-3/8×24-3/8×1-7/8	24-3/8×24-3/8×1-7/8	24-3/8×24-3/8×1-7/8	
	Panel Packaging	mm	701×701×125	701×701×125	701×701×125	
		inch	27-5/8×27-5/8×5	27-5/8×27-5/8×5	27-5/8×27-5/8×5	
Net Weigh	Main Body	LBS	38.6	38.6	38.6	
		kg	17.5	17.5	17.5	
	Panel	LBS	6.6	6.6	6.6	
		kg	3.0	3.0	3.0	
Gross Weigh	Main Body	LBS	49.6	49.6	49.6	
		kg	22.5	22.5	22.5	
	Panel	LBS	10	10	10	
		kg	4.5	4.5	4.5	
Pipe Connections	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35	
		inch	Φ1/4	Φ1/4	Φ1/4	
	Gas Side	mm	Φ9.52	Φ9.52	Φ9.52	
		inch	Φ3/8	Φ3/8	Φ3/8	
	Drain Pipe	mm	Φ25	Φ25	Φ25	
		inch	Φ1	Φ1	Φ1	
Power Supply			1-phase 208/230V 60Hz			
Fan	Type × Quantity		Centrifugal×1	Centrifugal×1	Centrifugal×1	
	Driving Mechanism		Direct-driven	Direct-driven	Direct-driven	
	Motor Type		BLDC	BLDC	BLDC	
	Motor Power Input	W	35	35	35	
	Motor Running Current	A	0.3	0.3	0.3	
	Airflow Rate(H/M/L)	CFM	270/250/220	295/270/220	335/280/250	
		m³/h	460/420/370	500/460/370	570/480/420	
Sound Pressure Level(H/M/L)		dB(A)	33/30/25	36/31/25	36/33/28	
Heat Exchanger			Fenestrate plain film --hydrophilic film			
Air Filter			PP	PP	PP	
Insulation Material			Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	
Refrigeration Control Device			EXV	EXV	EXV	
Protection Device			Fuse	Fuse	Fuse	
Panel Name			TF05	TF05	TF05	

Model		GMV-ND12T/E-T(U)	GMV-ND15T/E-T(U)	GMV-ND18T/E-T(U)	
Product Code		CM500N1580	CM500N1610	CM500N1570	
Cooling Capacity	Btu/h	12000	15000	18000	
	kW	3.5	4.4	5.3	
Heating Capacity	Btu/h	13500	17000	20000	
	kW	4	5	5.9	
Casing Finish		Galvanized Steel plate			
Dimensions (W×D×H)	Body Outline	mm	570×570×265	570×570×265	
		inch	22-7/16×22-7/16×10-7/16	22-7/16×22-7/16×10-7/16	
	Body Packaging	mm	698×653×295	698×653×295	
		inch	27-1/2×25-11/16×11-5/8	27-1/2×25-11/16×11-5/8	
	Panel Outline	mm	620×620×47.5	620×620×47.5	
		inch	24-3/8×24-3/8×1-7/8	24-3/8×24-3/8×1-7/8	
	Panel Packaging	mm	701×701×125	701×701×125	
		inch	27-5/8×27-5/8×5	27-5/8×27-5/8×5	
Net Weigh	Main Body	LBS	38.6	38.6	
		kg	17.5	17.5	
	Panel	LBS	6.6	6.6	
		kg	3.0	3.0	
Gross Weigh	Main Body	LBS	49.6	49.6	
		kg	22.5	22.5	
	Panel	LBS	10	10	
		kg	4.5	4.5	
Pipe Connections	Liquid Side	mm	Φ6.35	Φ6.35	
		inch	Φ1/4	Φ1/4	
	Gas Side	mm	Φ12.7	Φ12.7	
		inch	Φ1/2	Φ1/2	
	Drain Pipe	mm	Φ25	Φ25	
		inch	Φ1	Φ1	
Power Supply		1-phase 208/230V 60Hz			
Fan	Type × Quantity		Centrifugal×1	Centrifugal×1	
	Driving Mechanism		Direct-driven	Direct-driven	
	Motor Type		BLDC	BLDC	
	Motor Power Input	W	46	46	
	Motor Running Current	A	0.4	0.4	
	Airflow Rate(H/M/L)	CFM	365/325/280	430/385/330	
		m <sup>3</sup> /h	620/550/480	730/650/560	
Sound Pressure Level(H/M/L)		dB(A)	39/37/35	43/41/39	
Heat Exchanger		Fenestrate plain film --hydrophilic film			
Air Filter		PP	PP	PP	
Insulation Material		Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	
Refrigeration Control Device		EXV	EXV	EXV	
Protection Device		Fuse	Fuse	Fuse	
Panel Name		TF05	TF05	TF05	

## 4.17 360°Air Discharge Cassette Type Indoor Unit

Model		GMV-ND07T /C-T(U)	GMV-ND09T /C-T(U)	GMV-ND12T /C-T(U)	GMV-ND15T /C-T(U)	GMV-ND18T /C-T(U)	
Product Code		CM500N156 0	CM500N148 0	CM500N153 0	CM500N146 0	CM500N147 0	
Cooling Capacity	Btu/h	7500	9500	12000	15000	18000	
	kW	2.2	2.8	3.5	4.4	5.3	
Heating Capacity	Btu/h	8500	10500	13500	17000	20000	
	kW	2.5	3.1	4.0	5	5.9	
Casing Finish		Galvanized Steel plate					
Dimensions (W×D×H)	Body Outline	mm	840×840×240	840×840×240	840×840×240	840×840×240	
		inch	33-1/8×33-1/8× 9-1/2	33-1/8×33-1/8× 9-1/2	33-1/8×33-1/8× 9-1/2	33-1/8×33-1/8× 9-1/2	
	Body Packaging	mm	963×963×325	963×963×325	963×963×325	963×963×325	
		inch	37-7/8 ×37-7/8 ×12-3/4	37-7/8 ×37-7/8 ×12-3/4	37-7/8 ×37-7/8 ×12-3/4	37-7/8 ×37-7/8 ×12-3/4	
	Panel Outline	mm	950×950×65	950×950×65	950×950×65	950×950×65	
		inch	37-3/8×37-3/8 ×2-1/2	37-3/8×37-3/8 ×2-1/2	37-3/8×37-3/8 ×2-1/2	37-3/8×37-3/8 ×2-1/2	
	Panel Packaging	mm	1038×1033 ×112	1038×1033 ×112	1038×1033 ×112	1038×1033 ×112	
		inch	40-7/8 ×40-5/8×4-3/8	40-7/8 ×40-5/8×4-3/8	40-7/8 ×40-5/8×4-3/8	40-7/8 ×40-5/8×4-3/8	
Net Weigh	Main Body	LBS	64	64	64	64	
		kg	29	29	29	29	
	Panel	LBS	13	13	13	13	
		kg	6	6	6	6	
Gross Weigh	Main Body	LBS	82	82	82	82	
		kg	37	37	37	37	
	Panel	LBS	21	21	21	21	
		kg	9.5	9.5	9.5	9.5	
Pipe Connections	Liquid Side	mm	Φ6.35	Φ6.35	Φ6.35	Φ6.35	
		inch	Φ1/4	Φ1/4	Φ1/4	Φ3/8	
	Gas Side	mm	Φ9.52	Φ9.52	Φ12.7	Φ12.7	
		inch	Φ3/8	Φ3/8	Φ1/2	Φ5/8	
	Drain Pipe	mm	Φ25	Φ25	Φ25	Φ25	
		inch	Φ1	Φ1	Φ1	Φ1	
Power supply		1-phase 208/230V 60Hz					
Fan	Type × Quantity		Centrifugal×1	Centrifugal×1	Centrifugal×1	Centrifugal×1	
	Driving Mechanism		Direct-driven	Direct-driven	Direct-driven	Direct-driven	
	Motor Type		BLDC	BLDC	BLDC	BLDC	
	Motor Running Current	A	0.6	0.6	0.6	0.7	
	Airflow Rate(H/M/L)	CFM	470/410/355	470/410/355	470/410/355	470/410/355	
		m³/h	800/700/600	800/700/600	800/700/600	950/850/750	
Sound Pressure Level(H/M/L)		dB(A)	34/32/30	34/32/30	34/32/30	38/36/33	
Heat Exchanger			Fenestrate plain film --hydrophilic film				
Air Filter			PP	PP	PP	PP	
Insulation Material			Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	
Refrigeration Control Device			EXV	EXV	EXV	EXV	

Model		GMV-ND07T /C-T(U)	GMV-ND09T /C-T(U)	GMV-ND12T /C-T(U)	GMV-ND15T /C-T(U)	GMV-ND18T /C-T(U)
Protection Device		Fuse	Fuse	Fuse	Fuse	Fuse
Panel Name		TF06	TF06	TF06	TF06	TF06


Model		GMV-ND22 T/C-T(U)	GMV-ND24 T/C-T(U)	GMV-ND30 T/C-T(U)	GMV-ND36 T/C-T(U)	GMV-ND42 T/C-T(U)	GMV-ND48 T/C-T(U)
Product Code		CM500N1520	CM500N1490	CM500N1550	CM500N1500	CM500N1450	CM500N1540
Cooling Capacity	Btu/h	22000	24000	30000	36000	42000	48000
	kW	6.4	7	8.8	10.6	12.3	14.1
Heating Capacity	Btu/h	24000	27000	34000	40000	47000	54000
	kW	7	7.9	10	11.7	13.8	15.8
Casing Finish		Galvanized Steel plate					
Dimensions (W×D×H)	Body Outline	mm	840×840×240	840×840×240	840×840×290	840×840×290	840×840×290
		inch	33-1/8× 33-1/8×9-1/2	33-1/8× 33-1/8×9-1/2	33-1/8× 33-1/8×11-3/8	33-1/8× 33-1/8×11-3/8	33-1/8× 33-1/8×11-3/8
	Body Packaging	mm	963×963×325	963×963×325	963×963×379	963×963×379	963×963×379
		inch	37-7/8 ×37-7/8 ×12-3/4	37-7/8 ×37-7/8 ×12-3/4	37-7/8 ×37-7/8 ×14-7/8	37-7/8 ×37-7/8 ×14-7/8	37-7/8 ×37-7/8 ×14-7/8
	Panel Outline	mm	950×950×65	950×950×65	950×950×65	950×950×65	950×950×65
		inch	37-3/8×37-3/8 ×2-1/2	37-3/8×37-3/8 ×2-1/2	37-3/8×37-3/8 ×2-1/2	37-3/8×37-3/8 ×2-1/2	37-3/8×37-3/8 ×2-1/2
	Panel Packaging	mm	1038×1033 ×112	1038×1033 ×112	1038×1033 ×112	1038×1033 ×112	1038×1033 ×112
		inch	40-7/8 ×40-5/8×4-3/8	40-7/8 ×40-5/8×4-3/8	40-7/8 ×40-5/8×4-3/8	40-7/8 ×40-5/8×4-3/8	40-7/8 ×40-5/8×4-3/8
Net Weight	Main Body	LBS	64	64	73	73	73
		kg	29	29	33	33	33
	Panel	LBS	13	13	13	13	13
		kg	6	6	6	6	6
Gross Weight	Main Body	LBS	82	82	93	93	93
		kg	37	37	42	42	42
	Panel	LBS	21	21	21	21	21
		kg	9.5	9.5	9.5	9.5	9.5
Pipe Connections	Liquid Side	mm	Φ9.52	Φ9.52	Φ9.52	Φ9.52	Φ9.52
		inch	Φ3/8	Φ3/8	Φ3/8	Φ3/8	Φ3/8
	Gas Side	mm	Φ15.9	Φ15.9	Φ15.9	Φ15.9	Φ15.9
		inch	Φ5/8	Φ5/8	Φ5/8	Φ5/8	Φ5/8
	Drain Pipe	mm	Φ25	Φ25	Φ25	Φ25	Φ25
		inch	Φ1	Φ1	Φ1	Φ1	Φ1
Power Supply		1-phase 208/230V 60Hz					

Model		GMV-ND22 T/C-T(U)	GMV-ND24 T/C-T(U)	GMV-ND30 T/C-T(U)	GMV-ND36 T/C-T(U)	GMV-ND42 T/C-T(U)	GMV-ND48 T/C-T(U)
Fan	Type × Quantity	Centrifugal×1	Centrifugal×1	Centrifugal×1	Centrifugal×1	Centrifugal×1	Centrifugal×1
	Driving Mechanism	Direct-driven	Direct-driven	Direct-driven	Direct-driven	Direct-driven	Direct-driven
	Motor Type	BLDC	BLDC	BLDC	BLDC	BLDC	BLDC
	Motor Running Current	A	0.7	0.7	0.8	1.0	1.5
	Airflow Rate (H/M/L)	CFM m³/h	560/500/440 950/850/750	675/560/500 1150/950/850	1250/1000/900 735/590/530	1500/1200/1000 885/705/590	1650/1300/1100 970/765/645
Sound Pressure Level(H/M/L)		dB(A)	38/36/33	38/36/34	39/37/34	43/39/37	45/41/39
Heat Exchanger		Fenestrate plain film --hydrophilic film					
Air Filter		PP	PP	PP	PP	PP	PP
Insulation Material		Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	Foamed polystyrene	Foamed polystyrene
Refrigeration Control Device		EXV	EXV	EXV	EXV	EXV	EXV
Protection Device		Fuse	Fuse	Fuse	Fuse	Fuse	Fuse
Panel Name		TF06	TF06	TF06	TF06	TF06	TF06

## **CONTROL**

## CHAPTER 2 CONTROL

### 1 Operation Flowchart

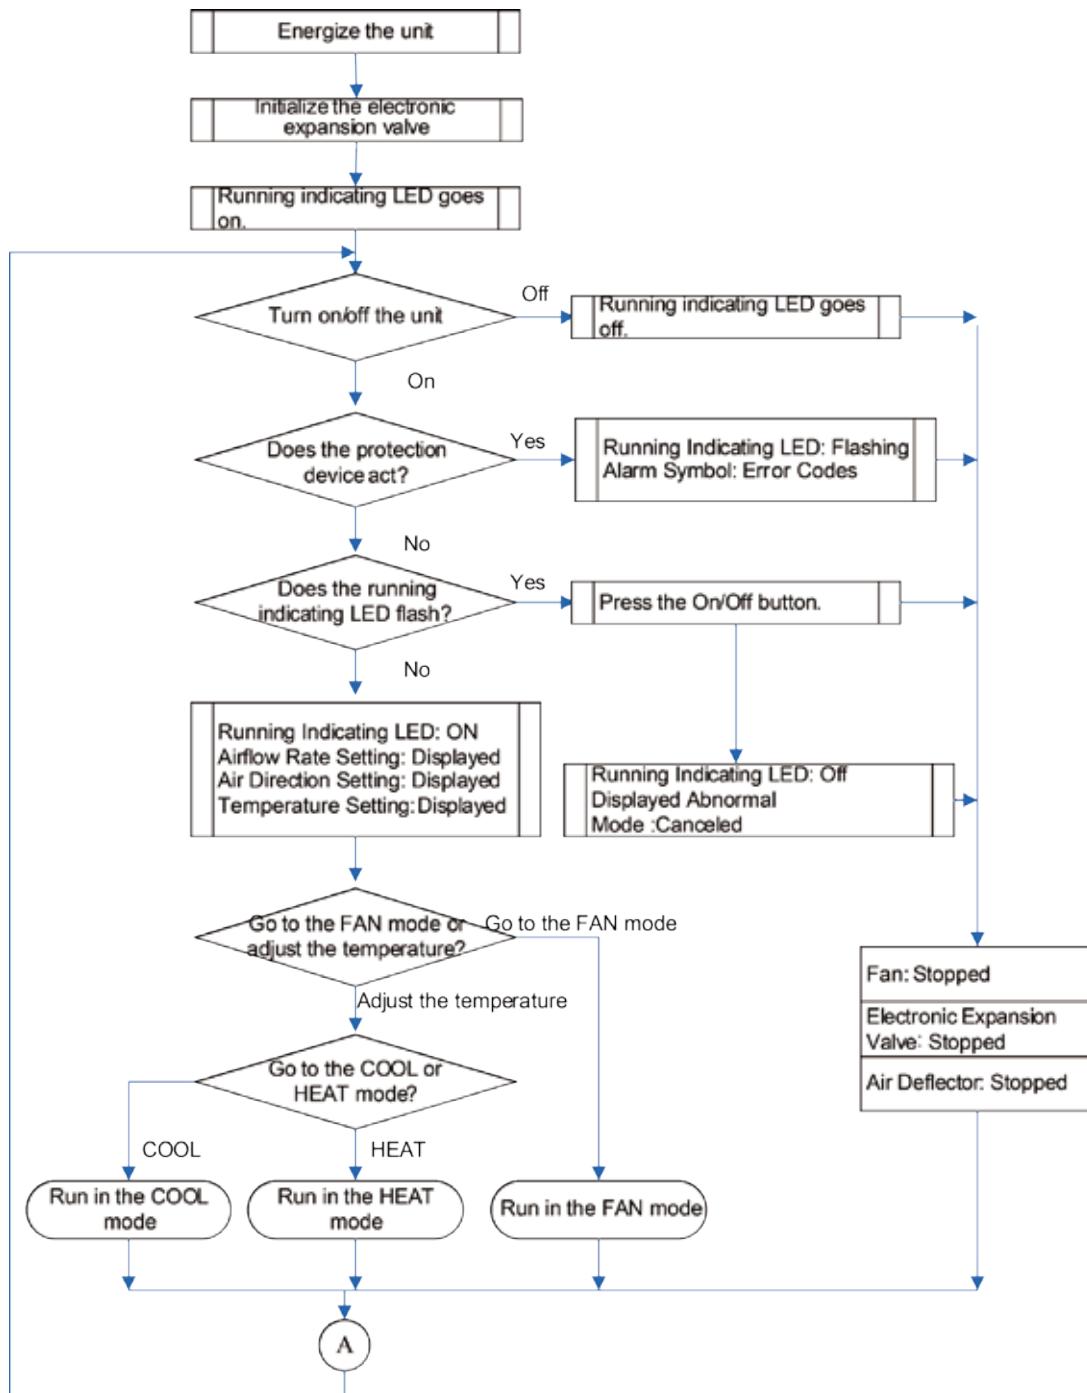

## 2 Wired Controller

### 2.1 Control Panel

#### 2.1.1 XK46 Wired Controller



Fig.2.1.1 Appearance of wired controller

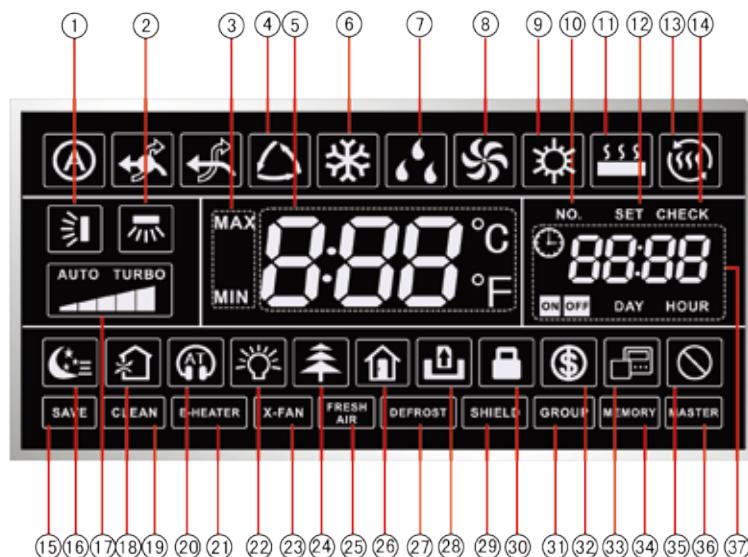


Fig.2.1.2 LED graphics of wired controller

Table 2.1 LED display instruction

No.	Symbols	Instructions
1		Up and down swing function
2	*	Left and right swing function
3		It's valid under Save mode and displays during setting process Temperature lower limit for Cooling: Limit the minimum temperature value under Cooling or Dry mode Temperature upper limit for Heating: Limit the maximum temperature value under Heating, Space Heating or 3D Heating mode
4	*	Auto mode (Under Auto mode, the indoor units will automatically select their operating mode as per the temperature change so as to make the ambient comfortable)
5		It shows the setting temperature value (In case the wired controller is controlling a Fresh Air Indoor Unit, then the temperature zone will display FAP)
6		Cooling mode
7		Dry mode
8		Fan mode
9		Heating mode
10		When inquiring or setting project number of indoor unit, it displays "NO." icon
11	*	Floor Heating mode (When Heating and Floor Heating simultaneously shows up, it indicates 3D Heating is activated)
12		Display "SET" icon under parameter setting interface
13	*	Space Heating mode
14		Display "CHECK" icon under parameter view interface
15		Outdoor unit operates under Save mode/upper limit of system capacitor less 100%/remote Save status
16		Sleep status
17		Current set fan speed (including auto, low speed, medium-low speed, medium speed, medium-high speed, high speed and turbo seven status)
18	*	Air status, Indoor unit optional function
19		Remind to clean the filter
20		Quiet status (including Quiet and Auto Quiet two status)
21	*	Allow auxiliary electric heating On icon
22		Light On/Off function
23		X-fan function

No.	Symbols	Instructions
24	*	Health function, Indoor unit optional function
25	*	Reserved function
26		Out function
27		Outdoor unit defrosting status
28		Gate-control function
29		Shielding status
30		Child Lock status
31		One wired controller controls multiple indoor units
32		Save status of indoor unit
33		It indicates the current wired controller is the slave wired controller (address of wired controller is 02)
34		Memory status (The indoor unit resumes the original setting state after power failure and then power recovery)
35		Invalid operation
36		Current wired controller connects master indoor unit
37		Timer zone: Display system clock and timer status

**NOTICE!** When wired controller is connected with different indoor units, some functions will be different

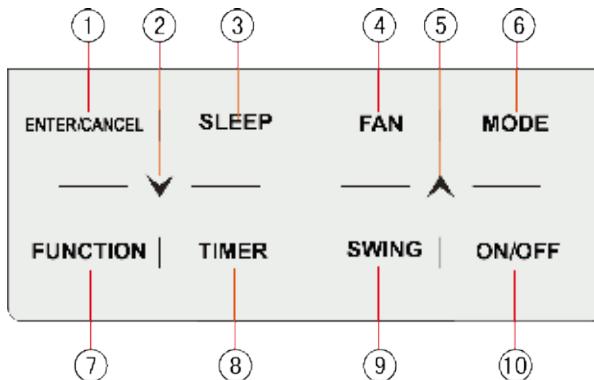


Fig.2.1.3 Button graphics


## Function instruction of buttons

No.	Buttons	Instructions
1	ENTER/CANCEL	Select and cancel function
2		Set operating temperature of indoor unit Set Timer
5		Switch Quiet mode, Air grade, Clean grade, set upper and lower temperature limit under Save mode Set and inquiry parameter
3	SLEEP	Set Sleep mode
4	FAN	Switch among auto, low speed, low-medium speed, medium speed, medium-high speed, high speed and turbo status
6	MODE	Switch Auto, Cooling, Dry, Fan, Heating, Floor Heating, 3D Heating and Space Heating modes for indoor unit. (NOTICE! The Floor Heating, 3D Heating and Space Heating function icon will show up when the unit has those functions)
7	FUNCTION	Switch among Air, Quiet, Light, Health, Absence, Save, Clean, E-heater and X-fan functions.
8	TIMER	Timer setting
9	SWING	Set up and down swing status
10	ON/OFF	Indoor unit On/Off
2+5		Simultaneously press “  ” and “  59

## 2.1.2 XK79 Wired Controller



Appearance of wired controller

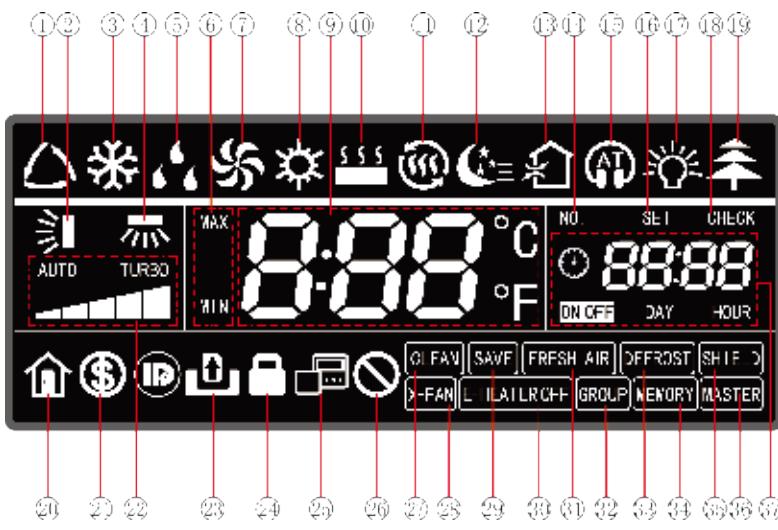

LED graphics of wired controller

Table LCD display instruction

No.	Symbols	Instructions
1	*	Auto mode (Under Auto mode, the indoor units will automatically select their operating mode as per the temperature change so as to make the ambient comfortable.)
2		Up and down swing function
3		Cooling mode
4	*	Left and right swing function
5		Dry mode
6		It's valid under Save mode and displays during setting process. Temperature lower limit for Cooling: Limit the minimum temperature value under Cooling or Dry mode. Temperature upper limit for Heating: Limit the maximum temperature value under Heating, Space Heating or 3D Heating mode.
7		Fan mode

No.	Symbols	Instructions
8		Heating mode
9		It shows the setting temperature value (In case the wired controller is controlling a Fresh Air Indoor Unit, then the temperature zone will display FAP)
10		Floor Heating mode (When Heating and Floor Heating simultaneously shows up, it indicates 3D Heating is activated.)
11		Space Heating mode
12		Sleep status
13		Air status, Indoor unit optional function
14		When inquiring or setting project number of indoor unit, it displays "NO." icon
15		Quiet status (including Quiet and Auto Quiet two status)
16		Display "SET" icon under parameter setting interface
17		Light On/Off function
18		Display "CHECK" icon under parameter view interface
19		Health function, Indoor unit optional function
20		Absence function
21		Save status of indoor unit
22		Current set fan speed (including auto, low speed, medium-low speed, medium speed, medium-high speed, high speed and turbo seven status)
23		Gate-control function
24		Child Lock status
25		It indicates the current wired controller is the slave wired controller (address of wired controller is 02)
26		Invalid operation
27		Remind to clean the filter
28		X-fan function
29		Outdoor unit operates under Save mode/upper limit of system capacitor less 100%/remote Save status
30		Allow auxiliary electric heating On icon
31		Reserved function
32		One wired controller controls multiple indoor units
33		Outdoor unit defrosting status
34		Memory status (The indoor unit resumes the original setting state after power failure and then power recovery)
35		Shielding status
36		Current wired controller connects master indoor unit
37		Timer zone: Display system clock and timer status

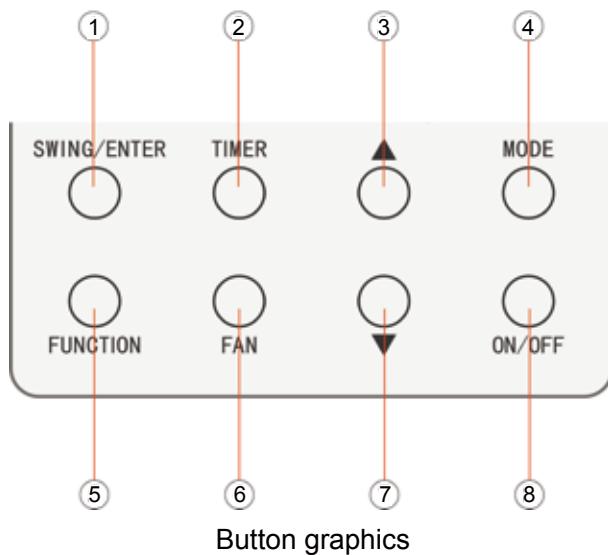


Table Function instruction of buttons

No.	Buttons	Instructions
1	SWING/ENTER	Set vertical air swing Select and cancel functions
2	TIMER	Timer setting
3	▲	Set operating temperature of indoor unit Set Timer
7	▼	Switch Quiet mode, Air grade, Clean grade, set upper and lower temperature limit under Save mode Set and inquiry parameter
4	MODE	Switch Auto, Cooling, Dry, Fan, Heating, Floor Heating, 3D Heating and Space Heating modes for indoor unit. (NOTICE! The Floor Heating, 3D Heating and Space Heating function icon will show up when the unit has those functions)
5	FUNCTION	Switch among Air, Quiet, Light, Health, Absence, Save, Clean, E-heater and X-fan functions
6	FAN	Switch among auto, low speed, low-medium speed, medium speed, medium-high speed, high speed and turbo status
8	ON/OFF	Indoor unit On/Off
3 + 7	▲+▼	Simultaneously press “▲” and “▼” for 5s to enter or cancel the Child Lock function

## 2.2 Installation and Removal

### 2.2.1 Installation Dimensions

Unit: mm(inch)

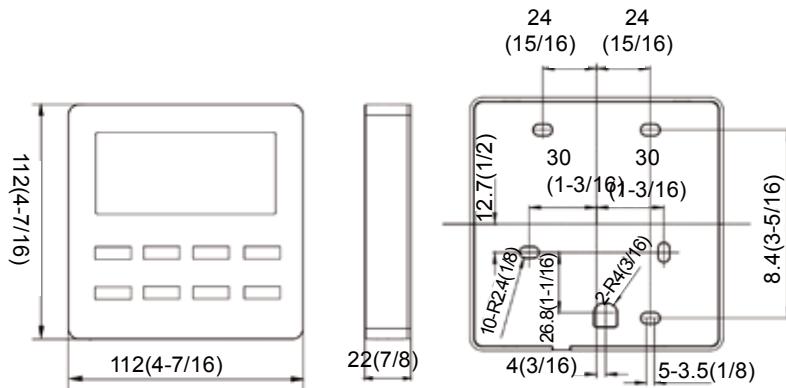


Fig.2.2.1 Installation dimensions for XK46

Unit:mm(inch)

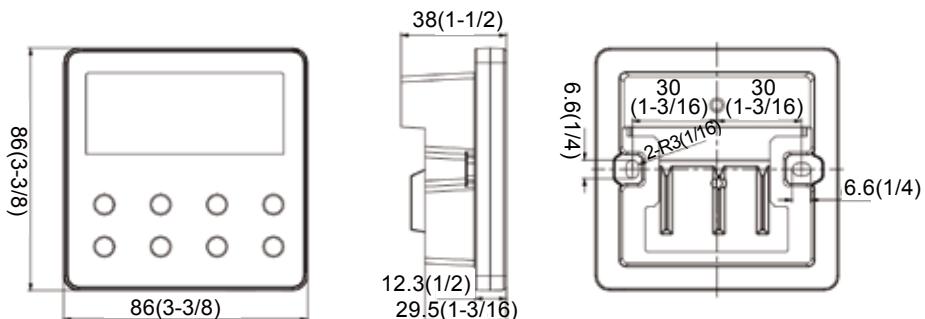


Fig.2.2.2 Dimension of wired controller XK79

## 2.2.2 Installation Method

### (1) Wired Controller XK46 Installation Method:

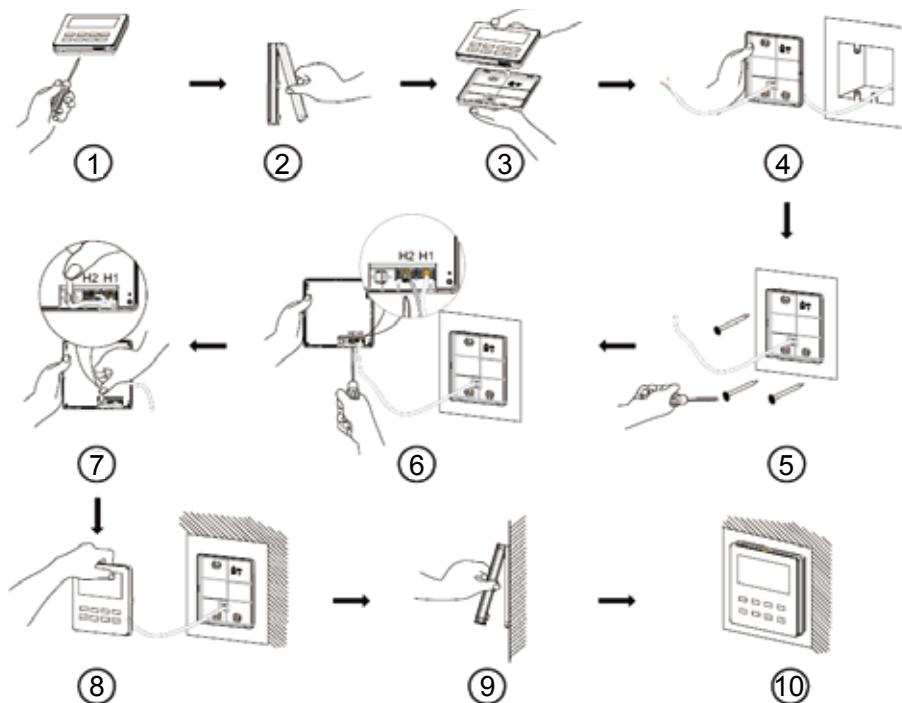


Fig. 2.2.3 Installation diagram for wired controller XK46

Fig. 2.2.3 is the simple installation process of wired controller; please pay attention to the following items:

- 1) Before installation, please cut off the power for indoor unit.
- 2) Pull out the two-core twisted pair from the installation hole on wall, and then pull this wire through the "U" shape hole at the rear side of Soleplate of wired controller.
- 3) Stick the bottom plate of wired controller on the wall and then use Self-tapping Screw ST3.9×25 MA to fix Soleplate and installation hole on wall together.
- 4) Connect two-core twisted pair to H1 and H2 wiring column and then fix the screws.
- 5) Set two-core into the groove at left side of wiring column, and then bundle panel and Soleplate of wired controller together.

### **WARNING**

If caliber of the communication cord is too large, which causes difficulty in leading or sticking the cord according to above point 2 and point 5, strip some of the sheath of the communication cable to meet the installation requirement.

## (2) Wired Controller XK79 Installation Method:

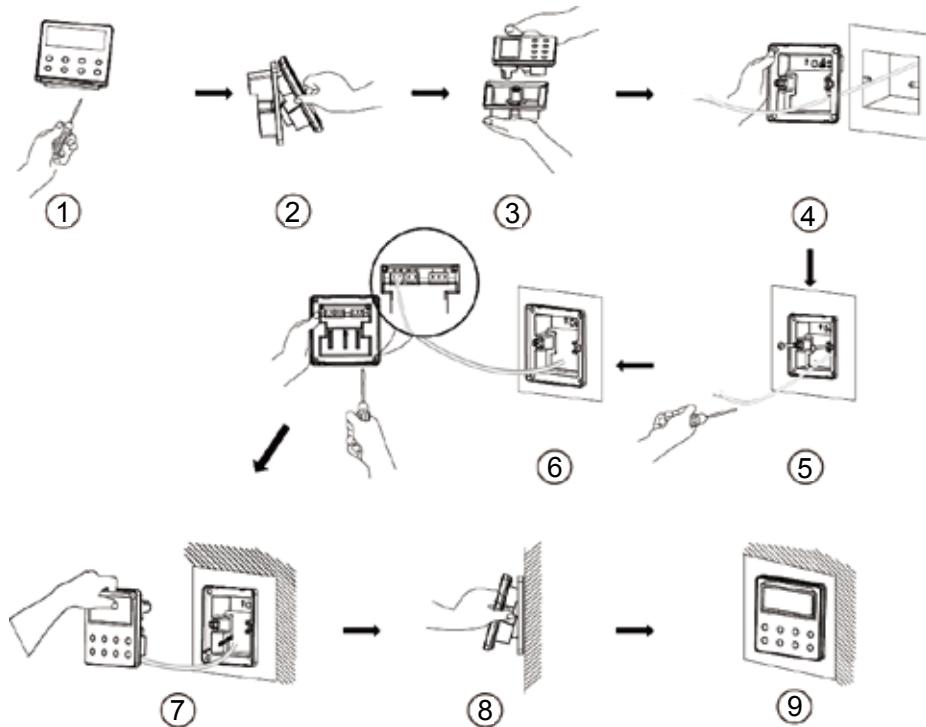


Fig. 2.2.4 Installation diagram for wired controller XK79

Fig.2.2.4 is the simple installation process of wired controller XK79; please pay attention to the following items:

- 1) Before installation, please cut off the power for indoor unit.
- 2) Pull out the 2-core twisted pair line connected with the indoor unit from the mounting hole and through the outer shell.
- 3) Set the wired controller soleplate on the wall and use the M4X25 screws to fix it with the mounting hole.
- 4) Separately fix the twisted pair on the H1 and H2 terminal by screws.
- 5) Gate-control wiring notice:
  - A. Factory default provided with Gate-control function (factory default the DIP switch S1 to “ON” side).
  - B. If the gate-control system is not involved, open the inner shell and turn the No.1 switch of the DIP switch S1 to the number side which is located at the PCB of the inner shell (please power up after finished switch the DIP).
  - C. If the gate-control system is connected, make sure the No.1 switch of the DIP switch S1 is turned to the “ON” side. Connect the gate-control terminal to the N and L port or the VCC and GND port. Attention to the following items:
    - a) The N and L port is the power supply interface of the 100-240V~50/60Hz gate control.
    - b) The VCC and GND port is the power supply interface of the DC 5-24V gate control.
    - c) Only one power input can be chosen between the 100-240V~50/60Hz and the DC 5-24V.

- 6) When connecting to terminals, the wire-stripping length for the conducting wire of twisted pair line should be no more than 6mm and the cores of conduction wire can't be exposed to terminal to preventing short-circuit or electric leakage.
- 7) After finishing the wiring, buckle the outer shell and the panel together.

### 2.2.3 Removal Method

- (1) Wired Controller XK46 Disassembly diagram:

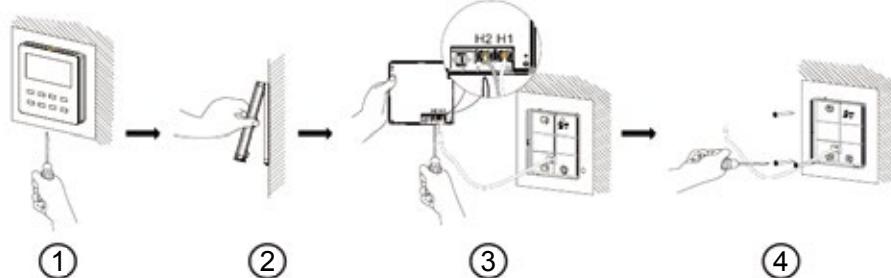


Fig. 2.2.5 Disassembly diagram of wired controller XK46

- (2) Wired Controller XK79 Disassembly diagram:

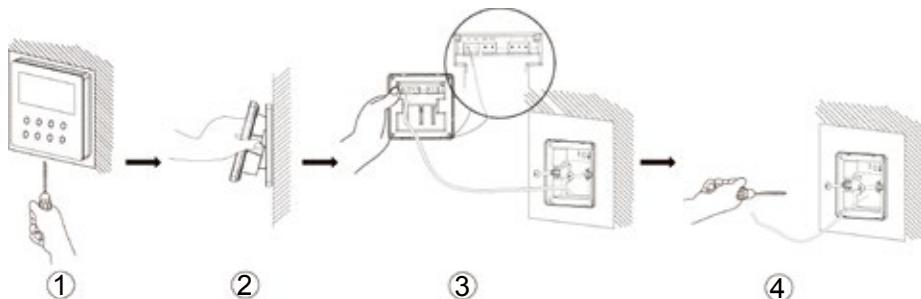


Fig. 2.2.6 Disassembly diagram of wired controller XK79

### 2.2.4 Connection of Communication Cord

There are 4 ways to connect wired controller with indoor units' network:

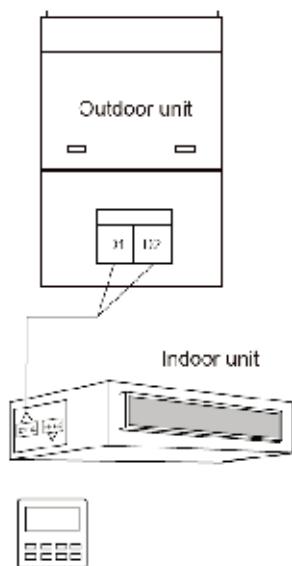


Fig. 2.2.7 One wired controller  
control one indoor unit

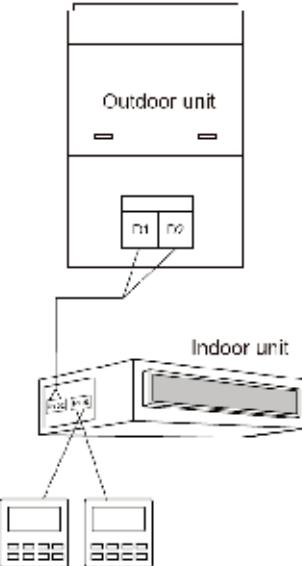


Fig. 2.2.8 Two wired controllers  
controls one indoor unit

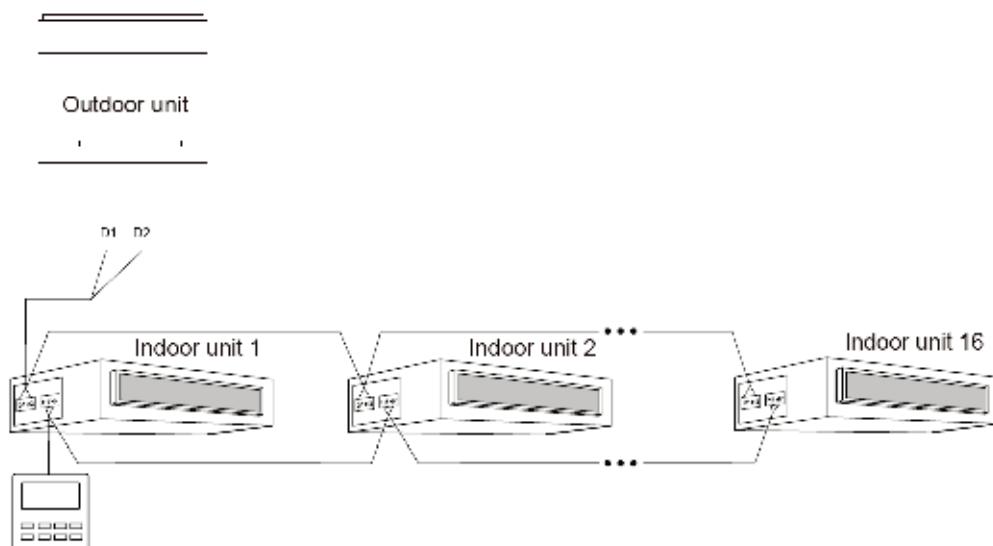


Fig. 2.2.9 One wired controller controls multiple indoor units simultaneously.


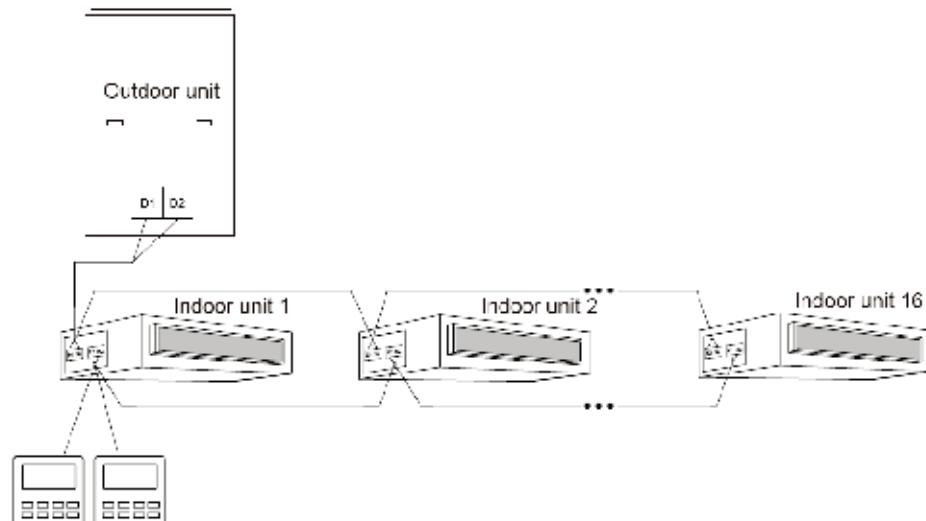


Fig. 2.2.10 Two wired controllers control multiple indoor units simultaneously.

## 3 Remote Controller


### 3.1 Remote Controller YAP1F

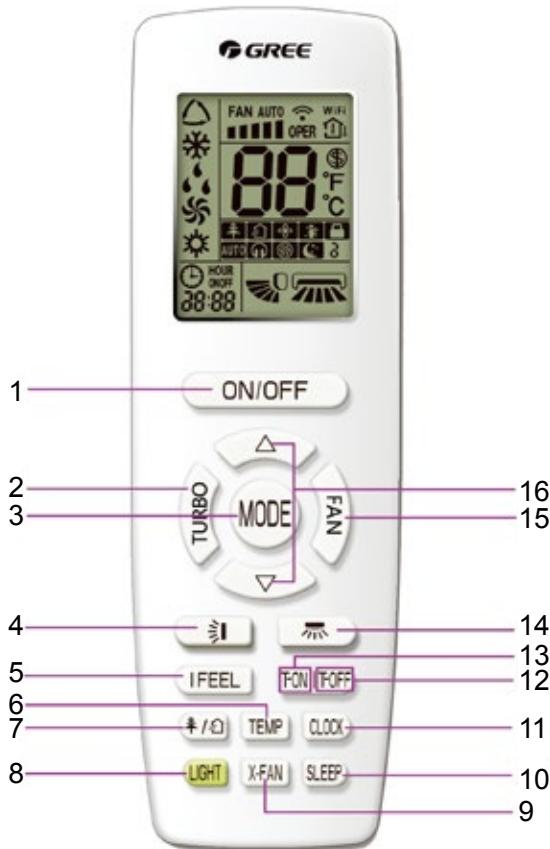

Button name and function introduction

No.	Button name	Function
1	ON/OFF	Turn on or turn off the unit
2	TURBO	Set turbo function
3	MODE	Set operation mode
4		Set up&down swing status
5	I FEEL	Set I FEEL function
6	TEMP	Switch temperature displaying type on the unit's display
7		Set health function and air function
8	LIGHT	Set light function
9	X-FAN	Set X-FAN function
10	SLEEP	Set sleep function
11	CLOCK	Set clock of the system
12	TOFF	Set timer off function
13	TON	Set timer on function
14		Set left&right swing status
15	FAN	Set fan speed
16		Set temperature and time

### 3.2 Remote Controller YV1L1

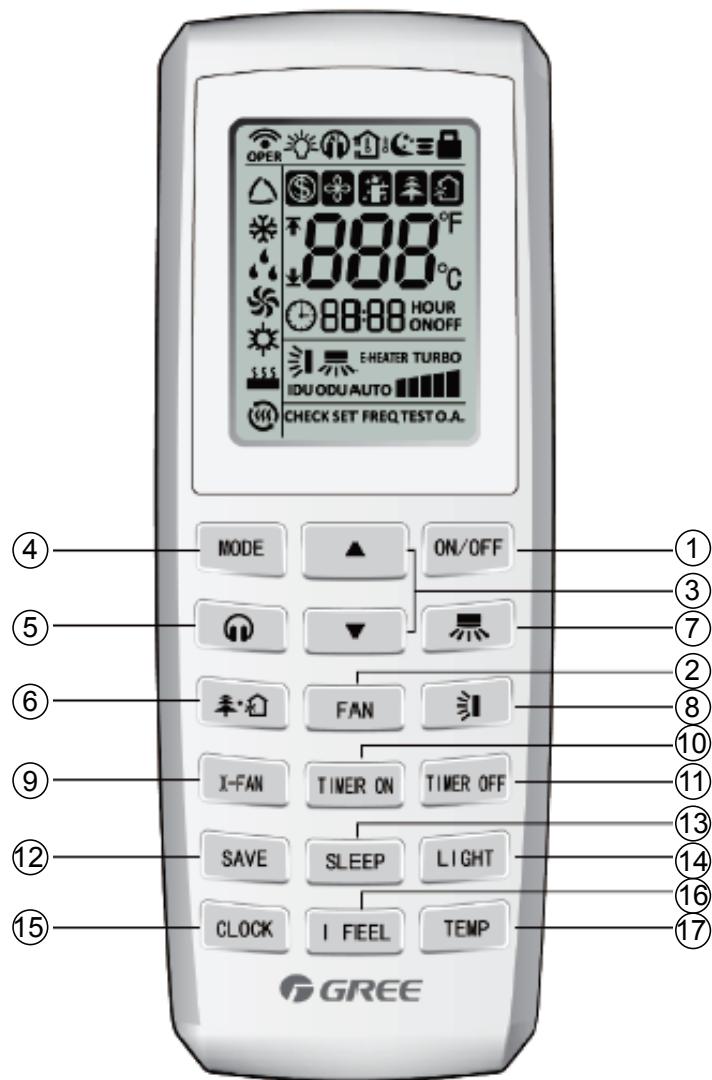

No.	Button name	Function
1	ON/OFF	Turn on or turn off the unit
2	FAN	Set fan speed
3	▲/▼	Set temperature and time
4	MODE	Set operation mode
5	Quiet function	
6	Health/Air function	
7	Left/Right swing	
8	Up/Down swing	
9	X-FAN	Set X-FAN function
10	TIMER ON	Set timer on function
11	TIMER OFF	Set timer off function
12	SAVE	Set energy-saving function
13	SLEEP	Set sleep function
14	LIGHT	Set light function
15	CLOCK	Set clock of the system
16	I FEEL	Set I FEEL function
17	TEMP	Switch temperature displaying type on the unit's display

## 4 Introduction to Unit Functions

### Function Application of IDUs

Indoor unit functions cover user operation functions and engineering application functions. For user operation functions, refer to operating instructions of the IDU, wired controller, and remote controller.

Engineering application functions include:

SN	Function Name
1	Master IDU query and settings
2	Indoor unit project number query and settings
3	User parameter query
4	User parameter settings
5	Engineering parameter query
6	Engineering parameter settings

Engineering application functions can be operated through the IDU wired controller (XK46 /XK49 or XK79) or remote controller (YV1L1, fittings selectable).

## 4.1 Engineering Application Functions Operated through the XK46 Wired Controller

### 4.1.1 Master IDU Settings


The master IDU can be set through the wired controller or remote controller. The methods for setting the master IDU through the wired controller are as follows:

#### Method 1:

Step 1: Set an IDU to power-off status.

Step 2: Press and hold the "MODE" button on the wired controller for more than five seconds.

Step 3: Check whether the setting is successful. If it is, "MASTER" on the wired controller will be on. Otherwise, repeat steps 1 and 2.

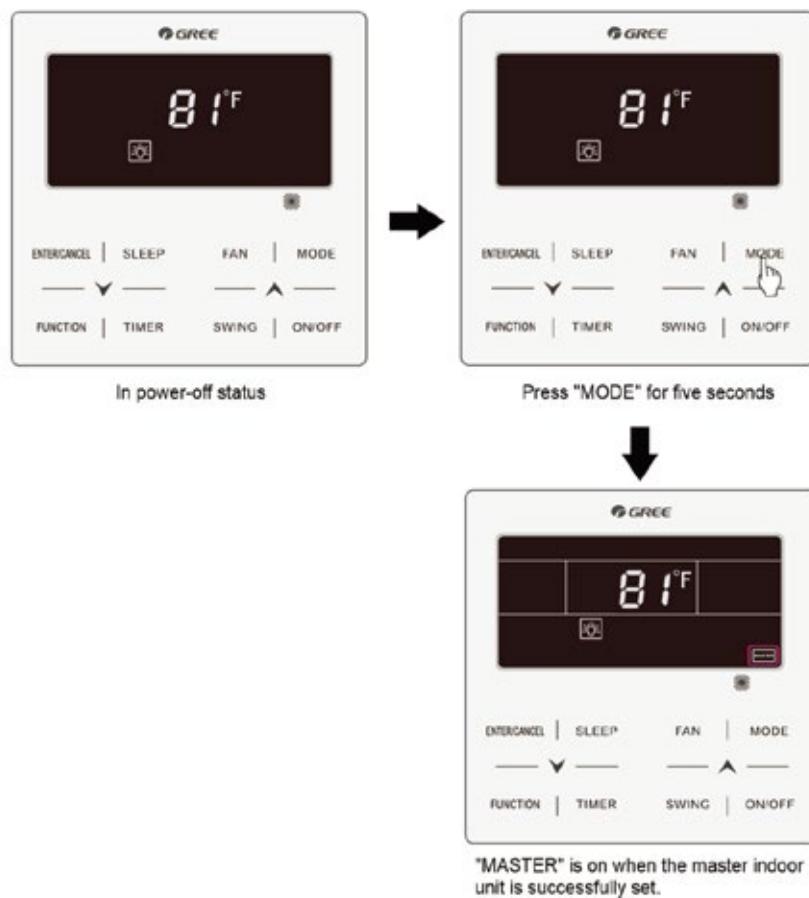

#### Method 2:

Step 1: Press and hold the "FUNCTION" button for five seconds in power-on or power-off status to enter the parameter query interface.

Step 2: Press and hold the "FUNCTION" button for five seconds in "C00" status to enter the parameter setting interface.

Step 3: Press "▲" or "▼" to switch level 2 parameter codes till "P10" is displayed on the temperature area.

Step 4: Press the "MODE" button to set the parameter to "01" and then Press the "ENTER" button. If the setting is successful, "MASTER" on the wired controller will be on.

## 4.1.2 Master IDU Display

For IDUs connected with wired controllers, "MASTER" on the wired controller connected with the master IDU will be on.

For IDUs embedded or connected with LED panels, the operation LED on the LED panel of the master IDU will blink three times.

**NOTICE!** After the master IDU is successfully set, stick the "MASTER" flag to the wired controller or unit panel for convenience of user operation and engineering maintenance. This flag is placed in the package bag of the ODU.

## 4.1.3 Project Number Query and Settings

### (1) Project number query of a single IDU.

Press and hold the "FUNCTION" button for five seconds in power-on or power-off status to enter the parameter query interface "C00". The timer area of the wired controller displays the project number of the current IDU. Synchronously, the double-eight digital LED of the IDU embedded or connected with an LED panel displays its own project number. If the current wired controller works in one-to-many mode, the timer area displays the IDU that has the minimum project number.

### (2) Project number of multiple IDUs.

- 1) Project number query of IDUs in one-to-many mode: Press and hold the "FUNCTION" button for five seconds in power-on or power-off status to enter the parameter query interface "C00". Press "▽" to switch to "C01". Press the "MODE" button to enter query. The timer area displays the project numbers of IDUs from small to large. Press "△" or "▽" to switch project numbers. Synchronously, the double-eight digital LED of the IDU embedded or connected with an LED panel displays its own project number.

**NOTICE!** It is normal if the buzzer of the IDU operated by the wired controller rings. The purpose of ringing the buzzer is to facilitate engineering commissioning personnel to locate the IDU, especially for the IDU without any LED panel because it cannot display its project number.

- 2) Project number query of IDUs in the entire communication network: Press and hold the "FUNCTION" button for five seconds in power-on or power-off status to enter the parameter query interface "C00". Press "▽" to switch to "C18". Press the "MODE" button to enter query. The timer area of each wired controller in the entire network displays the project number of the corresponding IDU. Synchronously, the double-eight digital LED of each IDU embedded or connected with an LED panel displays its own project number.

Method for quitting query:

Quit the "C18" query interface.

Press the "ON/OFF" button on any wired controller in the network.

### (3) Project number settings of IDU.

Press and hold the "FUNCTION" button for five seconds in power-on or power-off status to enter the parameter query interface "C00". Continuously press the "MODE" button for three times, and then press and hold the "FUNCTION" button for five seconds to enter the engineering parameter setting interface. The temperature area displays "P00". Press "▽" to switch to "P42".

Single IDU: Press the “MODE” button. The project number blinks in the timer area. Press “△” or “▽” to adjust the project number, and then Press the “ENTER” button to confirm and return to the upper-level menu.

One-to-many: Press the “MODE” button to enter the IDU selection menu. Press “△” or “▽” to switch IDUs. Press the “MODE” button to set the project number of the current IDU in the same method as above.

#### 4.1.4 User Parameter Query

User parameters can be queried in power-on or power-off status.

- (1) Press and hold the “FUNCTION” button for five seconds to enter the user parameter query interface. The temperature area displays “C00” and “View” is on.
- (2) Select a parameter code by pressing “▲” or “▼”.
- (3) Press the “ENTER/CANCEL” button to return to the upper-level menu till quitting parameter query.

The user parameter query list is as follows:

Table 4.1 User Parameter Query List

Parameter Code	Parameter Name	Parameter Range	View Method
C00	Parameter setting ingress	-	<b>Display mode:</b> Timer area: displays the project number of the current IDU. NOTICE! If the current HBS network consists of multiple IDUs, only the IDU that has the minimum project number is displayed.
C01	Project number query of IDU and faulty IDU location	1-255: project number of online IDU	<b>Operation method:</b> In “C01” status, press the “MODE” button to enter project number query of IDU. Press “▲” or “▼” to switch the IDU SN. <b>Display mode:</b> Temperature area: displays the fault of the current IDU (in the case of multiple faults, they are circularly displayed every three seconds). Timer area: displays (project number conflict C5 fault)/project number of the current IDU (project numbers are arranged from small to large). <b>Special operations:</b> After users press the “MODE” button to enter project number query, the buzzer of the IDU operated by the wired controller will ring till users quit “C01” query or switch to the next IDU.
C03	Indoor unit quantity query in the system network	1-80	<b>Timer area:</b> displays the number of IDUs in the system network.
C06	Preferential operation query	00: common operation 01: preferential operation	<b>Operation method:</b> In “C06” status, press the “MODE” button to enter the preferential operation query interface. Press “▲” or “▼” to switch the IDU SN. <b>Display mode:</b> Temperature area: displays the project number of the current IDU. Timer area: displays the preferential operation setting value of the current IDU.

Parameter Code	Parameter Name	Parameter Range	View Method
C07	Indoor environment temperature query	-	<p><b>Operation method:</b> In "C07" status, press the "MODE" button to enter the indoor environment temperature query interface. Press "▲" or "▼" to switch the IDU SN.</p> <p><b>Display mode:</b> Temperature area: displays the project number of the current IDU. Timer area: displays the temperature value of the indoor environment temperature sensor after replenishment.</p>
C08	Prompt time query for air filter cleaning	4-416: days	Timer area: displays the prompt time for air filter cleaning.
C09	Wired controller address query	01, 02	Timer area: displays the address of the current wired controller.
C11	Indoor unit quantity query in one-to-many mode	1-16	Timer area: displays the number of IDUs controlled by the wired controller.
C12	Outdoor environment temperature query	-	Timer area: displays the temperature value of the environment temperature sensor of the master ODU.
C17	Indoor relative humidity query	20-90	<p><b>Operation method:</b> In "C17" status, press the "MODE" button to enter the indoor relative humidity query interface. Press "▲" or "▼" to switch the IDU SN.</p> <p><b>Display mode:</b> Temperature area: displays the project number of IDU (project numbers are arranged from small to large). Timer area: displays the relative humidity value. If the HBS network consists of only one IDU, the timer area directly displays the IDU relative humidity value in the "C17" interface.</p>
C18	Indoor unit project number query in the communication network	1-255	<p><b>Operation method:</b> In "C18" status, press the "MODE" button to enter the IDU project number query interface. Press "▲" or "▼" to switch the IDU SN.</p> <p><b>Cancellation method:</b> If users quit the "C18" query interface within 20 seconds, the project number display is cancelled. If the query interface is quit after 20 seconds upon timeout, press the "ON/OFF" button in power-on or power-off status to cancel the project number display. The method for cancelling the project number display on any wired controller in the network is the same as ②.</p> <p><b>Display mode:</b> Temperature area: displays the SN of the current IDU (project numbers are arranged from small to large). Timer area: displays the project number of the current IDU. Each IDU/wired controller in the network displays its own project number (the wired controller circularly displays project numbers of IDUs every three seconds from small to large).</p>

Parameter Code	Parameter Name	Parameter Range	View Method
C20	Fresh-air IDU outlet temperature query	-9 to 99	<p><b>Operation method:</b> In "C20" status, press the "MODE" button to enter the fresh-air IDU temperature query interface. Press "▲" or "▼" to switch the IDU SN.</p> <p><b>Display mode:</b> Temperature area: displays the project number of the current IDU (1-16, project numbers are arranged from small to large). Timer area: displays the fresh-air IDU outlet temperature. If the HBS network consists of only one IDU, the timer area directly displays the fresh-air IDU outlet temperature in the "C20" interface.</p>
C23	Inquiry of the version of wired controller	-	<p><b>Display mode:</b> Display in timer zone: version of the wired controller (display on the right)</p> <p><b>Note:</b> Version of the wired controller refers to the version of the program of the wired controller The version number doesn't have decimal points. It's an integral number.</p>

**NOTICE!** In parameter query status, "FAN", "TIMER", "SLEEP", and "SWING" are invalid. By pressing the "ON/OFF" button, users can return to the main interface but not power on/off the unit.

In parameter query status, signals of the remote controller are invalid.

#### 4.1.5 User Parameter Settings

User parameters can be set in power-on or power-off status.

- (1) Press and hold the "FUNCTION" button for five seconds. The temperature area displays "C00".  
Press and hold the "FUNCTION" button for another five seconds to enter the wired controller parameter setting interface. The temperature area displays "P00".
- (2) Select a parameter code by pressing "▲" or "▼". Press the "MODE" button to switch to parameter value settings. The parameter value blinks. Adjust the parameter value by pressing "▲" or "▼" and then press the "ENTER/CANCEL" button to complete settings.
- (3) Press the "ENTER/CANCEL" button to return to the upper-level menu till quitting parameter settings.

The user parameter setting list is as follows:

Table 4.2 User Parameter Setting List

Parameter Code	Parameter Name	Parameter Range	Default Value	Remark
P10	Master IDU settings	00: Not change the master/slave status of the current IDU 01: set the current IDU to master IDU	00	After the IDU connected with the current wired controller is successfully set to master IDU, "MASTER" on the wired controller is on.
P11	Infrared connection settings of wired controller	00: disabled 01: enabled	01	This setting can only be enabled through the master wired controller. When the infrared remote receiving function of the wired controller is disabled, neither the master nor slave wired controller can receive remote signals. The wired controllers can only be operated by pressing.
P13	Wired controller address settings	01: master wired controller 02: slave wired controller	01	When two wired controllers simultaneously control one or more IDUs, the two wired controllers should use different addresses. The slave wired controller (address: 02) does not have the unit parameter setting function except its own address settings.
P14	Group-controlled IDU quantity settings	00: disabled 01-16: number of indoor units	01	This value is set based on the number of connected IDUs. If the current value is inconsistent with the actual number of group-controlled IDUs, "L9" fault may occur.
P16	Unit setting for display temperature	00: °C 01: °F	00	-
P30	Static pressure setting for general indoor unit	Type 1: 03.04.05.06.07 Type 2: 01.02.03.04.05.06.07.08 .09	05	01-09 are valid for high ESP duct type unit; only 03-07 are valid for other indoor unit.
P31	Ceiling installation height setting	00: standard-ceiling installation height 01: high-ceiling installation height	00	-
P33	Timer function settings	00: common timer 01: time-point timer	00	-
P34	Repeating validity for time-point timer	00: single timer 01: repeated everyday	01	This setting is valid only when the timer function is set to time-point timer.
P37	Upper temperature limit setting for auto mode	17°C -30°C (63°F~86°F)	25 (77°F)	When temperature unit is °C: upper temperature limit-lower temperature limit ≥1; When temperature unit is °F: upper temperature limit-lower temperature limit ≥2;
P38	Lower temperature limit setting for auto mode	16°C -29°C (61°F~84°F)	20 (68°F)	When power supply is insufficient, users are allowed to power on/off the IDU set with preferential operation and other IDUs are forcibly powered off. A fault code is displayed on the IDU that is forcibly powered off.
P43	Preferential operation settings	00: common operation 01: preferential operation	00	-
P46	Accumulated time clearing for air filter cleaning	00: not cleared 01: cleared	00	-

Parameter Code	Parameter Name	Parameter Range	Default Value	Remark
P49	Opening angle of indoor unit air-return plate*	01: angle 1(25°) 02: angle 2(30°) 03: angle 3(35°)	01	Only applicable to units with air-return plate.
P50	Air outlet temperature setting of cooling for Fresh Air Unit	16°C~30°C (61~86°F)	18°C (64°F)	Only applicable to Fresh Air Indoor Unit.
P51	Air outlet temperature setting of heating for Fresh Air Indoor Unit	16°C~30°C (61~86°F)	22°C (72°F)	Only applicable to Fresh Air Indoor Unit.
P54	Linkage function setting of Fresh Air Indoor Unit	00: without linkage control 01: with linkage control	00	After linkage function is set, Fresh Air Indoor Unit will be turned on/off following the on/off status of common indoor unit. Besides, Fresh Air Indoor Unit can also be turned on/off manually. NOTICE: Only applicable to Fresh Air Indoor Unit.
P69	Signal type of gate control	01: 5-12V DC (including 12V) signal of gate control 02: 12V-24V DC (excluding 12V) signal of gate control 03: 110V AC signal of gate control 04: 220V AC signal of gate control	04	Only applicable to wired controller XK79 with gate control.
P71	Setback function setting	00: invalid 01: valid	00	Only applicable for gate control wired controller.
P72	Upper temperature limit of Setback function	20~30°C (68~86°F)	26°C (79°F)	Only applicable for gate control wired controller.
P73	Lower temperature limit of Setback function	16~26°C (61~79°F)	20°C (68°F)	Only applicable for gate control wired controller.
P74	Gate control status setting	00: OFF 01: Operate at the status before pulling out the status	01	-
P78	Cold air prevention time setting for indoor unit	00: 180s 01: 300s 02: 420s 03: 600s	00	-
P82	Time format setting	00: 24h format 01: 12h format	00	-
P63, P64, P65, P76 and P77 are reserved code. Please do not set it.				

**NOTICE!** In parameter setting status, "FAN", "TIMER", "SLEEP", and "SWING" are invalid. By pressing the "ON/OFF" button, users can return to the main interface but not power on/off the unit.

In parameter setting status, signals of the remote controller are invalid.

#### 4.1.6 Engineering Parameter Query

Engineering parameters can be queried in power-on or power-off status.

Press and hold the "FUNCTION" button for five seconds to enter the engineering parameter query interface. The temperature area displays "C00" and "View" is on.

- (1) Within five seconds after "C00" is displayed, continuously press the "MODE" button for three times in an interval less than one second to enter engineering parameter query.
- (2) Select a parameter code by pressing " $\Delta$ " or " $\nabla$ ".
- (3) Press the "ENTER/CANCEL" button to return to the upper-level menu till quitting parameter query.

In the engineering parameter query interface, users can also query user parameters listed in Table 4.3.

The engineering parameter query list is as follows:

Table 4.3 Engineering Parameter Query List

Parameter Code	Parameter Name	Parameter Range	View Method
C00	Parameter setting ingress (default)	-	<b>Display mode:</b> <b>Timer area:</b> displays the project number of the current IDU. NOTICE! If the current HBS network consists of multiple IDUs, only the IDU that has the minimum project number is displayed.
C02	Indoor unit capacity query	-	<b>Operation method:</b> In "C02" status, press the "MODE" button to enter the preferential operation query interface. Press " $\Delta$ " or " $\nabla$ " to switch the project number of IDU. <b>Display mode:</b> <b>Temperature area:</b> displays the project number of the current IDU. <b>Timer area:</b> displays the current IDU capacity/IDU capacity after adjustment.
C04	Project number query of master IDU	1-255: project number 00: no master IDU	<b>Timer area:</b> displays the project number of the master IDU/00.
C05	Historical fault query ingress of IDU	Five historical faults	<b>Operation method:</b> In "C05" status, press the "MODE" button to enter the historical fault query interface. Press " $\Delta$ " or " $\nabla$ " to switch the project number of IDU. Press the "MODE" button to enter fault code query of the current IDU. Press " $\Delta$ " or " $\nabla$ " to switch the fault SN. Press the "ENTER/CANCEL" button to return to the upper-level menu. <b>Display mode:</b> <b>Temperature area:</b> displays the fault SN and fault code. <b>Timer area:</b> displays the project number of IDU.
C10	Static pressure setting query of ODU	00: 0 Pa 20: 20 Pa 50: 50 Pa 82: 82 Pa	<b>Operation method:</b> In "C10" status, press the "MODE" button to enter static pressure setting query of ODU. Press " $\Delta$ " or " $\nabla$ " to switch the ODU address. <b>Display mode:</b> <b>Temperature area:</b> displays the address of the current ODU. <b>Timer area:</b> displays the static pressure setting value.

Parameter Code	Parameter Name	Parameter Range	View Method
C13	Outdoor unit network number query	1-255	<b>Timer area:</b> displays the network number of the current ODU.
C14	Temperature query for inlet-tube temperature sensor of IDU	-9 to 99	<p><b>Operation method:</b> In "C14" status, press the "MODE" button to enter inlet-tube temperature sensor query of IDU. Press "<math>\Delta</math>" or "<math>\nabla</math>" to switch the IDU SN.</p> <p><b>Display mode:</b> <b>Temperature area:</b> displays the project number of the current IDU. <b>Timer area:</b> displays the temperature value. If the HBS network consists of only one IDU, the timer area directly displays the temperature value in the "C14" interface. No matter Fahrenheit or Centigrade remote signals are received, the temperature is displayed in Centigrade. When the wired controller displays the inlet-tube temperature after receiving signals from the remote controller, the inlet-tube temperature of the IDU that has the minimum project number in the HBS network is displayed by default.</p>
C15	Temperature query for outlet-tube temperature sensor of IDU	-9 to 99	<p><b>Operation method:</b> In "C15" status, press the "MODE" button to enter outlet temperature sensor query of IDU. Press "<math>\Delta</math>" or "<math>\nabla</math>" to switch the IDU SN.</p> <p><b>Display mode:</b> <b>Temperature area:</b> displays the project number of the current IDU. <b>Timer area:</b> displays the temperature value. If the HBS network consists of only one IDU, the timer area directly displays the temperature value in the "C15" interface. When the wired controller displays the outlet-tube temperature after receiving signals from the remote controller, the inlet-tube temperature of the IDU that has the minimum project number in the HBS network is displayed by default.</p>
C16	Opening degrees query of electronic expansion valve of IDU	0-20	<p><b>Operation method:</b> In "C16" status, press the "MODE" button to enter electronic expansion valve opening degree query of IDU. Press "<math>\Delta</math>" or "<math>\nabla</math>" to switch the IDU SN.</p> <p><b>Display mode:</b> <b>Temperature area:</b> displays the project number of the current IDU. <b>Timer area:</b> displays the opening degree value. If the HBS network consists of only one IDU, the timer area directly displays the opening degree value of electronic expansion valve in the "C16" interface. When the wired controller displays the opening degree of electronic expansion valve after receiving signals from the remote controller, the opening degree of electronic expansion valve of the IDU that has the minimum project number in the HBS network is displayed by default.</p>
n2	Capacity configuration ratio upper-limit of outdoor/IDU	35: 135% 50: 150%	<p><b>Temperature area:</b> displays the parameter code. <b>Timer area:</b> displays the setting value of capacity configuration ratio of the current outdoor/IDU.</p>

Parameter Code	Parameter Name	Parameter Range	View Method																																																																					
n6	Historical fault query ingress of ODU	Five historical faults	<p><b>Operation method:</b> In "n6" status, press the "MODE" button to enter fault code query of ODU (when a wired controller controls multiple IDUs, only the faults memorized by the IDU that has the minimum project number can be queried). Press "▲" or "▼" to switch the fault SN. Press the "ENTER/CANCEL" button to return to the upper-level menu.</p> <p><b>Display mode:</b> <b>Temperature area:</b> displays the fault SN and fault code from left to right (1-5, faults are arranged from the earliest to the latest). <b>Timer area:</b> displays the project number of the ODU.</p>																																																																					
n7	Parameter query ingress of ODU	01-13 25-29	<p><b>Operation method (n7 query is not supported for the slave wired controller):</b> In "n7" status, the timer area is not displayed. Press the "MODE" button to enter parameter query of ODU. The first bit in the temperature area (display bit of the ODU module ID) blinks. Press "▲" or "▼" to switch the ODU module ID. Press the "MODE" button to select an ODU module. In this case, the first bit in the temperature area stops blinking, and the second and third bits in the temperature area display the parameter code. The timer area displays a corresponding parameter value. Press "▲" or "▼" to switch the parameter code and press the "ENTER/CANCEL" button to return to the upper-level menu.</p> <p><b>Display mode:</b> <b>Temperature area:</b> displays the ODU module ID and parameter code from left to right. <b>Timer area:</b> displays a corresponding parameter value to the right.</p> <table border="1"> <thead> <tr> <th>Parameter Code</th><th>Parameter Name</th><th>Unit</th></tr> </thead> <tbody> <tr><td>01</td><td>Outdoor environment temperature</td><td>°C/°F</td></tr> <tr><td>02</td><td>Operation frequency of compressor 1</td><td>Hz</td></tr> <tr><td>03</td><td>Operation frequency of compressor 2</td><td>Hz</td></tr> <tr><td>04</td><td>Operation frequency of outdoor fan</td><td>Hz</td></tr> <tr><td>05</td><td>Module high-pressure</td><td>°C/°F</td></tr> <tr><td>06</td><td>Module low-pressure</td><td>°C/°F</td></tr> <tr><td>07</td><td>Discharge temperature of compressor 1</td><td>°C/°F</td></tr> <tr><td>08</td><td>Discharge temperature of compressor 2</td><td>°C/°F</td></tr> <tr><td>09</td><td>Discharge temperature of compressor 3</td><td>°C/°F</td></tr> <tr><td>10</td><td>Discharge temperature of compressor 4</td><td>°C/°F</td></tr> <tr><td>11</td><td>Discharge temperature of compressor 5</td><td>°C/°F</td></tr> <tr><td>12</td><td>Discharge temperature of compressor 6</td><td>°C/°F</td></tr> <tr><td>13</td><td>Operation frequency of compressor 3</td><td>Hz</td></tr> <tr><td>25</td><td>Outdoor unit heating EXV1 (Actual value = Displayed value * 10)</td><td>PLS</td></tr> <tr><td>26</td><td>Outdoor unit heating EXV2 (Actual value = Displayed value * 10)</td><td>PLS</td></tr> <tr><td>27</td><td>Subcooler EXV (Actual value = Displayed value * 10)</td><td>PLS</td></tr> <tr><td>28</td><td>Defrosting temperature</td><td>°C/°F</td></tr> <tr><td>29</td><td>Liquid-extracting temperature of subcooler</td><td>°C/°F</td></tr> <tr><td>30</td><td>Outlet temperature of accumulator</td><td>°C/°F</td></tr> <tr><td>31</td><td>Oil return temperature</td><td>°C/°F</td></tr> <tr><td>32</td><td>Inlet-tube temperature of condenser</td><td>°C/°F</td></tr> <tr><td>33</td><td>Outlet temperature of condenser</td><td>°C/°F</td></tr> </tbody> </table>	Parameter Code	Parameter Name	Unit	01	Outdoor environment temperature	°C/°F	02	Operation frequency of compressor 1	Hz	03	Operation frequency of compressor 2	Hz	04	Operation frequency of outdoor fan	Hz	05	Module high-pressure	°C/°F	06	Module low-pressure	°C/°F	07	Discharge temperature of compressor 1	°C/°F	08	Discharge temperature of compressor 2	°C/°F	09	Discharge temperature of compressor 3	°C/°F	10	Discharge temperature of compressor 4	°C/°F	11	Discharge temperature of compressor 5	°C/°F	12	Discharge temperature of compressor 6	°C/°F	13	Operation frequency of compressor 3	Hz	25	Outdoor unit heating EXV1 (Actual value = Displayed value * 10)	PLS	26	Outdoor unit heating EXV2 (Actual value = Displayed value * 10)	PLS	27	Subcooler EXV (Actual value = Displayed value * 10)	PLS	28	Defrosting temperature	°C/°F	29	Liquid-extracting temperature of subcooler	°C/°F	30	Outlet temperature of accumulator	°C/°F	31	Oil return temperature	°C/°F	32	Inlet-tube temperature of condenser	°C/°F	33	Outlet temperature of condenser	°C/°F
Parameter Code	Parameter Name	Unit																																																																						
01	Outdoor environment temperature	°C/°F																																																																						
02	Operation frequency of compressor 1	Hz																																																																						
03	Operation frequency of compressor 2	Hz																																																																						
04	Operation frequency of outdoor fan	Hz																																																																						
05	Module high-pressure	°C/°F																																																																						
06	Module low-pressure	°C/°F																																																																						
07	Discharge temperature of compressor 1	°C/°F																																																																						
08	Discharge temperature of compressor 2	°C/°F																																																																						
09	Discharge temperature of compressor 3	°C/°F																																																																						
10	Discharge temperature of compressor 4	°C/°F																																																																						
11	Discharge temperature of compressor 5	°C/°F																																																																						
12	Discharge temperature of compressor 6	°C/°F																																																																						
13	Operation frequency of compressor 3	Hz																																																																						
25	Outdoor unit heating EXV1 (Actual value = Displayed value * 10)	PLS																																																																						
26	Outdoor unit heating EXV2 (Actual value = Displayed value * 10)	PLS																																																																						
27	Subcooler EXV (Actual value = Displayed value * 10)	PLS																																																																						
28	Defrosting temperature	°C/°F																																																																						
29	Liquid-extracting temperature of subcooler	°C/°F																																																																						
30	Outlet temperature of accumulator	°C/°F																																																																						
31	Oil return temperature	°C/°F																																																																						
32	Inlet-tube temperature of condenser	°C/°F																																																																						
33	Outlet temperature of condenser	°C/°F																																																																						

Parameter Code	Parameter Name	Parameter Range	View Method
A6	Unit cooling/heating function	nA: cooling/heating nC: single-cooling nH: single-heating nF: air supply	<b>Temperature area:</b> displays the function code. <b>Timer area:</b> displays the cooling/heating function setting value of the current unit.

Parameter Code	Parameter Name	Parameter Range	View Method																															
nb	Bar code query of IDU	0-9, A-Z, a-z, -	<p><b>Operation method (nb query is not supported for the slave wired controller):</b>            In "nb" status, the timer area is not displayed. Press the "MODE" button to enter bar code query. The temperature area displays "nb" and the project number in the timer area blinks. Press "▲" or "▼" to switch the project number of IDU.</p> <p>Press the "MODE" button to select an IDU. The temperature area displays "Un" and the timer area displays "-n". Press "▲" or "▼" to display the entire-unit bar code and controller bar code of IDU. Press the "ENTER/CANCEL" button to return to the upper-level menu. The temperature area displays "nb" and the timer area displays the project number of the queried IDU. Press the "ENTER/CANCEL" button again to return to the upper-level menu.</p> <p><b>Display mode:</b></p> <p><b>Temperature area:</b> displays nb/Un/Pc/bar code.</p> <p><b>Timer area:</b> displays -n/project number/bar code.</p> <p><b>The following is an example:</b></p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Example</th> <th>Temper ature Area</th> <th>Timer Area</th> <th>Remark 1</th> <th>Remark 2</th> </tr> </thead> <tbody> <tr> <td rowspan="3">Entire-unit bar code of IDU N1r0128150066</td> <td>Un (to the right)</td> <td>-n (in the middle)</td> <td>It indicates that the following is the entire-unit bar code of IDU.</td> <td rowspan="6">Press "▼" to display downward and press "▲" to display upward.</td> </tr> <tr> <td>N1r</td> <td>0128</td> <td>It indicates the former seven bits of the bar code.</td> </tr> <tr> <td>150</td> <td>066</td> <td>It indicates the latter six bits of the bar code.</td> </tr> <tr> <td rowspan="3">Controller bar code of IDU N1r0128150067</td> <td>Pc</td> <td>-n</td> <td>It indicates that the following is the controller bar code of IDU.</td> </tr> <tr> <td>N1r</td> <td>0128</td> <td>It indicates the former seven bits of the bar code.</td> </tr> <tr> <td>150</td> <td>067</td> <td>It indicates the latter six bits of the bar code.</td> </tr> </tbody> </table> <p><b>NOTICE!</b>            Un indicates the entire-unit bar code of IDU and Pc indicates the controller bar code of IDU.            When there is only one IDU, press the "MODE" button in "nb" status to enter bar code query without selecting the project number of IDU.            The system quits the query status if no operations are performed in 60 seconds.            The bar code query starts from the entire-unit bar code of IDU and ends at the controller bar code of IDU without circulation. That is, the query does not start again even if users press "▼".</p>	Example	Temper ature Area	Timer Area	Remark 1	Remark 2	Entire-unit bar code of IDU N1r0128150066	Un (to the right)	-n (in the middle)	It indicates that the following is the entire-unit bar code of IDU.	Press "▼" to display downward and press "▲" to display upward.	N1r	0128	It indicates the former seven bits of the bar code.	150	066	It indicates the latter six bits of the bar code.	Controller bar code of IDU N1r0128150067	Pc	-n	It indicates that the following is the controller bar code of IDU.	N1r	0128	It indicates the former seven bits of the bar code.	150	067	It indicates the latter six bits of the bar code.					
Example	Temper ature Area	Timer Area	Remark 1	Remark 2																														
Entire-unit bar code of IDU N1r0128150066	Un (to the right)	-n (in the middle)	It indicates that the following is the entire-unit bar code of IDU.	Press "▼" to display downward and press "▲" to display upward.																														
	N1r	0128	It indicates the former seven bits of the bar code.																															
	150	066	It indicates the latter six bits of the bar code.																															
Controller bar code of IDU N1r0128150067	Pc	-n	It indicates that the following is the controller bar code of IDU.																															
	N1r	0128	It indicates the former seven bits of the bar code.																															
	150	067	It indicates the latter six bits of the bar code.																															

**NOTICE!** In parameter query status, "FAN", "TIMER", "SLEEP", and "SWING" are invalid. By pressing the "ON/OFF" button, users can return to the main interface but not power on/off the unit.

In parameter query status, signals of the remote controller are invalid.

#### 4.1.7 Engineering Parameter Settings

Engineering parameters can be set in power-on or power-off status.

- (1) Press and hold the "FUNCTION" button for five seconds. The temperature area displays "C00". Continuously press the "MODE" button for three times, and then press and hold the "FUNCTION" button for five seconds to enter the engineering parameter setting interface. The temperature area displays "P00".
- (2) Select a parameter code by pressing "▲" or "▼". Press the "MODE" button to switch to parameter value settings. The parameter value blinks. Adjust the parameter value by pressing "▲" or "▼" and then press the "ENTER/CANCEL" button to complete settings.
- (3) Press the "ENTER/CANCEL" button to return to the upper-level menu till quitting parameter settings.

In the engineering parameter setting interface, users can also set user parameters listed in Table 4.4.

The engineering parameter setting list is as follows:

Table 4.4 Engineering Parameter Setting List

Parameter Code	Parameter Name	Parameter Range	Default Value	Remark
P15	Power-down memory mode	00: standby after power-down recovery 01: restoring the original status after power-down recovery	00	-
P17	Historical fault clearing for IDU	00: not cleared 01: cleared	00	Historical faults of all IDUs controlled by the current wired controller are cleared.
P20	Environment temperature sensor settings for IDU	01: temperature sensor of air return vent 02: temperature sensor of wired controller 03: temperature sensor of air return vent for cooling, dehumidifying, and air supply; temperature sensor of wired controller for heating 04: temperature sensor of wired controller for cooling, dehumidifying, and air supply; temperature sensor of air return vent for heating	03	When there are master and slave wired controllers and the temperature sensor of wired controller is used, only the temperature sensor of the master wired controller is used by default. Note: ① In automatic mode, the environment temperature sensor settings are invalid for a common IDU but the setting value is memorized. ② The environment temperature sensor settings are invalid for a fresh-air IDU. The temperature sensor of air return vent is used by default.

Parameter Code	Parameter Name	Parameter Range	Default Value	Remark
P21	Corrected value of environment temperature sensor of IDU (for cooling, dehumidifying, and air supply)	-15 to +15	Temperature sensor of unit: 0°C; temperature sensor of wired controller: 0°C	Press “▲” or “▼” to add or reduce by 1°C.
P22	Corrected value of environment temperature sensor of IDU (for heating, fast heating, and air warming)	-15 to +15	Temperature sensor of unit: -2°C; temperature sensor of wired controller: 0°C	Press “▲” or “▼” to add or reduce by 1°C. The temperature sensor of unit and the temperature sensor of wired controller share the same corrected value. In heating mode, corrected value of temperature sensor of unit = corrected value of temperature sensor of wired controller - 2°C.
P32	Capacity adjustment function of IDU	-40% to +40%	00	Press “▲” or “▼” to add or reduce by 10%.
P35	Factory setting recovery for user functions	00: invalid 01: valid	00	Select “01” and then press and hold the “ENTER/CANCEL” button to restore the factory settings for user functions (factory setting recovery fails if remote shielding is valid).
P36	Factory setting recovery for engineering settings	00: invalid 01: valid	00	Select “01” and then press and hold the “ENTER/CANCEL” button to restore the factory status for engineering settings (factory setting recovery fails if remote shielding is valid).
P40	Prevention for heat collection	00: disabled 10: 10s 20: 20s 30: 30s 40: 40s 50: 50s 60: 60s	00	It indicates the number of seconds for enabling the low-level fan every 15min.
P41	Longest defrosting time setting for outdoor unit	10/15/20: 10/15/20min	15	-
P42	Project number settings of IDU	1-255	Automatically generated upon the initial system operation	In “P42” status, press the “MODE” button to enter the setting menu. The project number blinks in the timer area. Press “▲” or “▼” to adjust the project number. Press the “ENTER/CANCEL” button to confirm settings and return to the upper-level menu.
P45	One-key project number reset for IDU	00: invalid 01: valid	00	When it is set to “01”, the wired controller initiates an IDU project number reset command.

Parameter Code	Parameter Name	Parameter Range	Default Value	Remark
P48	Minimum opening degree setting for heating breakdown of IDU expansion valves	00: automatically controlled 1-500	-	After the default minimum opening degree for heating breakdown is manually modified, the opening degree remains unchanged upon heating breakdown.
P53	AHU-KIT linkage function setting	00: invalid 01: valid	00	When setting "01", multiple AHU-KIT can operate simultaneously.
P55	Static pressure settings for DC Fresh Air Indoor Unit	Setting range: 01、02、03、04、05、06、07、08、09、10、11、12、13	08	Only applicable to DC Fresh Air Indoor Unit.
P56	Fan status setting under heating mode	00: OFF; 01: fan speed setting;	00	It's the fan status when heating to the temperature point. When setting "01", the fan operates according to the set fan speed. Only applicable for AHU-KIT indoor unit.
P60	AHU-KIT working method setting	00: air-return type 01: fresh air type	-	Only applicable for AHU-KIT indoor unit.
P66	Flag bit for unit of dual heat source	01: cancel the setting of dual heat source for the indoor unit 02: set the indoor unit as dual heat source 03: cancel the setting of dual heat source for all units 04: set all units as dual heat source	01	-
P75	Fan speed setting when heating thermostat is OFF	00: LL speed 01: OFF	00	Only valid for the cassette type unit
P80	Display temperature setting	00: display setting temperature 01: display ambient temperature	00	-
P81	Functional setting of lifting panel	00: invalid 01: valid	00	Only valid for the 360° air discharge cassette type.
n0	System conservation operation settings	00: comfortability preferred 01: conservation preferred	00	-
n1	Defrosting period settings	40: 40min 50: 50min 60: 60min	50	-
n3	Forcible defrosting	00: common 01: forcible defrosting	-	After settings, it automatically restores to "00".
n4	Highest capacity output limitation settings for ODU	08: 80% 09: 90% 10: 100%	10	Enter query in "n4" status. The temperature area displays the function code and the timer area displays the corresponding function setting value.

Parameter Code	Parameter Name	Parameter Range	Default Value	Remark
A7	Silent function of ODU	00: no silent function 01-09: intelligent nighttime silent mode 10-12: forcible silent mode	00	Enter query in "A7" status. The temperature area displays the function code and the timer area displays the corresponding function setting value.

P47, P52-53, P57-59, P61-62, P67-68, P70, P79, qb, 4d, 4L are reserved code. Please do not set it.

**NOTICE!** In parameter setting status, "FAN", "TIMER", "SLEEP", and "SWING" are invalid. By pressing the "ON/OFF" button, users can return to the main interface but not power on/off the unit.

In parameter setting status, signals of the remote controller are invalid.

#### 4.1.8 Failure Display

When a fault occurs during the system operation, the temperature area of wired controller displays the fault code. When multiple faults occur, fault codes are circularly displayed.

When a fault occurs, power off the unit and ask for professional maintenance personnel for help.

The following figure shows the power-on high-pressure protection fault interface.



Power-on High-pressure Protection Fault Interface

**NOTICE!** If the IDU connected with the current wired controller is a fresh-air IDU, "FAP" is displayed on the main interface of the wired controller. Only the outlet temperature can be set for the fresh-air IDU. For the setting method, see the "IDU Function Settings" section.



## 4.2 Engineering Application Functions Operated through the XK49 Wired Controller



XK49 Wired Controller

### 4.2.1 Master IDU Settings

**Method 1:** In power-off status, press and hold the “MODE” button for five seconds to set the IDU connected with the current wired controller to master IDU. If the setting is successful, “MASTER” will be on.

#### Method 2:

Step 1: In power-on or power-off status, press and hold the “MODE” button and "SWING" simultaneously for five seconds to enter the parameter query interface.

Step 2: In "C00" status, press and hold the “MODE” button and "SWING" simultaneously for five seconds to enter the parameter setting interface.

Step 3: Press "▲" or "▼" to switch level 2 parameter codes till “P10” is displayed on the temperature area.

Step 4: Press the “MODE” button to set the parameter to "01" and then Press the “ENTER” button. If the setting is successful, “MASTER” on the wired controller will be on.



## 4.2.2 User Parameter Query

User parameters can be queried in power-on or power-off status.

- (1) Press and hold the "MODE" button and "SWING" simultaneously for five seconds to enter the user parameter query interface. The temperature area displays "C00" and "View" is on.
- (2) Select a parameter code by pressing "∨" or "∧".
- (3) Press the "SWING" button to return to the upper-level menu till quitting parameter query.

For the user parameter query list of the XK49 wired controller, refer to the user parameter query list in XK46 user parameter query.

**NOTICE!** In parameter query, the function of "SWING" on the XK49 wired controller is equivalent to the function of "ENTER/CANCEL" on the XK46 wired controller.

## 4.2.3 User Parameter Settings

User parameters can be set in power-on or power-off status.

- (1) Press and hold the "MODE" button and "SWING" simultaneously for five seconds. The temperature area displays "C00". Press and hold the "MODE" button and "SWING" simultaneously for another five seconds to enter the wired controller user parameter setting interface. The temperature area displays "P00".
- (2) Select a parameter code by pressing "∨" or "∧". Press the "MODE" button to switch to parameter value settings. The parameter value blinks. Adjust the parameter value by pressing "∨" or "∧" and then press the "SWING" button to complete settings.
- (3) Press the "SWING" button to return to the upper-level menu till quitting parameter settings.

For the user parameter setting list of the XK49 wired controller, refer to the user setting query list in XK46 user parameter settings.

**NOTICE!** In parameter settings, the function of "SWING" on the XK49 wired controller is equivalent to the function of "ENTER/CANCEL" on the XK46 wired controller.

## 4.2.4 Engineering Parameter Query

Engineering parameters can be queried in power-on or power-off status.

- (1) Press and hold the "MODE" and "SWING" button simultaneously for five seconds to enter the engineering parameter query interface. The temperature area displays "C00" and "VIEW" is on.
- (2) In "C00" status, continuously press the "MODE" button for three times to enter engineering parameter query.
- (3) Select a parameter code by pressing "∨" or "∧".
- (4) Press the "SWING" button to return to the upper-level menu till quitting parameter query.

For the engineering parameter query list of the XK49 wired controller, refer to the engineering parameter query list in XK46 engineering parameter query.

**NOTICE!** In parameter query, the function of "SWING" on the XK49 wired controller is equivalent to the function of "ENTER/CANCEL" on the XK46 wired controller.

## 4.2.5 Engineering Parameter Settings

Engineering parameters can be set in power-on or power-off status.

- (1) Press and hold the "MODE" and "SWING" button simultaneously for five seconds. The temperature area displays "C00". Continuously press the "MODE" button for three times, and then press and hold the "MODE" button and "SWING" simultaneously for another five seconds to enter the wired controller engineering parameter setting interface. The temperature area displays "P00".
- (2) Select a parameter code by pressing " $\swarrow$ " or " $\searrow$ ". Press the "MODE" button to switch to parameter value settings. The parameter value blinks. Adjust the parameter value by pressing " $\swarrow$ " or " $\searrow$ " and then press the "SWING" button to complete settings.
- (3) Press the "SWING" button to return to the upper-level menu till quitting parameter settings.

For the engineering parameter setting list of the XK49 wired controller, refer to the engineering setting query list in XK46 engineering parameter settings.

**NOTICE!** In parameter settings, the function of "SWING" on the XK49 wired controller is equivalent to the function of "ENTER/CANCEL" on the XK46 wired controller.

## 4.3 Engineering Application Functions Operated through the XK79 Wired Controller



### 4.3.1 Master IDU Settings


The master IDU can be set through the wired controller or remote controller. The methods for setting the master IDU through the wired controller are as follows:

#### Method 1:

Step 1: Set an IDU to power-off status.

Step 2: Press and hold the "MODE" button on the wired controller for more than five seconds.

Step 3: Check whether the setting is successful. If it is, "MASTER" on the wired controller will be on. Otherwise, repeat steps 1 and 2.

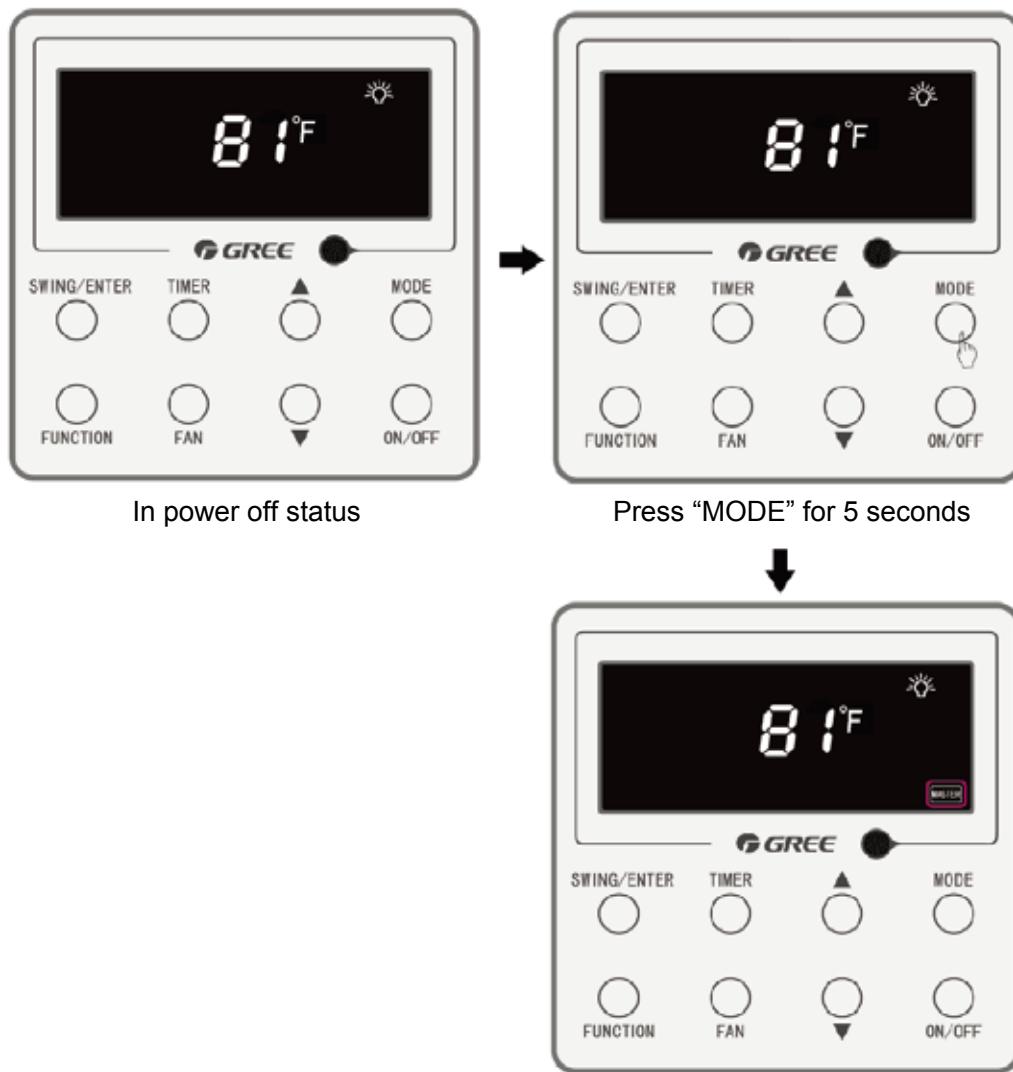

#### Method 2:

Step 1: Press and hold the "FUNCTION" button for five seconds in power-on or power-off status to enter the parameter query interface.

Step 2: Press and hold the "FUNCTION" button for five seconds in "C00" status to enter the parameter setting interface.

Step 3: Press "▲" or "▼" to switch level 2 parameter codes till "P10" is displayed on the temperature area.

Step 4: Press the "MODE" button to set the parameter to "01" and then Press the "SWING/ENTER"

button. If the setting is successful, "MASTER" on the wired controller will be on.

#### Master IDU Display

- (1) For IDUs connected with wired controllers, "MASTER" on the wired controller connected with the master IDU will be on.
- (2) For IDUs embedded or connected with LED panels, the operation LED on the LED panel of the master IDU will blink three times.

**Note:** After the master IDU is successfully set, stick the “MASTER” flag to the wired controller or unit panel for convenience of user operation and engineering maintenance. This flag is placed in the package bag of the ODU.

### 4.3.2 User Parameter Query

User parameters can be queried in power-on or power-off status.

- (1) Press and hold the “FUNCTION” button for five seconds to enter the user parameter query interface. The temperature area displays “C00” and “View” is on.
- (2) Select a parameter code by pressing “▲” or “▼”.
- (3) Press the “SWING/ ENTER” button to return to the upper-level menu till quitting parameter query.
- (4) For the user parameter query list of the XK79 wired controller, refer to the user parameter query list in XK46 user parameter query.

**Note:** In parameter query, the function of "SWING/ ENTER" on the XK79 wired controller is equivalent to the function of “ENTER/CANCEL” on the XK46 wired controller.

### 4.3.3 User Parameter Settings

User parameters can be set in power-on or power-off status.

- (1) Press and hold the “FUNCTION” button for five seconds. The temperature area displays “C00”. Press and hold the “FUNCTION” button for another five seconds to enter the wired controller user parameter setting interface. The temperature area displays “P00”.
- (2) Select a parameter code by pressing“▲” or “▼”. Press the “MODE” button to switch to parameter value settings. The parameter value blinks. Adjust the parameter value by pressing “▲” or “▼” and then press the “SWING/ ENTER” button to complete settings.
- (3) Press the “SWING/ ENTER” button to return to the upper-level menu till quitting parameter settings.
- (4) For the user parameter setting list of the XK79 wired controller, refer to the user setting query list in XK46 user parameter settings.

**Note:** In parameter settings, the function of "SWING/ ENTER" on the XK79 wired controller is equivalent to the function of “ENTER/CANCEL” on the XK46 wired controller.

### 4.3.4 Engineering Parameter Query

Engineering parameters can be queried in power-on or power-off status.

- (1) Press and hold the “FUNCTION” button for five seconds to enter the engineering parameter query interface. The temperature area displays “C00” and “VIEW” is on.

- (2) In "C00" status, continuously press the "MODE" button for three times to enter engineering parameter query.
- (3) Select a parameter code by pressing "▲" or "▼".
- (4) Press the "SWING/CANCEL" button to return to the upper-level menu till quitting parameter query.
- (5) For the engineering parameter query list of the XK79 wired controller, refer to the engineering parameter query list in XK46 engineering parameter query.

**Note:** In parameter query, the function of "SWING/CANCEL" on the XK79 wired controller is equivalent to the function of "ENTER/CANCEL" on the XK46 wired controller.

### 4.3.5 Engineering Parameter Settings

Engineering parameters can be set in power-on or power-off status.

- (1) Press and hold the "FUNCTION" button for five seconds. The temperature area displays "C00". Continuously press the "MODE" button for three times, and then press and hold the "FUNCTION" button for another five seconds to enter the wired controller engineering parameter setting interface. The temperature area displays "P00".
- (2) Select a parameter code by pressing "▲" or "▼". Press the "MODE" button to switch to parameter value settings. The parameter value blinks. Adjust the parameter value by pressing "▲" or "▼" and then press the "SWING/CANCEL" button to complete settings.
- (3) Press the "SWING/CANCEL" button to return to the upper-level menu till quitting parameter settings.

For the engineering parameter setting list of the XK79 wired controller, refer to the engineering setting query list in XK46 engineering parameter settings.


**Note:** In parameter settings, the function of "SWING/CANCEL" on the XK79 wired controller is equivalent to the function of "ENTER/CANCEL" on the XK46 wired controller.

## 4.4 Engineering Application Functions Operated through the YV1L1 Remote Controller

The YV1L1 remote controller provides all engineering application functions. It is set to common type by default upon factory departure. It can use engineering application functions only after being set to professional type. The following only describes engineering application functions. For other user operation functions, refer to the "Remote Controller Operating Instructions".

Method for setting the professional remote controller: Press "" and "" simultaneously in power-off status. If "" blinks for three times, it indicates that the setting succeeds.

Method for restoring the common remote controller: Press "" and "" simultaneously in power-off status. If "" blinks for three times, it indicates that the setting succeeds.

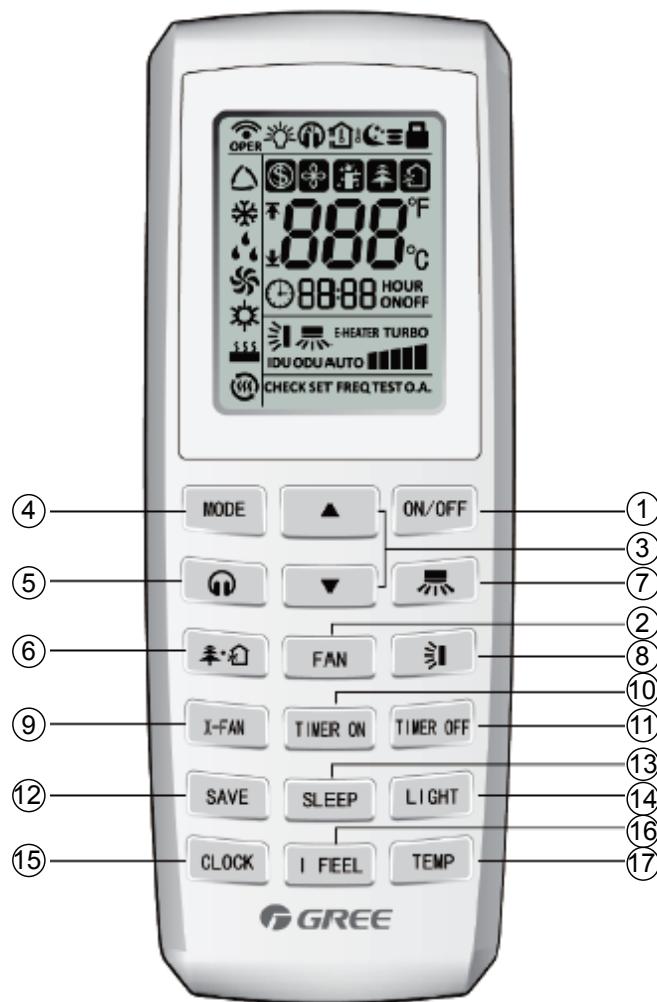

No.	Button name	Function
1	ON/OFF	Turn on or turn off the unit
2	FAN	Set fan speed
3	▲/▼	Set temperature and time
4	MODE	Set operation mode
5	SILENT	Set quiet function
6	AIR	Set health function and air function
7	SWING	Set left & right swing status
8	SWING	Set up & down swing status
9	X-FAN	Set X-FAN function
10	TIMER ON	Set timer on function
11	TIMER OFF	Set timer off function
12	SAVE	Set energy-saving function
13	SLEEP	Set sleep function
14	LIGHT	Set light function
15	CLOCK	Set clock of the system
16	I FEEL	Set I FEEL function
17	TEMP	Switch temperature displaying type on the unit's display

#### 4.4.1 Master IDU Settings

The master IDU can be set through the wired controller or remote controller. The methods for setting the master IDU through the remote controller are as follows:

Step 1: Set an IDU to air-supply status and set the temperature to 30°C.

Step 2: Continuously press “—” and “+” for three times within five seconds.


Step 3: Check whether the setting is successful. If it is, the LED panel of the IDU will display "UC" for five seconds and "MASTER" on the wired controller will be on. Otherwise, repeat steps 1 and 2.

#### 4.4.2 Parameter Query

Engineering application functions cover parameter query and parameter settings.

For parameter query, users can query user parameters and engineering parameters of the unit. The parameter query method is as follows:


(1) On the professional remote controller of YV1L1, press and hold "  " for five seconds to enter the parameter query status. The viewing text is displayed. The query code "C00" blinks in the temperature area.

(2) Press "  " to switch the query code and select a unit parameter to be queried (see Table

(3) 2.5 for parameters that can be queried).

(4) If the timer area displays query sub-items, it indicates that there are level 2 query menus. Press

(5) "  " to enter level 2 query menu selection. The content blinks in the timer area. Press

"  " to switch query sub-items and select a level 2 menu to be queried.

(6) Press "  " to confirm query and return to step 2.

After entering the engineering application function, the system automatically quits the engineering commissioning status if no valid operations are performed within 20 seconds. To directly quit the engineering commissioning status, press "  ".

Table 2.5 Query Parameters

Query Code	Query Content	Query Sub-item	Level 2 Query Content
C00	Invalid		
C01	Project number query of the current IDU		
C02	Capacity query of the current IDU		
C03	Indoor unit quantity query in the CAN1 network		
C04	Project number query of the master IDU		
C05	Historical fault query ingress of the current IDU	01	Fault 1
		02	Fault 2
		03	Fault 3
		04	Fault 4
		05	Fault 5
C06	Preferential operation query		
C07	Temperature query for environment temperature sensor of the current IDU		
C08	Prompt time query for air filter cleaning		
C10	Static pressure setting query of ODU	01	Module 1
		02	Module 2
		03	Module 3
		04	Module 4
C11	Indoor unit quantity query in one-to-many control mode		
C12	Temperature query for outdoor environment temperature sensor		
C13	CAN2 bus line ID query		
C14	Inlet-tube temperature query of IDU		
C15	Outlet temperature query of IDU		
C16	Opening degrees query of electronic expansion valve of IDU		
n2	Capacity configuration ratio upper-limit query of outdoor and IDUs		
n4	Highest capacity output limitation query		
n6	Historical fault query ingress of ODU	01	Fault 1
		02	Fault 2
		03	Fault 3
		04	Fault 4
		05	Fault 5
A6	Unit cooling/heating function		
A7	Outdoor silent mode		

### 4.4.3 Parameter Settings

For parameter settings, users can set user parameters and engineering parameters of the unit. The parameter setting method is as follows:

- (1) After entering parameter query, switch the query code to "C00". Press and hold "" for five seconds to enter the parameter setting status. The setting text is displayed and "P00" blinks in the temperature area.
- (2) Press "" to switch the setting code and select a unit parameter to be set (see Table 2.6 for parameters that can be set).
- (3) Press "" to enter parameter settings. The current parameter value blinks in the timer area. Press "" to change the parameter value.
- (4) Press "" to confirm query and return to step 2.
- (5) After entering engineering commissioning, the system automatically quits the engineering commissioning status if no valid operations are performed within 20 seconds. To directly quit the engineering commissioning status, press ".


Table 2.6 Setting Parameters

Setting Code	Setting Content	Setting Value
P00	Invalid	—
P10	Master IDU settings	00: not changing the current settings 01: setting the corresponding IDU to master IDU 001-255: setting the IDU corresponding to *** to master IDU
P15	Power-down memory mode settings	00: standby after power-down recovery 01: restoring the original status after power-down recovery
P17	Historical fault clearing	00: not cleared 01: cleared
P20	Indoor environment temperature value	01: temperature sensor of air return vent 02: temperature sensor of wired controller 03: temperature sensor of air return vent for cooling, dehumidifying, and air supply; temperature sensor of wired controller for heating 04: temperature sensor of wired controller for cooling, dehumidifying, and air supply; temperature sensor of air return vent for heating and automatic mode
P21	Corrected value settings of environment temperature sensor of IDU (for cooling, dehumidifying, and air supply)	-15 to 15
P22	Corrected value settings of environment temperature sensor of IDU (for heating)	-15 to 15
P30	Static pressure settings for indoor fan	Type 1: 03.04.05.06.07 Type 2: 01.02.03.04.05.06.07.08.09
P31	High-ceiling installation settings	00: standard-ceiling installation height 01: high-ceiling installation height
P32	Capacity adjustment function of IDU	-40% to +40%

Setting Code	Setting Content	Setting Value
P34	Repeating validity for time-point timing	00: invalid 01: valid
P35	Factory setting recovery for user functions	00: invalid 01: factory setting recovery
P36	Factory setting recovery for engineering settings	00: invalid 01: factory setting recovery
P40	Prevention for heat collection	00: disabled 10: 10 seconds 20: 20 seconds 30: 30 seconds 40: 40 seconds 50: 50 seconds 60: 60 seconds
P42	Project number settings of IDU	1-255
P43	Preferential operation settings	00: no preferential operation 01: preferential operation
P44	One-key project number setting query for IDU	00: not displayed 01: displayed
P45	One-key project number reset for IDU	00: invalid 01: project number reset
P46	Accumulated time clearing for air filter cleaning	00: not cleared 01: cleared
P47	Prompt settings for air filter cleaning	00: no cleaning prompt settings 10-39: The first digit indicates the pollution degree of the using place and the second digit indicates the accumulated operating time of IDU. The two digits are described as follows: Slight pollution: The first digit is "1". If the second digit is "0", it indicates that the accumulated operating time is 5500 hours. The accumulated operating time is added by 500 hours when the second digit is increased by "1". When the second digit is "9", the accumulated operating time is 10000 hours. Medium pollution: The first digit is "2". If the second digit is "0", it indicates that the accumulated operating time is 1400 hours. The accumulated operating time is added by 400 hours when the second digit is increased by "1". When the second digit is "9", the accumulated operating time is 5000 hours. Heavy pollution: The first digit is "3". If the second digit is "0", it indicates that the accumulated operating time is 100 hours. The accumulated operating time is added by 100 hours when the second digit is increased by "1". When the second digit is "9", the accumulated operating time is 1000 hours.
n0	System conservation operation settings	00: comfortability preferred 01: conservation preferred
n1	Defrosting period settings	40: 40 minutes 50: 50 minutes 60: 60 minutes
n3	Forcible defrosting	00: no defrosting 01: forcible defrosting
A7	Silent function of ODU	00: no silent function 01-09: intelligent nighttime silent mode 10-12: forcible silent mode
n4	Highest capacity output limitation settings	08: highest energy consumption limitation being 80% 09: highest energy consumption limitation being 90% 10: no conservation limitation

## 4.5 Engineering Application Functions Operated through the YAP1F Remote Controller

**4.5.1 The method for setting the master IDU through the YAP1F remote controller is as follows**

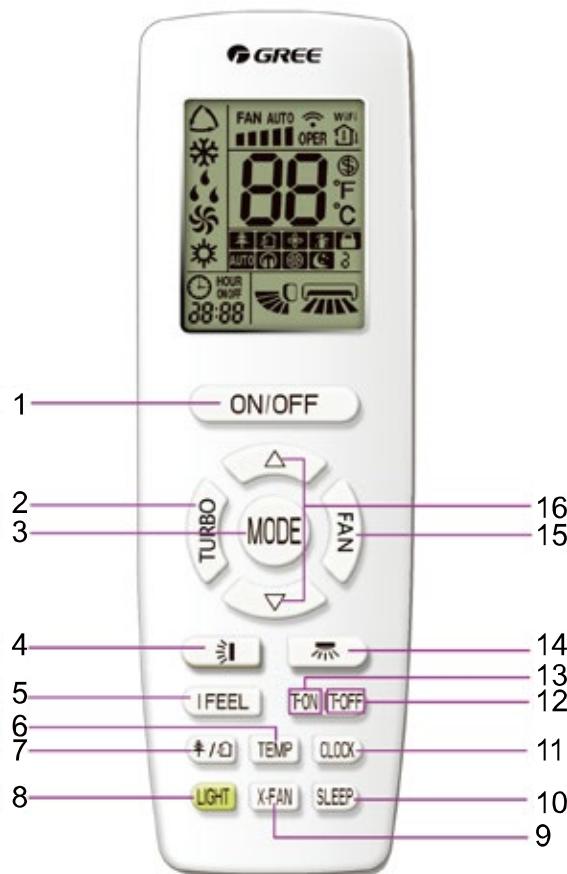

No.	Button name	Function
1	ON/OFF	Turn on or turn off the unit
2	TURBO	Set turbo function
3	MODE	Set operation mode
4		Set up&down swing status
5	I FEEL	Set I FEEL function
6	TEMP	Switch temperature displaying type on the unit's display
7		Set health function and air function
8	LIGHT	Set light function
9	X-FAN	Set X-FAN function
10	SLEEP	Set sleep function
11	CLOCK	Set clock of the system
12	TOFF	Set timer off function
13	TON	Set timer on function
14		Set left&right swing status
15	FAN	Set fan speed
16		Set temperature and time

For details about the above figures, refer to the instructions 66174100016.

Perform settings by pressing “▲” and “▼” in air supply mode:

- (1) Set the temperature to 30°C.
- (2) Press “▼” and then “▲” in five seconds. Repeat this operation for three times.

After successful settings, “UC” is displayed on the receiving indicator panel of the remote controller for five seconds and “MASTER” is displayed on the wired controller.

#### **4.5.2 IDU Project Number Query by Remote Controller YAP1F**

- (1) Query method for project number of single IDU:

Enter query:

Under fan mode, set temperature in 16°C, press “Light” button for 5 times continuously within 5 seconds and then the IDU light board will display its project number.

Exit query:

- 1) After entering query status, press “Light” button for 5 times continuously within 5 seconds to exit query status.
- 2) After 30min, it will exit query status automatically and display normal status.

- (2) Query method for project numbers of all IDUs in a single system:

Enter query:

Under fan mode, set temperature in 30°C, press “Light” button for 5 times continuously within 5 seconds and then the light boards of all indoor units will display their project numbers respectively.

Exit query:

- 1) After entering query status, press “Light” button for 5 times continuously within 5 seconds to exit query status.
- 2) After 30min, it will exit query status automatically and display normal status.

## INSTALLATION

## CHAPTER 3 INSTALLATION

### 1 Engineering Installation Preparation and Notice

#### 1.1 Installation Notice

Personnel and property safety are highly concerned during the entire installation process. Installation implementation must abide by relevant national safety regulations to ensure personnel and property safety.

All personnel involved in the installation must attend safety education courses and pass corresponding safety examinations before installation. Only qualified personnel can attend the installation. Relevant personnel must be held responsible for any violation of the regulation.

#### 1.2 Installation Key Points and Importance

VRF air conditioning systems use refrigerant, instead of other agent, to directly evaporate to carry out the system heat. High level of pipe cleanliness and dryness is required in the system. Since various pipes need to be prepared and laid out onsite, carelessness or maloperation during installation may leave impurities, water, or dust inside refrigerant pipes. If the design fails to meet the requirement, various problems may occur in the system or even lead to system breakdown.

Problems that usually occur during installation are as follows:

No.	Installation Problem	Possible Consequence
1	Dust or impurities enter into the refrigeration system.	Pipes are more likely to be blocked; air conditioning performance is reduced; compressor wear is increased or even hinder the normal operation of the system and burn the compressor.
2	Nitrogen is not filled into the refrigerant pipe or insufficient Nitrogen is filled before welding.	Pipes are more likely to be blocked; air conditioning performance is reduced; compressor wear is increased or even hinder the normal operation of the system and burn the compressor.
3	The vacuum degree in the refrigerant pipe is insufficient.	The refrigeration performance is reduced. The system fails to keep normal operation due to frequent protection measures. When the problem getting serious, compressor and other major components can be damaged.
4	Water enters into the refrigeration system.	Copper plating may appear on the compressor and reduce the compressor efficiency with abnormal noise generated; failures may occur in the system due to ice plug.
5	The refrigerant pipe specifications do not meet the configuration requirements.	Smaller configuration specifications can increase the system pipe resistance and affect the cooling performance; larger configuration specifications are waste of materials and can also reduce the cooling performance.
6	Refrigerant pipe is blocked.	The cooling performance is reduced; in certain cases, it may cause long-term compressor operating under overheat conditions; the lubricating effect can be affected and the compressor may be burnt if impurities were mixed with the lubricating oil.
7	Refrigerant pipe exceeds the limit.	The loss in pipe is considerable and the unit energy efficiency decreases, which are harmful for long-term running of the system.
8	Incorrect amount of refrigerant is filled.	The system cannot correctly control the flow allocation; the compressor may be operating under over-heating environment or running when the refrigerant flows back to the compressor.
9	The refrigerant pipe leaks.	Insufficient refrigerant circulating in the system decreases the cooling performance of the air conditioner. Long-term operation under such circumstance may cause an overheating compressor or even damage the compressor.

No.	Installation Problem	Possible Consequence
10	Water drainage from the condensate water pipe is not smooth.	Residual water in IDUs can affect the normal operation of the system. The possible water leakage can damage the IDU's decoration.
11	The ratio of slop for condensate water pipe is insufficient or the condensate water pipe is incorrectly connected.	Reverse slop or inconsistent connection of condensate water pipe can hinder the smooth drainage and cause leakage of the IDU.
12	The air channel is improperly fixed.	The air channel will deform; vibration and noise occur during unit operating.
13	The guide vane of air channel is not reasonably manufactured.	Uneven air quantity allocation reduces the overall performance of the air conditioner.
14	The refrigerant pipe or condensate water pipe does not meet the insulation requirement.	Water can easily condensate and drip to damage the indoor decoration, or even trigger the protection mode of system due to overheating operation.
15	The installation space for IDU is insufficient.	Since there is a lack of space for maintenance and checking, indoor decoration might need to be damaged during such operation.
16	The IDU or the location of the air outlet or return air inlet is not designed reasonably.	The air outlet or return air inlet may be short-circuited, thus affecting the air conditioning performance.
17	The ODU is improperly installed.	The ODU is difficult to be maintained; unit exhaust is not smooth, which reduces the heat exchanging performance or even prevent the system from normal operation; in addition, the cold and hot air for heat exchange and the noise may annoy people in surrounding areas.
18	Power cables are incorrectly provided.	Unit components may be damaged and potential safety hazard may occur.
19	Control communication cables are incorrectly provided or improperly connected.	The normal communication in the system fails or the control over IDUs and ODUs turn in a mess.
20	Control communication cables are not properly protected.	The communication cables are short-circuited or disconnected, and the unit cannot be started up due to communication failure.

Understand the special requirement (if any) for unit installation before implementation to ensure installation quality.

Relevant installers must have corresponding engineering construction qualifications.

Special type operators involved in the engineering implementation, such as welders, electricians, and refrigeration mechanics must have relevant operating licenses and are accredited with vocational qualification certification.

## 2 Installation Materials Selection

The materials, equipment and instruments used during air conditioning engineering construction must have certifications and test reports. Products with fireproof requirements must be provided with fireproof inspection certificates and must meet national and relevant compulsory standards. If environmentally-friendly materials are to be used as required by customers, all such materials must meet national environmental protection requirement and be provided with relevant certificates.

## 2.1 Refrigerant Piping

- (1) Material requirement: Dephosphorization drawing copper pipe for air conditioners.
- (2) Appearance requirement: The inner and outer surface of pipe should be smooth without pinhole, crack, peeling, blister, inclusion, copper powder, carbon deposition, rust, dirt or severe oxide film, and without obvious scratch, pit, spot and other defects.
- (3) Test report: Certifications and quality test reports must be provided.
- (4) The tensile strength must be at least 240 kgf/mm<sup>2</sup>.
- (5) Specifications requirement.

R410A Refrigerant System		
OD (mm/inch)	Wall Thickness (mm)	Model
Φ6.35(1/4)	≥0.8	O
Φ9.52(3/8)	≥0.8	O
Φ12.70(1/2)	≥0.8	O
Φ15.9(5/8)	≥1.0	O
Φ19.05(3/4)	≥1.0	1/2 H

- (6) After the inner part of the copper pipe is cleaned and dried, the inlet and outlet must be sealed tightly by using pipe caps, plugs or adhesive tapes.

## 2.2 Condensate Water Pipe

- (1) Pipes that can be used for air conditioner drainage include: water supplying UPVC pipe, PP-R pipe, PP-C pipe, and HDG steel pipe;
- (2) All relevant certificates and quality test reports are provided.
- (3) Requirements for specifications and wall thickness.

Water supplying UPVC pipe:

Φ32mm(1-1/4inch)×2mm(1/16inch), Φ40mm(1-3/4inch)×2mm(1/16inch),  
Φ50mm(1-15/16inch)×2.5mm(1/8inch).

HDG steel pipe:

Φ25mm(1inch)×3.25mm(1/8inch), Φ32mm(1-1/4inch)×3.25mm(1/8inch).  
Φ40mm(1-3/4inch)×3.5mm(1/8inch), Φ50mm(1-15/16inch)×3.5mm(1/8inch).

## 2.3 Insulation Material

- (1) Rubber foam insulation material.
- (2) Flame retardancy level: B1 or higher.
- (3) Refractoriness: at least 120°C (248°F).
- (4) The insulation thickness of condensate water pipe: at least 10mm (3/8inch).
- (5) When the diameter of copper pipe is equal to or greater than Φ15.9mm(5/8inch), the thickness of insulation material should be at least 20mm(3/4inch); when the diameter of copper pipe is less than 15.9mm(5/8inch), the thickness of insulation material should be at least 15mm(5/8inch).

## 2.4 Communication Cable and Control Cable

**NOTICE!** For air conditioning units installed in places with strong electromagnetic interference, shielded wire must be used as the communication cables of the IDU and wired controller, and shielded twisted pairs must be used as the communication cables between IDUs and between the IDU and ODU.

Communication cable selection for ODU and IDUs

Material Type	Total Length L (m) of Communication Cable between Indoor Unit and Indoor (Outdoor) Unit	Wire size (mm <sup>2</sup> /AWG)	Material Standard	Remarks
Light/Ordinary polyvinyl chloride sheathed cord. (60227 IEC 52 /60227 IEC 53)	L≤1000m(3280-5/6ft)	≥2×0.75 (2×AWG 18)	IEC 60227-5	(1) If the wire diameter is enlarged to 2×1 mm <sup>2</sup> (2×AWG16), the total communication line length can reach 1500 m (4921-1/4ft.). (2) The cord shall be Circular cord (the cores shall be twisted together). (3) If unit is installed in places with intense magnetic field or strong interference, it is necessary to use shielded wire.

Communication cable selection for IDU and wired controller

Material type	Total length of communication line between indoor unit and wired controller	Wire size(mm <sup>2</sup> /AWG)	Material Standard	Remarks
Light/Ordinary polyvinyl chloride sheathed cord. (60227 IEC 52 /60227 IEC 53)	L≤250m(820-1/5ft)	2×0.75 ~2×1.25 (2×AWG18 ~2×AWG16)	IEC 60227-5	(1) Total length of communication line can't exceed 250m(820-1/5ft.). (2) The cord shall be Circular cord (the cores shall be twisted together). (3) If unit is installed in places with intense magnetic field or strong interference, it is necessary to use shielded wire.

## 2.5 Power Cable

Only copper conductors can be used as power cables. The copper conductors must meet relevant national standard and satisfy the carrying capacity of unit.

## 2.6 Hanger Rod and Support


- (1) Hanger rod: M8 or M10.
- (2) U-steel: 14# or above.
- (3) Angle steel: 30mm (1-1/6inch)×30mm (1-1/6inch)×3mm (1/8inch) or above.
- (4) Round steel: Φ10mm (4/10inch) or above.

### 3 Installation of Indoor Unit

#### 3.1 Installation of Low Static Pressure Duct Type Indoor Unit

##### 3.1.1 Outline and Installation Dimension

The following diagram is applicable for units with the cooling capacity ranging from 7k Btu/h to 22kBtu/h.

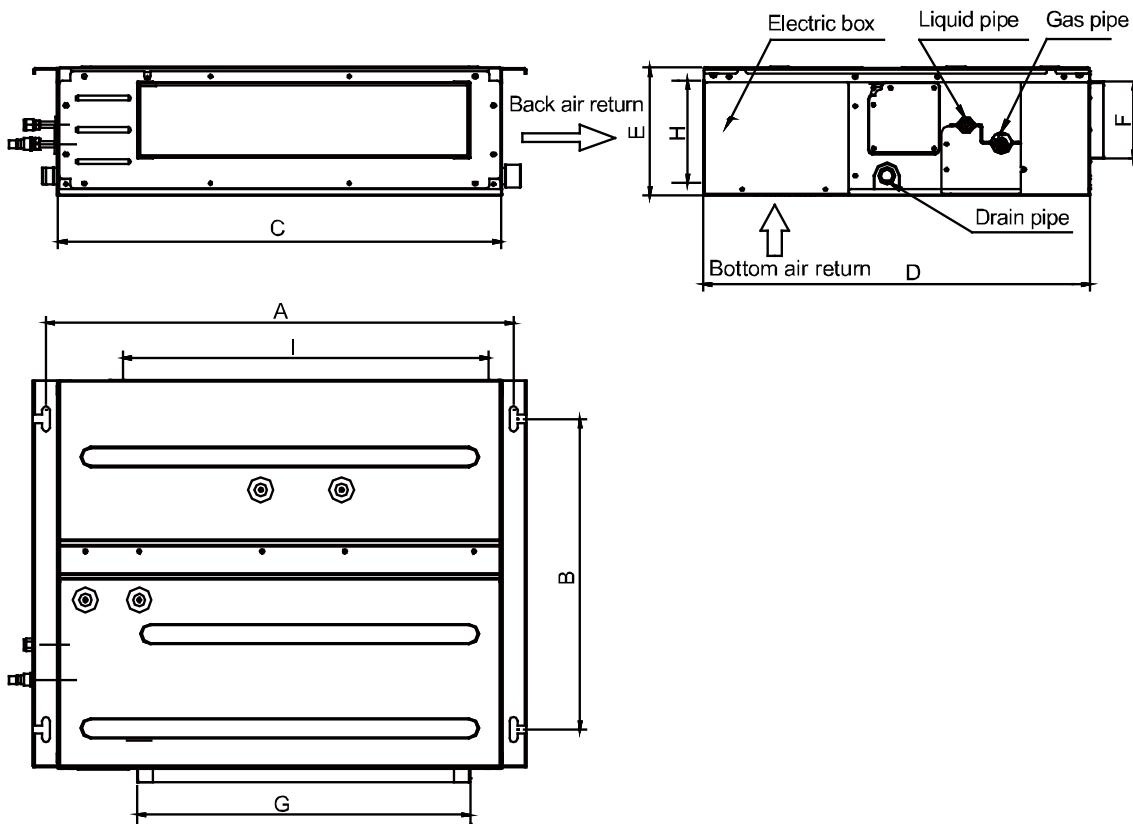


The following table lists the detailed dimensions.

Unit: mm(inch)

Model \ Item	A	B	C	D	E	F	G	H	I
GMV-ND07PLS/A-T(U)	742 (29 3/16)	491 (19 5/16)	700 (27-1/2)	615 (24-1/4)	200 (7-7/8)	121 (4-3/4)	528 (20-13/16)	161 (6-5/16)	580 (22-13/16)
GMV-ND09PLS/A-T(U)									
GMV-ND12PLS/A-T(U)									
GMV-ND14PLS/A-T(U)	942 (37-1/16)	491 (19-5/16)	900 (35-3/8)	615 (24-1/4)	200 (7-7/8)	121 (4-3/4)	728 (28-11/16)	161 (6-5/16)	780 (30-11/16)
GMV-ND18PLS/A-T(U)	1142 (44-15/16)	491 (19-5/16)	1100 (43-1/4)	615 (24-1/4)	200 (7-7/8)	121 (4-3/4)	928 (36-9/16)	161 (6-5/16)	980 (38-9/16)
GMV-ND22PLS/A-T(U)									

### 3.1.2 Installation Space

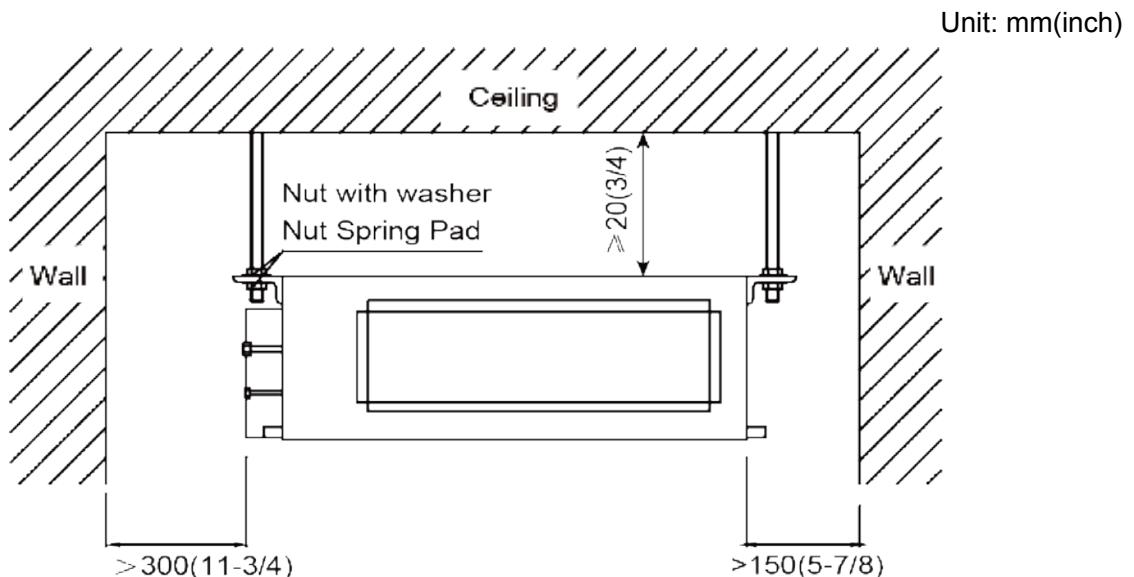

### 3.1.3 Installation Notice

- (1) Installation dimension (refer to the outline dimension in the figure).
- (2) Installation foundation.
- (3) Make sure the top hanging rod, ceiling and building structure have sufficient strength to withstand the weight of unit.
- (4) Installation site and environment.
  - 1) Keep the unit from insolation and rainch
  - 2) Keep the unit from fire, flammable objects, corrosive gap or exhaust gas.
  - 3) Please reserve ventilation space.
  - 4) Please reserve sufficient space for maintenance.
  - 5) Please take proper measures to reduce noise and vibration.
- (5) Electrical installation of unit.

All electrical installation must be done by professionals according to national and local laws and regulations.

The unit must be grounded reliably. Please connect wire according to the wiring diagram on the unit.

### 3.1.4 Selection of Air Switch and Power Cord

Model	Power Cord Size	Air Switch capacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-ND07PLS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND09PLS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND12PLS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND14PLS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND18PLS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND22PLS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18

### 3.1.5 Outline Dimension and Installation Spots

Equip with a service port after lifting the unit. For the convenience of maintenance, the service port should be on one side of the electric box and below unit's lower level. Below are the outline dimension applicable to indoor units of GMV-ND05~24PLS/B1-T(U).GMV

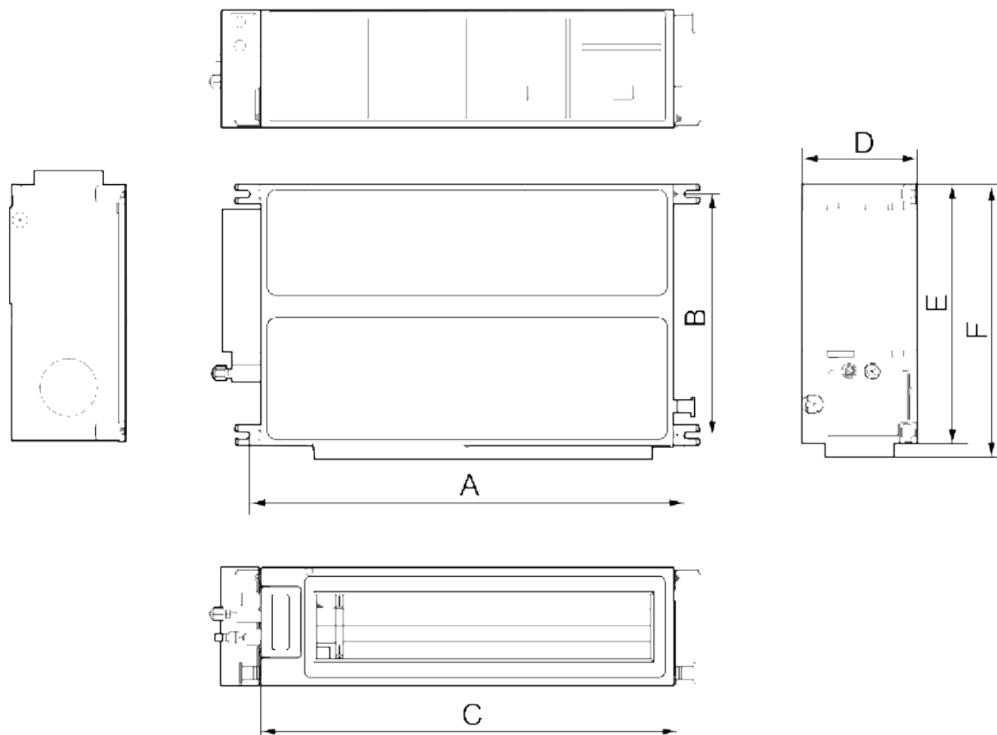


Fig 3.1.5

Below are dimensions of A, B, C, etc. for different models:

Unit: mm(in.)

Item Model	A	B	C	D	E	F
GMV-ND05~12PLS/B1-T(U)	760 (30)	415 (16-3/8)	710 (27-15/16)	200 (7-14/16)	462 (18-3/16)	486 (19-2/16)
GMV-ND14~18PLS/B1-T(U)	1060 (41-3/4)	415 (16-3/8)	1010 (39-12/16)	200 (7-14/16)	462 (18-3/16)	486 (19-2/16)
GMV-ND24PLS/B1-T(U)	1360 (53-1/2)	415 (16-3/8)	1310 (51-9/16)	200 (7-14/16)	462 (18-3/16)	486 (19-2/16)

### 3.1.6 Installation Space

Lift up the unit to the ceiling and secure it on the bolt. Use specialized nut to secure the unit.

Unit: mm(in.)

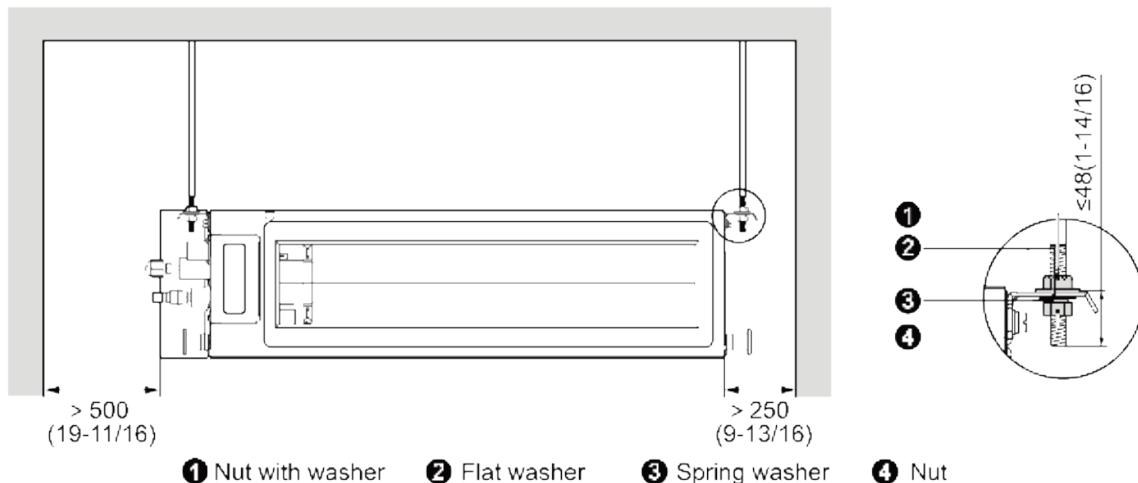


Fig 3.1.6

### 3.1.7 Installation Notice

- (1) Before installation, please finish the preparation work of all pipes (connection pipe, drain pipe) and wires (wired controller wire, connection wire of IDU and ODU) that need to be connected with the indoor unit.
- (2) Punch holes on the ceiling (air return opening or air inlet). Ceiling may have to be strengthened to make it level and to prevent it from vibration. You may consult user or constructor for details.
- (3) If the ceiling is not strong enough, you can install a beam bracket in a corner and secure the unit on the beam


### 3.1.8 Selection of Air Switch and Power Cord

Model	Power Supply	Minimum Circuit Ampacity (A)	Maximum Overcurrent Protection (A)
GMV-ND05PLS/B1-T(U)	208/230V 1Ph 60Hz	1	15
GMV-ND07PLS/B1-T(U)		1	15
GMV-ND09PLS/B1-T(U)		1	15
GMV-ND12PLS/B1-T(U)		1	15
GMV-ND14PLS/B1-T(U)		1	15
GMV-ND18PLS/B1-T(U)		1	15
GMV-ND24PLS/B1-T(U)		1	15

## 3.2 Installation of Slim Duct Type Indoor Unit

### 3.2.1 Outline and Installation Dimension

The following diagram is applicable for units with the cooling capacity ranging from 06kBtu/h to 24kBtu/h.

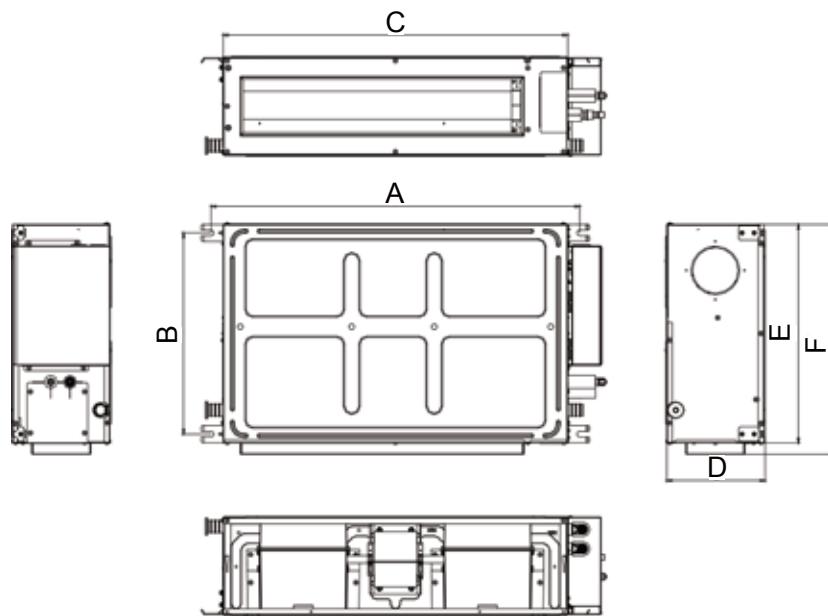


The following table lists the detailed dimensions.

Model \ Item	A	B	C	D	E	F
GMV-ND06~12PLS/B-T(U)	760 (30)	415 (16-3/8)	710 (28)	200 (17-7/8)	462 (18-3/16)	486 (19-2/16)
GMV-ND14~18PLS/B-T(U)	1060 (41-3/4)	415 (16-3/8)	1010 (39-3/4)	200 (17-7/8)	462 (18-3/16)	486 (19-2/16)
GMV-ND24PLS/B-T(U)	1360 (53-1/2)	415 (16-3/8)	1310 (51-3/4)	200 (17-7/8)	462 (18-3/16)	486 (19-2/16)

### 3.2.2 Installation Space

Unit: mm(inch)

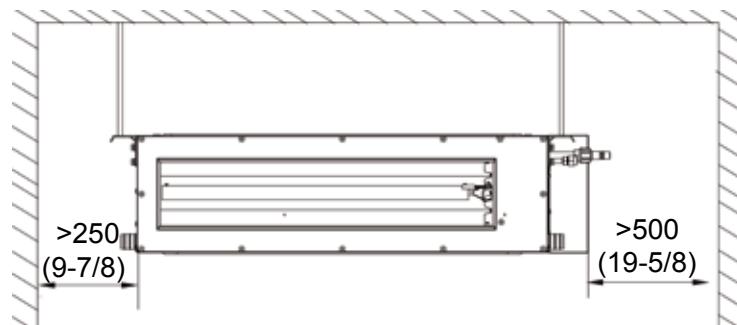

### 3.2.3 Installation Notice

- (1) Installation dimension (refer to the outline dimension in the figure).
- (2) Installation foundation.
- (3) Make sure the top hanging rod, ceiling and building structure have sufficient strength to withstand the weight of unit.
- (4) Installation site and environment.
  - 1) Keep the unit from insolation and rainach
  - 2) Keep the unit from fire, flammable objects, corrosive gap or exhaust gas.
  - 3) Please reserve ventilation space.
  - 4) Please reserve sufficient space for maintenance.
  - 5) Please take proper measures to reduce noise and vibration.

(5) Electrical installation of unit.

All electrical installation must be done by professionals according to national and local laws and regulations.


The unit must be grounded reliably. Please connect wire according to the wiring diagram on the unit.


### 3.2.4 Selection of Air Switch and Power Cord

Model	Power Cord Size	Air Switch capacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-ND06PLS/B-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND07PLS/B-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND09PLS/B-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND12PLS/B-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND14PLS/B-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND18PLS/B-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND24PLS/B-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18

## 3.3 Installation of Four-way Cassette Type Indoor Unit

### 3.3.1 Requirements for External Dimensions and Installation and Maintenance Spaces

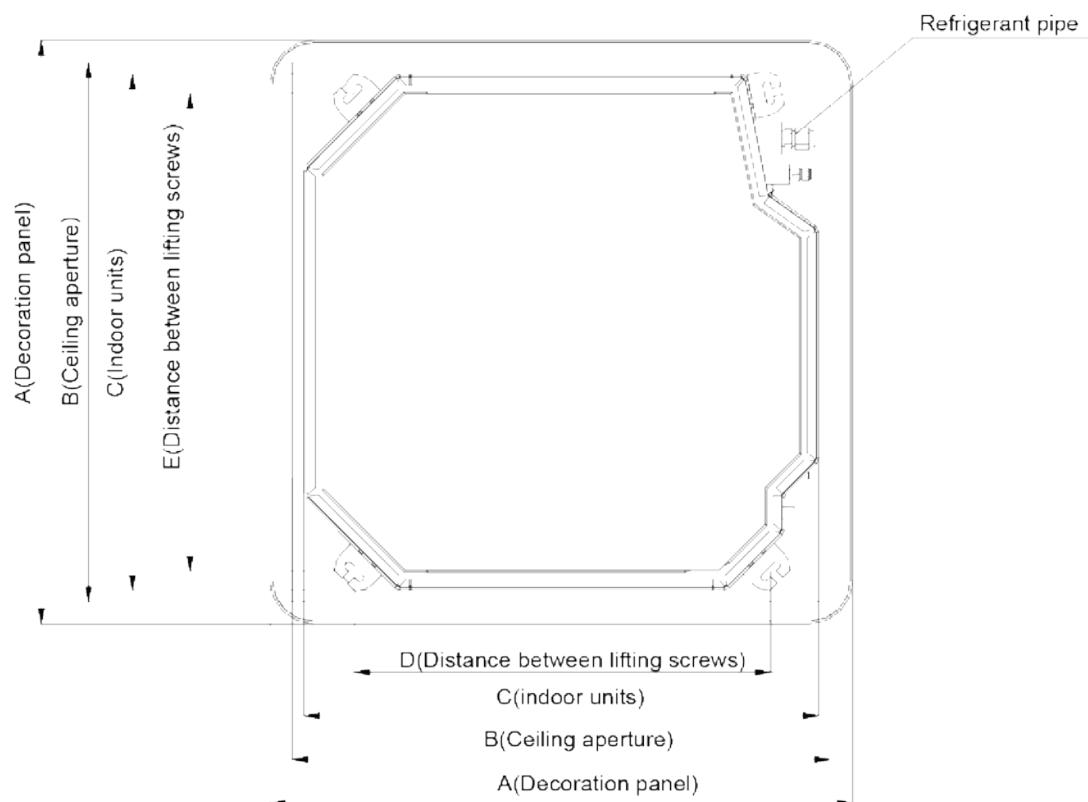

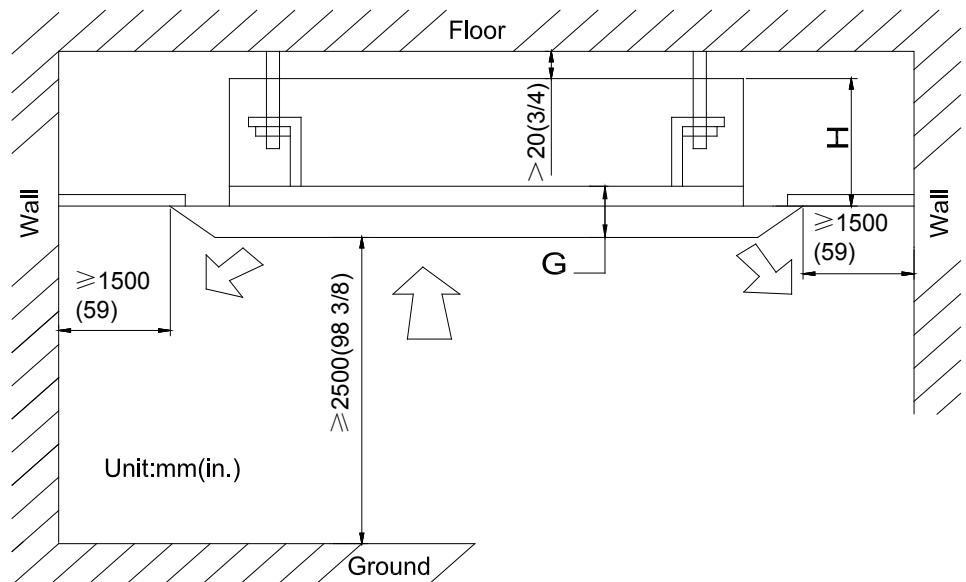

Unit: mm (inch)

Model	A	B	C	D	E	G	H
GMV-ND07T/A-T(U)	950 (37-3/8)	890 (35)	840 (33)	680 (26-3/4)	780 (30-3/4)	65 (2-1/2)	210 (8-1/4)
GMV-ND09T/A-T(U)							
GMV-ND12T/A-T(U)	950 (37-3/8)	890 (35)	840 (33)	680 (26-3/4)	780 (30-3/4)	65 (2-1/2)	260 (10-1/4)
GMV-ND15T/A-T(U)							
GMV-ND18T/A-T(U)							
GMV-ND24T/A-T(U)							
GMV-ND30T/A-T(U)							
GMV-ND36T/A-T(U)	950 (37-3/8)	890 (35)	840 (33)	680 (26-3/4)	780 (30-3/4)	65 (2-1/2)	340 (13-3/8)
GMV-ND42T/A-T(U)							
GMV-ND48T/A-T(U)							

### 3.3.2 Installation Notice


- This indoor unit may be installed on ceilings up to 3.5m(137-3/4inch) in height(for 30~48k units: 4.0m(157-1/2inch)). Install then unit higher than 2.5m(98-3/8inch) to avoid accidental touching.
- The unit shall be installed by the professional personnel according to this installation instruction to ensure proper use.
- Please contact the local Gree appointed service center before installation. Any malfunction caused by the unit that is not installed by the Gree appointed service center would probably not be dealt with on time because of the inconvenience of the business contact.
- It should be guided under the professional personnel when the air conditioner unit is moved to other place.
- The unit shall be installed in accordance with national standards or local regulations.
- Only qualified personnel can carry out installation work, please contact with local dealer before installation.
- Make sure all the installation work completed before energizing.
- The appliances are not accessible to general public.

### 3.3.3 Selection of Air Switch and Power Cord

Model	Power Cord Size	Air Switch apacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-ND07T/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND09T/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND12T/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND15T/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND18T/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND24T/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND30T/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND36T/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND42T/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND48T/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18

## 3.4 Installation of Wall-mounted Indoor Unit

### 3.4.1 Outline and Installation Dimension

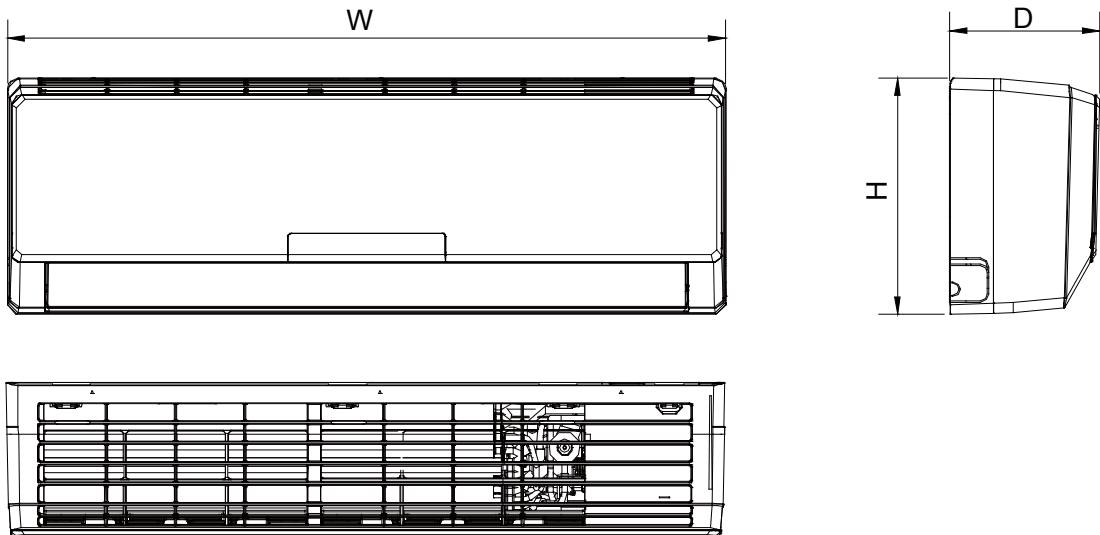


Unit: mm(inch)

Model	W	H	D
GMV-N07G/A3A-D(U) GMV-N09G/A3A-D(U) GMV-N07G/E3A-D(U) GMV-N09G/E3A-D(U)	843 (33-3/16)	275 (10-13/16)	180 (7-1/16)
GMV-N12G/A3A-D(U) GMV-N18G/A3A-D(U) GMV-N12G/E3A-D(U) GMV-N18G/E3A-D(U)	940 (37)	298 (11-3/4)	200 (7-7/8)
GMV-N24G/A3A-D(U) GMV-N24G/E3A-D(U)	1008 (39-11/16)	319 (12-9/16)	221 (8-11/16)
GMV-ND06G/B4B-T(U) GMV-ND07G/B4B-T(U) GMV-ND09G/B4B-T(U) GMV-ND12G/B4B-T(U)	845 (33-1/4)	289 (11-3/8)	209 (8-1/4)
GMV-ND14G/B4B-T(U)	970 (38-3/16)	300 (11-13/16)	224 (8-13/16)
GMV-ND18G/B4B-T(U) GMV-ND24G/B4B-T(U)	1078 (42-7/16)	325 (12-13/16)	246 (9-11/16)

Model	W	H	D
GMV-ND30G/B4B-T(U)	1350 (53-1/8)	326 (12-13/16)	258 (10-3/16)
GMV-ND36G/B4B-T(U)			

### 3.4.2 Installation Space

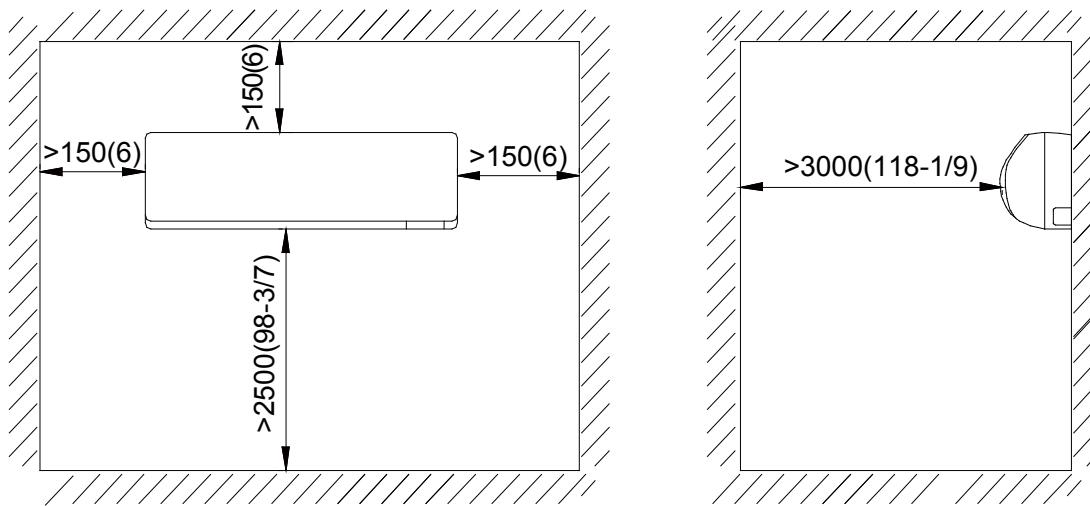

### 3.4.3 Installation Notice

(1) Installation dimension (refer to the outline dimension in the figure shown above).

(2) Installation foundation.

Make sure the top hanger has sufficient strength to withstand the weight of unit.

(3) Installation site and environment.

- 1) Keep the unit from insolation and rainch
- 2) Water can be drained from drainage pipe conveniently.
- 3) Keep the unit from fire, flammable objects, corrosive gap or exhaust gas.
- 4) There can't be any obstacle at air inlet and air outlet to in order to keep good ventilation.
- 5) Please reserve sufficient space for maintenance.
- 6) Please take proper measures to reduce noise and vibration.

### 3.4.4 Electrical Installation of Unit

All electrical installation must be done by professionals according to national and local laws and regulations.


The unit must be grounded reliably according to related requirements.

Please connect wire according to the wiring diagram on the unit.


## 3.5 Installation of Console Type Indoor Unit

### 3.5.1 Outline and Installation Dimension

Unit: mm(inch)

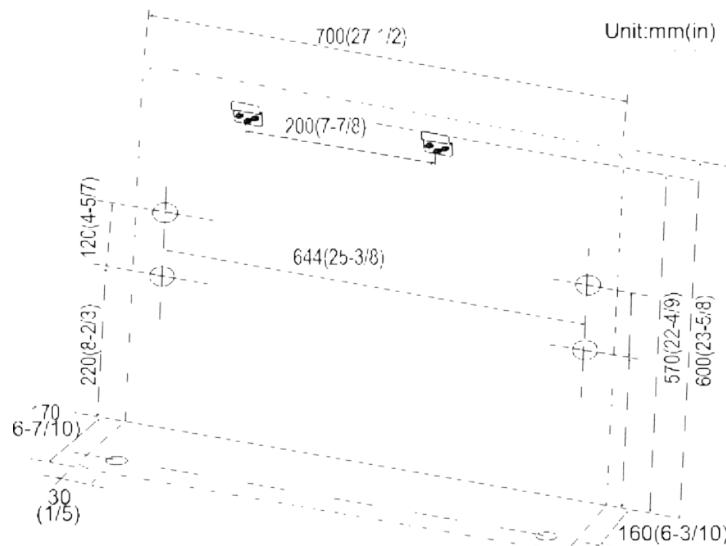



Location for securing the installation pane

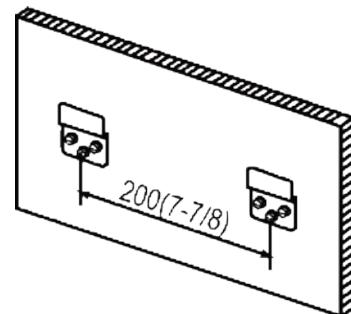

Schematic drawing of hooks

### 3.5.2 Installation Space

Exposed		Half concealed	Concealed
Floor Installation	Wall Installation		

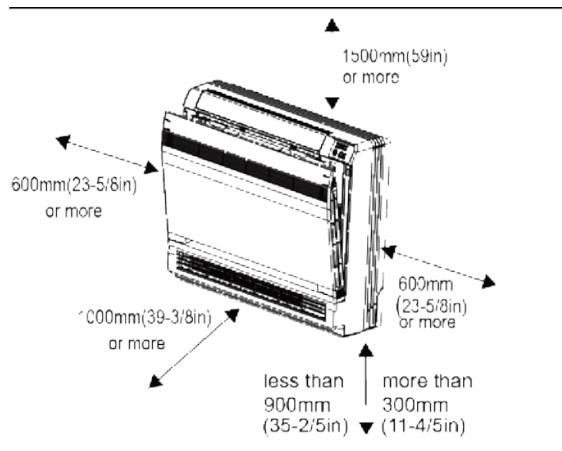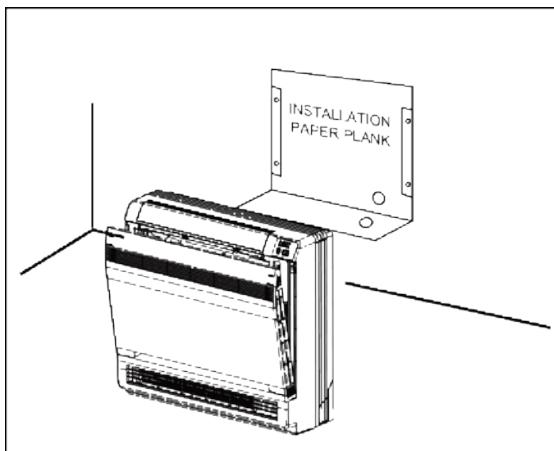

### 3.5.3 Installation Notice

(1) Installation dimension (refer to the outline dimension in the figure).

(2) Installation foundation.

Make sure building structure have sufficient strength to withstand the weight of unit.

(3) Installation site and environment.

1) Keep the unit from insolation and rainch

2) Keep the unit from fire, flammable objects, corrosive gap or exhaust gas.

3) Please reserve ventilation space.

4) Please reserve sufficient space for maintenance.

5) Please take proper measures to reduce noise and vibration.

(4) Electrical installation of unit.

All electrical installation must be done by professionals according to national and local laws and regulations.

The unit must be grounded reliably. Please connect wire according to the wiring diagram on the unit.

### 3.5.4 Electrical Installation of Unit


Live the sensor securing plate, remove the front metal plate cover, and connect the wire to the terminal board.

(1) Open the cover of electric box of indoor unit.

(2) Lead the communication line across the rubber ring.

(3) Connect the communication line to terminal D1 and D2 on the wiring board of indoor unit.

(4) Secure the communication line with the wire clamp on the electric box. Pull wires to make sure that they are securely latches up, and then retain wires with wire retainer.

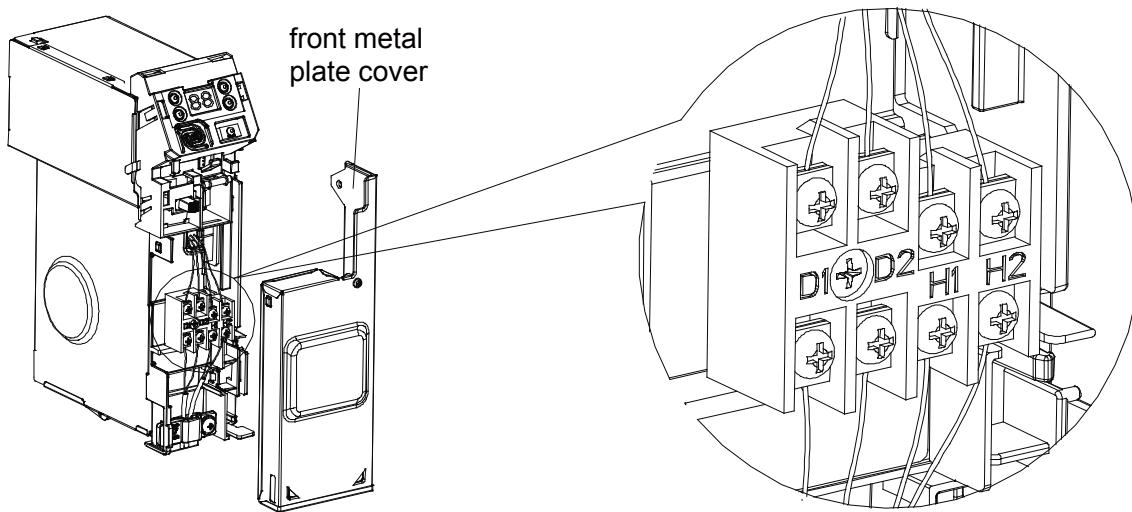

C


① The power of every indoor unit should be unity power supply.

② Do not use tapped wires, stranded wires, extension cords, or starburst connections, as they may cause overheating, electrical shock, or fire.

③ Do not use locally purchased electrical parts inside the product. (Do not branch the power for the drain pump, etc., from the terminal block.) Doing so may cause electric shock or fire.)

(5) The power connection cords have been inserted on the mainboard through the piping hole of

the chassis. Please connect the power connection cord with the breaker. If the power cord is not long enough, please prolong it with terminal block.

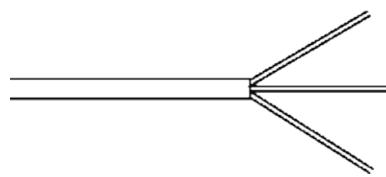

- (6) Reinstall the wiring cover on the original place and tighten the bolt;
- (7) Recover the surface panel.


### 3.5.5 Selection of Air Switch

Mode	Power Supply Specification	Circuit Breaker Capacity/A
GMV-ND07C/A-T(U)	208-230V~60Hz	6
GMV-ND09C/A-T(U)	208-230V~60Hz	6
GMV-ND12C/A-T(U)	208-230V~60Hz	6
GMV-ND18C/A-T(U)	208-230V~60Hz	6

## 3.6 Installation of High Static Pressure Duct Type Indoor Unit

### 3.6.1 Outline and Installation Dimension

The following diagram is applicable for units with the cooling capacity ranging from 18 kBtu/h to 48 kBtu/h.

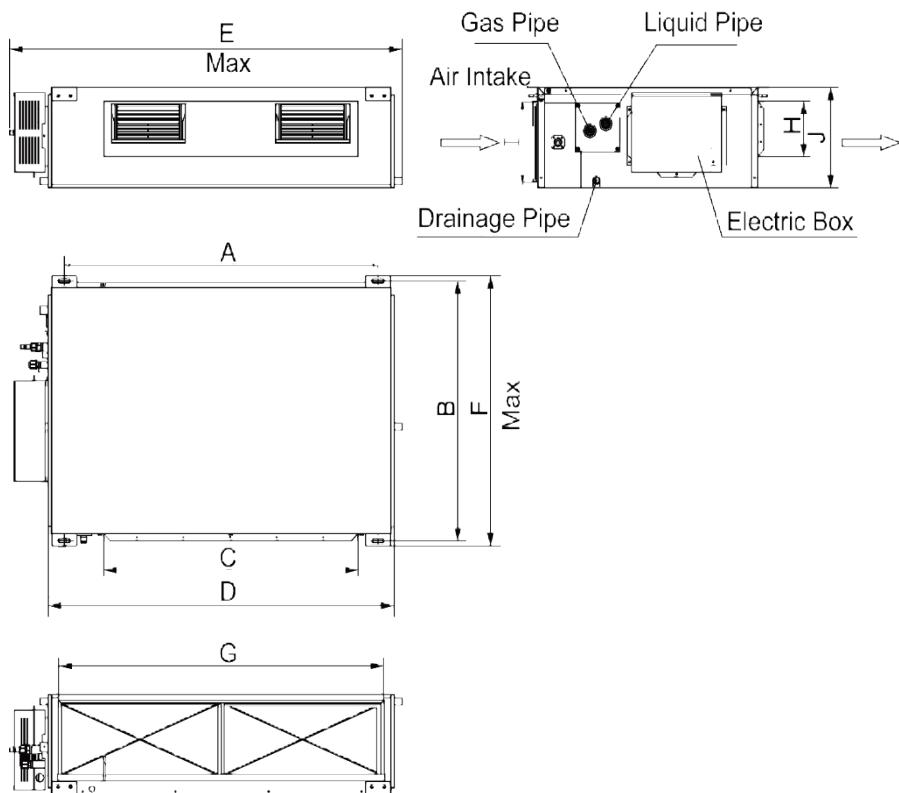


Below are dimensions of A, B, C, etc. for different models:

Unit: mm (inch)

Model	A	B	C	D	E	F	G	H	I	J
GMV-ND18PHS/A-T(U)	1101 (43-3/8)	517 (20-3/8)	820 (32-1/4)	1159 (45-5/8)	1271 (50)	558 (22)	1002 (39-1/2)	160 (6-1/4)	235 (9-1/4)	268 (10-1/2)
GMV-ND24PHS/A-T(U)										
GMV-ND30PHS/A-T(U)										
GMV-ND36PHS/A-T(U)	1011 (39-3/4)	748 (29-1/2)	820 (32-1/4)	1115 (43-7/8)	1229 (48-3/8)	775 (30-1/2)	979 (38-1/2)	160 (6-1/4)	231 (9-1/8)	290 (11-3/8)
GMV-ND42PHS/A-T(U)										
GMV-ND48PHS/A-T(U)										

The following diagram is applicable for units with the cooling capacity 72/96 kBtu/h.

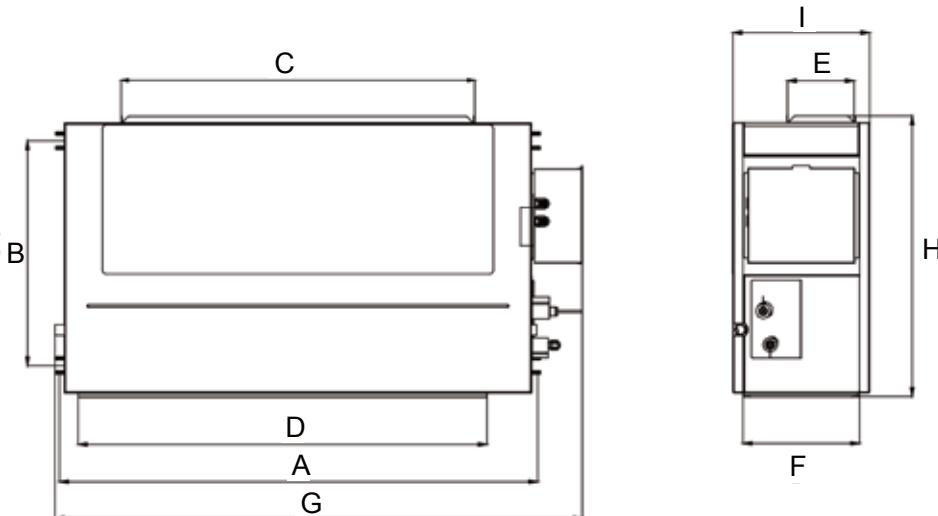

Below are dimensions of A, B, C, etc. for different models:


Unit: mm (inch)

Model	A	B	C	D	E	F	G	H	I
GMV-ND72PH/A-T(U)	1353 (53-1/4)	632 (24-7/8)	992 (39)	1150 (45-1/4)	192 (7-1/2)	327 (12-7/8)	1483 (58-3/8)	791 (31-1/8)	385 (15-3/16)
GMV-ND96PH/A-T(U)	1563 (61-1/8)	706 (27-3/4)	992 (39)	1350 (53-1/8)	192 (7-1/2)	402 (15-7/8)	1686 (66-3/8)	870 (34-1/4)	450 (17-3/4)

### 3.6.2 Installation Space


Model:GMV-ND18PHS/A-T(U) ~ GMV-ND48PHS/A-T(U)

Unit: mm(inch)

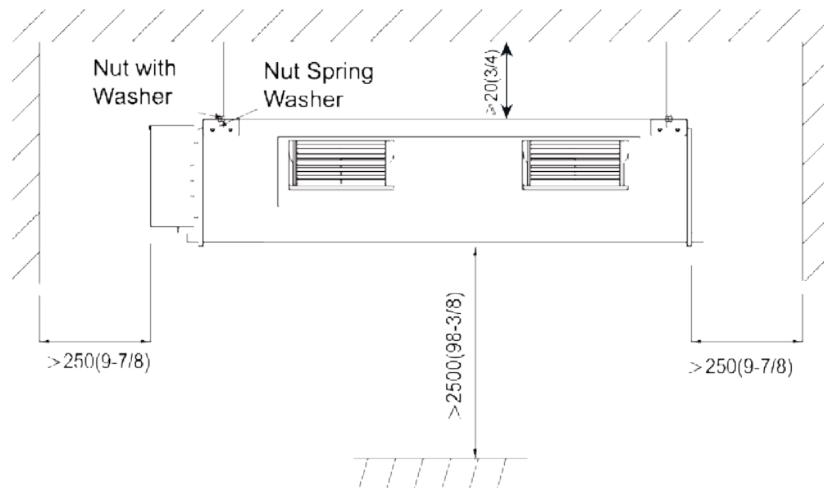

Model:GMV-ND72PH/A-T(U) / GMV-ND96PH/A-T(U)

Unit: mm (inch)

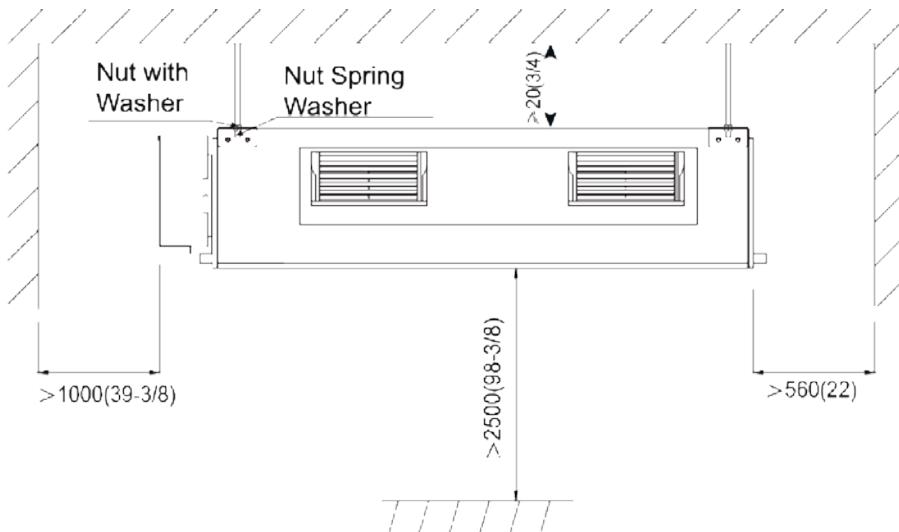

### 3.6.3 Installation Notice

- The unit shall be installed by the professional personnel according to this installation instruction to ensure proper use.
- Please contact the local Gree appointed service center before installation. Any malfunction caused by the unit that is not installed by the Gree appointed service center would probably not be dealt with on time because of the inconvenience of the business contact.
- It should be guided under the professional personnel when the air conditioner unit is moved to other place.
- Installation of the unit must be in accordance with National Electric Codes and local regulations.
- Improper installation will affect unit's performance, so do not install the unit by yourself. Please contact local dealer to arrange professional technicians for the installation.
- Do not connect power until all installation work is finished.
- If the supply cord is damaged, it must be replaced by the manufacturer or its service agent or a similarly qualified person in order to avoid a hazard.


### 3.6.4 Selection of Air Switch and Power Cord

Model	Power Cord Size	Air Switch capacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-ND18PHS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND24PHS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND30PHS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND36PHS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND42PHS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND48PHS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND72PH/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND96PH/A-T(U)	208/230V/60Hz	15	1.5/AWG18	1.5/AWG18

## 3.7 Installation of Two-way Cassette Type Indoor Unit

### 3.7.1 Outline and Installation Dimension

Unit: mm (inch)

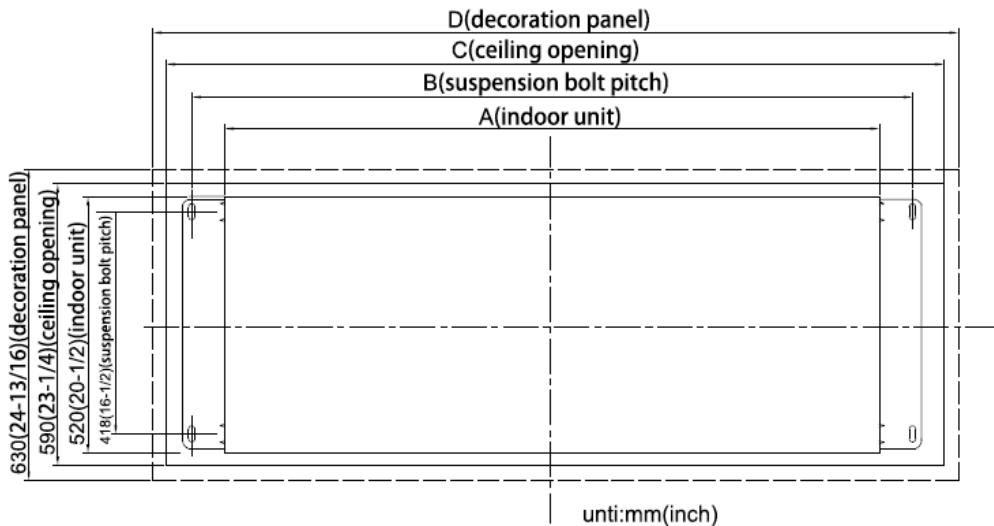


Unit: mm (inch)

Model	Indoor unit(A)	Suspension bolt pitch(B)	Ceiling opening(C)	Decoration panel(D)
GMV-ND09TS/A-T(U)	1200(47-1/4)	1252(49-5/16)	1403(55-1/4)	1443(56-13/16)
GMV-ND12TS/A-T(U)	1200(47-1/4)	1252(49-5/16)	1403(55-1/4)	1443(56-13/16)
GMV-ND15TS/A-T(U)				
GMV-ND18TS/A-T(U)	1200(47-1/4)	1252(49-5/16)	1403(55-1/4)	1443(56-13/16)
GMV-ND24TS/A-T(U)				

### 3.7.2 Installation Space

Unit: mm (inch)

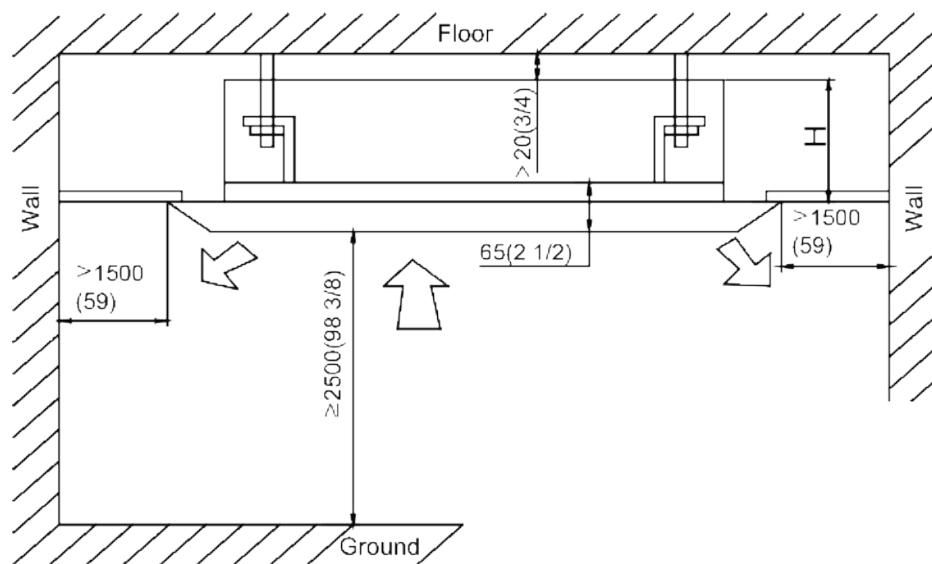

### 3.7.3 Installation Notice


- The unit shall be installed by the professional personnel according to this installation instruction to ensure proper use.
- Please contact the local Gree appointed service center before installation. Any malfunction caused by the unit that is not installed by the Gree appointed service center would probably not be dealt with on time because of the inconvenience of the business contact.
- It should be guided under the professional personnel when the air conditioner unit is moved to other place.
- The unit shall be installed in accordance with national standards or local regulations.
- Only qualified personnel can carry out installation work, please contact with local dealer before installation.
- Make sure all the installation work completed before energizing.

### 3.7.4 Selection of Air Switch and Power Cord

Model	Power Cord Size	Air Switch apacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-ND09TS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND12TS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND15TS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND18TS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND24TS/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18

## 3.8 Installation of Floor Ceiling Type Indoor Unit

### 3.8.1 Outline and Installation Dimension

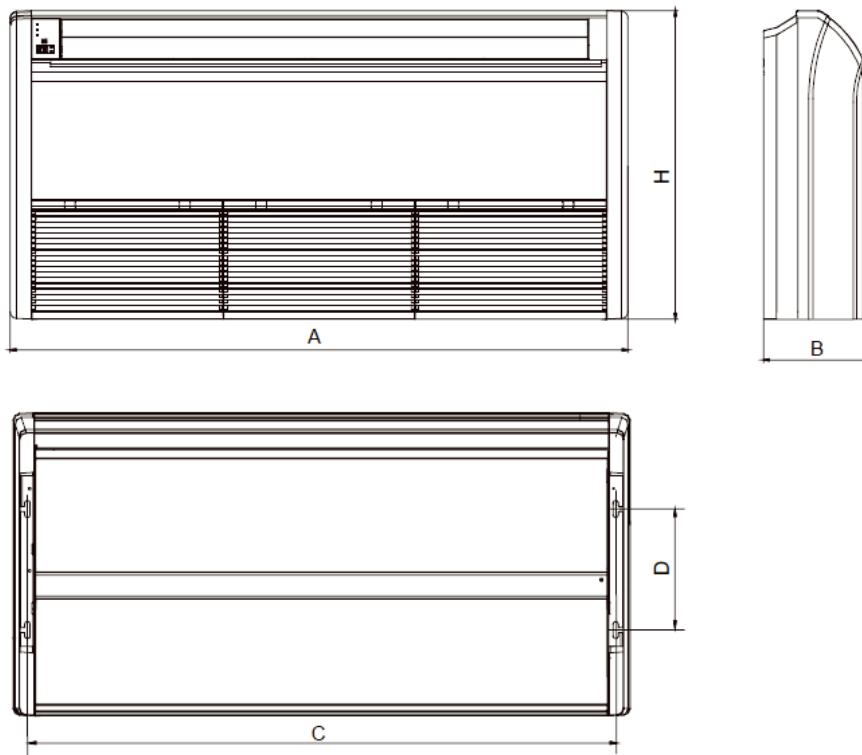


Below are dimensions of A, B, C, etc. for different models:

Unit: mm(inch)


Models	A	B	C	D	H
GMV-ND09ZD/A-T(U)	1220 (48)	225 (8-7/8)	1158 (45-5/8)	280 (11)	700 (27-9/16)
GMV-ND12ZD/A-T(U)					
GMV-ND18ZD/A-T(U)					
GMV-ND24ZD/A-T(U)	1420 (56)	245 (9-5/8)	1354 (53-5/16)	280 (11)	700 (27-9/16)
GMV-ND30ZD/A-T(U)					
GMV-ND36ZD/A-T(U)	1700 (66-15/16)	245 (9-5/8)	1634 (64-5/16)	280 (11)	700 (27-9/16)
GMV-ND42ZD/A-T(U)					
GMV-ND48ZD/A-T(U)					

### 3.8.2 Installation Space

Floor type

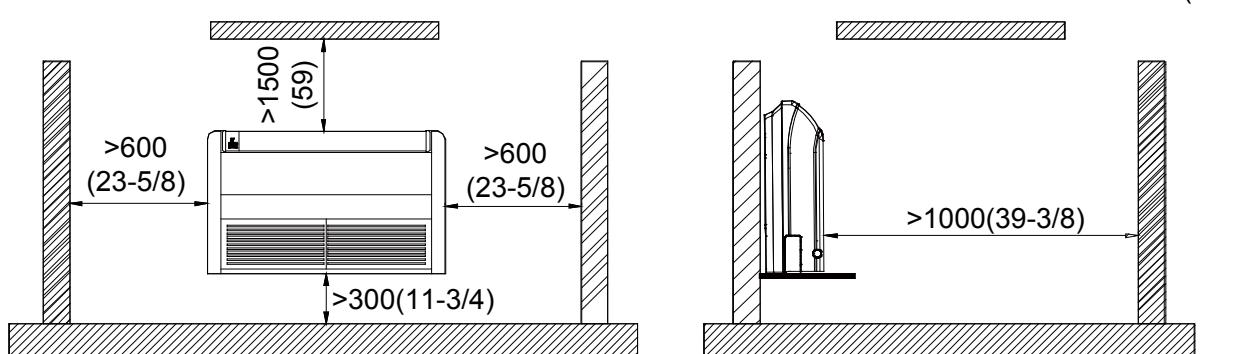

Ceiling type

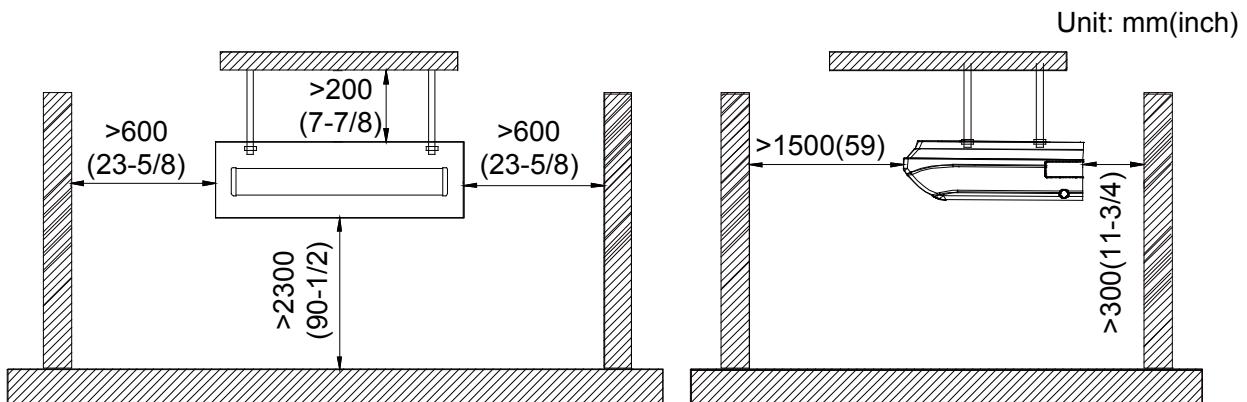

### 3.8.3 Installation Notice

- The unit shall be installed by the professional personnel according to this installation instruction to ensure proper use.
- Please contact the local Gree appointed service center before installation. Any malfunction caused by the unit that is not installed by the Gree appointed service center would probably not be dealt with on time because of the inconvenience of the business contact.
- It should be guided under the professional personnel when the air conditioner unit is moved to other place.
- The unit shall be installed in accordance with national standards or local regulations.
- Only qualified personnel can carry out installation work, please contact with local dealer before installation.


- Make sure all the installation work completed before energizing.

### 3.8.4 Selection of Air Switch and Power Cord

Model	Power Cord Size	Air Switch capacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-ND09ZD/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND12ZD/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND18ZD/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND24ZD/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND30ZD/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND36ZD/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND42ZD/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND48ZD/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18

## 3.9 Installation of Fresh Air Processing Indoor Unit


### 3.9.1 Outline and Installation Dimension

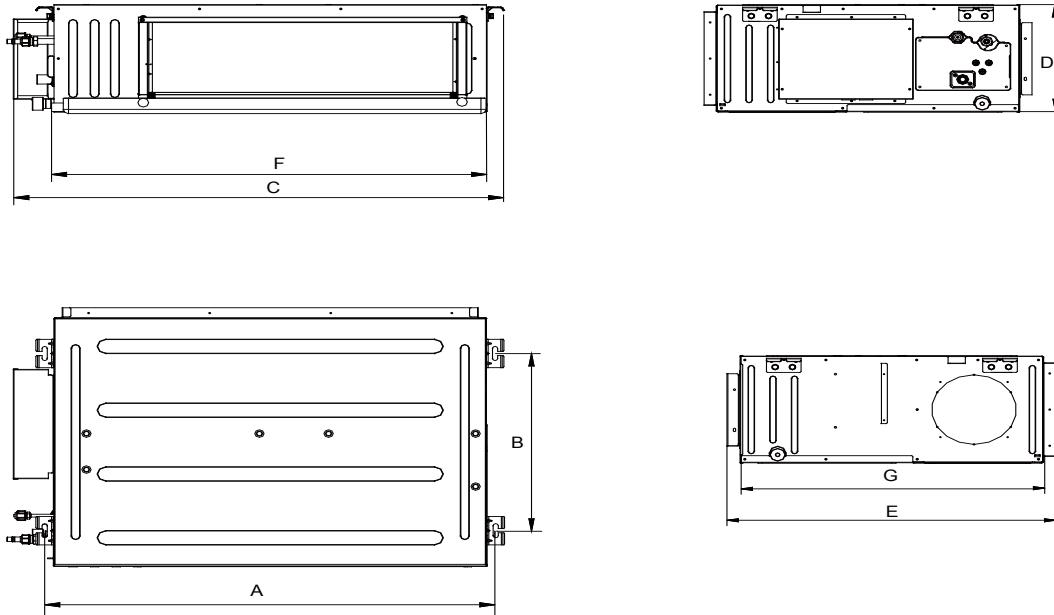

The table below lists the detailed dimensions.

Unit: mm(inch)

Model	A	B	C	D	E	F	G
GMV-NDX42P/A-T(U)	1440 (56-11/16)	500 (19-11/16)	1580 (62-7/32)	300 (11-13/16)	754 (29-11/16)	1400 (55-1/8)	700 (27-9/16)
GMV-NDX48P/A-T(U)	1440 (56-11/16)	500 (19-11/16)	1580 (62-7/32)	300 (11-13/16)	754 (29-11/16)	1400 (55-1/8)	700 (27-9/16)

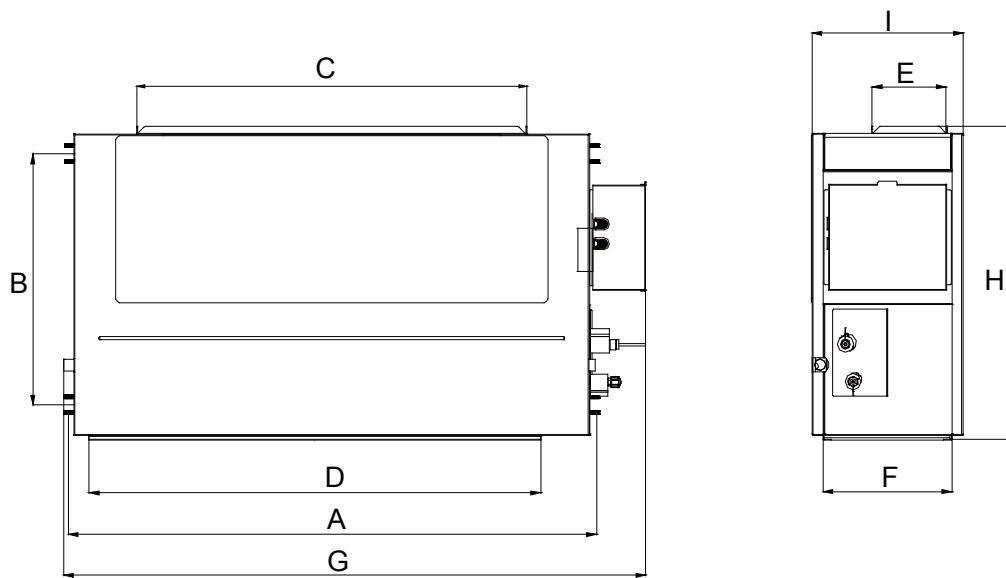


The table below lists the detailed dimensions.

Unit: mm(inch)

Item Model	A	B	C	D	E	F	G	H	I
GMV-NDX54P/A-T(U)	1353 (53-1/4)	632 (24-7/8)	992 (39)	1150 (45-1/4)	192 (7-1/2)	327 (12-7/8)	1483 (58-3/8)	791 (31-1/8)	385 (15-3/16)
GMV-NDX72P/A-T(U)	1353 (53-1/4)	632 (24-7/8)	992 (39)	1150 (45-1/4)	192 (7-1/2)	327 (12-7/8)	1483 (58-3/8)	791 (31-1/8)	385 (15-3/16)
GMV-NDX96P/A-T(U)	1353 (53-1/4)	632 (24-7/8)	992 (39)	1150 (45-1/4)	192 (7-1/2)	327 (12-7/8)	1483 (58-3/8)	791 (31-1/8)	385 (15-3/16)

### 3.9.2 Installation Space

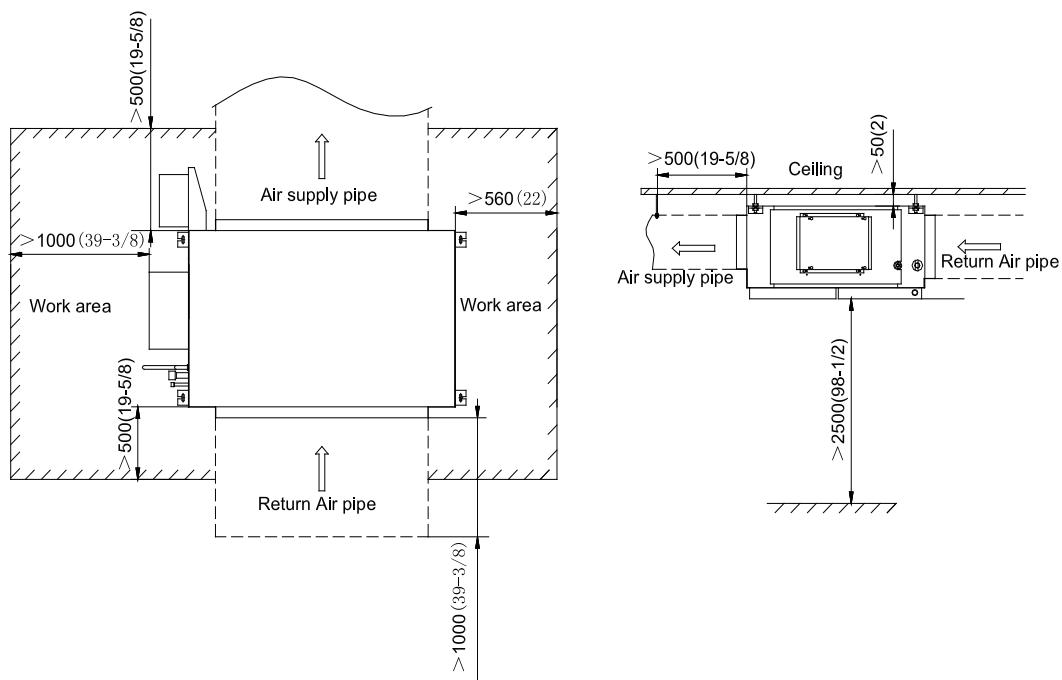

#### NOTICE!

- ① Installation of the unit must be in accordance with National Electric Codes and local safety regulations.
- ② Improper installation will affect unit's performance, so do not install the unit by yourself. Please

contact local dealer to arrange professional technicians for the installation.

- ③ Do not connect power until all installation work is finished.

### 3.9.3 Installation Notice


- The unit shall be installed by the professional personnel according to this installation instruction to ensure proper use.
- Please contact the local Gree appointed service center before installation. Any malfunction caused by the unit that is not installed by the Gree appointed service center would probably not be dealt with on time because of the inconvenience of the business contact.
- It should be guided under the professional personnel when the air conditioner unit is moved to other place.

### 3.9.4 Selection of Air Switch and Power Cord

Model	Power Cord Size	Air Switch capacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-NDX42P/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-NDX48P/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-NDX54P/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-NDX72P/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-NDX96P/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18

## 3.10 Installation of Compact Four-way Cassette Type Indoor Unit

### 3.10.1 Outline and installation dimension

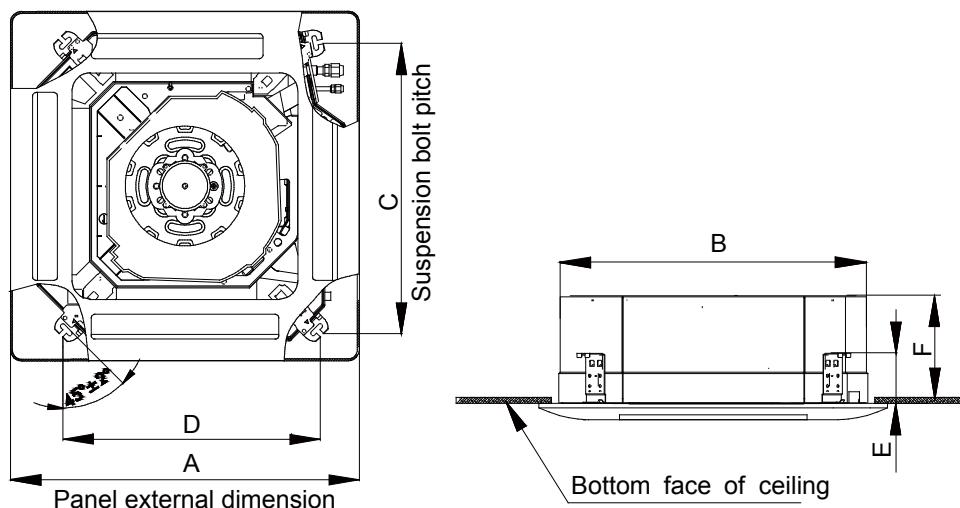


Unit: mm(inch)

Model	A	B	C	D	E	F
GMV-ND07T/B-T(U)						
GMV-ND09T/B-T(U)						
GMV-ND12T/B-T(U)						
GMV-ND15T/B-T(U)						
GMV-ND18T/B-T(U)						
	670 (26-3/8)	596 (23-1/2)	592 (23-5/16)	571 (22-1/2)	145 (5-11/16)	240 (9-1/2)

### 3.10.2 Installation space

Unit: mm(inch)

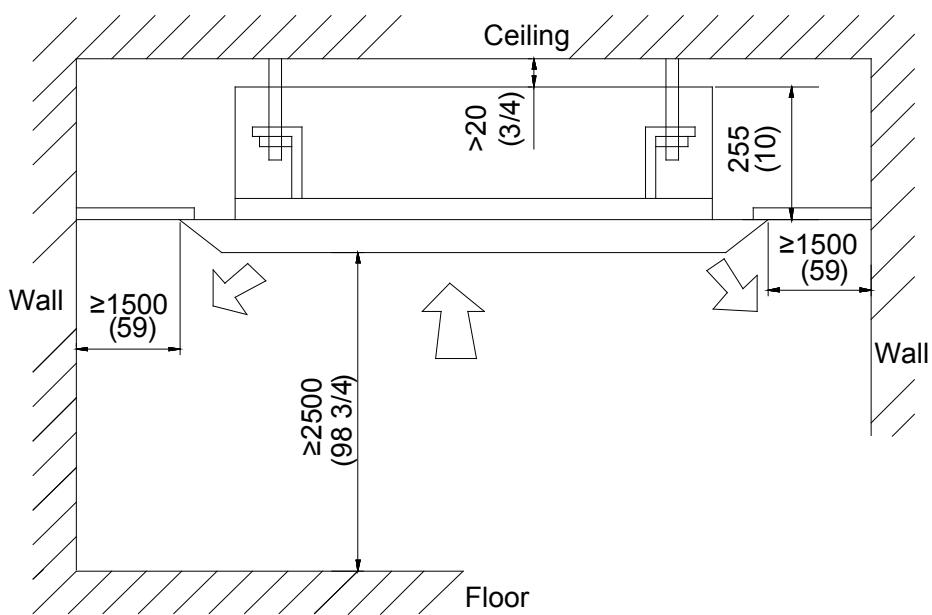

### 3.10.3 Installation notice


- The unit shall be installed by the professional personnel according to this installation instruction to ensure proper use.
- Please contact the local Gree appointed service center before installation. Any malfunction caused by the unit that is not installed by the Gree appointed service center would probably not be dealt with on time because of the inconvenience of the business contact.
- It should be guided under the professional personnel when the air conditioner unit is moved to other place.
- The unit shall be installed in accordance with national standards or local regulations.
- Only qualified personnel can carry out installation work, please contact with local dealer before installation.
- Make sure all the installation work completed before energizing.
- The appliances are not accessible to general public.

### 3.10.4 Selection of air switch and power cord

Model	Power Cord Size	Air Switch capacity (A)	Minimum Sectional Area of Ground Wire (AWG)	Minimum Sectional Area of Power Cord (AWG)
GMV-ND07T/B-T(U)	208/230V~,60Hz	15	AWG18	AWG18
GMV-ND09T/B-T(U)	208/230V~,60Hz	15	AWG18	AWG18
GMV-ND12T/B-T(U)	208/230V~,60Hz	15	AWG18	AWG18
GMV-ND15T/B-T(U)	208/230V~,60Hz	15	AWG18	AWG18
GMV-ND18T/B-T(U)	208/230V~,60Hz	15	AWG18	AWG18

### 3.11 Installation of Super High Static Pressure Duct Type Indoor Unit


#### 3.11.1 Outline and Installation Dimension

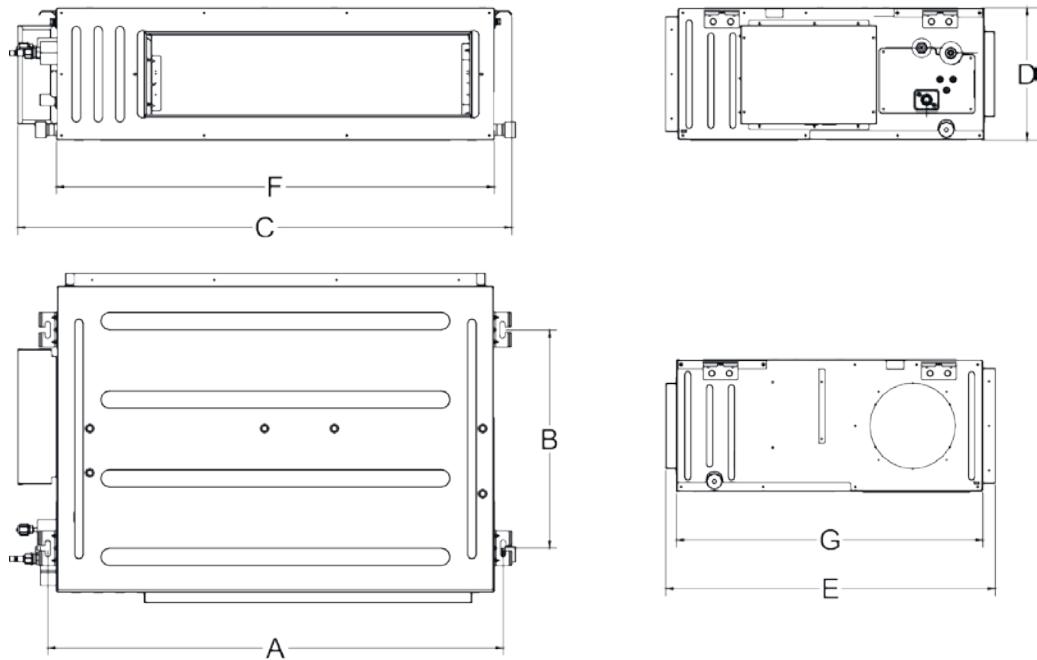

Below are dimensions of A, B, C, etc. for different models:

Unit: mm(inch)

Model	A	B	C	D	E	F	G
GMV-ND07~09PHS/B-T(U)	740 (29-1/8)	500 (19-11/16)	830 (32-11/16)	300 (11-13/16)	754 (29-11/16)	700 (27-9/16)	700 (27-9/16)
GMV-ND12~24PHS/B-T(U)	1040 (40-15/16)	500 (19-11/16)	1130 (44-31/64)	300 (11-13/16)	754 (29-11/16)	1000 (39-3/8)	700 (27-9/16)
GMV-ND30~42PHS/B-T(U)	1440 (56-11/16)	500 (19-11/16)	1530 (60-1/4)	300 (11-13/16)	754 (29-11/16)	1400 (55-1/8)	700 (27-9/16)
GMV-ND48~54PHS/B-T(U)	1440 (56-11/16)	500 (19-11/16)	1580 (62-7/32)	300 (11-13/16)	754 (29-11/16)	1400 (55-1/8)	700 (27-9/16)

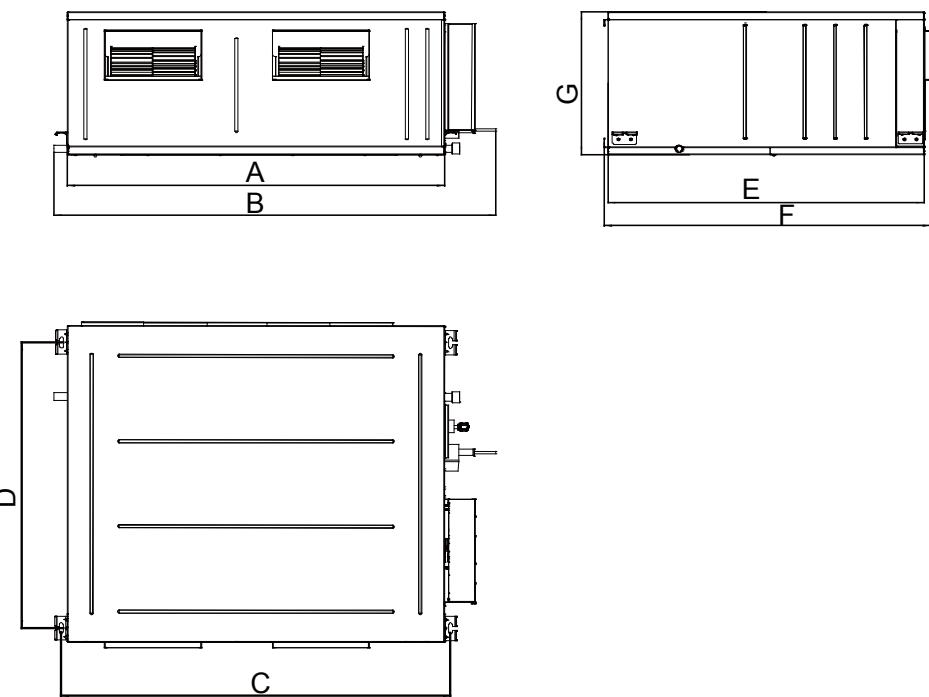

Below are dimensions of A, B, C, etc. for different models:


Unit: mm(inch)

Model	A	B	C	D	E	F	G
GMV-ND72~96PH/B-T(U)	1240 (48-3/4)	1452 (57-1/8)	1280 (50-3/8)	940 (38)	1040 (41)	1071 (42-1/8)	470 (18-1/2)



### 3.11.2 Installation space

Unit: mm(inch)

GMV-ND07 ~ 54PHS/B-T(U)

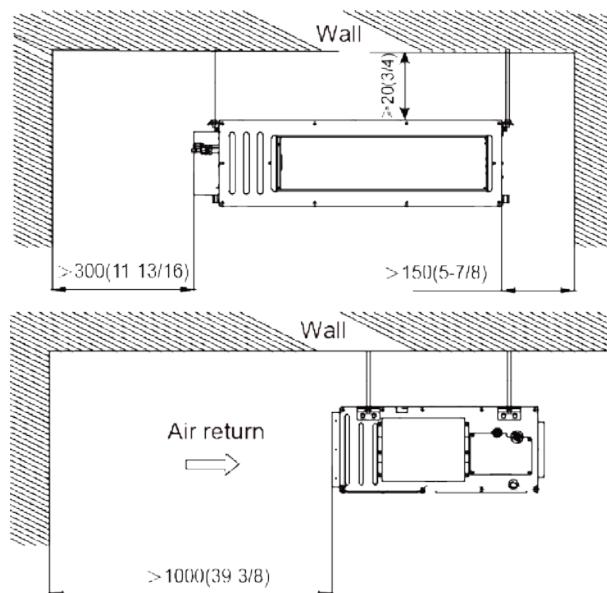

GMV-ND72 ~ 96PH/B-T(U)

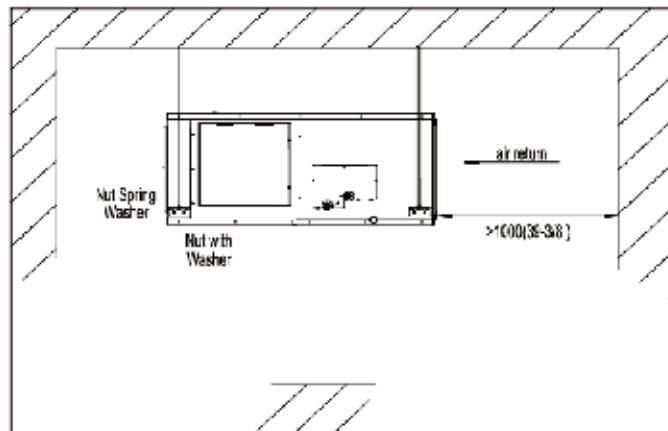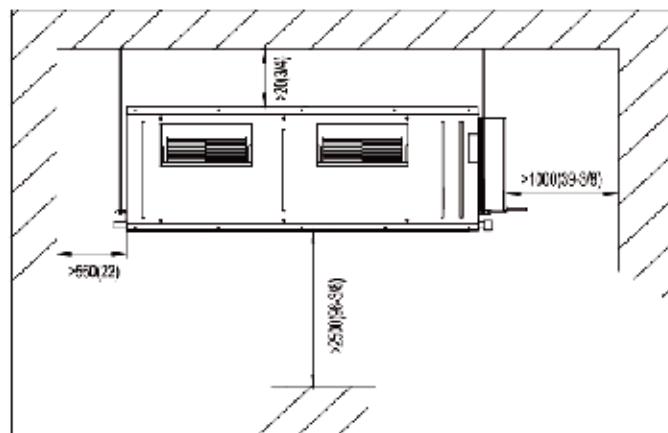

### 3.11.3 Installation notice


- The unit shall be installed by the professional personnel according to this installation instruction to ensure proper use.
- Please contact the local Gree appointed service center before installation. Any malfunction caused by the unit that is not installed by the Gree appointed service center would probably not be dealt with on time because of the inconvenience of the business contact.
- It should be guided under the professional personnel when the air conditioner unit is moved to other place.
- Installation of the unit must be in accordance with National Electric Codes and local regulations.
- Improper installation will affect unit's performance, so do not install the unit by yourself. Please contact local dealer to arrange professional technicians for the installation.
- Do not connect power until all installation work is finished.
- If the supply cord is damaged, it must be replaced by the manufacturer or its service agent or a similarly qualified person in order to avoid a hazard.

### 3.11.4 Selection of air switch and power cord

Model	Power Cord Size	Air Switch Capacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-ND07PHS/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND09PHS/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND12PHS/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND15PHS/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND18PHS/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND22PHS/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND24PHS/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND30PHS/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND36PHS/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND42PHS/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND48PHS/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND54PHS/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND72PH/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND96PH/B-T(U)	208-230V~60Hz	15	1.0/AWG18	1.0/AWG18

### 3.12 Installation of Air Handler type Indoor Unit

#### 3.12.1 Outline and installation dimension

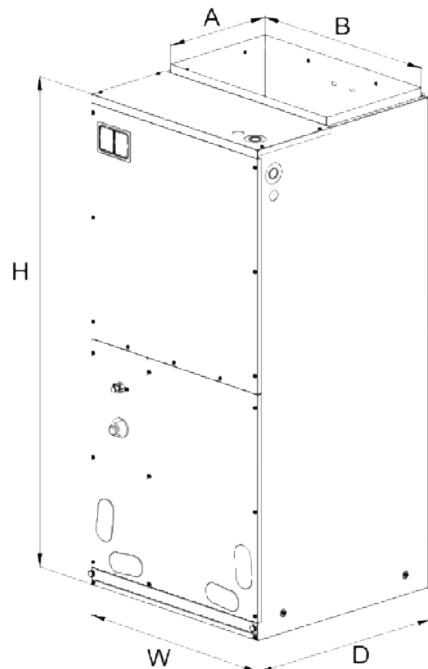

Unit: mm(inch)

MODEL	DIMENSION				
	W	D	H	A	B
GMV-ND09A/A-T(U)	460 (18-1/8)	540 (21-1/4)	1105 (43-1/2)	295 (11-5/8)	426 (16-3/4)
GMV-ND12A/A-T(U)	460 (18-1/8)	540 (21-1/4)	1105 (43-1/2)	295 (11-5/8)	426 (16-3/4)
GMV-ND18A/A-T(U)	460 (18-1/8)	540 (21-1/4)	1105 (43-1/2)	295 (11-5/8)	426 (16-3/4)
GMV-ND24A/A-T(U)	460 (18-1/8)	540 (21-1/4)	1105 (43-1/2)	295 (11-5/8)	426 (16-3/4)
GMV-ND30A/A-T(U)	460 (18-1/8)	540 (21-1/4)	1105 (43-1/2)	295 (11-5/8)	426 (16-3/4)
GMV-ND36A/A-T(U)	540 (21-1/4)	540 (21-1/4)	1224 (48-1/4)	295 (11-5/8)	508 (20)
GMV-ND42A/A-T(U)	540 (21-1/4)	540 (21-1/4)	1224 (48-1/4)	295 (11-5/8)	508 (20)
GMV-ND48A/A-T(U)	630 (24-7/8)	540 (21-1/4)	1224 (48-1/4)	295 (11-5/8)	508 (20)
GMV-ND54A/A-T(U)	630 (24-7/8)	540 (21-1/4)	1224 (48-1/4)	295 (11-5/8)	508 (20)


### 3.12.2 Installation notice

When installing the air handler, take consideration to minimize the length of refrigerant tubing as much as possible. Do not install the air handler in a location either above or below the condenser that violates the instructions provided with the condenser. Service clearance is to take precedence. Allow a minimum of 24" in front of the unit for service clearance. When installing in an area directly over a finished ceiling (such as an attic), an emergency drain pan is required directly under the unit. See local and state codes for requirements. When installing this unit in an area that may become wet, elevate the unit with a sturdy, non-porous material. In installations that may lead to physical damage (i.e. a garage) it is advised to install a protective barrier to prevent such damage.

This air handler is designed for a complete supply and return ductwork system. Do not operate this product without all ductwork attached.

Based upon the actual conditions, if air handler is installed as type (A), the air handler should be concealed in a specific room or space and make sure the air handler is not accessible to the general public.

Based upon the actual conditions, if air handler is installed as type (B), make sure that there is enough space for care and maintenance and the height between the air handler and ground is above 2500mm. And the air handler is not accessible to the general public.

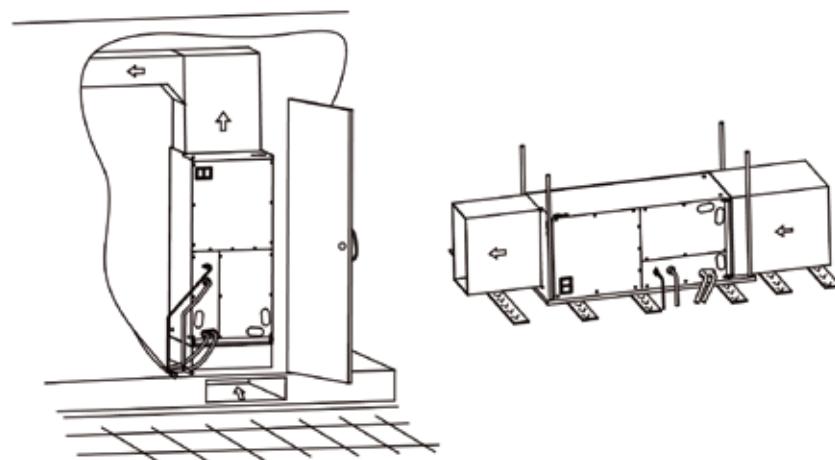

### 3.12.3 Selection of air switch and power cord


Model	Power Supply	Circuit Breaker Capacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-ND09A/A-T(U)	208/230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND12A/A-T(U)	208/230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND18A/A-T(U)	208/230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND24A/A-T(U)	208/230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND30A/A-T(U)	208/230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND36A/A-T(U)	208/230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND42A/A-T(U)	208/230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND48A/A-T(U)	208/230V~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND54A/A-T(U)	208/230V~60Hz	15	1.0/AWG18	1.0/AWG18

## 3.13 Installation of AHU-KIT


### 3.13.1 Outline and installation dimension

Size of control box for GMV-N12U/A-T(U) / GMV-N24U/A-T(U) / GMV-N48U/A-T(U) / GMV-N96U/A-T(U) and GMV-N192U/A-T(U):


Unit: mm(inch)

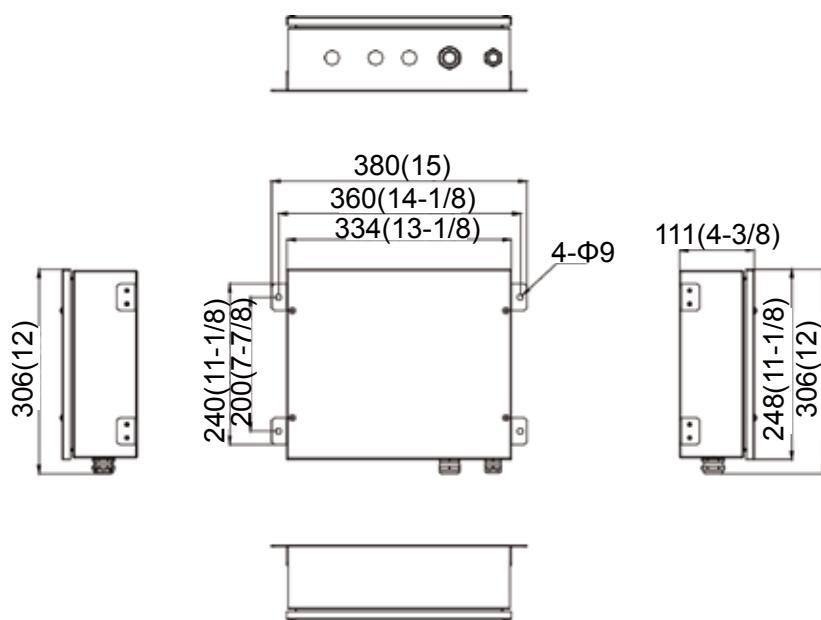

Size of EXV box for GMV-N12U/A-T(U) / GMV-N24U/A-T(U) / GMV-N48U/A-T(U) / GMV-N96U/A-T(U):


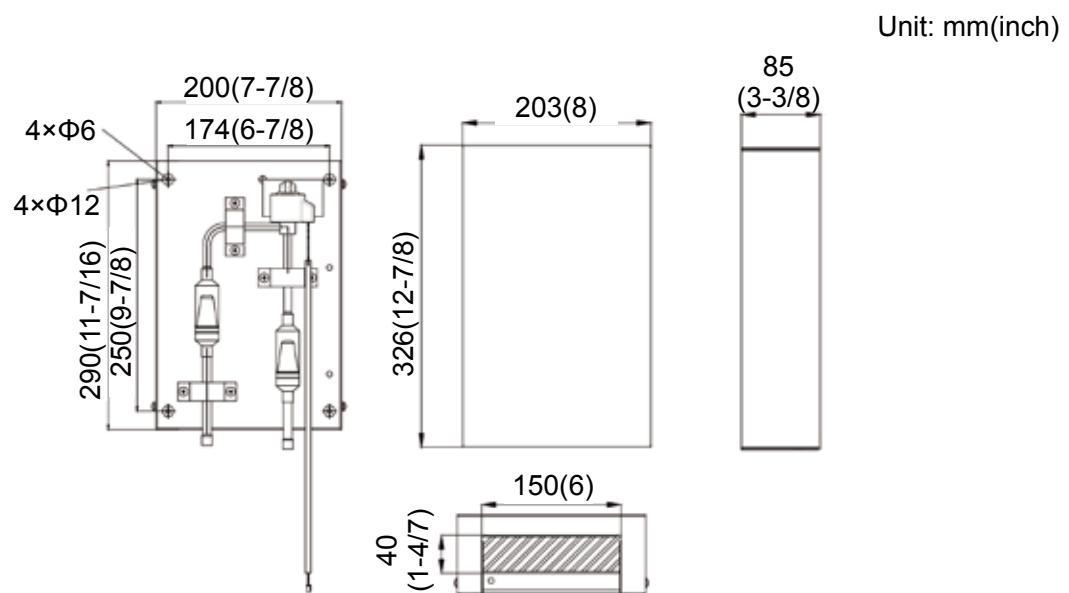


Size of EXV box for GMV-N192U/A-T(U):

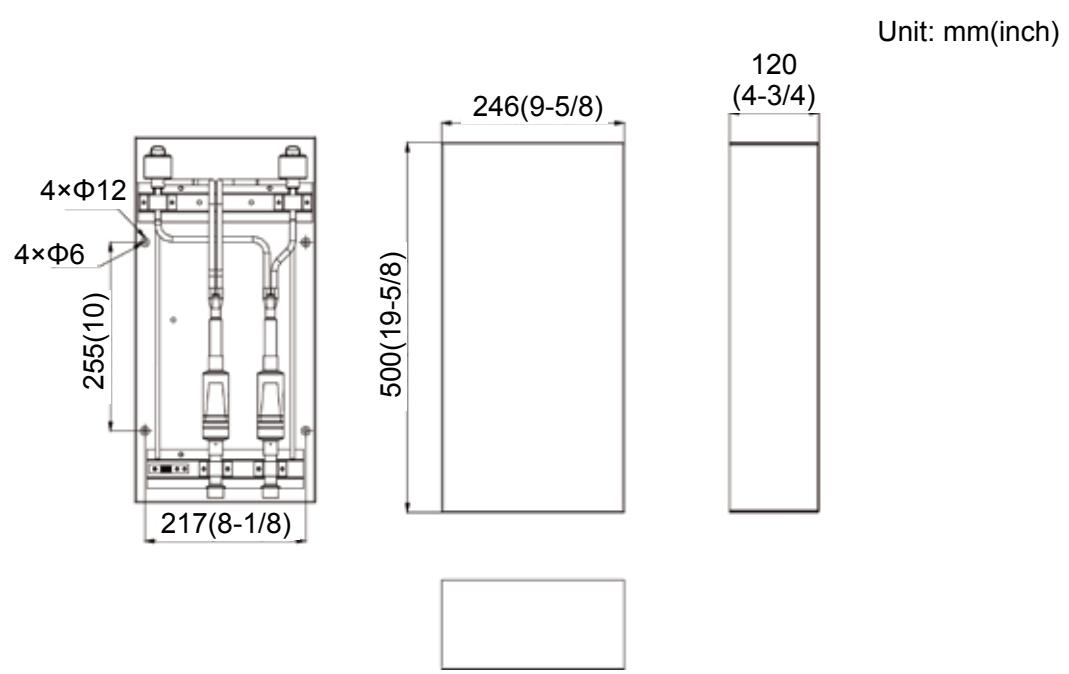

## Maintenance space of control space:



Unit: mm(inch)

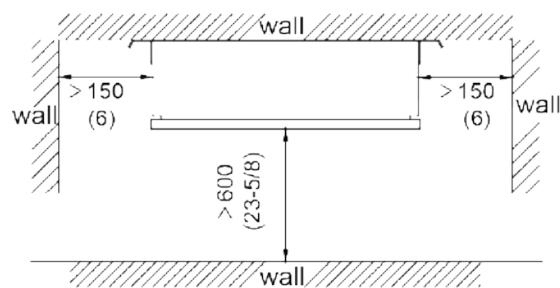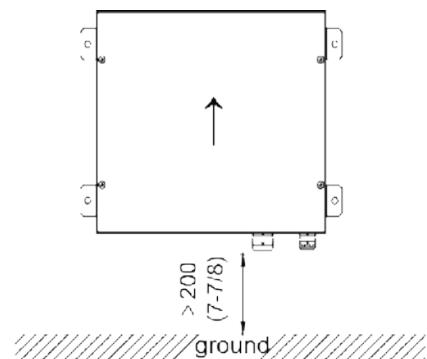

The control box must be installed upwards as the direction of the arrow shown in the figure

## Maintenance space of EXV box:



Unit: mm(inch)

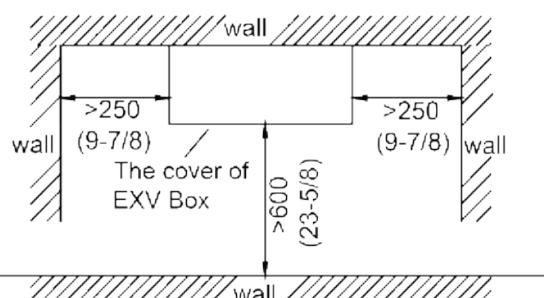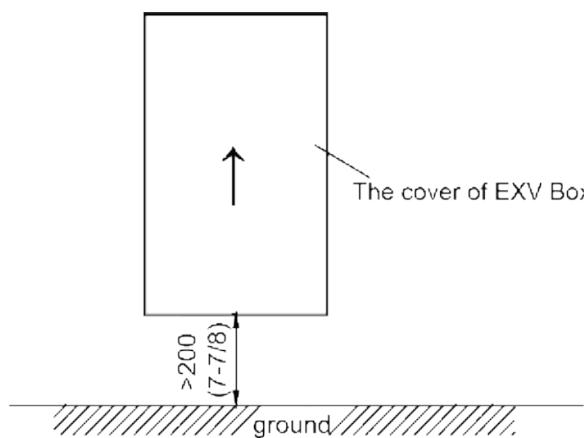

The EXV box must be installed upwards as the direction of the arrow shown in the figure


Size of control box for GMV-N12U/C-T(U) / GMV-N24U/C-T(U) / GMV-N48U/C-T(U) / GMV-N96U/C-T(U) and GMV-N192U/C-T(U) :

Unit: mm(inch)

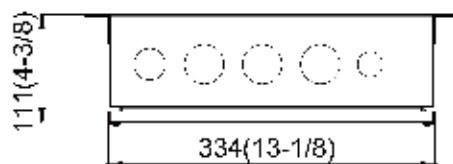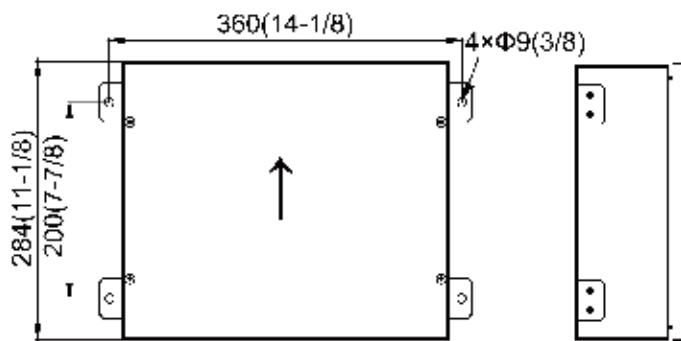


Size of EXV box for GMV-N12U/C-T(U):

Unit: mm(inch)

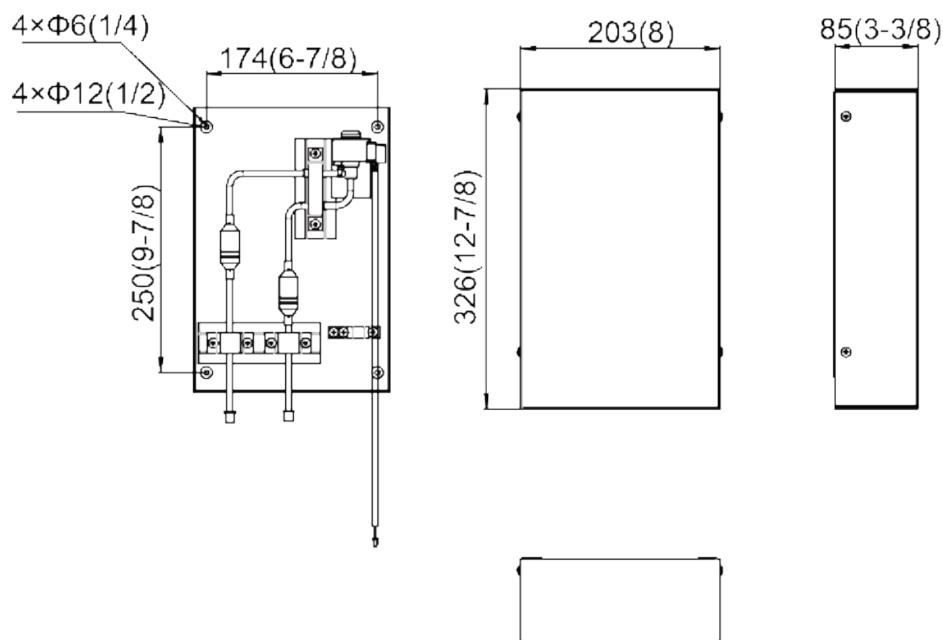


Size of EXV box for GMV-N24U/C-T(U) , GMV-N48U/C-T(U) , GMV-N96U/C-T(U):

Unit: mm(inch)

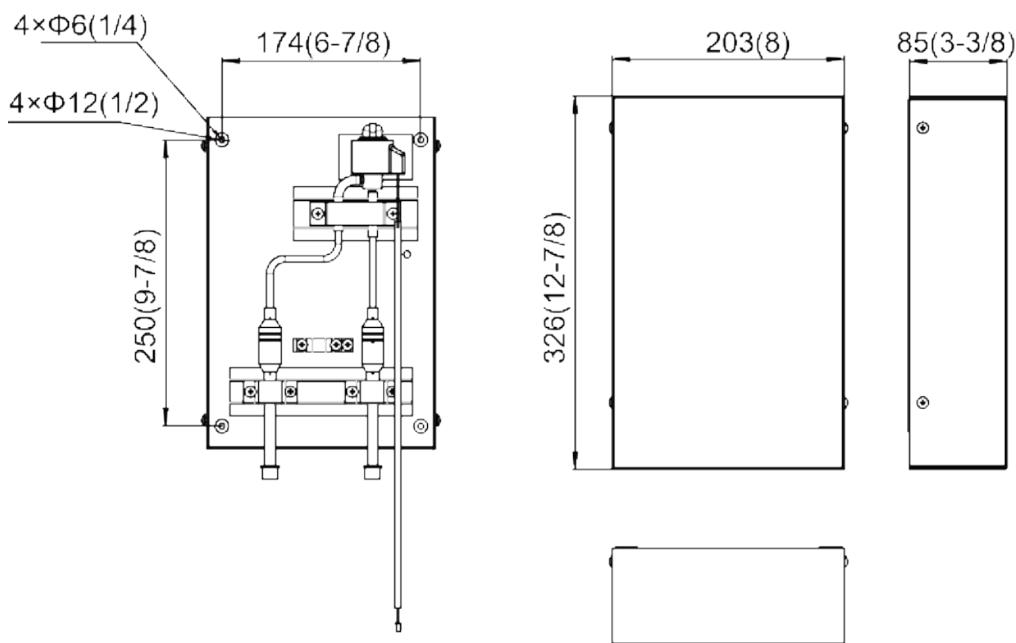


Size of EXV box for GMV-N192U/C-T(U):

Unit: mm(inch)

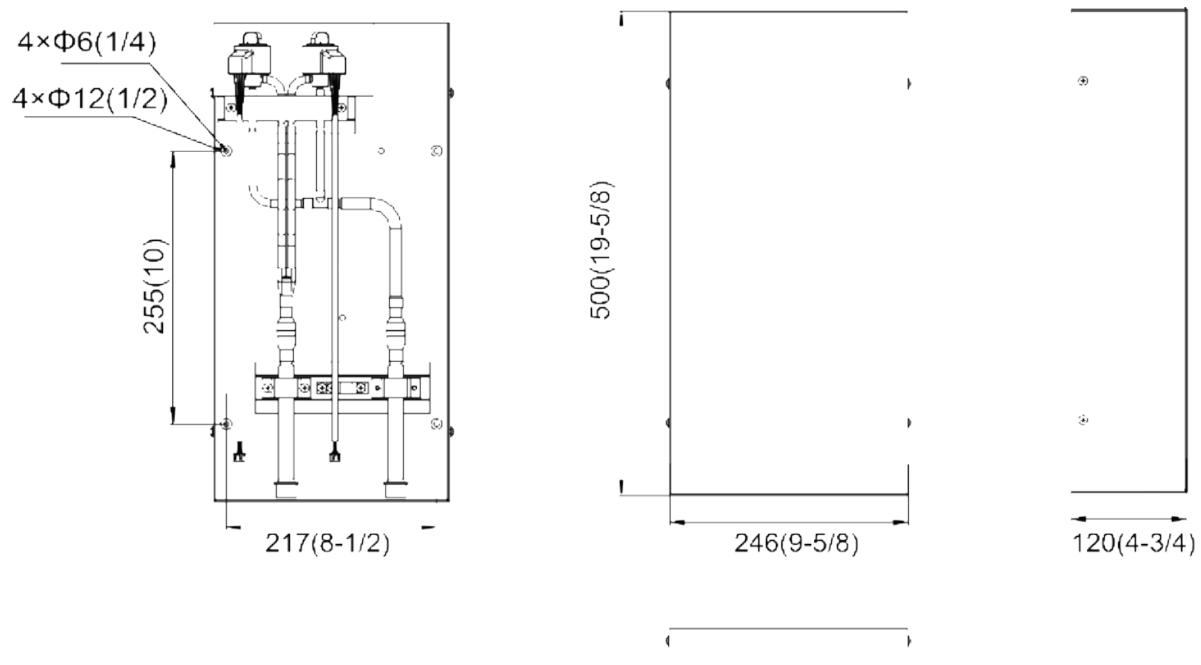

Maintenance space of control space:



Unit: mm(inch)

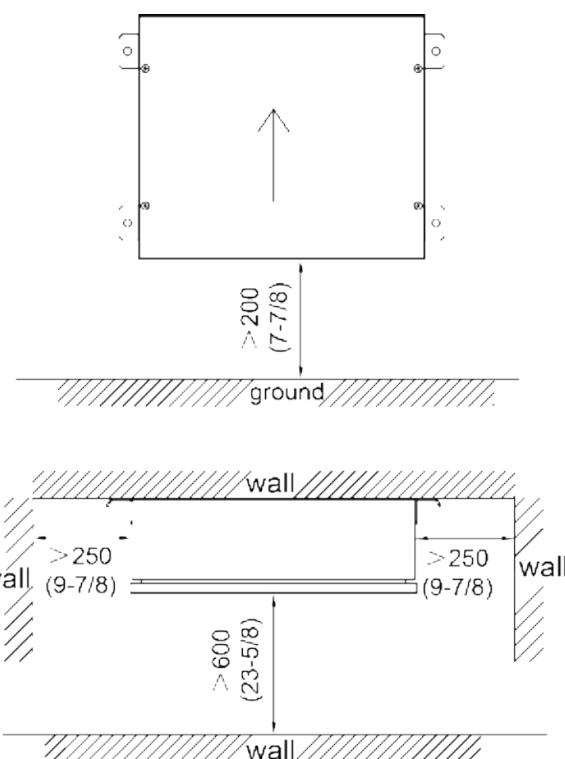

The control box must be installed upwards as the direction of the arrow shown in the figure

Maintenance space of EXV box:

Unit: mm(inch)

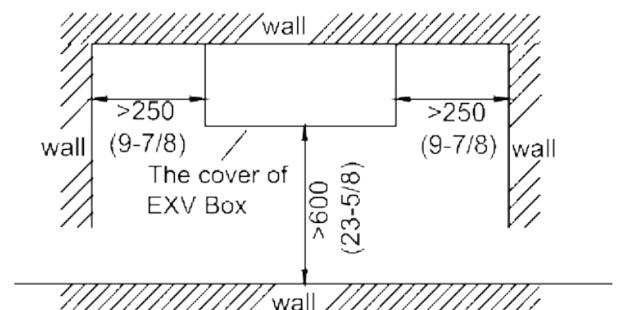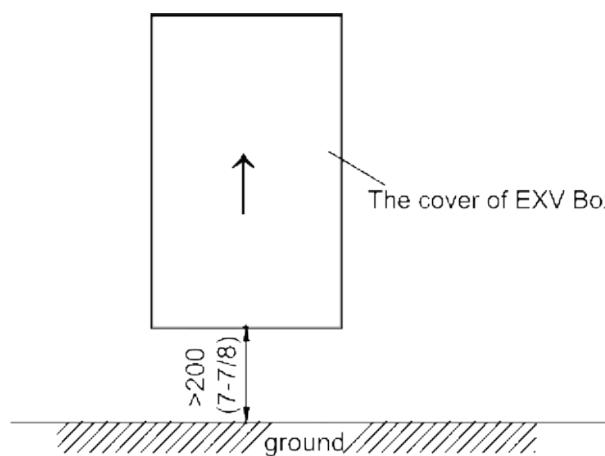

The EXV box must be installed upwards as the direction of the arrow shown in the figure

### 3.13.2 Installation notice

- The EXV box can be installed inside and outside. The control box should be installed inside.
- Do not install the EXV box in or on the outdoor unit.
- Do not put the option boxes in direct sunlight. Direct sunlight will increase the temperature inside the option boxes and may reduce its lifetime and influence its operation.
- Choose a flat and strong mounting surface.
- Make sure there is enough free space in front and in the side of the AHU-KIT unit for future maintenance.
- The installation site should be far away from heat source, inflammable gas and smoke.
- Keep the air handling unit, power supply wiring and transmission wiring at least 1 m(39-3/8 inch) away from televisions and radios. This is to prevent image interference and noise in those electrical appliances (Noise may be generated depending on the conditions under which the electric wave is generated, even if 1 m(39-3/8 inch) is kept).
- Make sure the electronic expansion valve is installed in an upright position.


### 3.13.3 Selection of air switch and power cord

Model	Power Supply	Circuit Breaker Capacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-N12U/A-T(U)	208/230V ~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-N24U/A-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-N48U/A-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-N96U/A-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-N192U/A-T(U)		15	1.0/AWG18	1.0/AWG18

Model	Power Supply	Circuit Breaker Capacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-N12U/C-T(U)	208/230V ~60Hz	15	1.0/AWG18	1.0/AWG18
GMV-N24U/C-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-N48U/C-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-N96U/C-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-N192U/C-T(U)		15	1.0/AWG18	1.0/AWG18

## 3.14 Installation of 1-way Cassette Type Indoor Unit


### 3.14.1 Outline and Installation Dimension

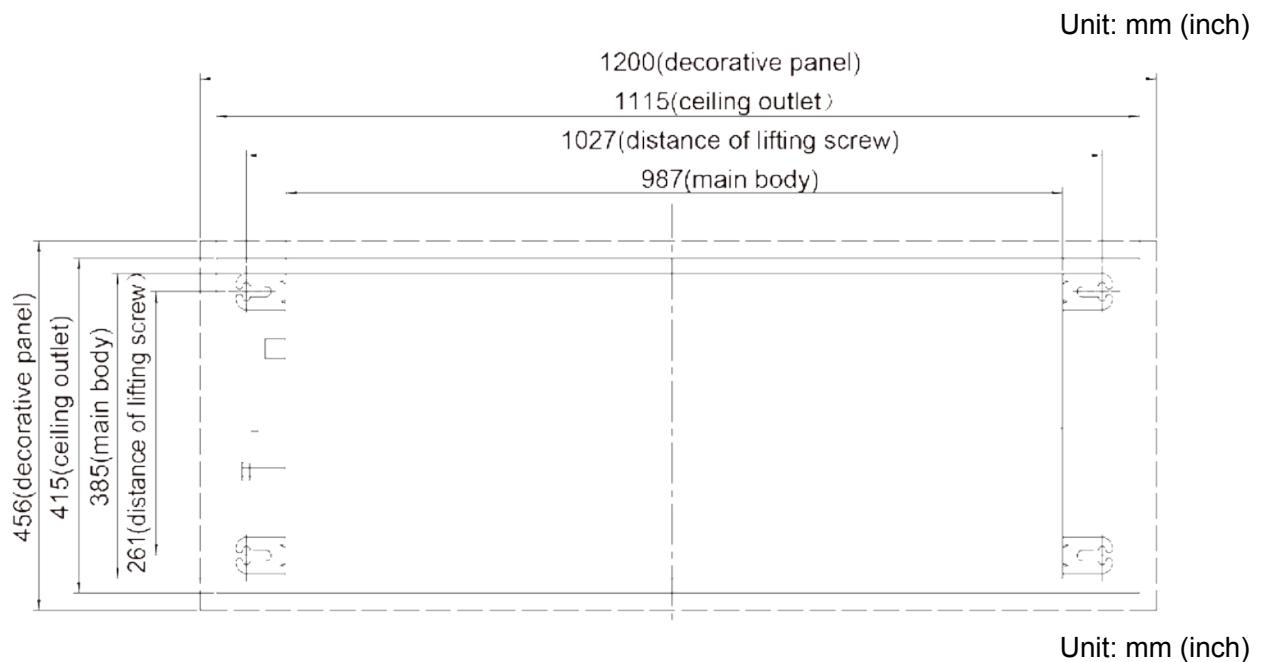

Model	Indoor unit(A)	Suspension bolt pitch(B)	Ceiling opening(C)	Decoration panel(D)
GMV-ND07TD/A-T(U)	987(38-7/8)	1027(40-3/8)	1115(43-7/8)	1200(47-1/4)
GMV-ND09TD/A-T(U)	987(38-7/8)	1027(40-3/8)	1115(43-7/8)	1200(47-1/4)
GMV-ND12TD/A-T(U)	987(38-7/8)	1027(40-3/8)	1115(43-7/8)	1200(47-1/4)

### 3.14.2 Installation Space

Unit: mm (inch)

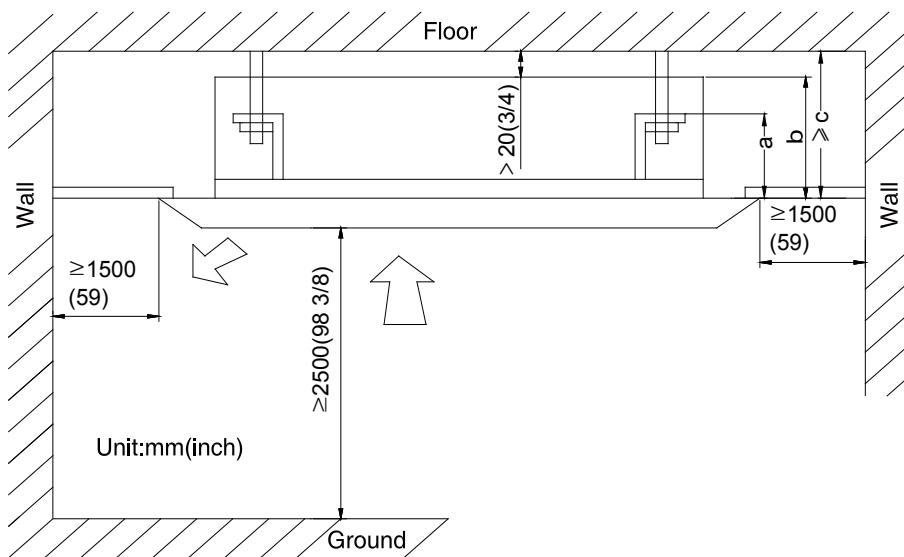

Model	a	b	c
07	141(5 1/2)	207(8 1/8)	227(8 7/8)
09	141(5 1/2)	207(8 1/8)	227(8 7/8)
12	141(5 1/2)	207(8 1/8)	227(8 7/8)

### 3.14.3 Installation Notice

- The unit shall be installed by the professional personnel according to this installation instruction to ensure proper use.
- Please contact the local Gree appointed service center before installation. Any malfunction caused by the unit that is not installed by the Gree appointed service center would probably not be dealt with on time because of the inconvenience of the business contact.
- It should be guided under the professional personnel when the air conditioner unit is moved to other place.
- The unit shall be installed in accordance with national standards or local regulations.
- Only qualified personnel can carry out installation work, please contact with local dealer before installation.
- Make sure all the installation work completed before energizing.


### 3.14.4 Selection of Air Switch and Power Cord

Model	Power Cord Size	Air Switch apacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-ND07TD/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND09TD/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND12TD/A-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18

## 3.15 Installation of General Static Pressure Duct Type Indoor Unit

### 3.15.1 Outline and Installation Dimension


The following diagram is applicable for units with the cooling capacity ranging from 30kBtu/h to 48kBtu/h.

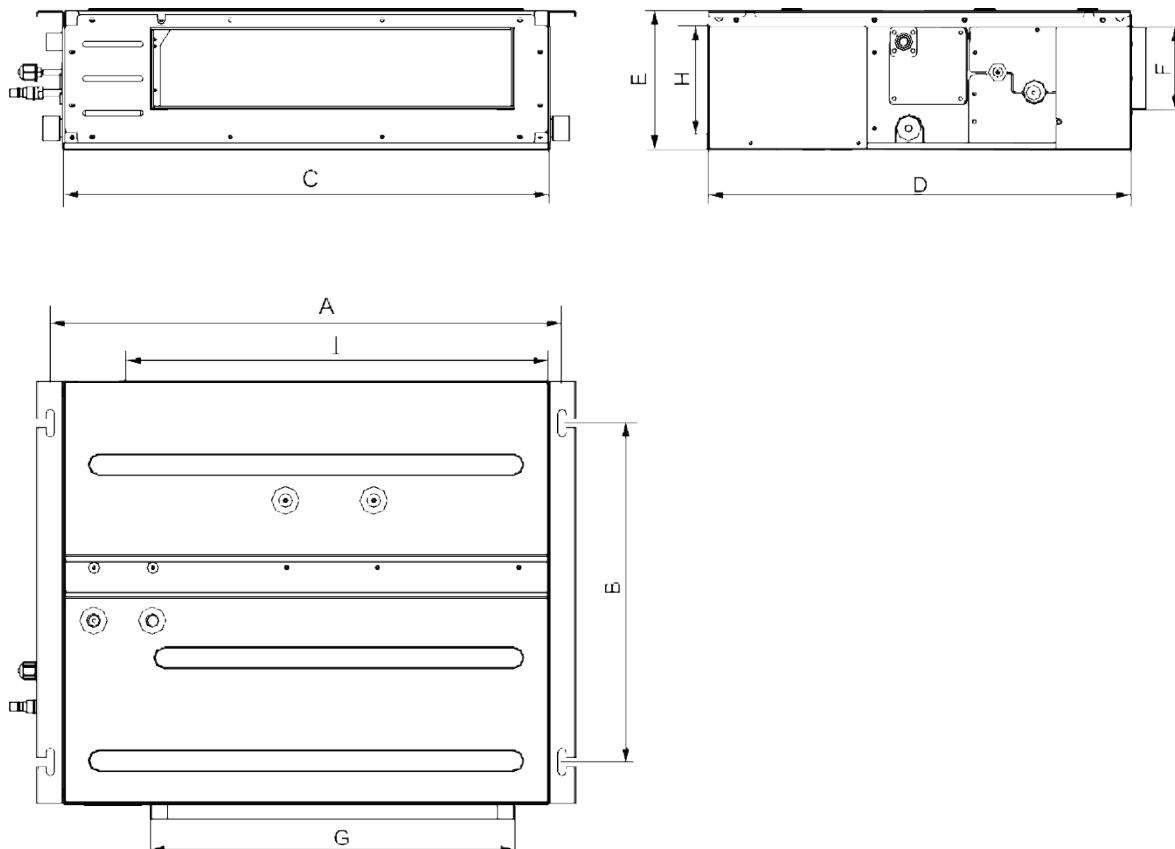

The following table lists the detailed dimensions.

Model \ Item	A	B	C	D	E	F	G	H	I
GMV-ND30PLS/C-T(U)									
GMV-ND36PLS/C-T(U)	1379 (54-5/16)	565 (22-1/4)	1340 (52-3/4)	655 (25-13/16)	260 (10-1/4)	207 (8-1/8)	1153 (45-3/8)	220 (8-11/16)	1188 (46-3/4)
GMV-ND42PLS/C-T(U)									
GMV-ND48PLS/C-T(U)									

### 3.15.2 Outline and Installation Dimension

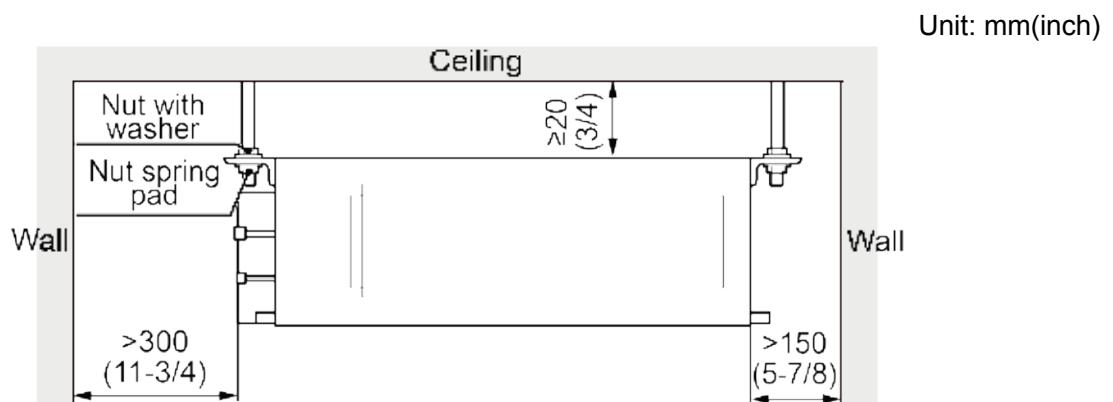

### 3.15.3 Installation Notice

- (1) Installation dimension (refer to the outline dimension in the figure).
- (2) Installation foundation.
- (3) Make sure the top hanging rod, ceiling and building structure have sufficient strength to withstand the weight of unit.
- (4) Installation site and environment.
  - 1) Keep the unit from insulation and rain.
  - 2) Keep the unit from fire, flammable objects, corrosive gas or exhaust gas.
  - 3) Please reserve ventilation space.
  - 4) Please reserve sufficient space for maintenance.
  - 5) Please take proper measures to reduce noise and vibration.
- (5) Electrical installation of unit.

All electrical installation must be done by professionals according to national and local laws and regulations.


The unit must be grounded reliably. Please connect wire according to the wiring diagram on the unit.

### 3.15.4 Selection of Air Switch and Power Cord

Model	Power Cord Size	Air Switch Capacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-ND30PLS/C-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND36PLS/C-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND42PLS/C-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND48PLS/C-T(U)	208/230V/60Hz	15	1.0/AWG18	1.0/AWG18

## 3.16 Installation of 360°Air Discharge Compact Cassette Type Indoor Unit

### 3.16.1 Outline and Installation Dimension

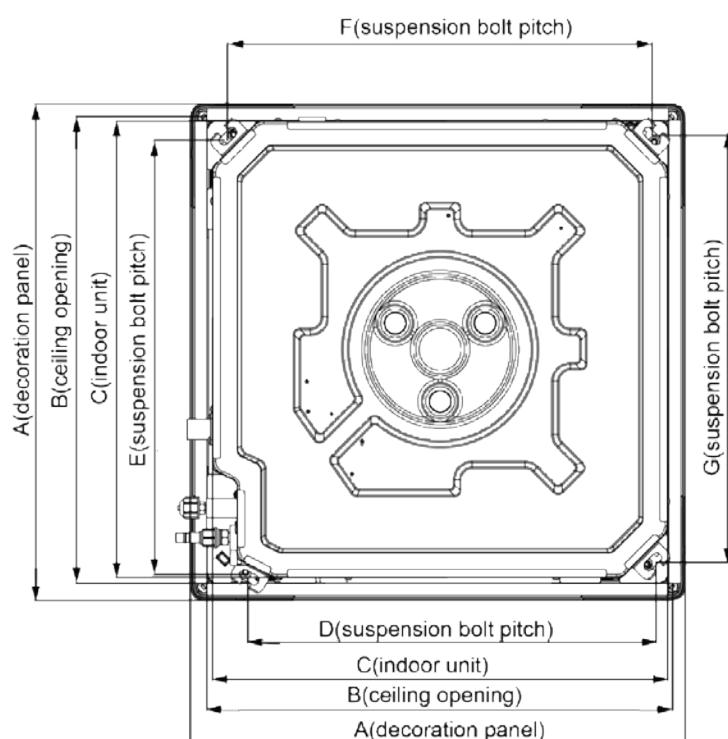


Unit: mm (inch)

Model	A	B	C	D	E	F	G
GMV-ND05T/E-T(U)							
GMV-ND07T/E-T(U)							
GMV-ND09T/E-T(U)	620 (24-3/8)	580 (22-13/16)	570 (22-7/16)	505 (19-7/8)	550 (22-5/8)	530 (20-7/8)	530 (20-7/8)
GMV-ND12T/E-T(U)							
GMV-ND15T/E-T(U)							
GMV-ND18T/E-T(U)							

### 3.16.2 Installation Space

Unit: mm (inch)

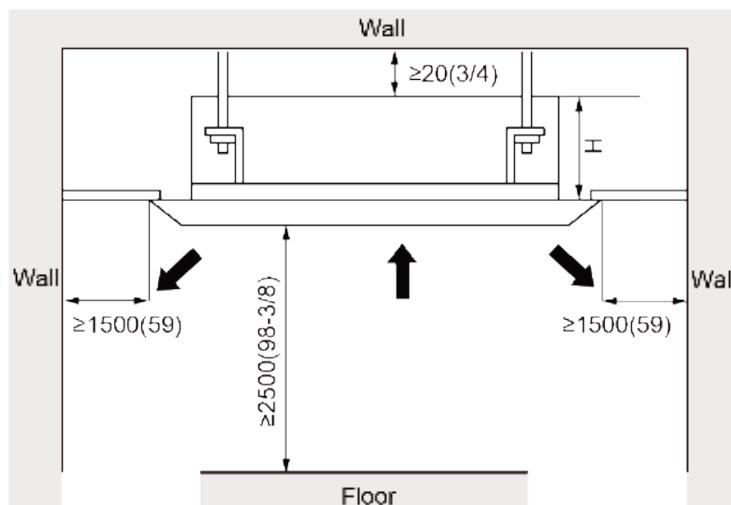

Unit: mm (inch)


Model	H
GMV-ND05~18T/E-T(U)	305(12)

### 3.16.3 Installation notice

- The unit shall be installed by the professional personnel according to this installation instruction to ensure proper use.
- Please contact the local Gree appointed service center before installation. Any malfunction caused by the unit that is not installed by the Gree appointed service center would probably not be dealt with on time because of the inconvenience of the business contact.
- It should be guided under the professional personnel when the air conditioner unit is moved to other place.
- The unit shall be installed in accordance with national standards or local regulations.
- Only qualified personnel can carry out installation work, please contact with local dealer before installation.
- Make sure all the installation work completed before energizing.
- The appliances are not accessible to general public.

### 3.17 Installation of 360°Air Discharge Cassette Type Indoor Unit

#### 3.17.1 Outline and Installation Dimension

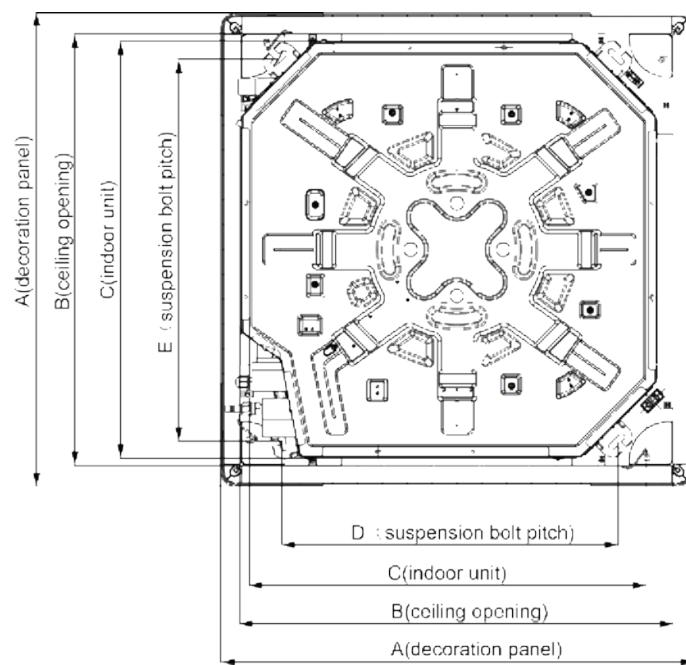


Unit: mm (inch)

Model	A	B	C	D	E
GMV-ND07~48T/C-T(U)	950(37 3/8)	890(35)	840(33 1/8)	680(26 3/4)	780(30 3/4)

#### 3.17.2 Installation Space

Unit: mm (inch)

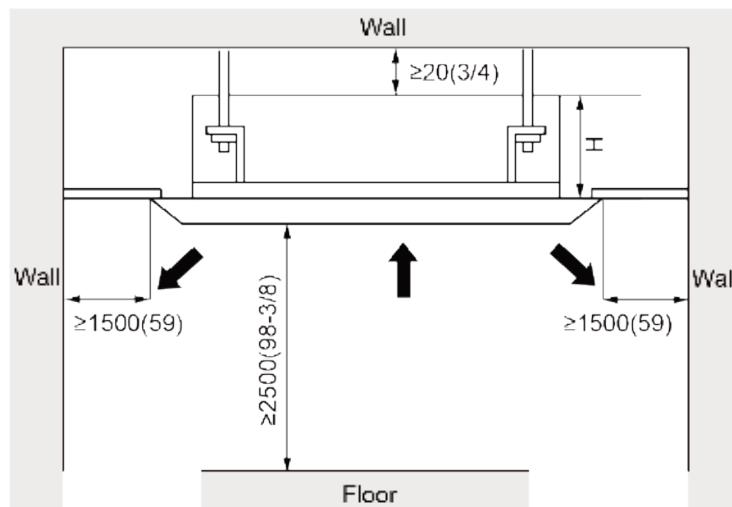

Unit: mm (inch)

Model	H
GMV-ND07~24T/C-T(U)	280(11)
GMV-ND30~48T/C-T(U)	330(13)

### 3.17.3 Installation notice

- The unit shall be installed in accordance with national standards or local regulations.
- Only qualified personnel can carry out installation work, please contact with local dealer before installation.
- Make sure all the installation work completed before energizing.
- The appliances are not accessible to general public.

### 3.17.4 Selection of Air Switch and Power Cord

Model	Power Cord Size	Air Switch capacity (A)	Minimum Sectional Area of Ground Wire (mm <sup>2</sup> /AWG)	Minimum Sectional Area of Power Cord (mm <sup>2</sup> /AWG)
GMV-ND07T/C-T(U)	208/230V~,60Hz	15	1.0/AWG18	1.0/AWG18
GMV-ND09T/C-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-ND12T/C-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-ND15T/C-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-ND18T/C-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-ND22T/C-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-ND24T/C-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-ND30T/C-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-ND36T/C-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-ND42T/C-T(U)		15	1.0/AWG18	1.0/AWG18
GMV-ND48T/C-T(U)		15	1.0/AWG18	1.0/AWG18

## 4 Installation of Connection Pipe

### ▲ CAUTION

- ① Conform to the following principles during pipe connection: Connection pipe should be as short as possible, so is the height difference between indoor and outdoor units. Keep the number of bends as little as possible. Radius of curvature should be as large as possible.
- ② Weld the connection pipe between indoor and outdoor units. Please strictly follow the requirements for welding process. Rosin joint or pin hole is not allowed.
- ③ When laying the pipe, be careful not to distort it. Radius of bending parts should be over 200mm (8inch). Note that pipes cannot be repeatedly bent or stretched; otherwise the material will get harder. Do not bend or stretch the pipe for more than 3 times at the same position.

### 4.1 Flaring Process

- (1) Use pipe cutter to cut the connection pipe in case it is unshaped.
- (2) Keep the pipe downward in case cutting scraps get into the pipe. Clear away the burrs after cutting.
- (3) Remove the flared nut connecting indoor connection pipe and outdoor unit. Then use flaring tool to fix the flared nut into the pipe (as shown in Fig.4.1).
- (4) Check if the flared part is flaring evenly and if there is any crack.

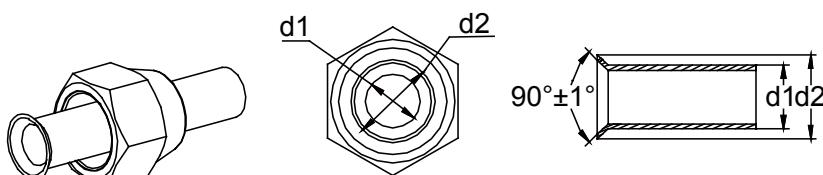


Fig. 4.1

## 4.2 Pipe Bending

- (1) Reshape the pipe by hand. Be careful not to damage the pipe.
- (2) Do not bend the pipe over 90°.
- (3) If pipe is repeatedly bent or stretched, it will get hard and difficult to bend and stretch again. Therefore, do not bend or stretch the bend for over 3 times.
- (4) In case that direct bending will open cracks to the pipe, first use sharp cutter to cut the insulating layer, as shown in Fig. 4.3. Do not bend the pipe until it is exposed. When bending is done, wrap the pipe with insulating layer and then secure it with adhesive tape.

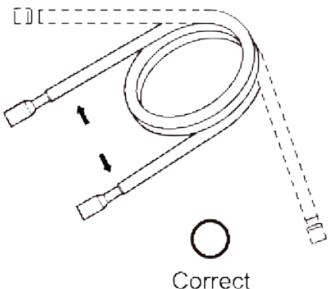


Fig. 4.2

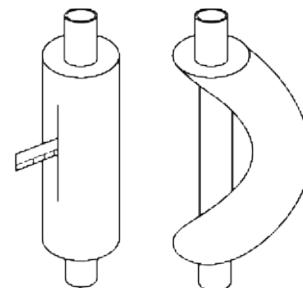


Fig. 4.3

## 4.3 Indoor Pipe Connection

- (1) Remove pipe cover and pipe plug.
- (2) Direct the flared part of copper pipe to the center of screwed joint. Twist on the flared nut tightly by hand, as in Fig. 4.4 (Make sure indoor pipe is correctly connected. Improper location of the center will prevent flared nut from being securely twisted. Thread of nut will get damaged if the flared nut is twisted forcibly).
- (3) Use torque wrench to twist on the flared nut tightly until the wrench gives out a click sound (Hold the handle of wrench and make it at right angle to the pipe. as in Fig. 4.5).

### CAUTION

- |   |
|---|
| ① Use sponge to wrap the un-insulated connection pipe and joint. Then tie the sponge tightly with plastic tape.   |
| ② Connection pipe should be supported by a bearer rather than the unit.   |
| ③ The bending angle of piping should not be too small; otherwise the piping might have cracks. Please use a pipe bender to bend the pipe.                                   |
| ④ When connecting IDU with connection pipe, do not pull the big and small joints of IDU with force in case the capillary tube or other tubes have cracks and cause leakage. |

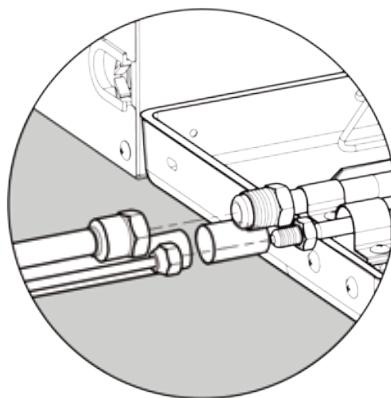


Fig. 4.4

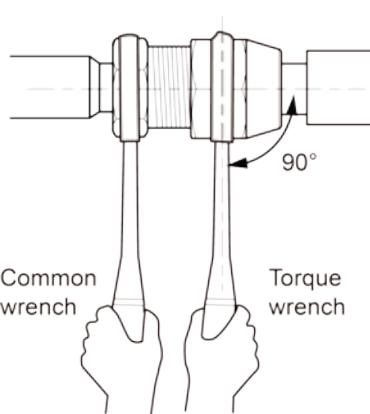


Fig. 4.5


Pipe Diameter(mm/inch)	Tightening Torque
6(1/4)	15-30N·m(11-22ft.-1b.)
9.5(3/8)	35-40N·m(26-29ft.-1b.)
12.7(1/2)	45-50N·m(33-37ft.-1b.)
16(5/8)	60-65N·m(44-48ft.-1b.)

## 5 Installation of Drain Pipe


### 5.1 Precautions When Doing the Piping Work

- Keep piping as short as possible and slope it downwards at a gradient of at least 1/100 so that air may not remain trapped inside the pipe.


For example:

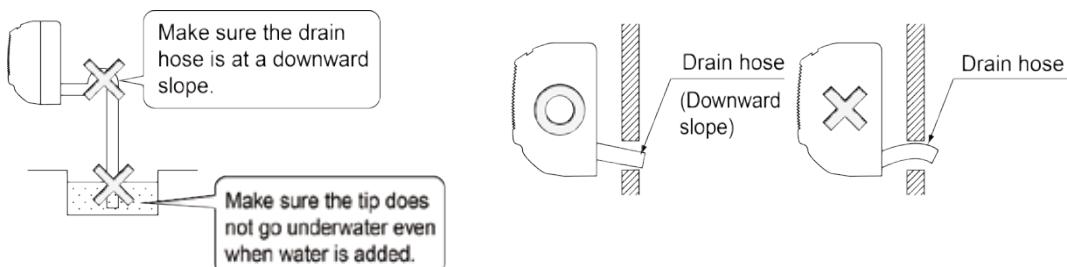

- Keep pipe size equal to or greater than that of the connecting pipe.
- Install the drain piping as shown and take measures against condensation. Improperly rigged piping could lead to leaks and eventually wet furniture and belongings.

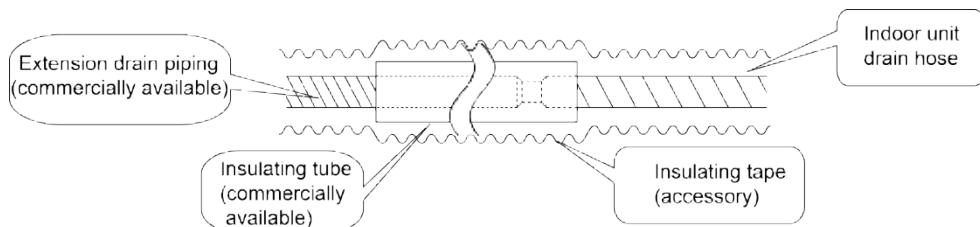

- When directly connecting a hard vinyl chloride pipe joint to the drain hose connected to the indoor unit, use a commercially available hard vinyl chloride pipe joint (nominal diameter 13mm (1/2 inch)).

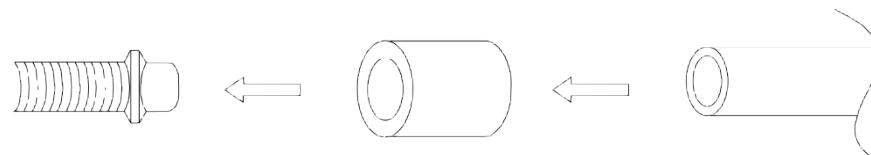

Drain hose connected to the indoor unit

Commercially available hard vinyl chloride pipe  
joint (nominal diameter 13mm)


Commercially available hard vinyl chloride pipe  
(nominal diameter 13mm)

- Drain hose connected to the indoor unit Commercially available hard vinyl chloride pipe joint (nominal diameter 13mm(1/2 inch)), Commercially available hard vinyl chloride pipe(nominal diameter 13mm(1/2 inch))
- Do not connect the drain piping directly to sewage pipes that smell of ammonia. The ammonia in the sewage might enter the indoor unit through the drain pipes and corrode the heat exchanger.

## 5.2 Installing the Drain Pipes


- Insert the drain hose into the drain outlet, and tighten the clamp securely with tape.
- Tighten the clamp until the screw head is less than 4mm (3/16 inch) from the hose.

- ① . Metal clamp (accessory)  
 ② . Drain hose (accessory)  
 ③ . Grey tape (accessory)




- Insulate the pipe clamp and the drain hose using heat insulation sponge.

- ① . Metal clamp (accessory)  
 ② . Insulation sponge (accessory)




- Install water trap as shown below.
- Install one water trap for each unit.
- Installation of water trap shall consider easy cleaning in the future.

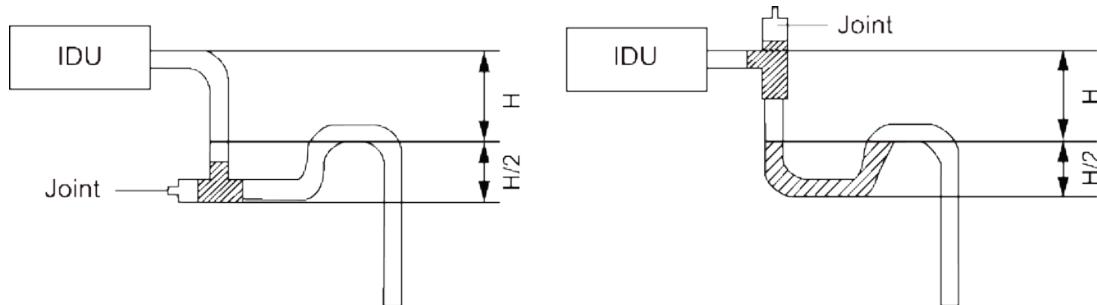


- Connection of drainage branch pipe to the standpipe or horizontal pipe of drainage main pipe
- The horizontal pipe cannot be connected to the vertical pipe at a same height. It can be connected in a manner as shown below:


NO.1: 3-way connection of drainage pipe joint

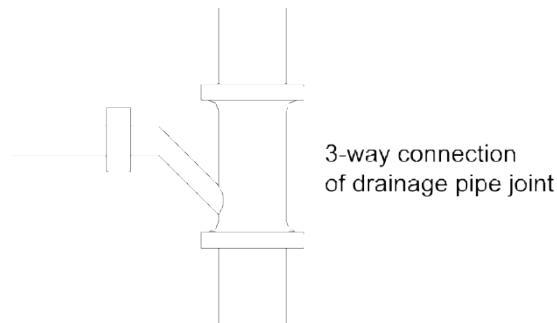

## NO.2: Connection of drain elbow

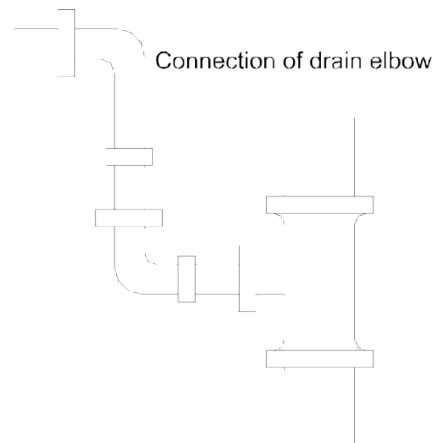


## NO.3: Connection of horizontal pipe

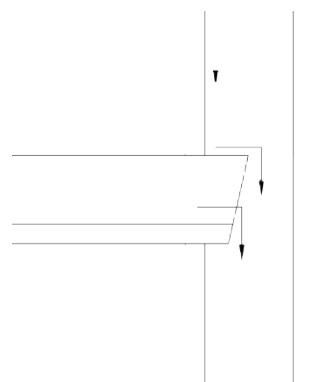


Connection of horizontal pipe

- When unifying multiple drain pipes, install the pipes as shown below. Select converging drain pipes whose gauge is suitable for the operating capacity of the unit.(take the cassette type unit for example)

Unit: mm (inch)

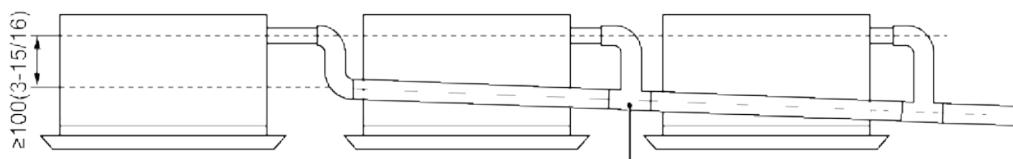

Drainage pipes assembled by I shaped joints

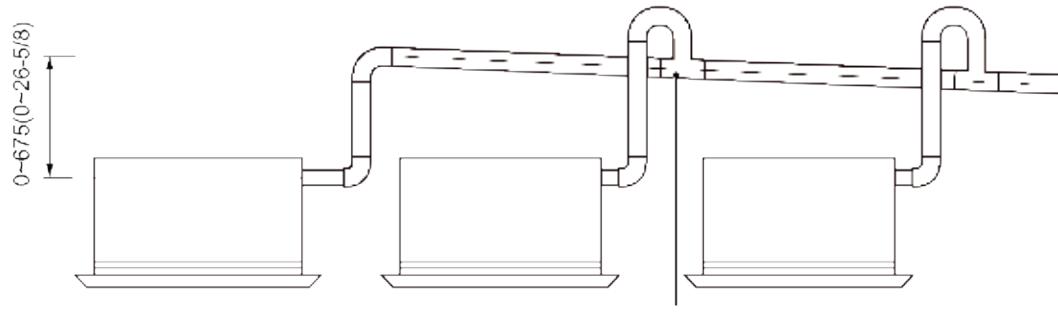


Drainage pipes assembled by I-shaped joints

## 5.3 Precautions When Doing Riser Piping Work


- (1) Make sure that heat insulation work is executed on the following 2 spots to prevent any possible water leakage due to dew condensation.
  - 1) Connect the drain hose to the drain raiser pipe, and insulate them.
  - 2) Connect the drain hose to the drain outlet on the indoor unit, and tighten it with the clamp.

Unit: mm (inch)

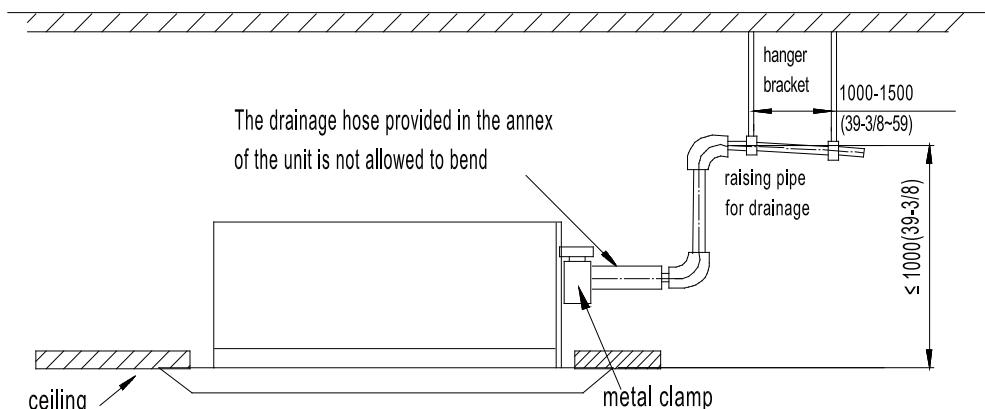

- (2) Secure a downward gradient of 1/100 or more for the drain pipe. To accomplish this, mount supporting brackets at an interval of 1 -1.5 m (39-3/8~59in).

Unit: mm (inch)

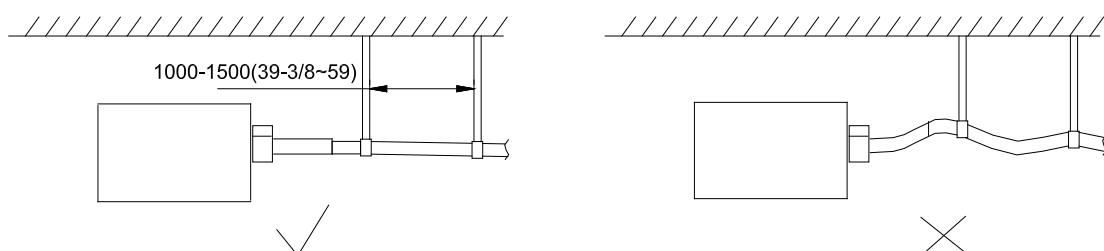

## 5.4 Testing of Drain Piping

- After piping work is finished, check if drainage flows smoothly.
- Shown in the figure, Add approximately 1liter of water slowly into the drain pan and check drainage flow during COOL running.

## 6 Electrical Installation

- The wiring must be in accordance with the local rules.
- Rated supply voltage and special circuit for air conditioner must be used.
- Do not pull the power cord forcefully.
- All the electric installations must be carried out by specialist technicians in accordance with the local laws, rules and these instructions.
- The diameter of flexible wire should be wide enough. Replace the damaged power cord and connecting wire with special flexible wire.
- The earthing shall be reliable and connected to the special earthing device on the construction. The installation must be done by specialist technicians. The leak protection switch and air switch with enough capacity must be installed. The air switch shall have both the magnetic

tripping and thermal tripping functions to ensure protection against the short circuit and overload.

- Earthing Requirements
- The air conditioner belongs to I type electric appliances. The reliable earthing action is a must.
- The yellow and green wire inside the air conditioner is the earthed wire. Do not use it for other purpose or even cut off it. Do not fix it with tapping screw, Otherwise it may cause electric shock.
- The earthed resistance must meet the requirements of national standard GB17790.
- There should be reliable earthing terminal for the power supply. Never connect the earth lead to the following articles:
  - ①water pipe; ②gas pipe; ③drain pipe; ④unreliable place considered by professionals.

## **MAINTENANCE**

## CHAPTER 4 MAINTENANCE

### 1 Malfunction List

#### 1.1 Malfunction List for the Wired Controller

Error Code	Content	Error Code	Content	Error Code	Content
L0	Indoor Unit Error	LA	Indoor Units Incompatibility Error	d9	Jumper Cap Error
L1	Indoor Fan Protection	LH	Low Air Quality Warning	dA	Indoor Unit Network Address Error
L2	E-heater Protection	LC	ODU-IDU Incompatibility Error	dH	Wired Controller PCB Error
L3	Water Full Protection	d1	Indoor Unit PCB Error	dC	Capacity DIP Switch Setting Error.
L4	Wired Controller Power Supply Error	d3	Ambient Temperature Sensor Error	dL	Outlet Air Temperature Sensor Error
L5	Freeze protection	d4	Inlet Pipe Temperature Sensor Error	dE	Indoor Unit CO <sub>2</sub> Sensor Error
L7	No Master Indoor Unit Error	d6	Outlet Pipe Temperature Sensor Error	dy	Water Temperature Sensor Error
L8	Power Insufficiency Protection	d7	Humidity Sensor Error	C0	Communication Error
L9	Quantity Of Group Control Indoor Units Setting Error	d8	Water Temperature Error	AJ	Filter Cleaning Reminder
db	Special Code: Field Debugging Code				

#### 1.2 Display of Light Board (Only for Two-way Cassette Type Indoor Unit)

The panel of this model is without nixie tube display. The error codes will be displayed through the power light, operation light and timer light; ○, ● and ◇ stand for on, off and blink respectively.

Power light	○	◇	◇	◇	◇
Operation light	◇	●	○	○	○
Timer light	●	○	●	○	●

Error code display sheet

Error code	C0	A0	A3/A4	L0	L1	L3	L5	d1	d3	d4	d6	d7	E0	db	Field debugging code
Power light	◇	○	○	●	●	●	○	○	○	○	●	○	●	○	◇
Operation light	○	◇	○	●	○	○	●	○	●	○	○	○	○	○	●
Timer light	○	○	○	○	○	○	○	○	○	○	○	○	●	●	●
Error description	Communication on error	To be debugged	Defrosting/oil return	Indoor unit error	Indoor fan protection	Water full protection	Freeze protection	Ambient temperature sensor error	Indoor unit PCB error	Inlet pipe temperature sensor error	Outlet pipe temperature sensor error	Humidity sensor error	Outdoor unit error		

## 1.3 Exception Analyzing and Troubleshooting

### 1.3.1 “d1” Indoor circuit board error

**Error display:** IDU wired controller and IDU receive light board will display



**Error judgment condition and method:**

Check if the reading of address chip and memory chip of IDU mainboard is normal. If the data of address chip and memory chip cannot be read, it is abnormal

**Possible reason:**

- Address chip is abnormal
- Memory chip is abnormal. Replace main control board directly

**Troubleshooting:**

Replace main control board directly

### 1.3.2 “d3” Ambient temperature sensor error

**Error display:** IDU wired controller and IDU receive light board will display




**Error judgment condition and method:**

Sample the AD value of temperature sensor through temperature sensor detecting circuit and judge the range of AD value, if the sampling AD value exceeds upper limit and lower limit in 5 seconds continuously, report the error

**Possible reason:**

- Poor contact between ambient temperature sensor and terminal in mainboard interface
- Ambient temperature sensor is abnormal
- Detecting circuit is abnormal

**Troubleshooting:**

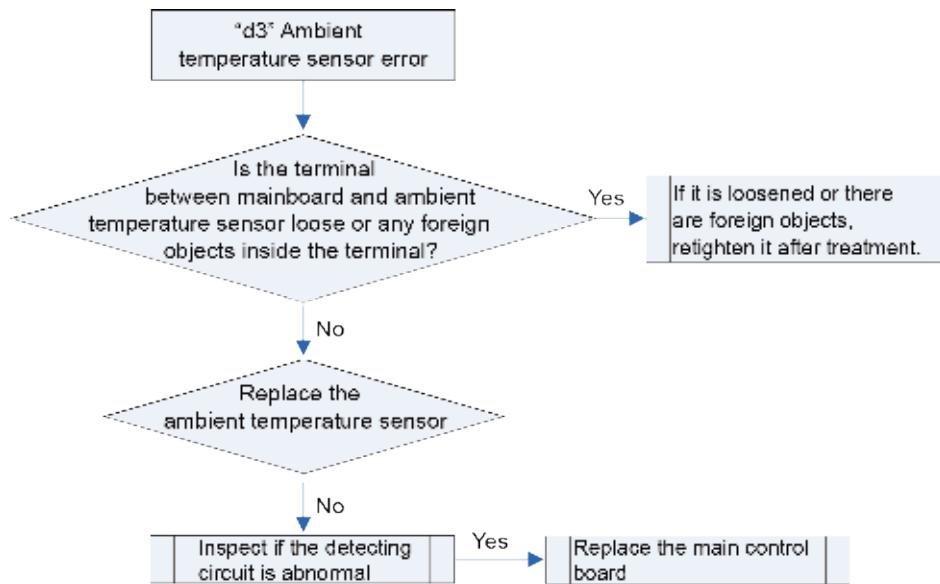

### 1.3.3 “d4” Inlet pipe temperature sensor error

**Error display:** IDU wired controller and IDU receive light board will display




#### Error judgment condition and method:

Sample the AD value of temperature sensor through temperature sensor detecting circuit and judge the range of AD value. If the sampling AD value exceeds upper limit and lower limit in 5 seconds continuously, report the error

#### Possible reason:

- Poor contact between inlet pipe temperature sensor and terminal in mainboard interface
- Inlet pipe temperature sensor is abnormal
- Detecting circuit is abnormal

#### Troubleshooting:

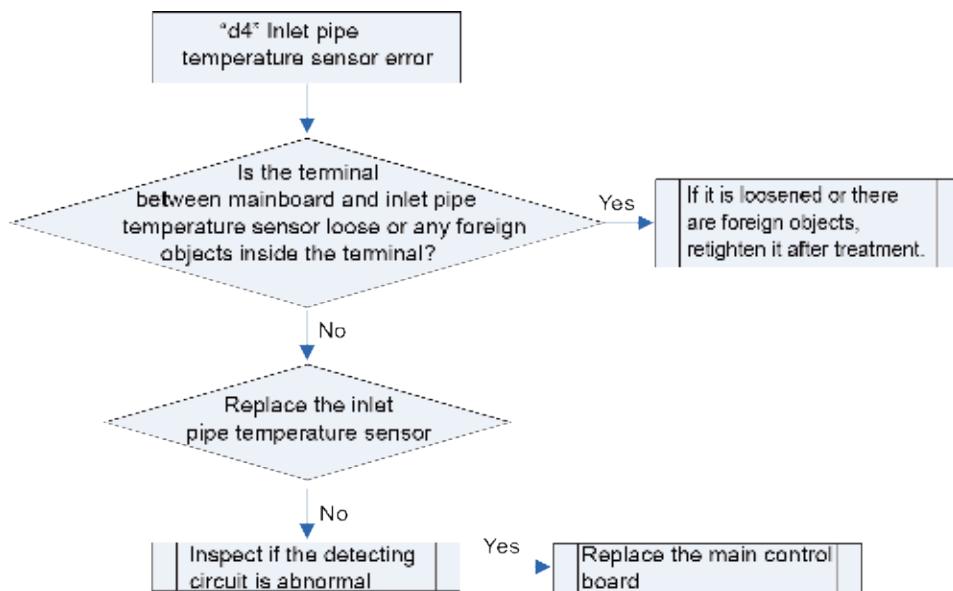

### 1.3.4 “d6” Outlet pipe temperature sensor error

**Error display:** IDU wired controller and IDU receive light board will display




#### Error judgment condition and method:

Sample the AD value of temperature sensor through temperature sensor detecting circuit and judge the range of AD value. If the sampling AD value exceeds upper limit and lower limit in 5 seconds continuously, report the error

**Possible reason:**

- Poor contact between outlet pipe temperature sensor and terminal in mainboard interface
- Outlet pipe temperature sensor is abnormal
- Detecting circuit is abnormal

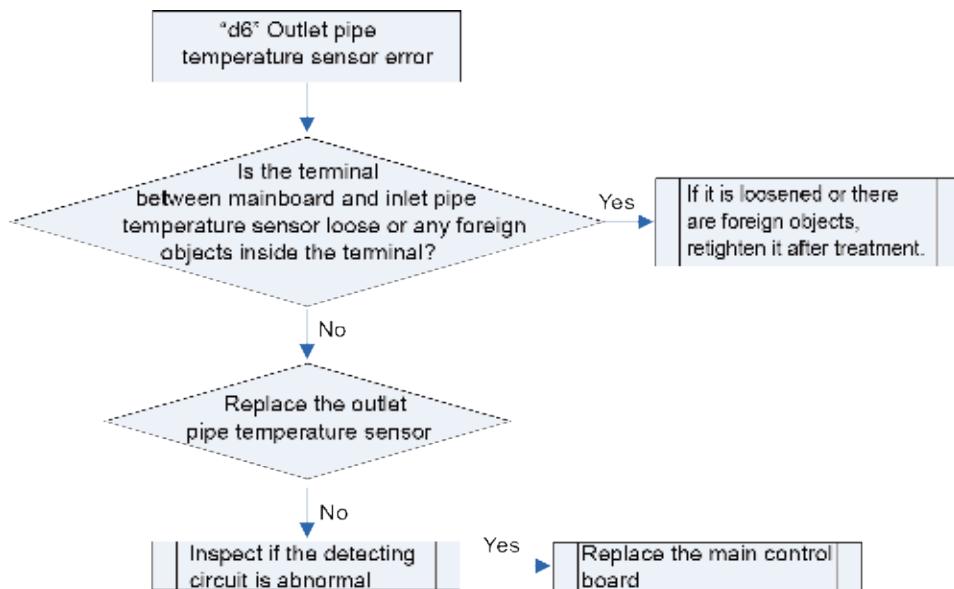**1.3.5 “d7” Humidity sensor error**


**Error display:** IDU wired controller and IDU receive light board will display

**Error judgment condition and method:**

Sample the AD value of temperature sensor through temperature sensor detecting circuit and judge the range of AD value. If the sampling AD value exceeds upper limit and lower limit in 5 seconds continuously, report the error

**Possible reason:**


- Poor contact between humidity sensor and terminal in mainboard interface
- Humidity sensor is abnormal
- Detecting circuit is abnormal

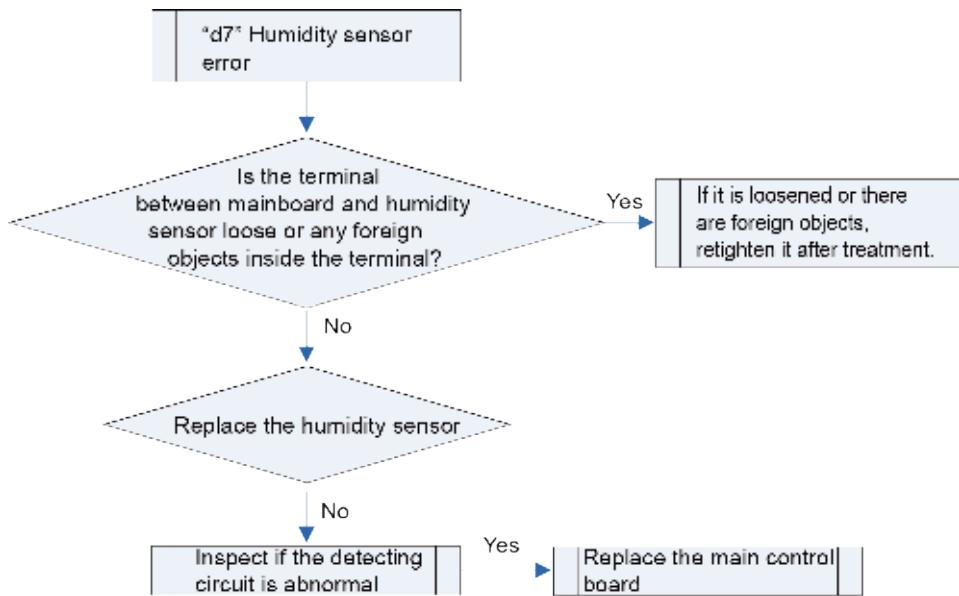**Troubleshooting:****1.3.6 "d9" Jumper cap error**

**Error display:** IDU wired controller and IDU receive light board will display

**Error judgment condition and method:****Possible reason:**

- If jumper cap model doesn't match with mainboard, report the error
- Jumper cap is not installed
- Jumper cap model is wrong
- Detecting circuit is abnormal

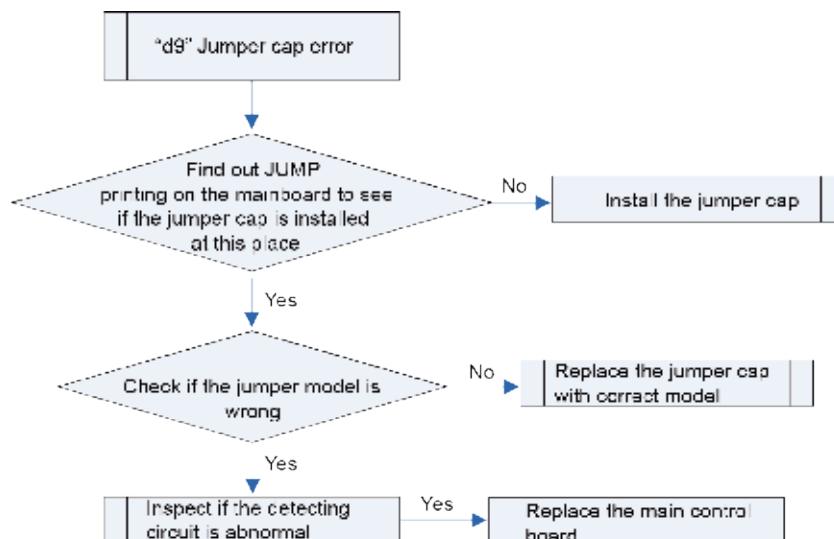**Troubleshooting:**

### 1.3.7 “dA” IDU network address error

**Error display:** IDU wired controller and IDU receive light board will display




**Error judgment condition and method:**

Through testing the IDU address chip and IP address, if address chip cannot be read, IDU IP is 0 or IP is in conflict, report the error.

**Possible reason:**

- ODU allocated address is wrong
- IDU treatment is wrong
- Address chip is abnormal

**Troubleshooting:**

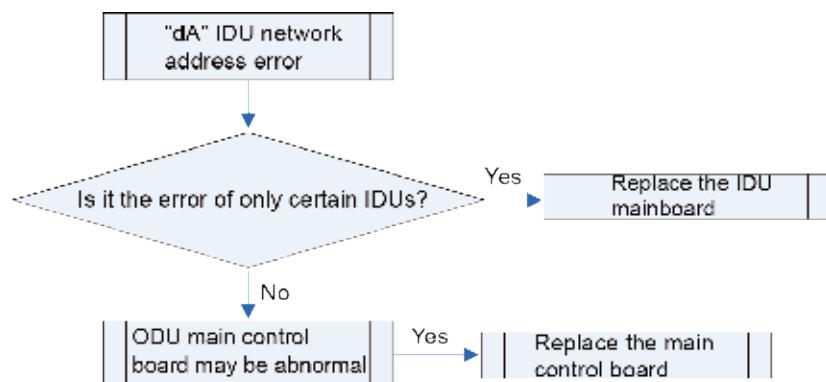

### 1.3.8 “dH” wired controller circuit board error

**Error display:** IDU wired controller and IDU receive light board will display




**Error judgment condition and method:**

Wired controller IIC communication is abnormal

**Possible reason:**

- Communication of wired controller touch button board and display board IIC is abnormal;
- Read and write of wired controller memory chip IIC is abnormal (when memory chip is existed);

**Troubleshooting:**

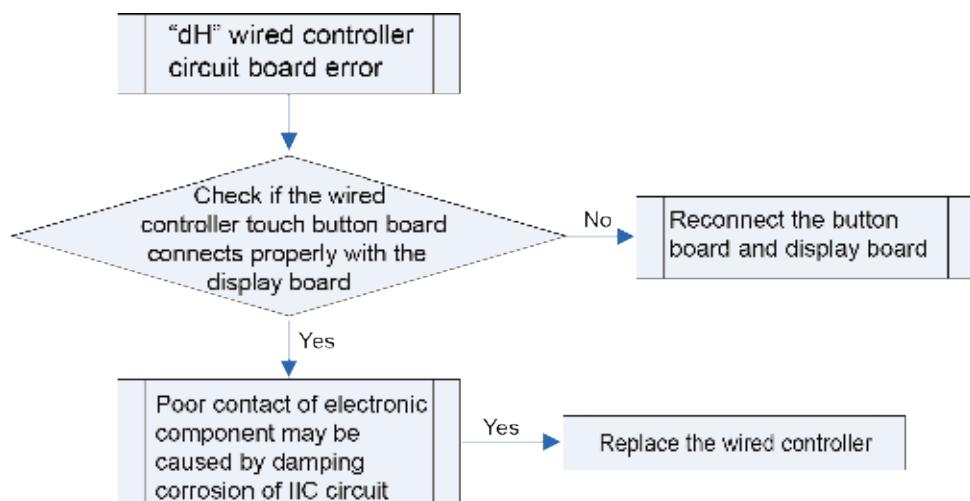

### 1.3.9 “dC” Capacity DIP switch setting error

**Error display:** IDU wired controller and IDU receive light board will display




#### Error judgment condition and method:

If capacity DIP switch is set to the wrong position, report the error.

#### Possible reason:

- Capacity DIP switch is set to the wrong position
- Detecting circuit is abnormal

#### Troubleshooting:

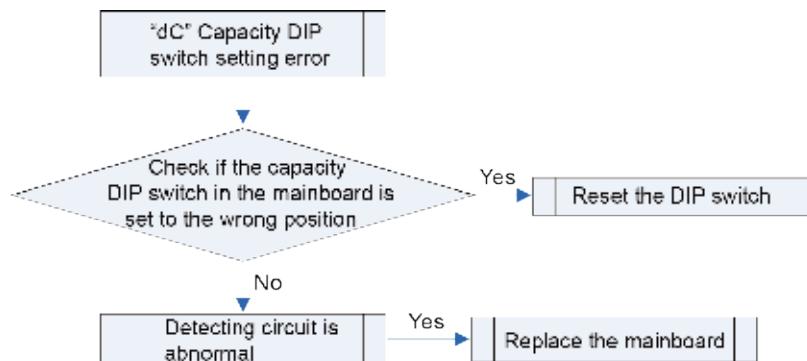

### 1.3.10 “dL” Air outlet temperature sensor error

**Error display:** IDU wired controller and IDU receive light board will display




#### Error judgment condition and method:

Sample the AD value of temperature sensor through temperature sensor detecting circuit and judge the range of AD value. If the sampling AD value exceeds upper limit and lower limit in 5 seconds continuously, report the error

#### Possible reason:

- Poor contact between air outlet temperature sensor and terminal in mainboard interface
- Air outlet temperature sensor is abnormal
- Detecting circuit is abnormal

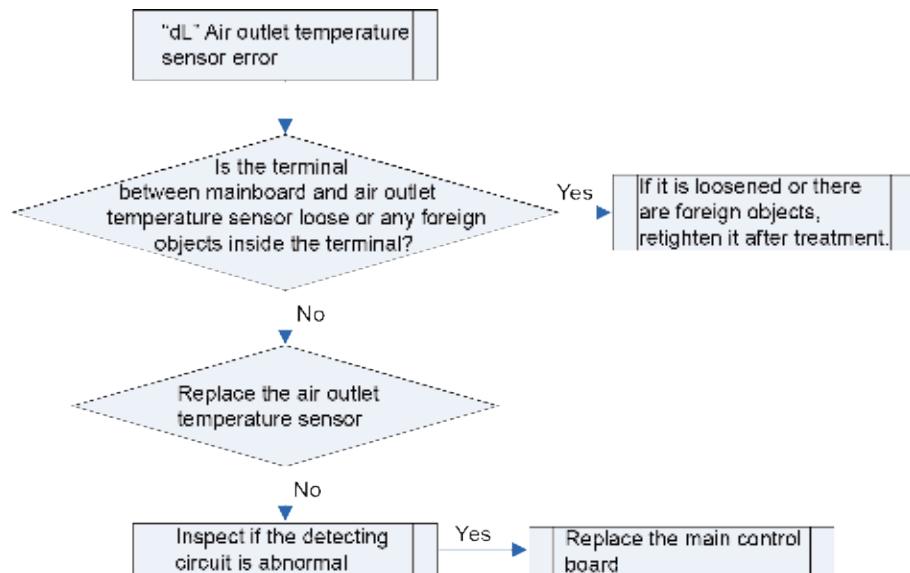**Troubleshooting:****1.3.11 “db” Project debugging**

**Error display:** ODU mainboard, IDU wired controller and IDU receive light board will display

**Error judgment condition and method:**

This is a status code of project debugging, not an error code. When IDU or ODU displays this code, it means the unit is under debugging status and the IDU cannot be operated.

**Troubleshooting:** —

**Possible reason:** —

**1.3.12 “L1” Indoor fan protection**


**Error display:** IDU wired controller and IDU receive light board will display

**Error judgment condition and method:**

Check if the rotation speed of IDU is too slow, or it stops rotation, or protection signal of outdoor fan is transferred. If yes, it is judged that indoor fan protection occurs.

**Possible reason:**

- Motor stops operation or it is blocked
- IDU mainboard is abnormal

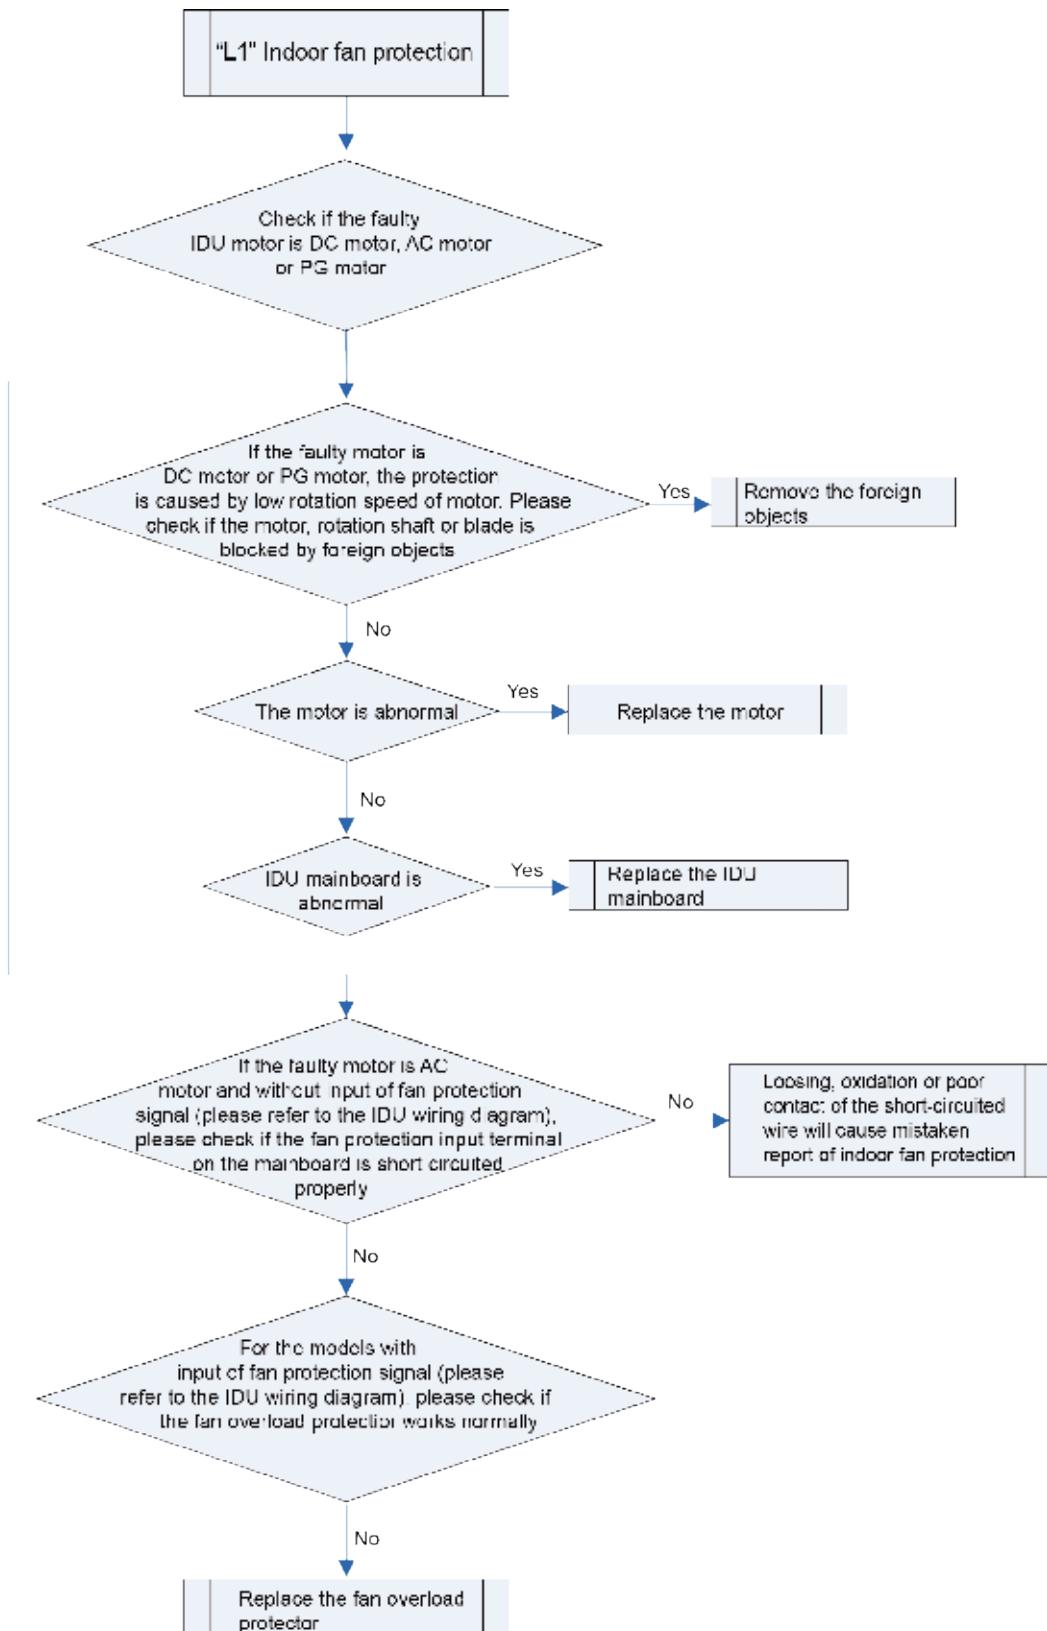**Troubleshooting:**

### 1.3.13 “L3” Water full protection

**Error display:** IDU wired controller and IDU receive light board will display




#### Error judgment condition and method:

Check the status of IDU float switch. When water level is too high, float switch is activated, so water full protection happens.

#### Possible reason:

- IDU is installed improperly
- Drainage pump is broken
- Float switch operates abnormally
- IDU mainboard is abnormal

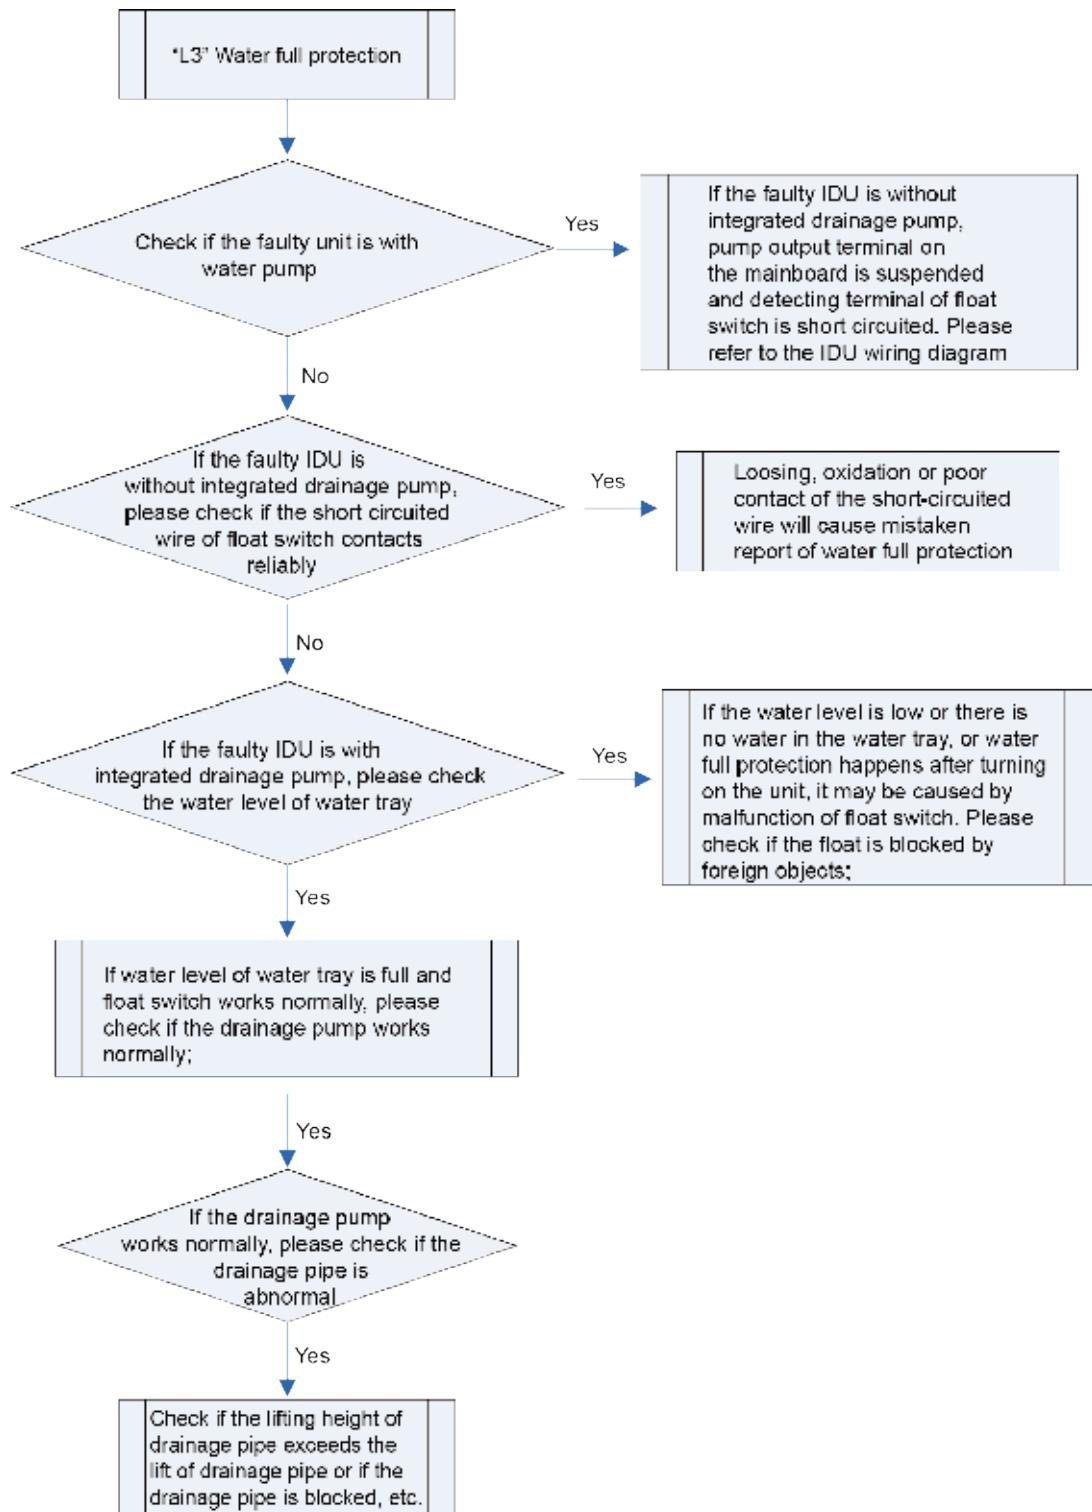**Troubleshooting:**

### 1.3.14 “L4” Power supply overcurrent protection

**Error display:** IDU wired controller and IDU receive light board will display




#### Error judgment condition and method:

Check if the power supply current from IDU to wired controller is normal. If power supply current is too big, it is judged that the current is abnormal.

#### Possible reason:

- Power supply conducting wire of wired controller is short circuited
- IDU mainboard is abnormal
- Mainboard of wired controller is abnormal

#### Troubleshooting:

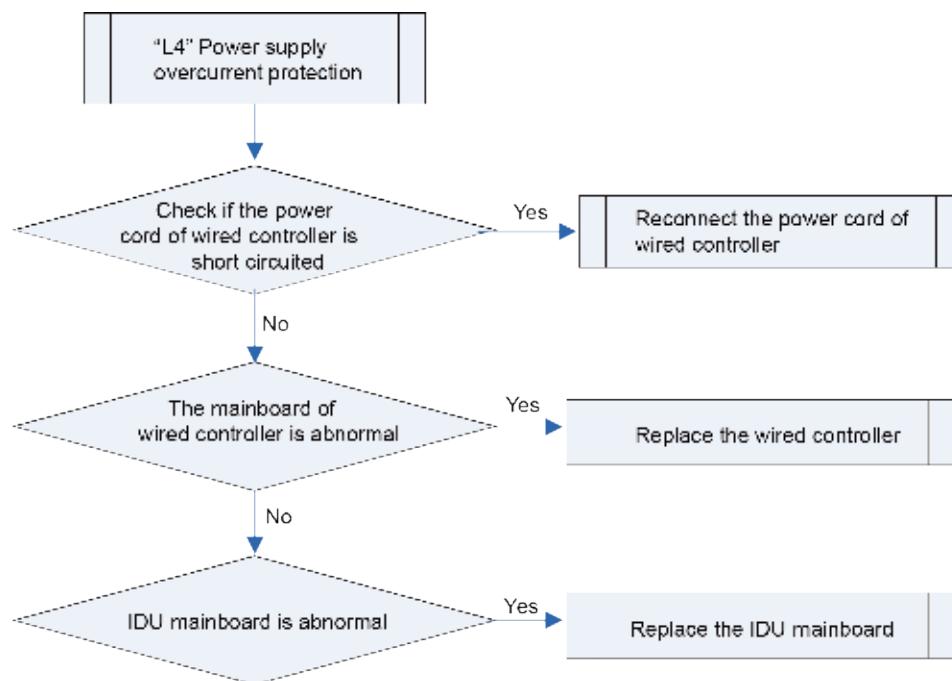

### 1.3.15 “L5” Freeze protection

**Error display:** IDU wired controller and IDU receive light board will display




#### Error judgment condition and method:

Check IDU pipe temperature. When pipe temperature is too low, freeze protection will be activated to prevent freezing damage of evaporator.

#### Possible reason:

- IDU filter and evaporator are dirty
- IDU motor is blocked
- Refrigerant amount is insufficient
- Ambient temperature of IDU and ODU is too low

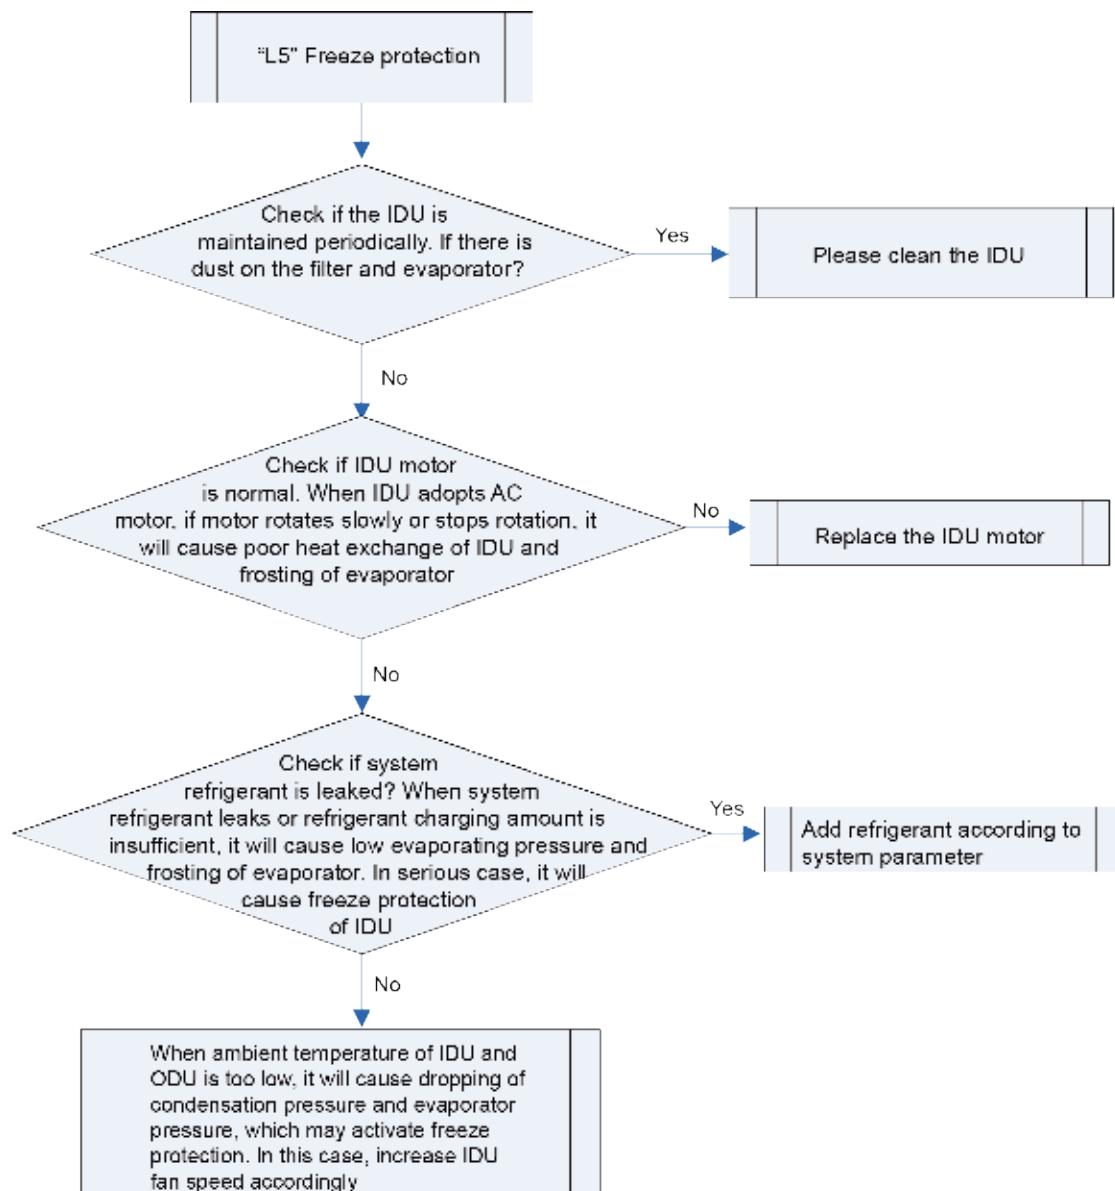**Troubleshooting:****1.3.16 “L7” No master IDU**


**Error display:** IDU wired controller and IDU receive light board will display

**Error judgment condition and method:**

No master IDU error will happen when there is no master IDU in the system

**Possible reason:**

- Master IDU is offline
- The mainboard of master IDU is replaced
- The mainboard of master IDU has error

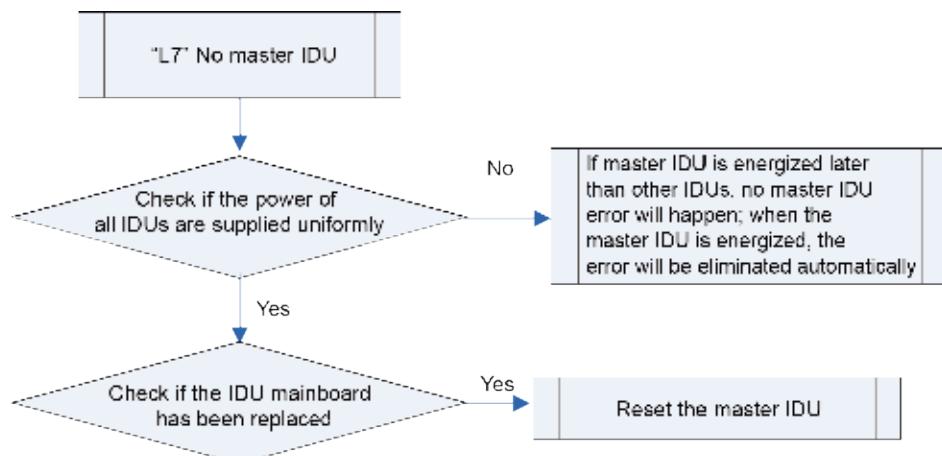**Troubleshooting:****1.3.17 "L9" Group-controlled IDU quantity inconsistency**


**Error display:** IDU wired controller and IDU receive light board will display

**Error judgment condition and method:**

If the IDU quantity connected with wired controller exceeds 16 sets or actually connected IDU quantity is inconsistent with the set group-controlled IDU quantity.

**Possible reason:**

- IDU quantity connected with one wired controller exceeds 16 sets;
- Actually connected IDU quantity is inconsistent with the set group-controlled IDU quantity.

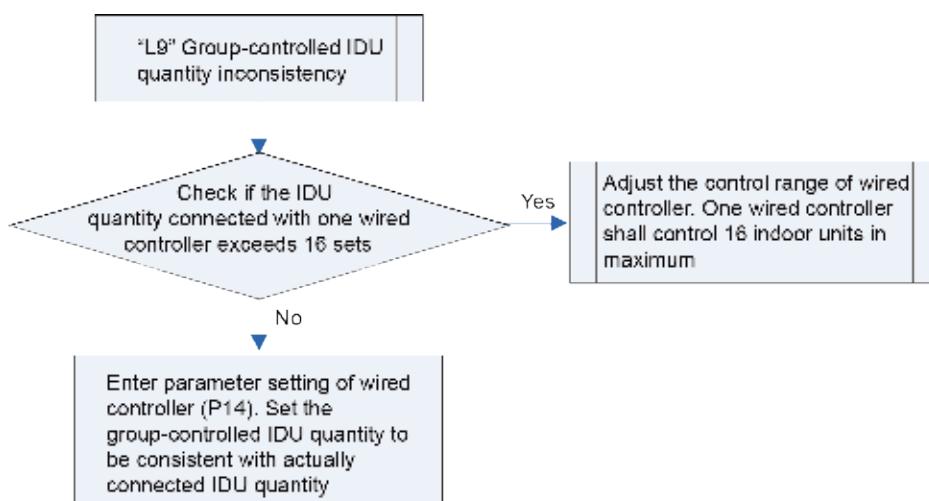**Troubleshooting:****1.3.18 "LA" Group-controlled IDU series inconsistency**

**Error display:** IDU wired controller and IDU receive light board will display

**Error judgment condition and method:**

Wired controller detects that the IDUs connected with itself belong to different series.

**Possible reason:**

- IDUs connected with one wired controller belong to different series

**Troubleshooting:**

Make sure the IDUs connected with one wired controller belong to the same series.

### 1.3.19 “LC” Mismatch of IDU and ODU models

**Error display:** IDU wired controller and IDU receive light board will display



#### Error judgment condition and method:

When some IDUs or devices which cannot be identified by some ODUs are installed in the system, mismatch error of IDU and ODU models will occur.

#### Possible reason:

- Mismatch of IDU and ODU

#### Troubleshooting:

When some IDUs or devices which cannot be identified by some ODUs are installed in the system (E.g. floor heating device is installed in modular DC inverter multiple VRF system), the error will occur. Please remove the relevant IDU devices or replace the ODU with suitable model.

## 2 After-sales Emergency Measures

When some unrecoverable fault occurs to one module which is connected with several others in parallel, the following emergency measures are recommended to guarantee the heating or cooling capacity of the indoor units and the service life of modules except the faulted one are not affected.

Step 1: set all indoor units under “Off” mode and cut off the power supply to the indoor and outdoor units.

Step 2: shut off all cutoff valves of the faulted outdoor unit, including the cutoff valves of the liquid/gas pipe as well as the oil balancing valve.

Step 3: cut off the air switch of the module.

Step 4: remove the communication line between the faulted module and other modules which are still kept connected through the communication line.

Step 5: readjust the address and quantity settings on the main board of the modules except the faulted one.


Step 6: power and restart the unit.

### 3 Wiring Diagram


**NOTICE!** This drawing is just for reference; please always refer to the electric wiring stuck to the unit for actual wiring.

#### 3.1 Low Static Pressure Duct Type Indoor Unit

Model: GMV-ND07PLS/A-T(U) ~ GMV-ND22PLS/A-T(U)

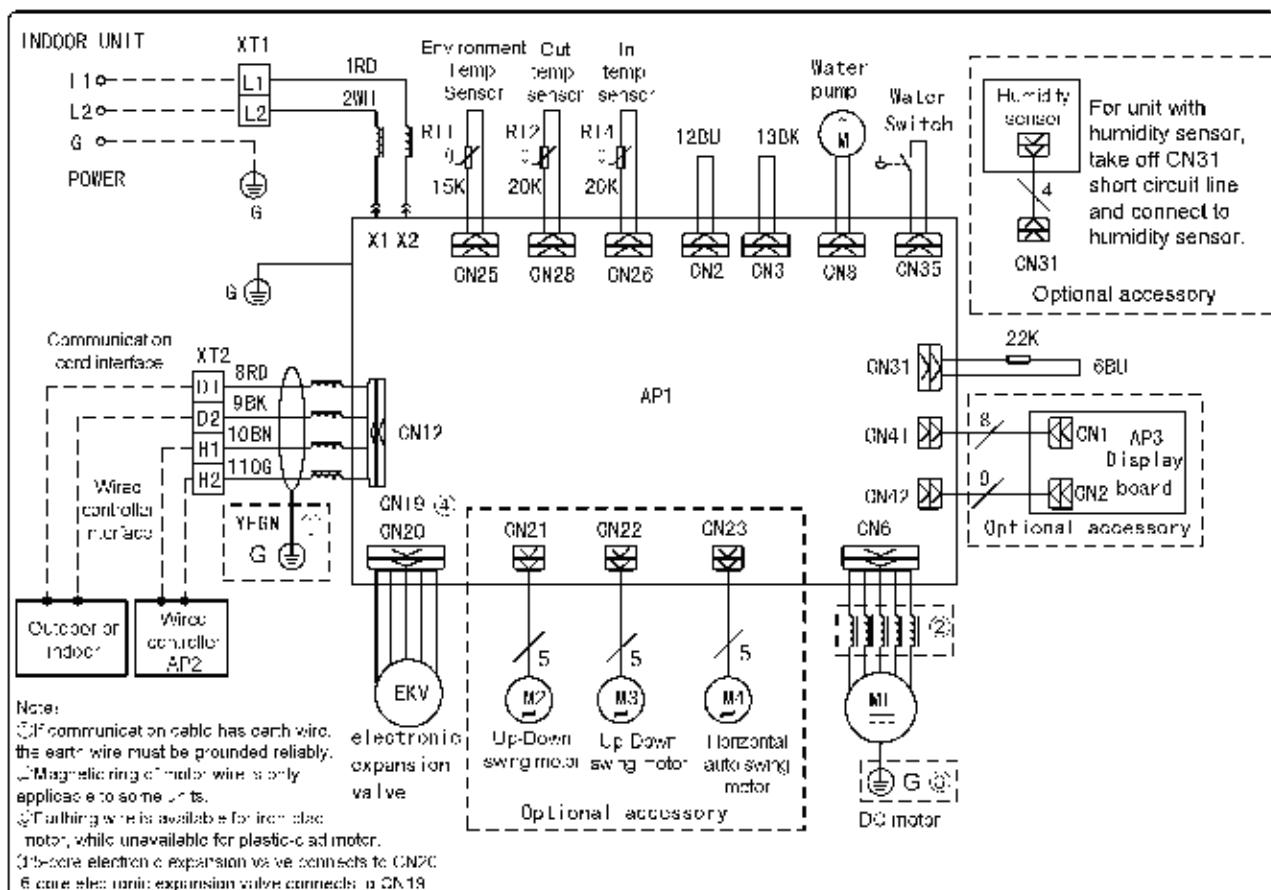


Model:GMV-ND05PLS/B1-T(U) ~ GMV-ND24PLS/B1-T(U)

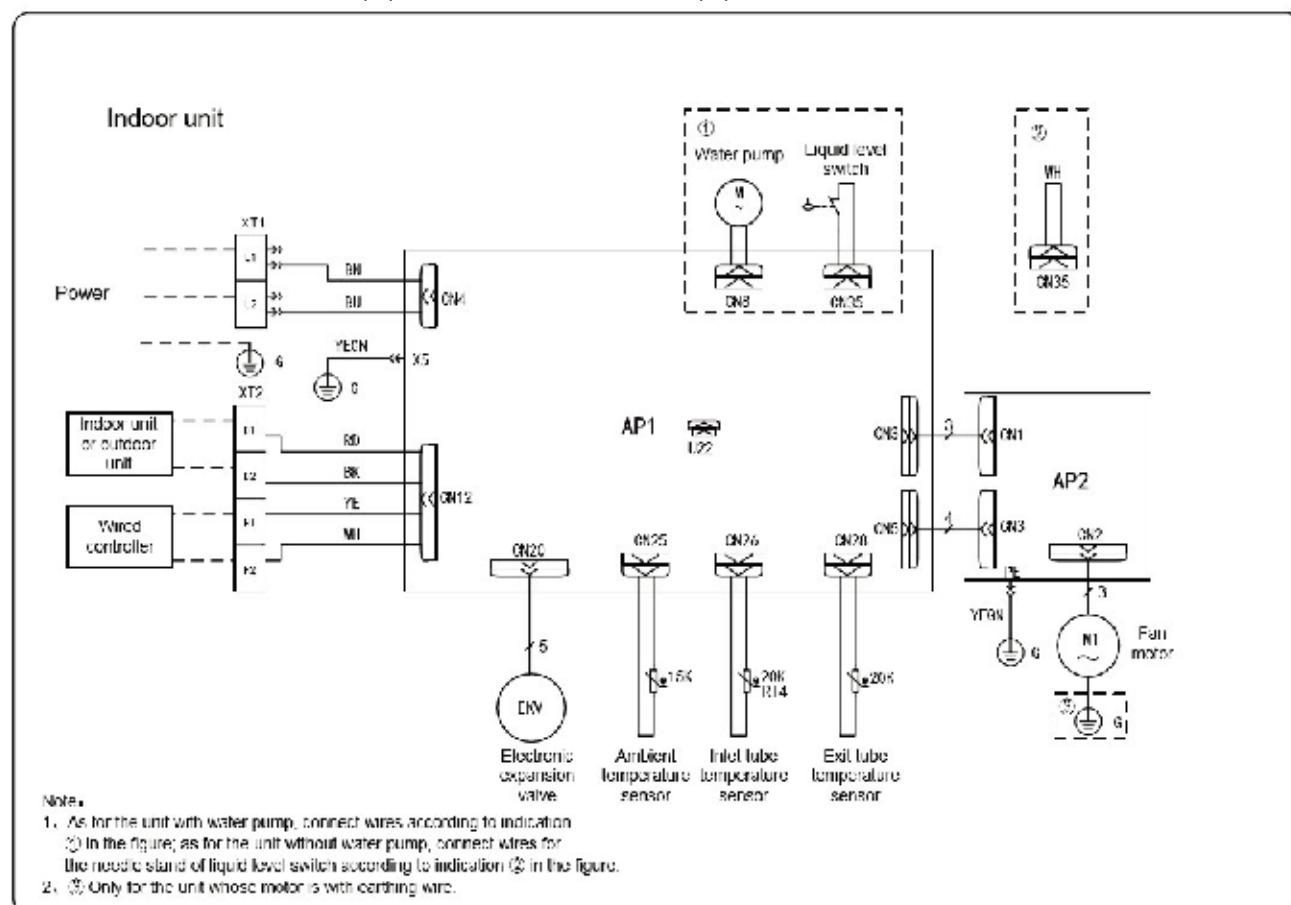


### **3.2 Slim Duct Type Indoor Unit**

Model: GMV-ND06PLS/B-T(U) ~ GMV-ND24PLS/B-T(U)

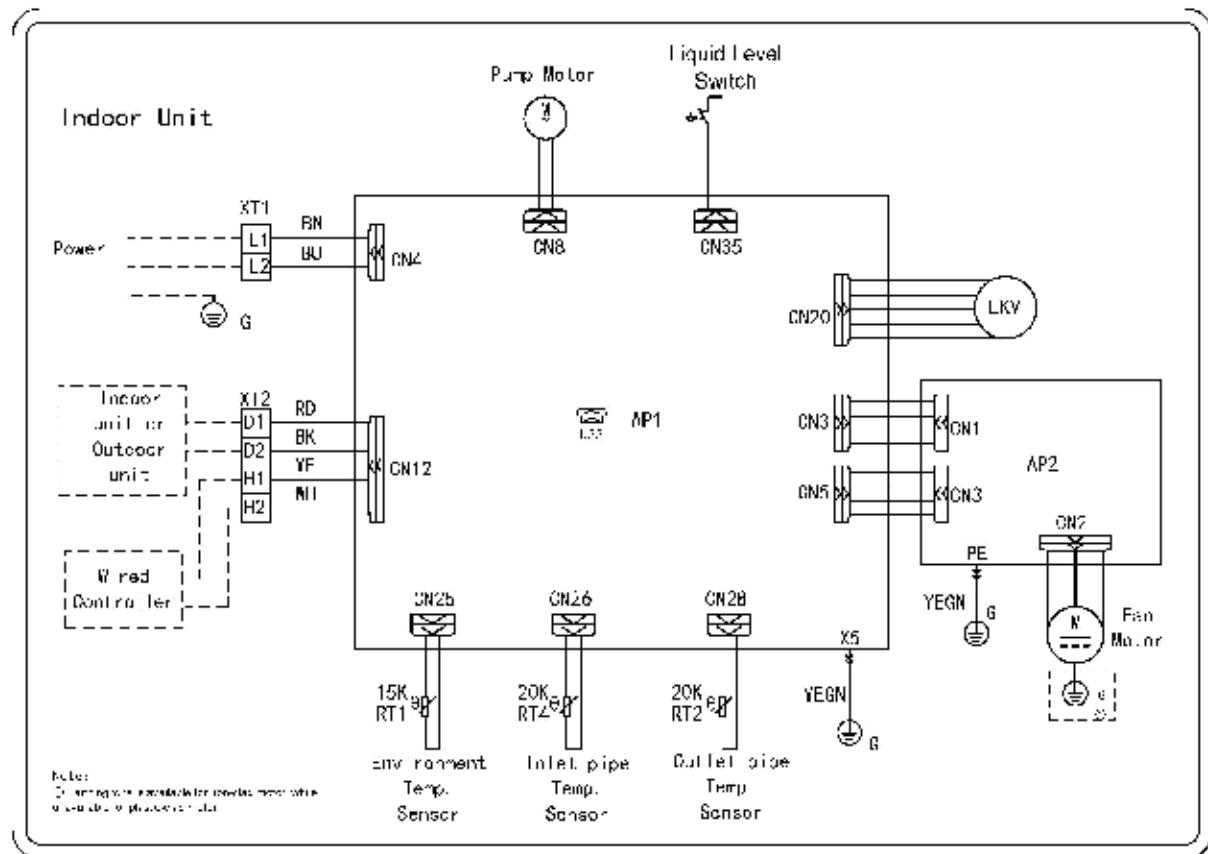

### **3.3 Four-way Cassette Type Indoor Unit**


Model: GMV-ND07T/A-T(U) ~ GMV-ND48T/A-T(U)

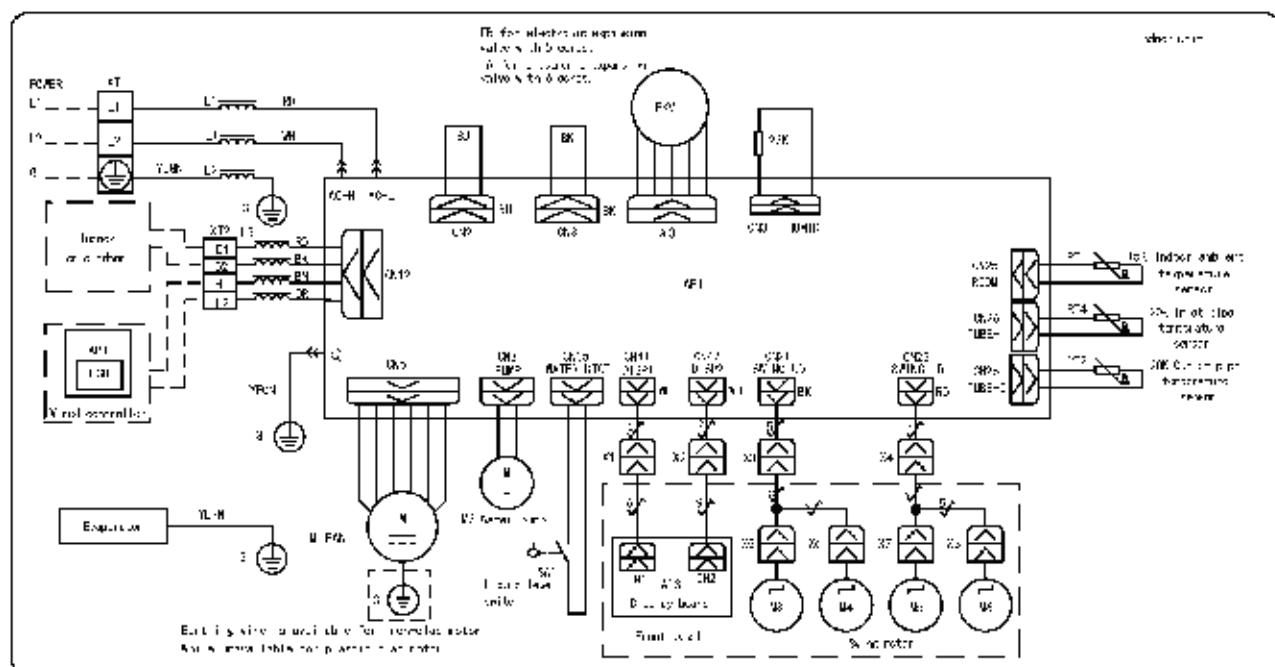


### 3.4 Wall Mounted Type Indoor Unit

Model: GMV-N07G/A3A-D(U) ~ GMV-N24G/A3A-D(U);


GMV-N07G/E3A-D(U)~ GMV-N24G/E3A-D(U):

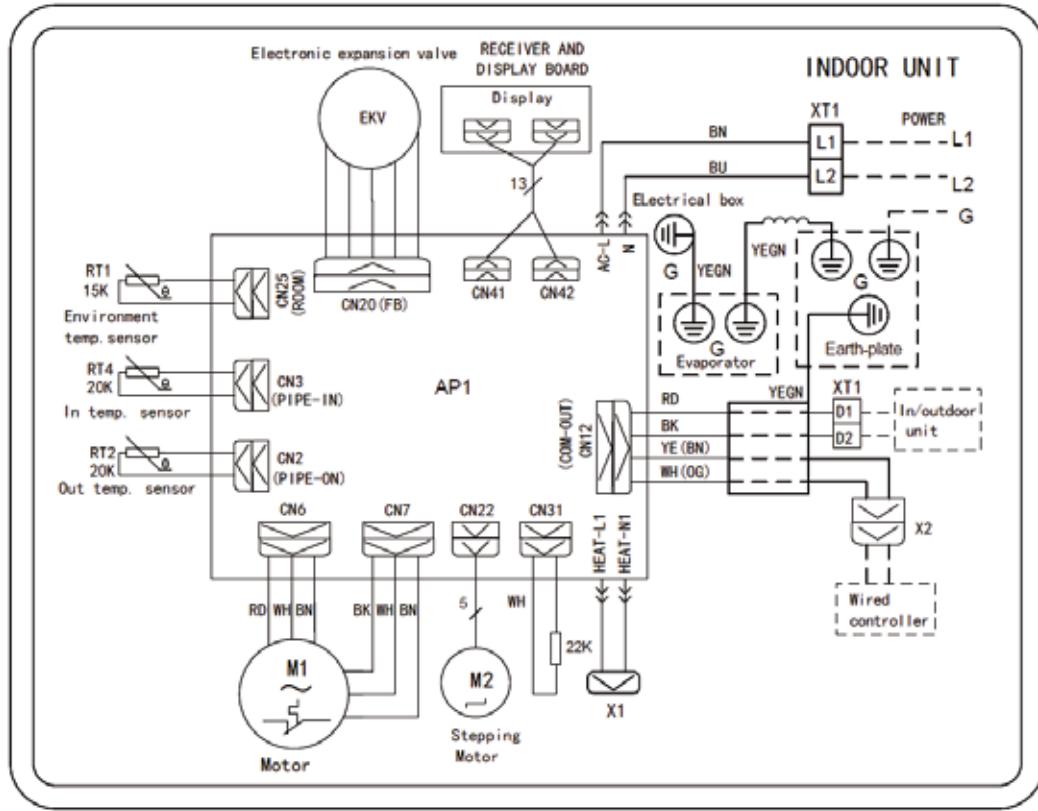

Model: GMV-ND06G/B4B-T(U) ~ GMV-ND24G/B4B-T(U):

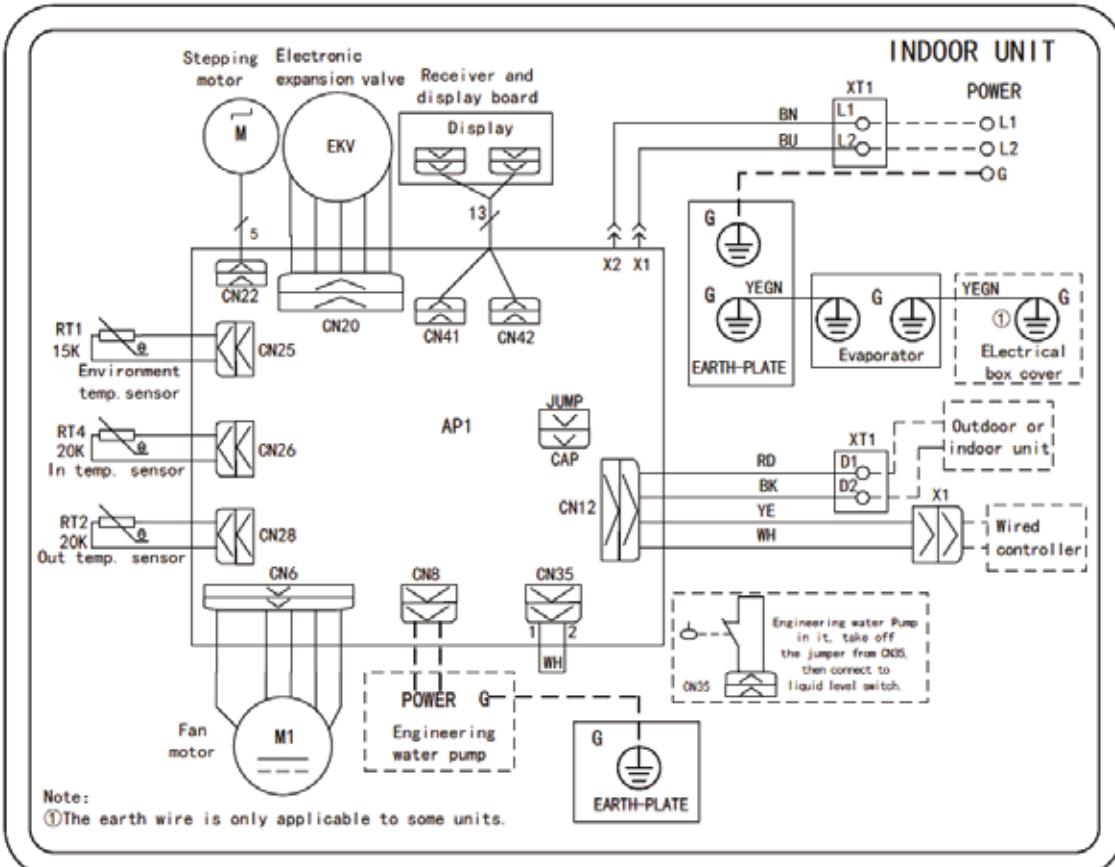


Model: GMV-ND30G/B4B-T(U), GMV-ND36G/B4B-T(U):

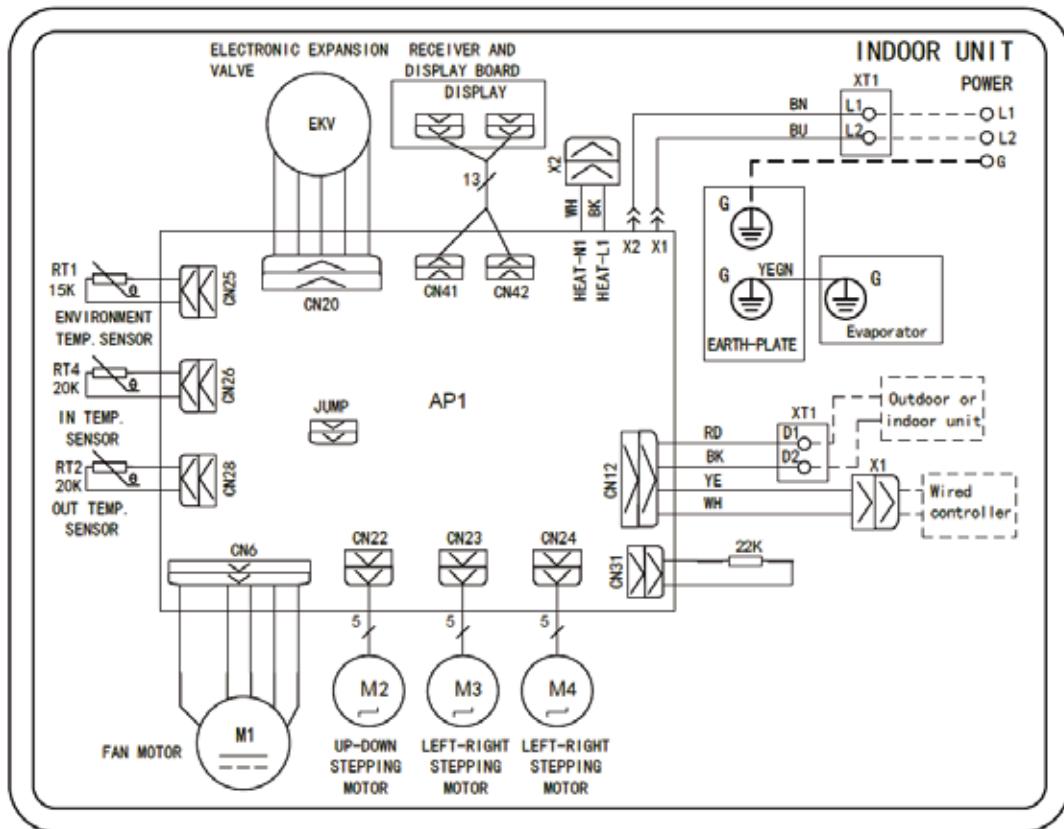


### 3.5 Console Type Indoor Unit

Model: GMV-ND07C/A-T(U) ~ GMV-ND18C/A-T(U):

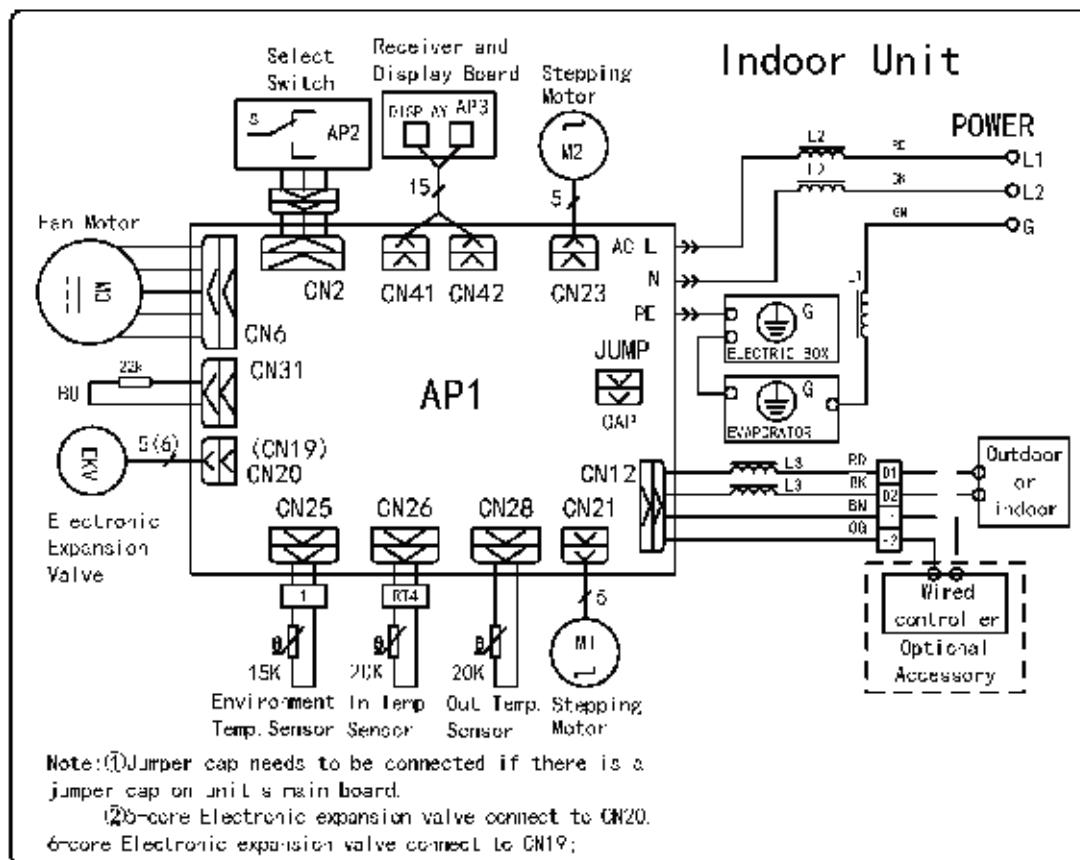


### 3.6 High Static Pressure Duct Type Indoor Unit

Model: GMV-ND18PHS/A-T(U) ~ GMV-ND48PHS/A-T(U)

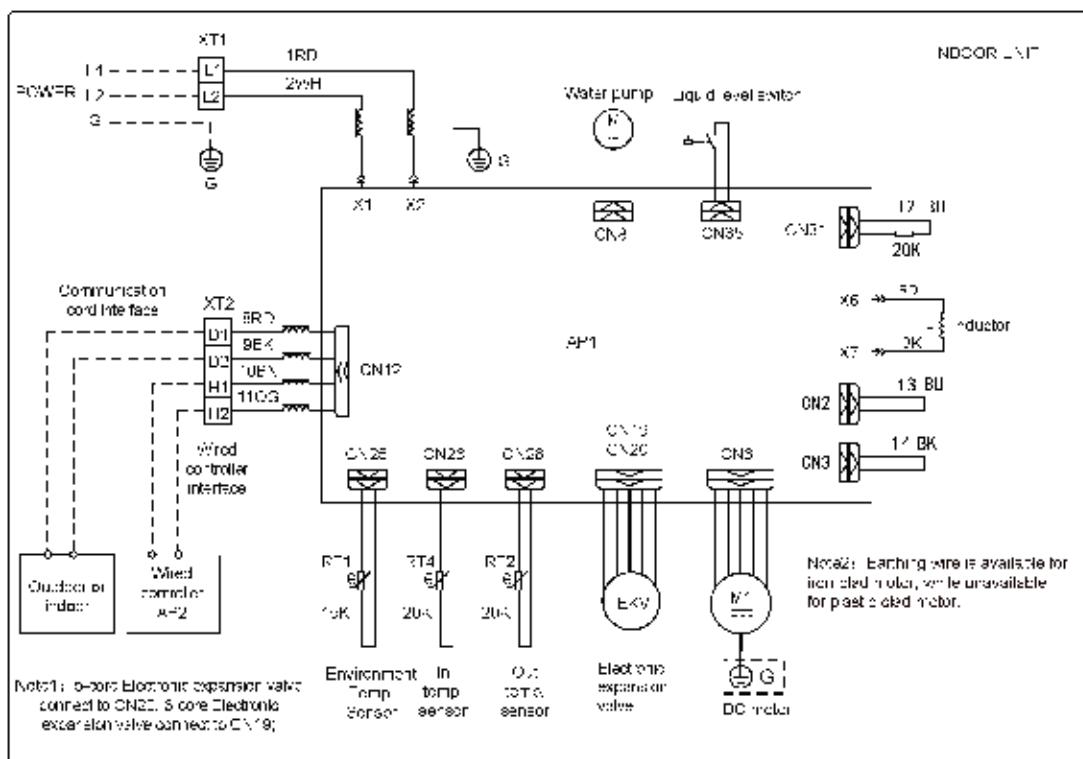


Model: GMV-ND72PH/A-T(U) / GMV-ND96PH/A-T(U)

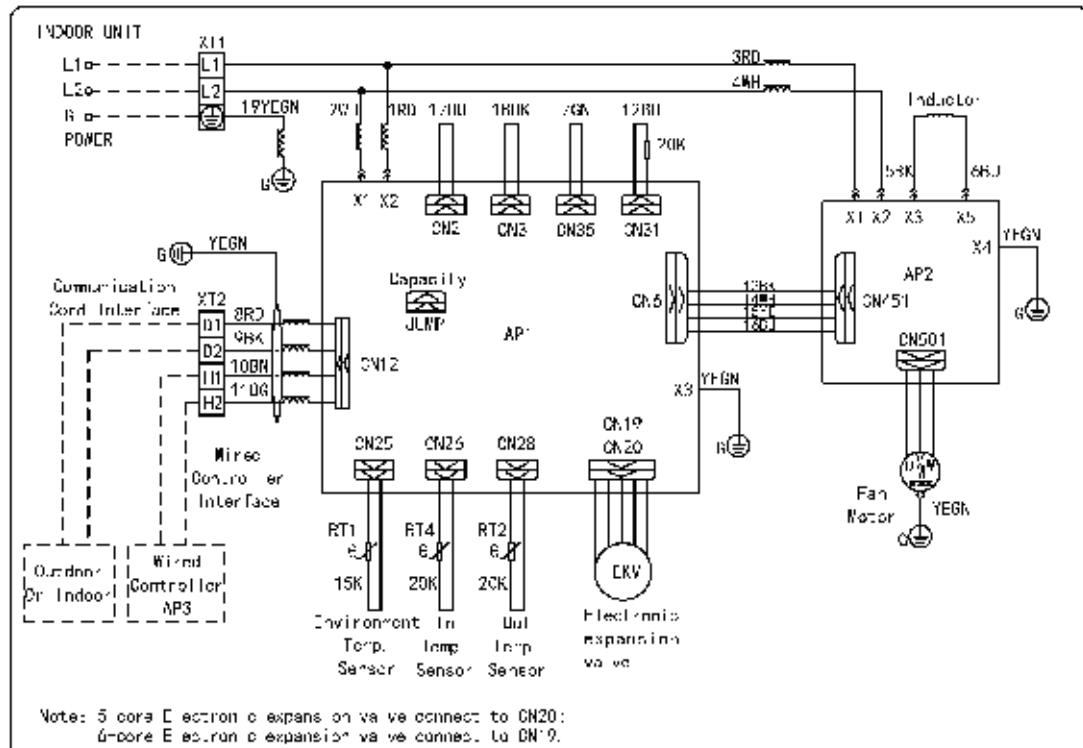


### **3.7 Two-way Cassette Type Indoor Unit**

Model: GMV-ND09TS/A-T(U) ~ GMV-ND24TS/A-T(U)

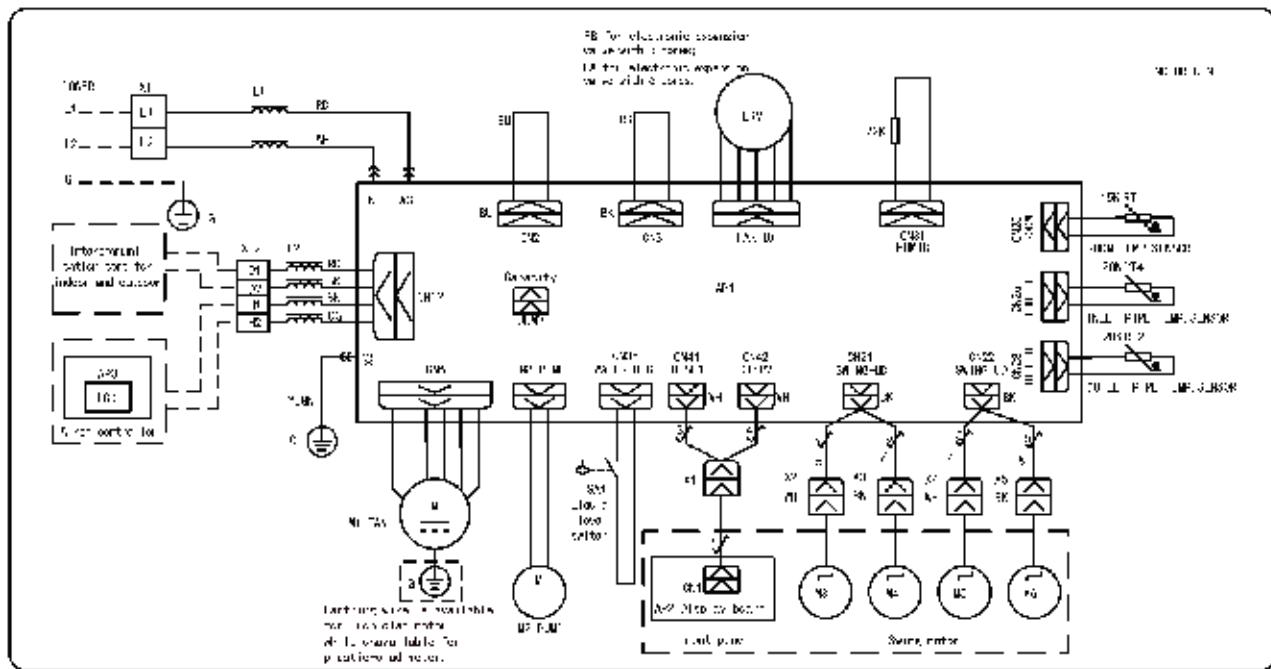


### **3.8 Floor Ceiling Type Indoor Unit**

Model: GMV-ND09ZD/A-T(U) ~ GMV-ND48ZD/A-T(U)

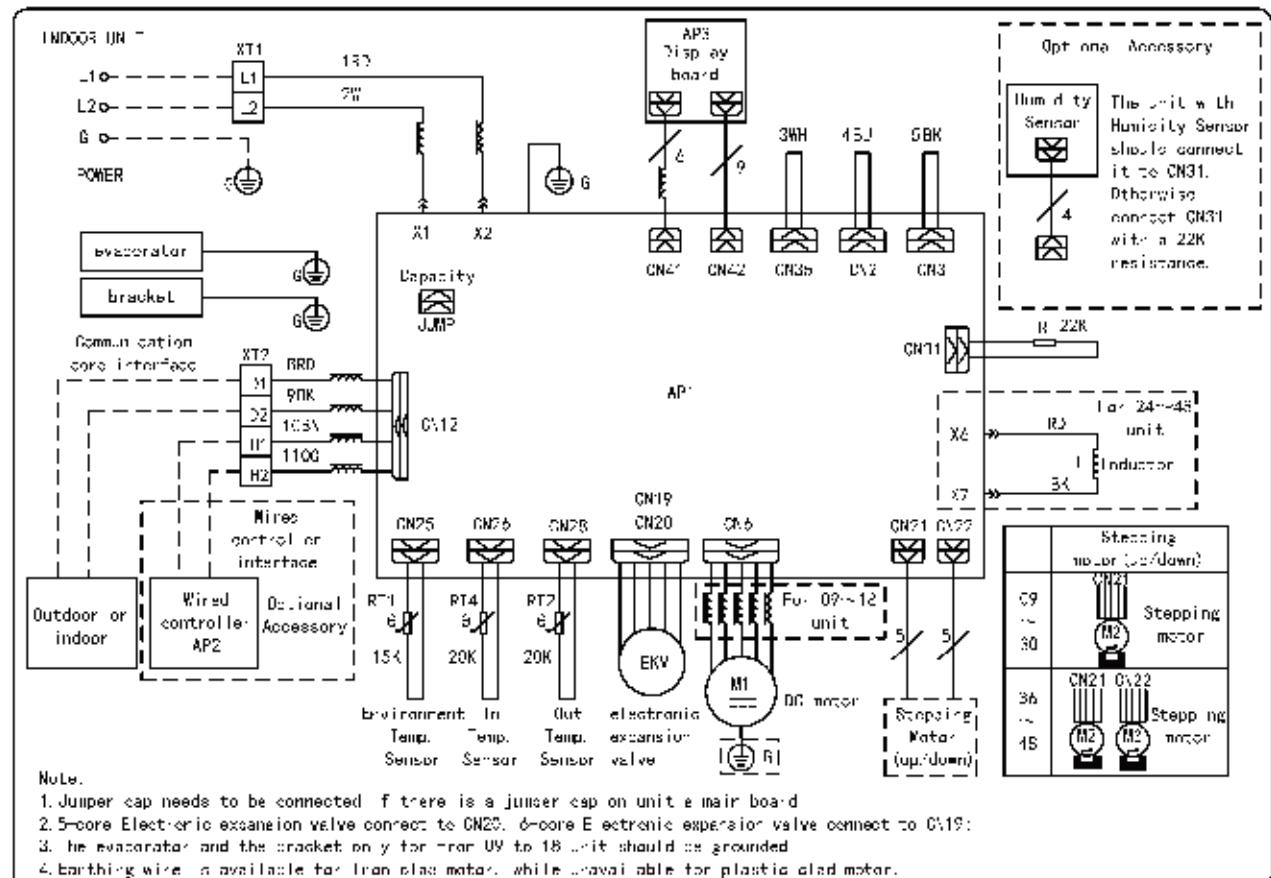


### 3.9 Fresh Air Processing Indoor Unit

Model: GMV-NDX42P/A-T(U) / GMV-NDX48P/A-T(U)

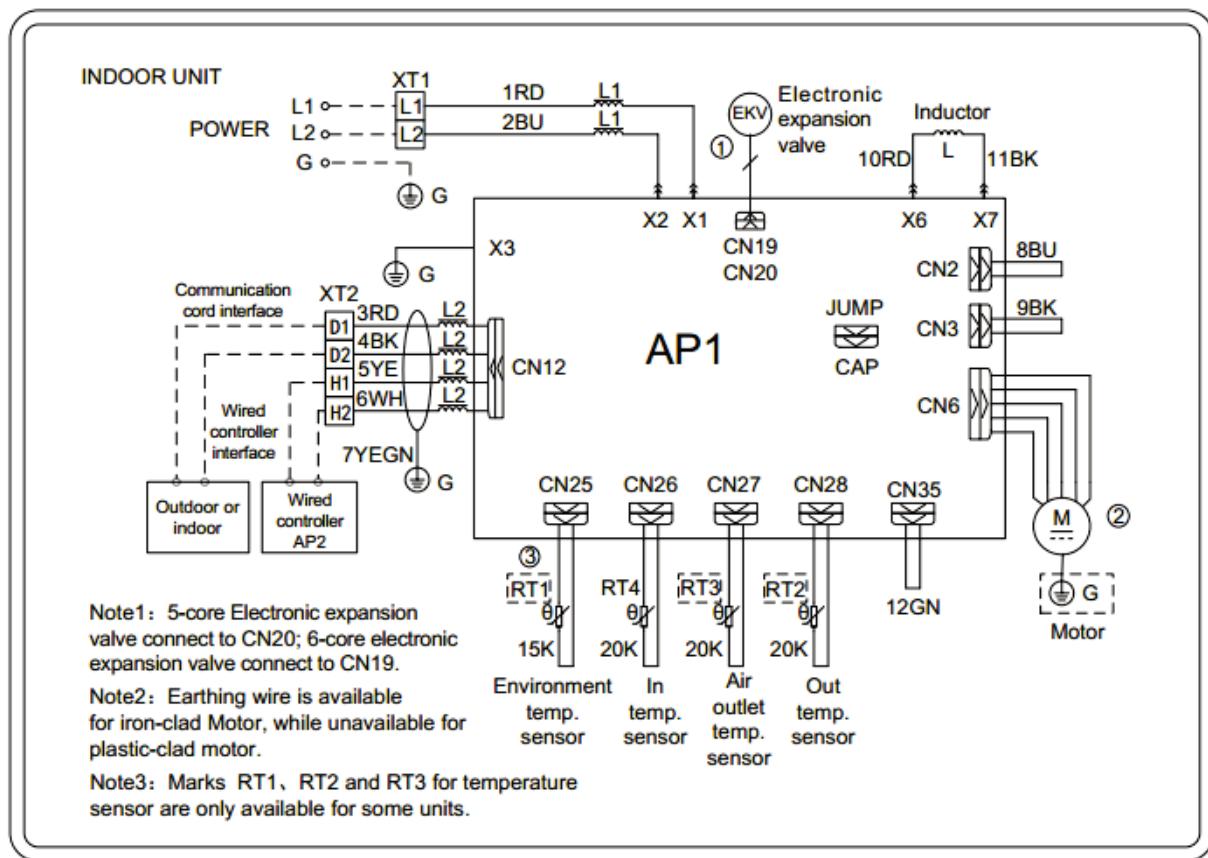


Model: GMV-NDX54P/A-T(U) / GMV-NDX72P/A-T(U) / GMV-NDX96P/A-T(U)

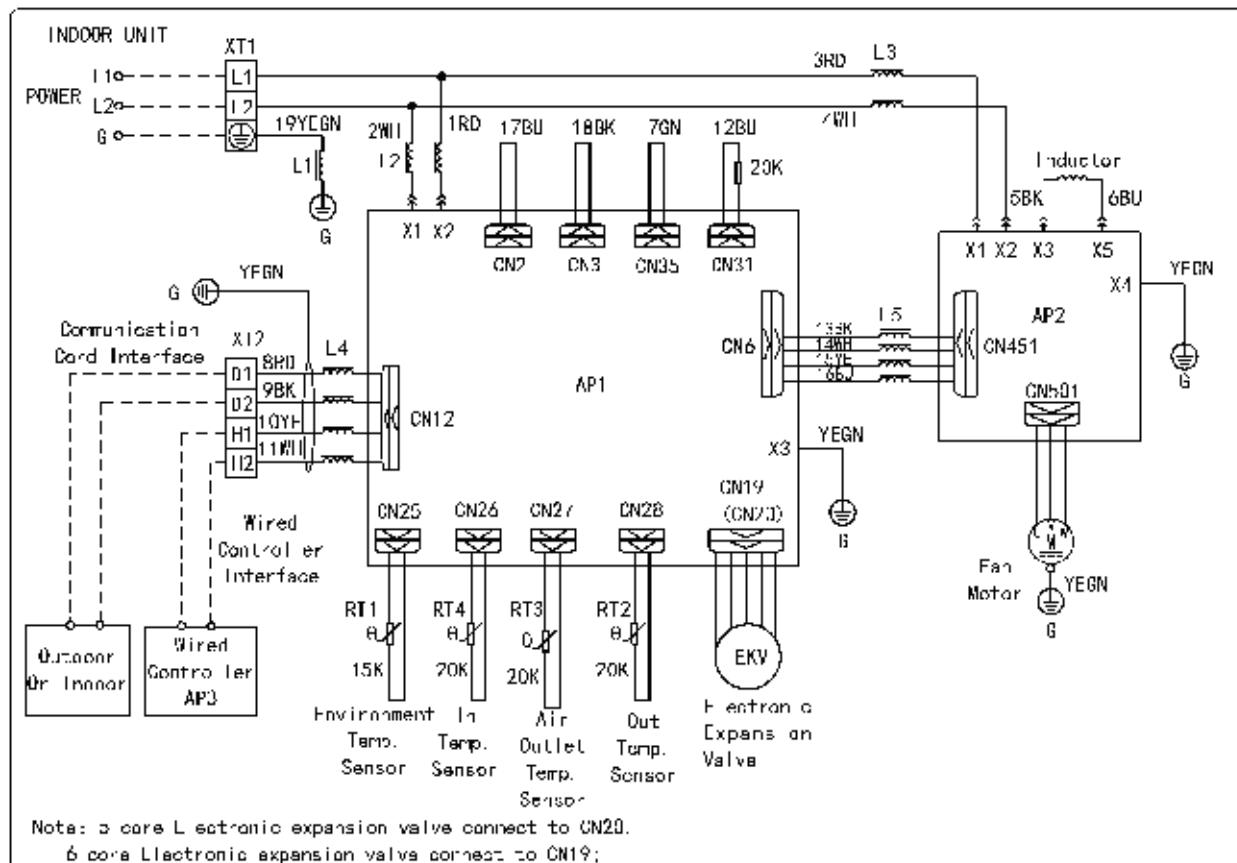


### 3.10 Compact Four-way Cassette Type Indoor Unit

Model: GMV-ND07T/B-T(U) ~ GMV-ND18T/B-T(U)

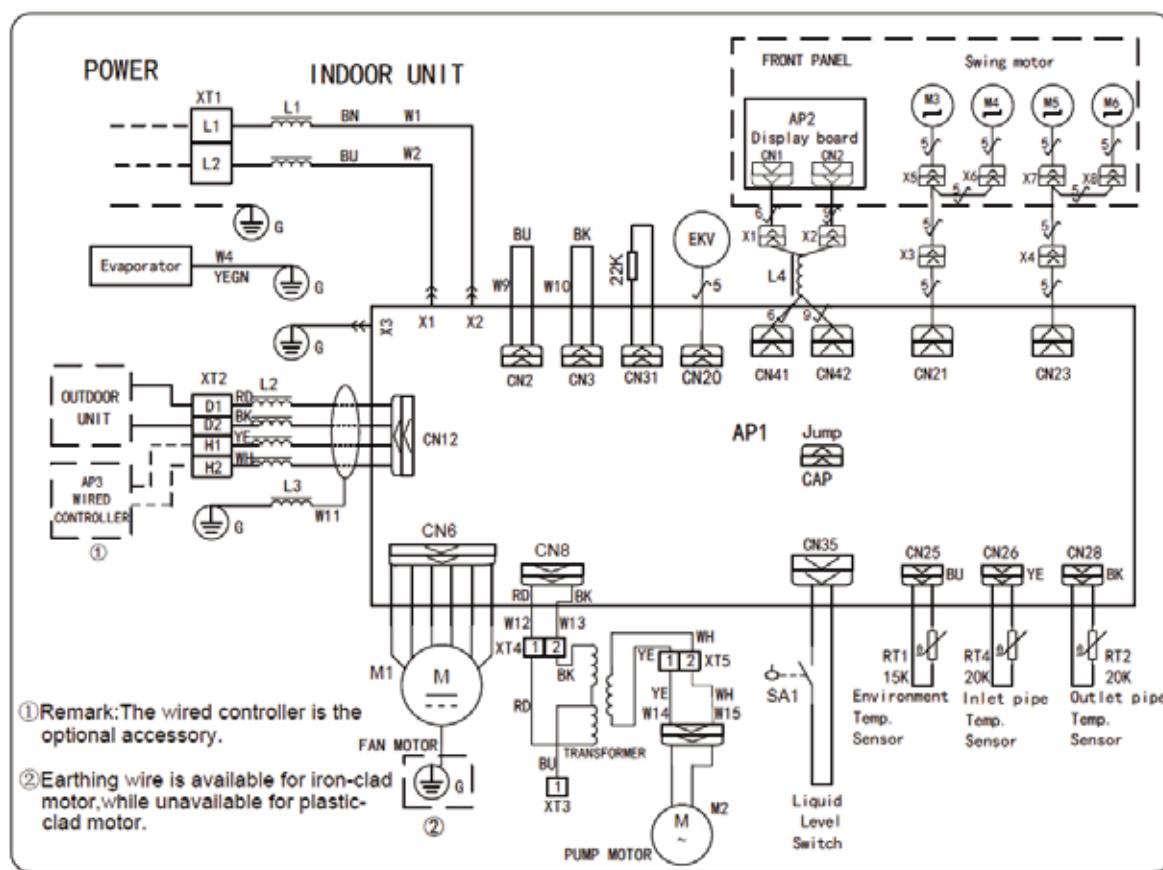


### 3.11 Super High Static Pressure Duct Type Indoor Unit


Model: GMV-ND07PHS/B-T(U) ~ GMV-ND24PHS/B-T(U)

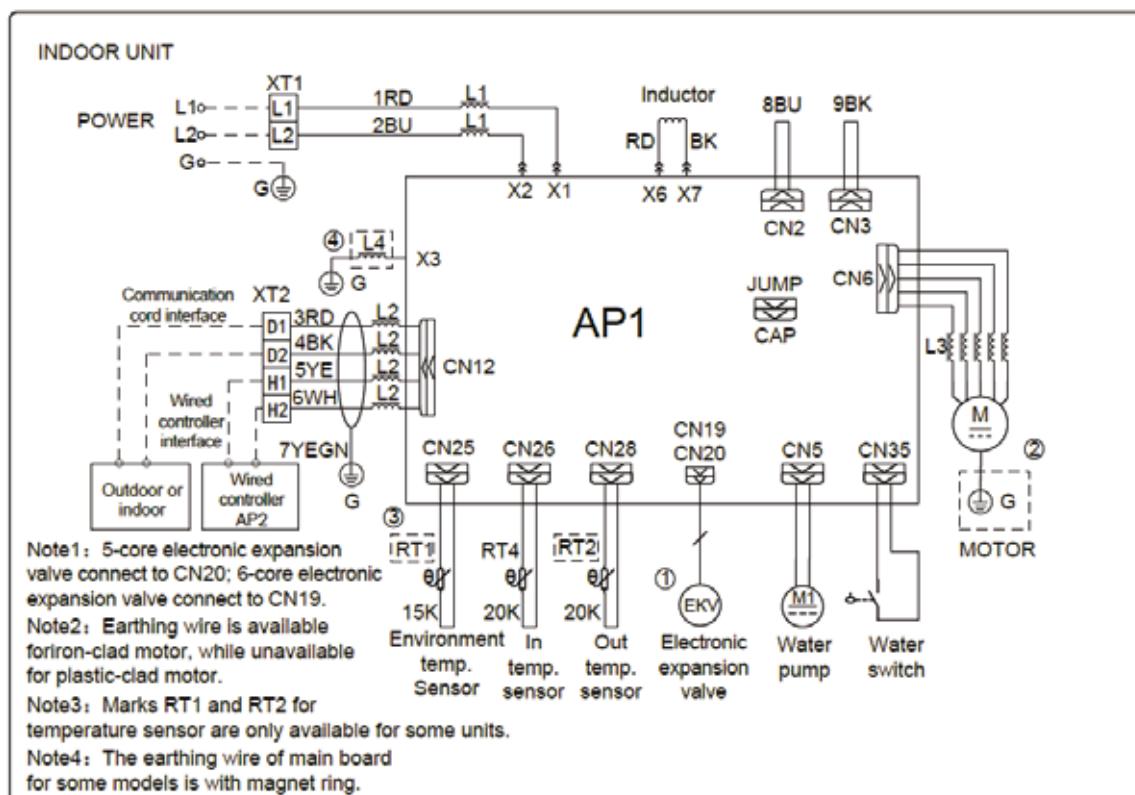


Model: GMV-ND30PHS/B-T(U) ~ GMV-ND42PHS/B-T(U)

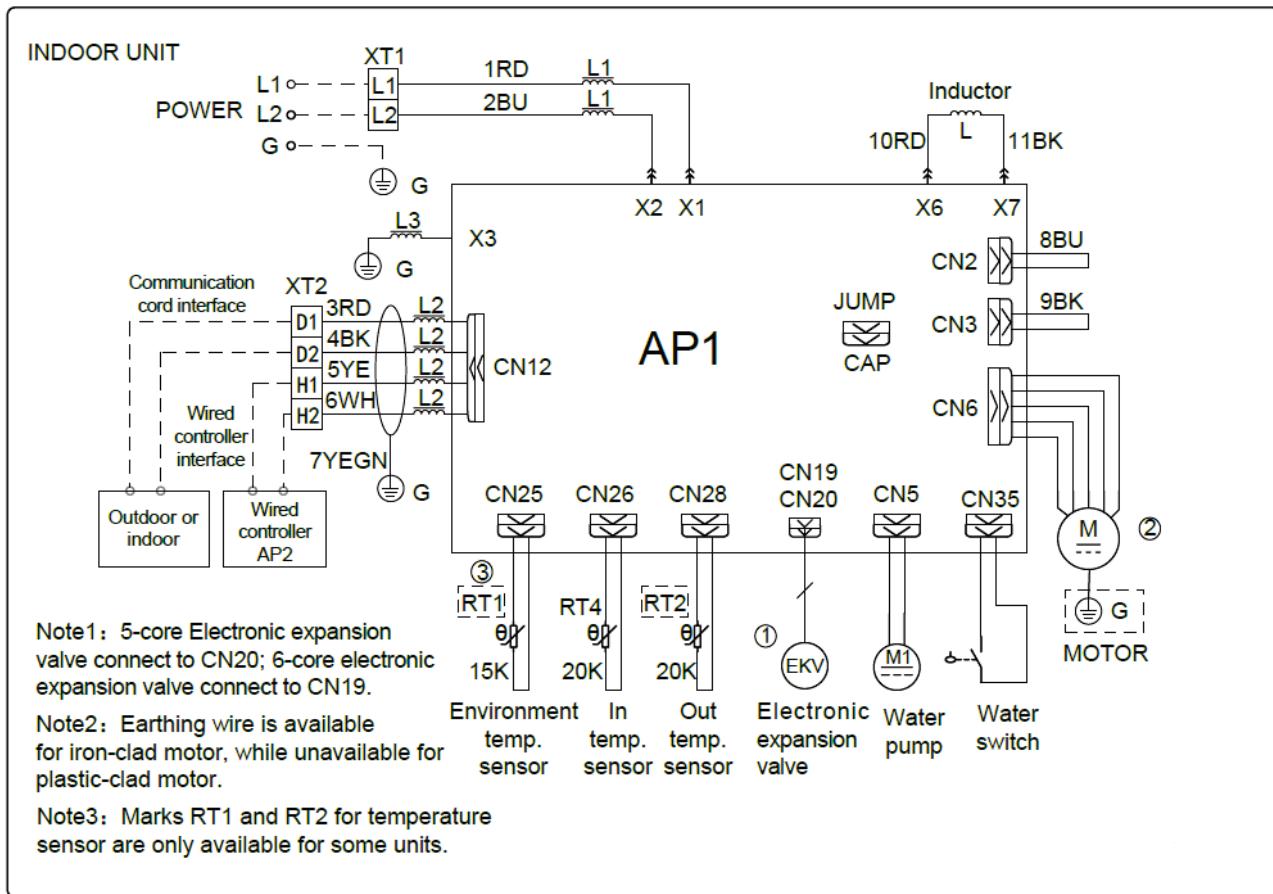

Model: GMV-ND48PHS/B-T(U) ~ GMV-ND54PHS/B-T(U)

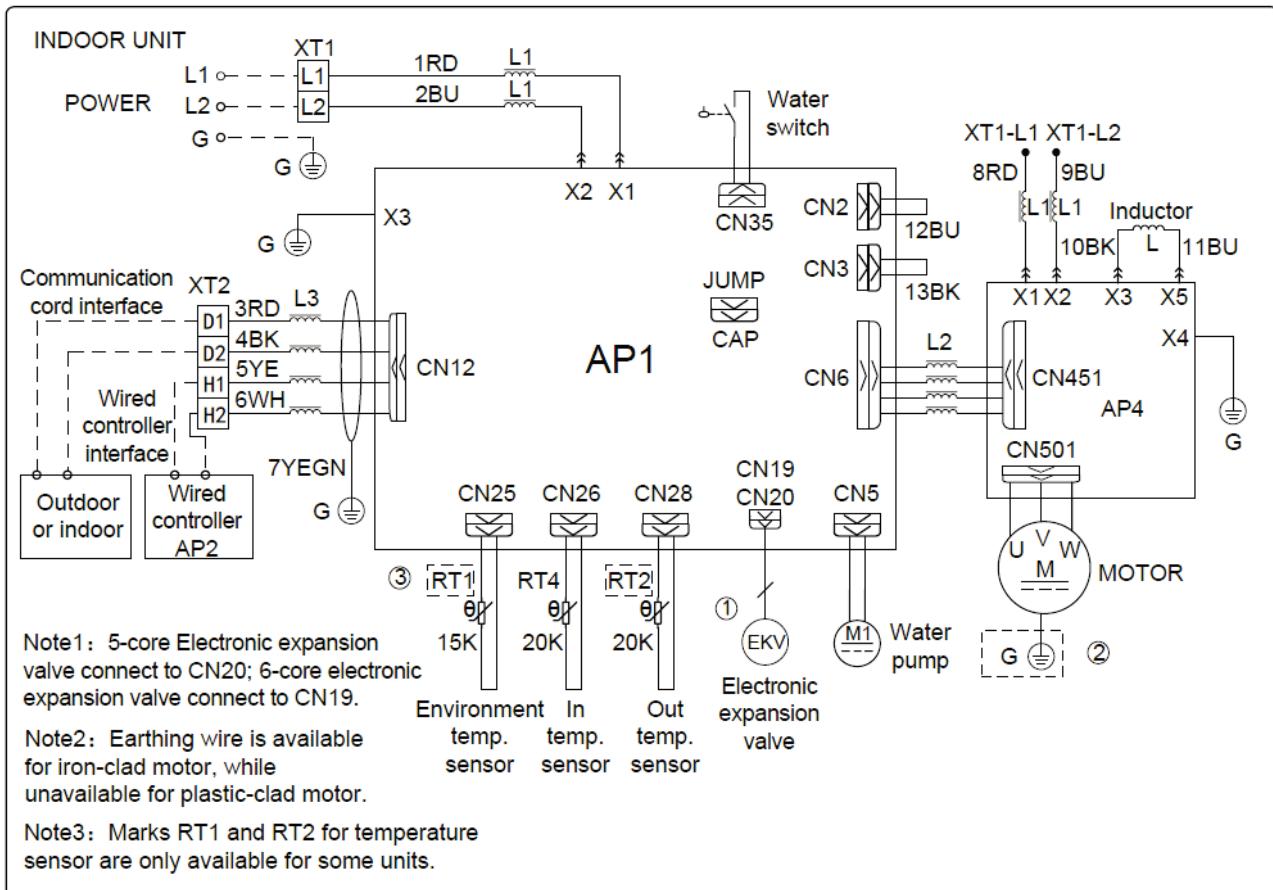


Model: GMV-ND72PH/B-T(U) / GMV-ND96PH/B-T(U)

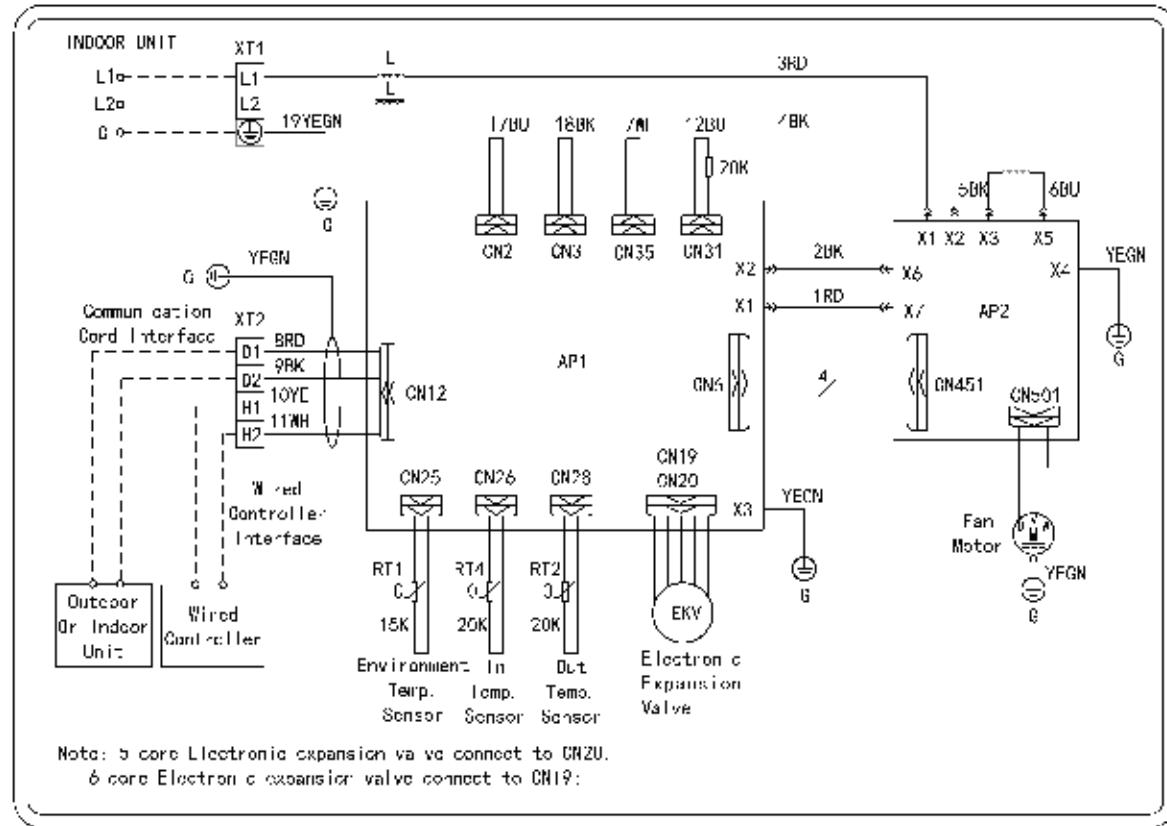


### **3.12 Air Handler type Indoor Unit**

Model: GMV-ND09A/A-T(U) / GMV-ND12A/A-T(U) / GMV-ND18A/A-T(U) / GMV-ND24A/A-T(U) /  
GMV-ND30A/A-T(U) / GMV-ND36A/A-T(U) / GMV-ND42A/A-T(U) / GMV-ND48A/A-T(U) /  
GMV-ND54A/A-T(U)

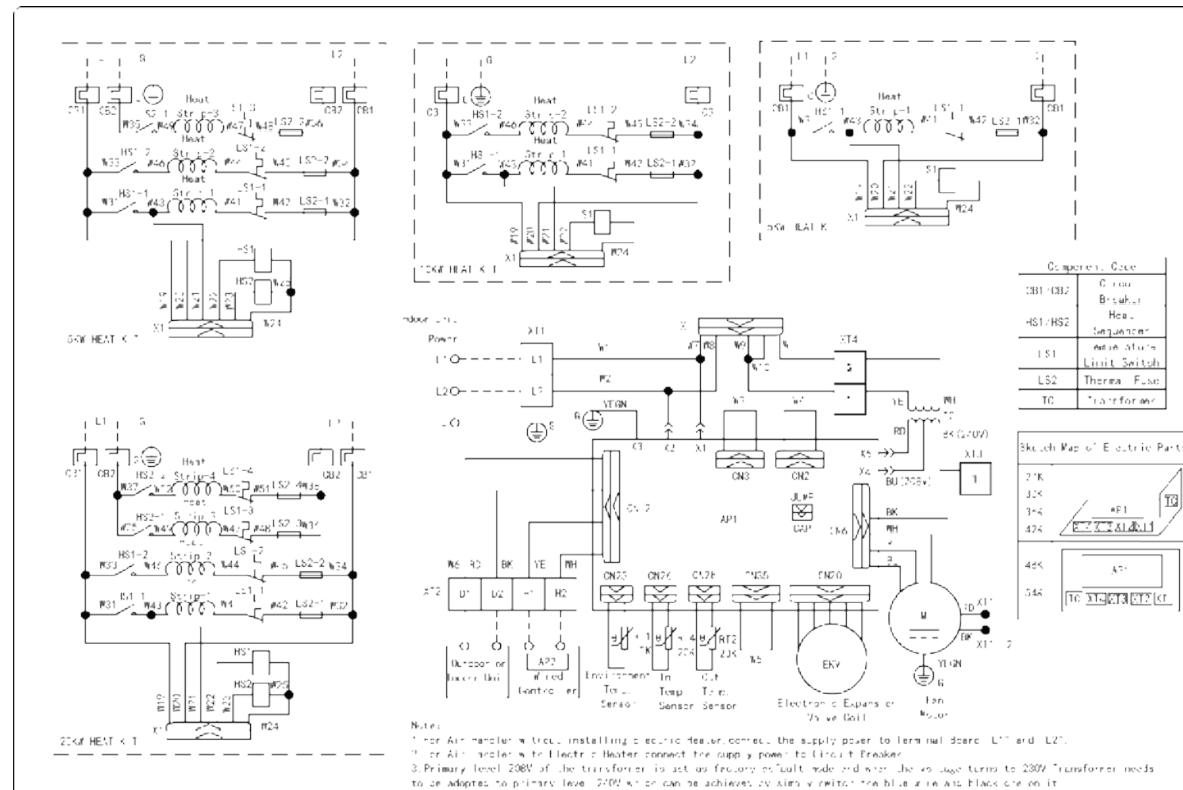


### 3.13 AHU-KIT

Model: GMV-N12U/A-T(U) / GMV-N24U/A-T(U) / GMV-N48U/A-T(U) / GMV-N96U/A-T(U) / GMV-N192U/A-T(U)

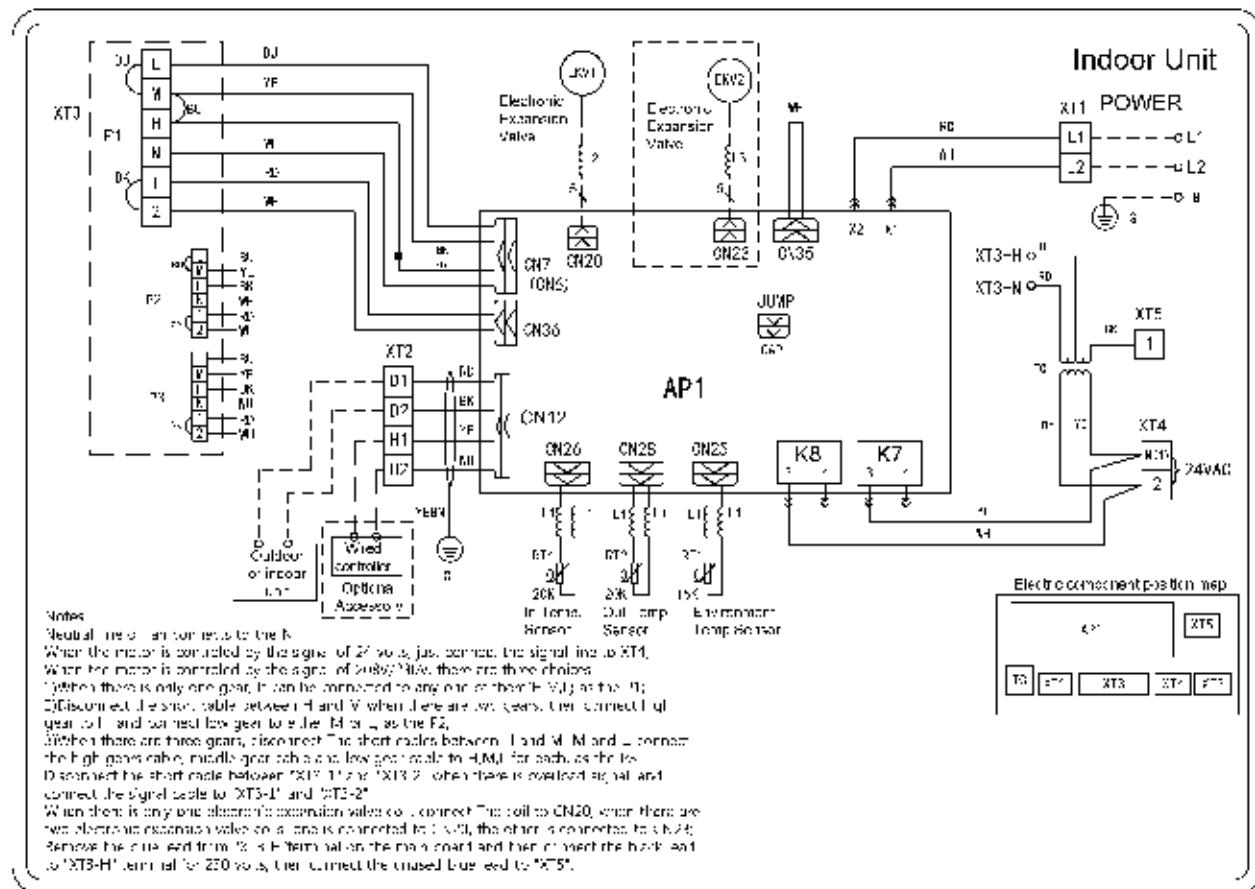


Model: GMV-N12U/C-T(U) / GMV-N24U/C-T(U) / GMV-N48U/C-T(U) / GMV-N96U/C-T(U) / GMV-N192U/C-T(U)

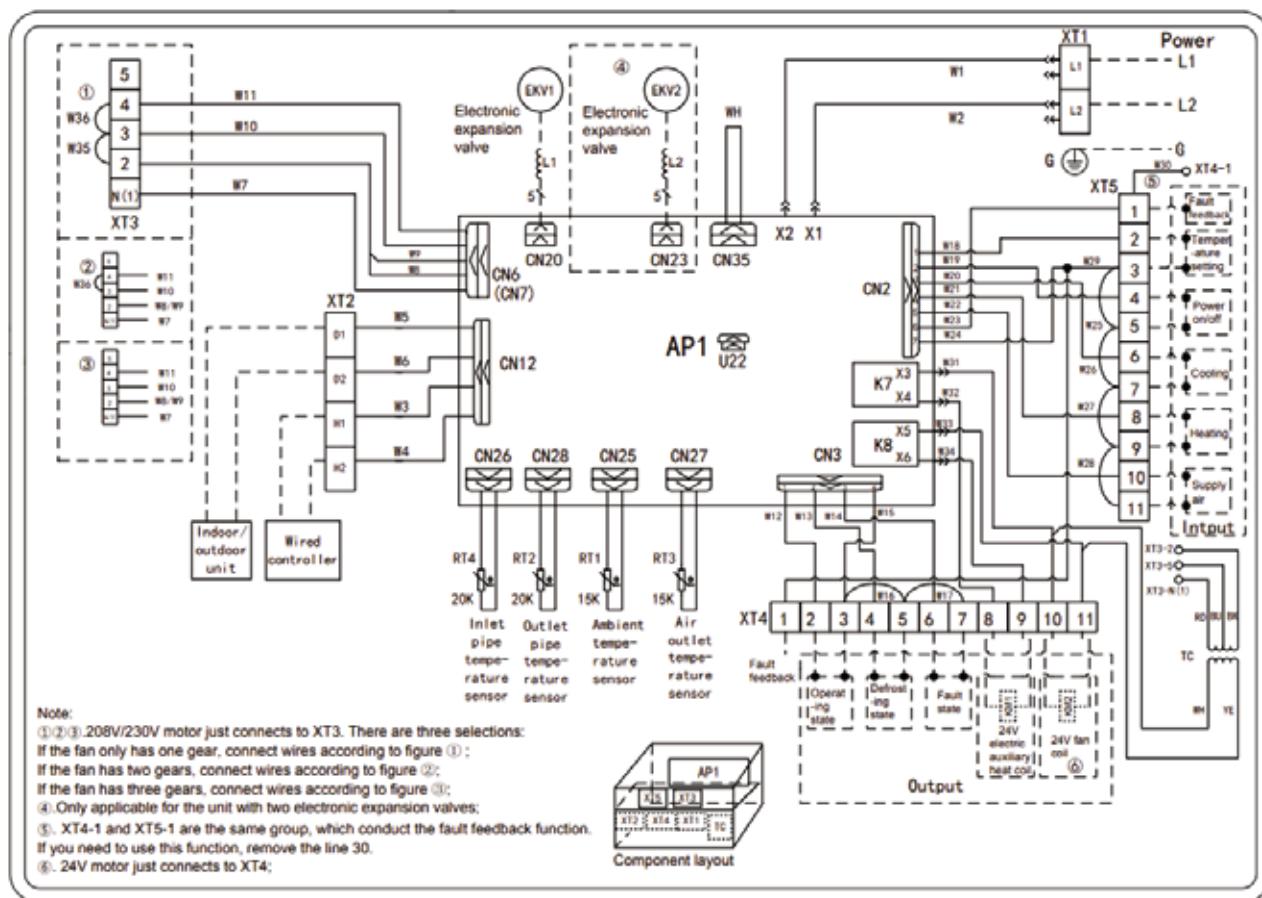


### 3.14 1-way Cassette Type Indoor Unit

Model: GMV-ND07TD/A-T(U) / GMV-ND09TD/A-T(U) / GMV-ND12TD/A-T(U)

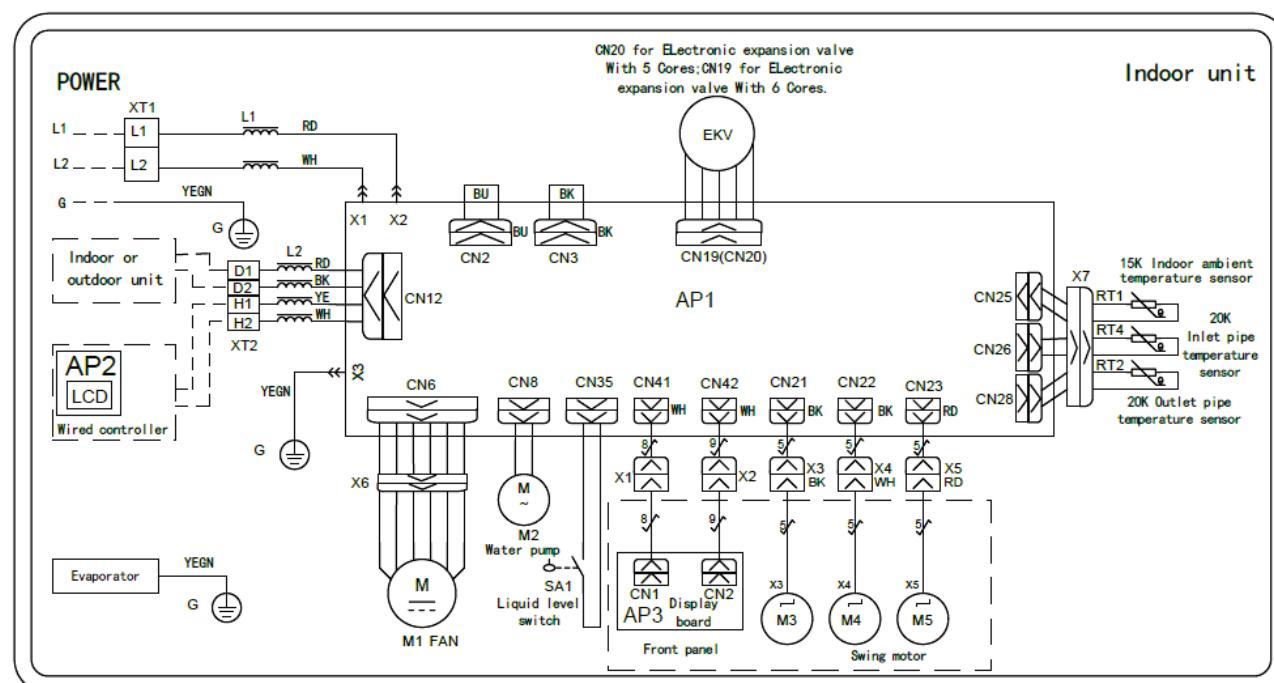


### 3.15 General Static Pressure Duct Type Indoor Unit

Model: GMV-ND30PLS/C-T(U) ~ GMV-ND48PLS/C-T(U)

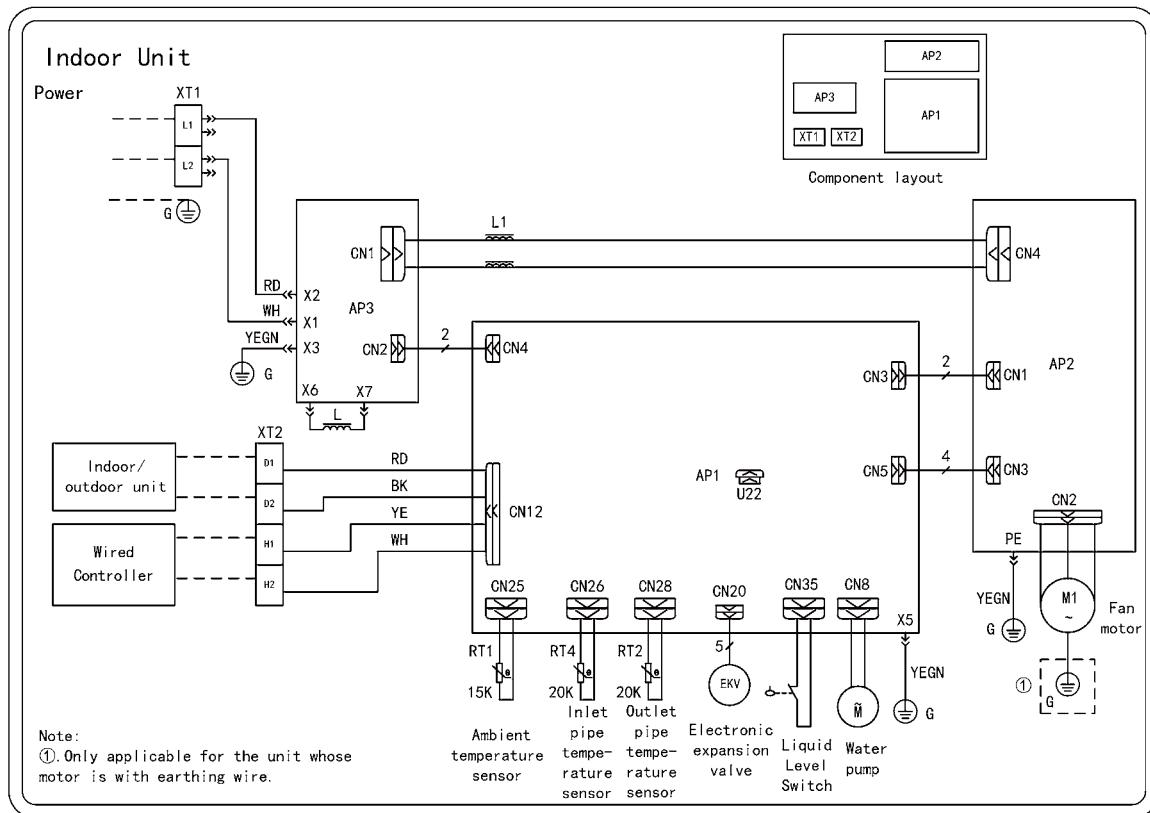


### 3.16 360°Air Discharge Compact Cassette Type Indoor Unit

Model: GMV-ND05T/E-T(U) / GMV-ND07T/E-T(U) / GMV-ND09T/E-T(U) / GMV-ND12T/E-T(U) / GMV-ND15T/E-T(U) / GMV-ND18T/E-T(U)

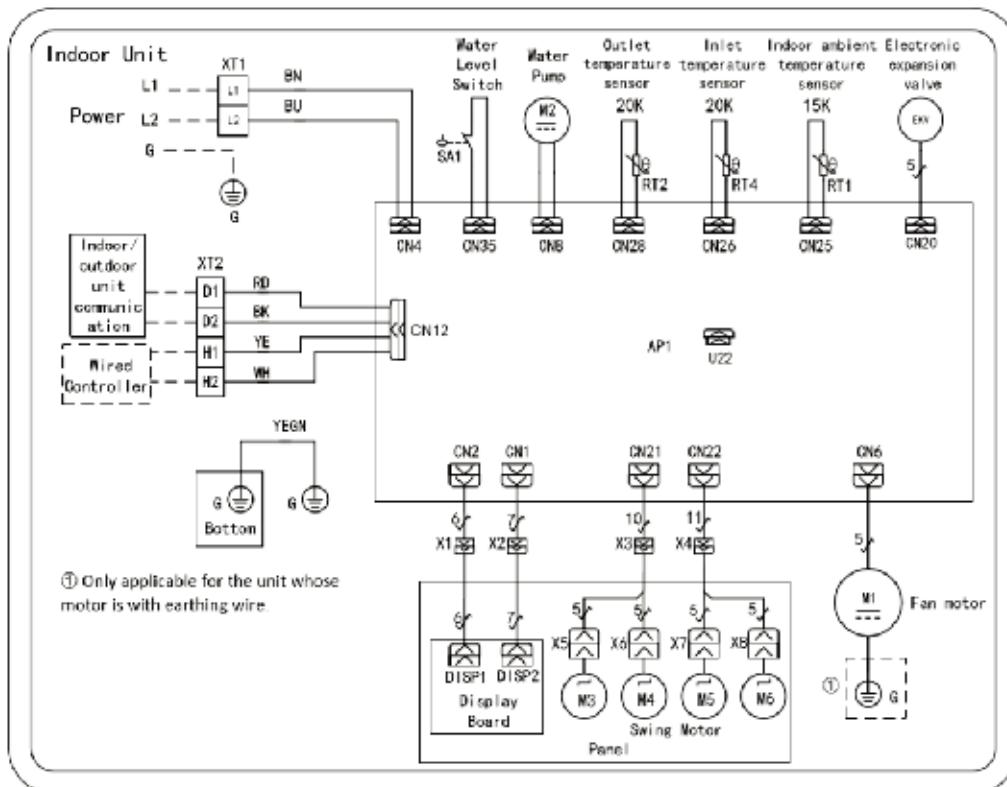

### 3.17 360°Air Discharge Cassette Type Indoor Unit









Model: GMV-ND07T/C-T(U) / GMV-ND09T/C-T(U) / GMV-ND12T/C-T(U) / GMV-ND15T/C-T(U) / GMV-ND18T/C-T(U) / GMV-ND22T/C-T(U) / GMV-ND24T/C-T(U) / GMV-ND30T/C-T(U) GMV-ND36T/C-T(U) / GMV-ND42T/C-T(U) / GMV-ND48T/C-T(U)

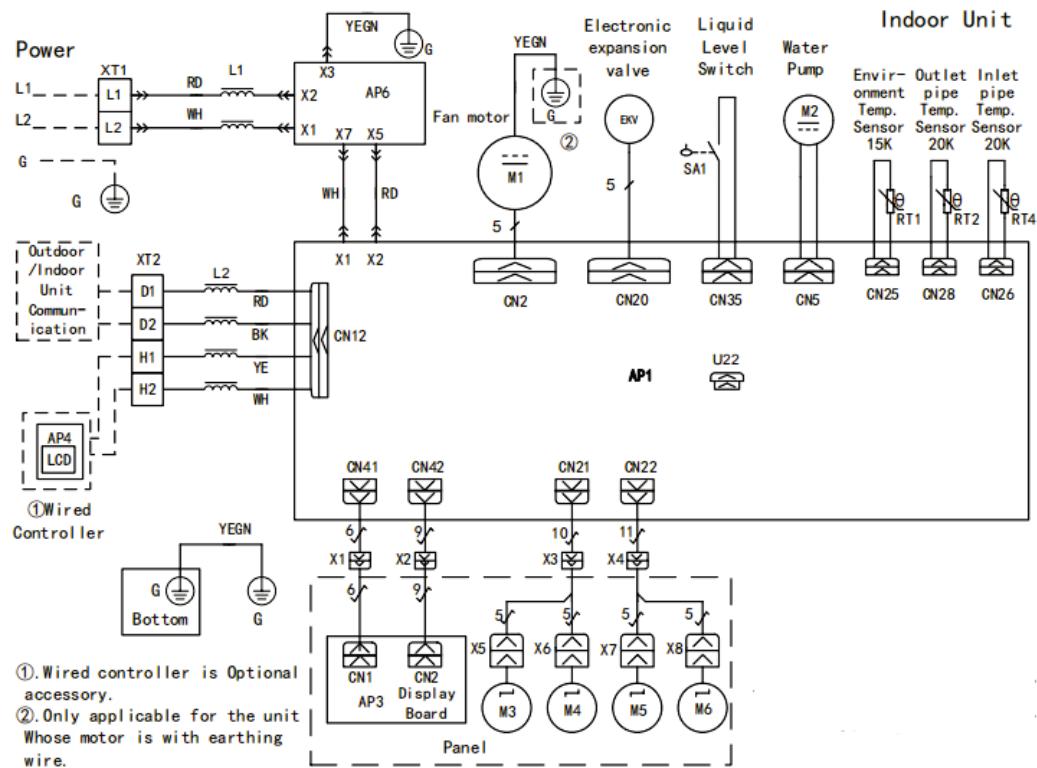







## 4 Disassembly And Assembly Procedure of Main Parts


### 4.1 Low Static Pressure Duct Type Indoor Unit

**NOTICE!** The following steps are specific for GMV-ND09PLS/A-T(U) units. For other units, the assembly and disassembly procedure is similar except the numbers of centrifugal fans and motors.

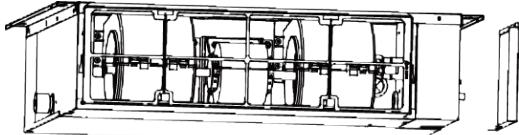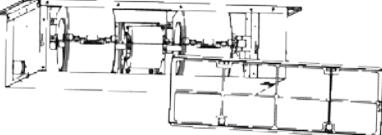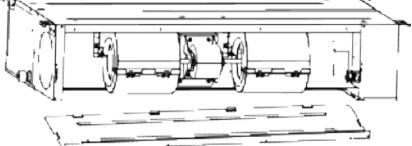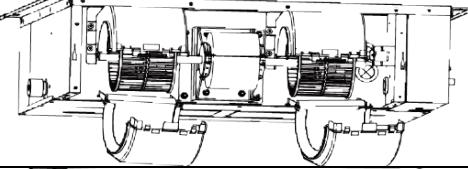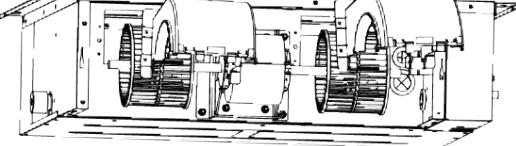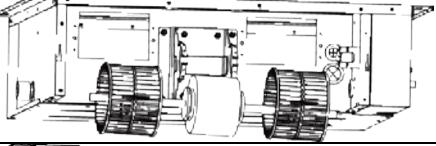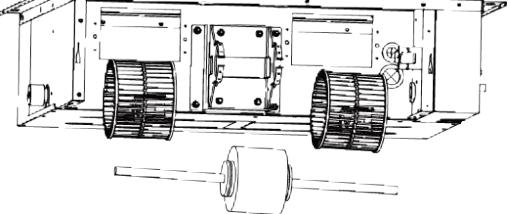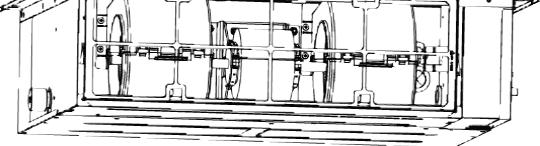Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(1) Remove the line connecting to the motor.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the electric box cover.</li> <li>Remove from the master board the line connecting to the motor and remove the tie.</li> </ul>
(2) Remove the filter.		<ul style="list-style-type: none"> <li>Remove the filter from the air return frame.</li> </ul>
(3) Remove the air return cover plate.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the air return cover plate.</li> </ul>
(4) Remove the rear volute casing.		<ul style="list-style-type: none"> <li>Loosen the fasteners that connect the rear volute casing with the front volute casing and remove the rear volute casing.</li> </ul>
(5) Remove the front volute casing.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the front volute casing and then remove the volute casing.</li> </ul>
(6) Loosen the centrifugal fan and motor.		<ul style="list-style-type: none"> <li>Use a hexagon to unscrew the centrifugal fan and loosen the fasteners of the motor.</li> </ul>
(7) Remove the motor.		<ul style="list-style-type: none"> <li>Remove the motor from the support and remove the centrifugal fan from the motor axle. Then, remove the motor.</li> <li>For motors that are accompanied with supports, the supports need removing as well.</li> </ul>
(8) Install a new motor.		<ul style="list-style-type: none"> <li>Assemble units based on the reverse order of this procedure and power on the units for test.</li> </ul>






**NOTICE!** The following steps are specific for GMV-ND09PLS/B-T(U) units. For other units, the assembly and disassembly procedure is similar except the numbers of centrifugal fans and motors.

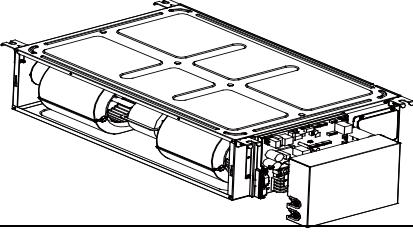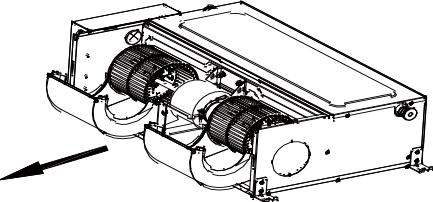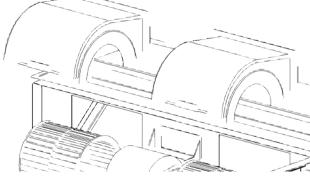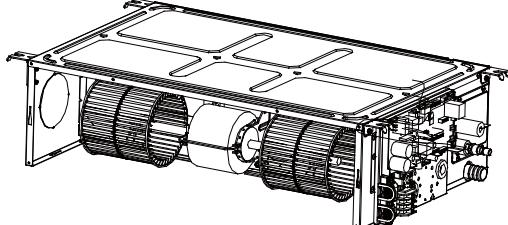
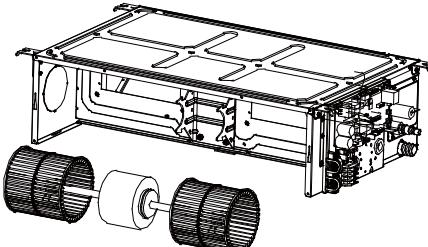
Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(1) Remove the air return filter.		<ul style="list-style-type: none"> <li>Draw the air return filter to both sides respectively at the return air inlet.</li> </ul>
(2) Remove the cover plate of the electric box.		<ul style="list-style-type: none"> <li>Disconnect the power supply of the IDUs, use a screwdriver to unscrew the cover plate of the electric box, and then remove the line connecting to the motor.</li> </ul>
(3) Remove the rear volute casing.		<ul style="list-style-type: none"> <li>Loosen the fasteners that connect the rear volute casing with the front volute casing and remove the rear volute casing.</li> </ul>
(4) Remove the front volute casing.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the front volute casing and then remove the volute casing.</li> </ul>
(5) Remove the louver and motor.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the louver and loosen the fasteners of the motor.</li> </ul>
(6) Install a new motor.		<ul style="list-style-type: none"> <li>Remove the motor from the support and remove the louver from the motor. Then, remove the motor.</li> <li>Install a new motor.</li> </ul>

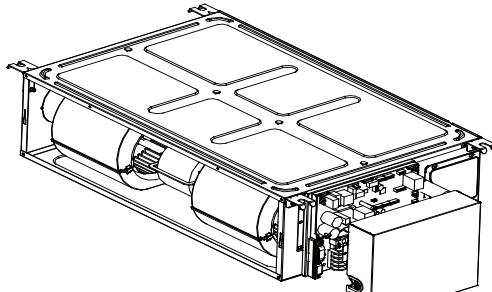Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(7) Install units in a reverse order of this procedure.		<ul style="list-style-type: none"> <li>Assemble units based on the reverse order of this procedure and power on the units for test.</li> </ul>






## 4.2 Slim Duct Type Indoor Unit





**NOTICE!** The following steps are specific for GMV-ND24PLS/B-T(U) units. For other units, the assembly and disassembly procedure is similar except the numbers of louvers and motors.

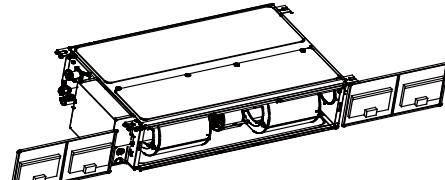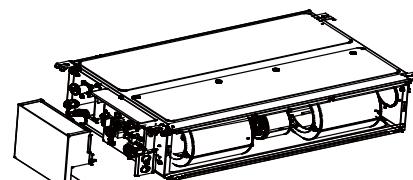
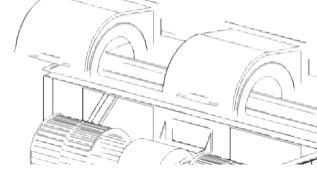
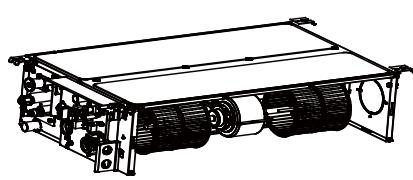
Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(1) Remove the air return filter.		<ul style="list-style-type: none"> <li>Draw the air return filter to both sides respectively at the return air inlet.</li> </ul>
(2) Remove the cover plate of the electric box.		<ul style="list-style-type: none"> <li>Disconnect the power supply of the IDUs, use a screwdriver to unscrew the cover plate of the electric box, and then remove the line connecting to the motor.</li> </ul>
(3) Remove the rear volute casing.		<ul style="list-style-type: none"> <li>Loosen the fasteners that connect the rear volute casing with the front volute casing and remove the rear volute casing.</li> </ul>
(4) Remove the front volute casing.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the front volute casing and then remove the volute casing.</li> </ul>
(5) Remove the louver and motor.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the louver and loosen the fasteners of the motor.</li> </ul>

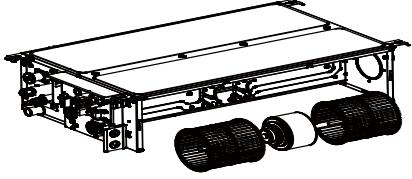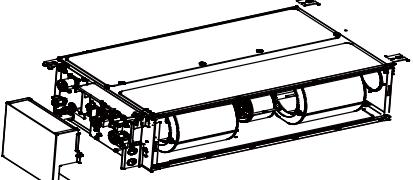Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(6) Install a new motor.		<ul style="list-style-type: none"> <li>Remove the motor from the support and remove the louver from the motor. Then, remove the motor.</li> <li>Install a new motor.</li> </ul>
(7) Install units in a reverse order of this procedure.		<ul style="list-style-type: none"> <li>Assemble units based on the reverse order of this procedure and power on the units for test.</li> </ul>

### 4.3 Four-way Cassette Type Indoor Unit

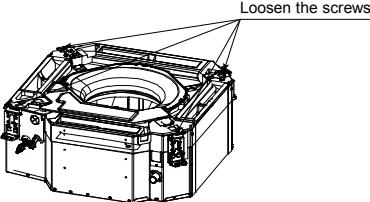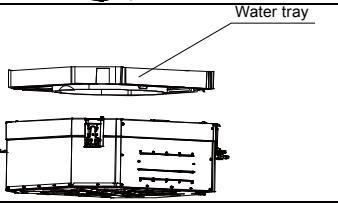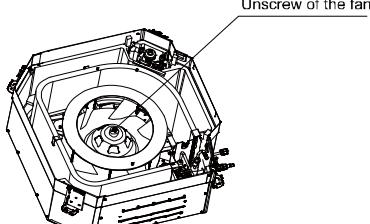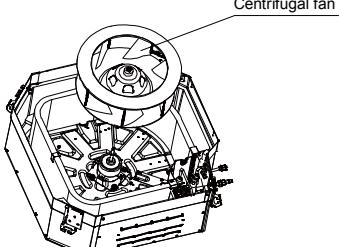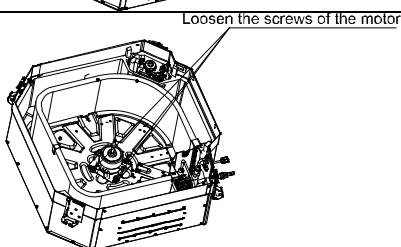Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(1) Unscrew the water tray.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the water tray.</li> </ul>
(2) Remove the water tray.		<ul style="list-style-type: none"> <li>Remove the water tray.</li> </ul>
(3) Unscrew the centrifugal fan.		<ul style="list-style-type: none"> <li>Use a wrench to unscrew the centrifugal fan.</li> </ul>
(4) Remove the centrifugal fan.		<ul style="list-style-type: none"> <li>Remove the centrifugal fan.</li> </ul>
(5) Unscrew the motor.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the motor.</li> </ul>

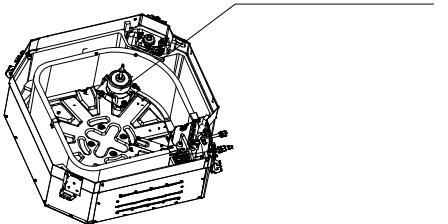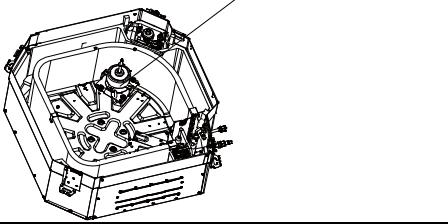
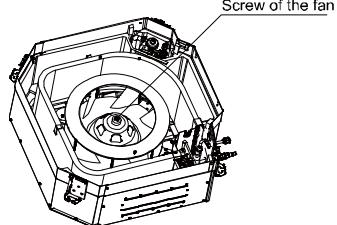
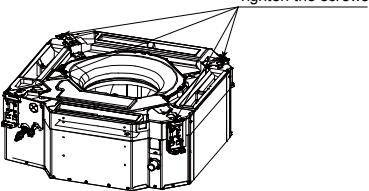
Motor and fan		
Step	Diagram	Operation Procedure
(6) Replace the motor with a new one.		<ul style="list-style-type: none"> <li>Replace the motor with a new one.</li> </ul>
(7) Screw the motor.		<ul style="list-style-type: none"> <li>Use a screwdriver to screw the motor.</li> </ul>
(8) Install and screw the centrifugal fan.		<ul style="list-style-type: none"> <li>Install the centrifugal fan and use a wrench to screw the centrifugal fan.</li> </ul>
(9) Install and screw the water tray.		<ul style="list-style-type: none"> <li>Use a screwdriver to screw the water tray.</li> </ul>

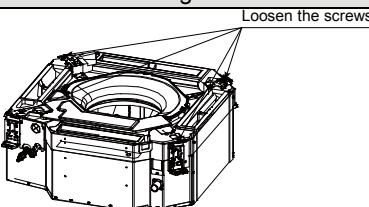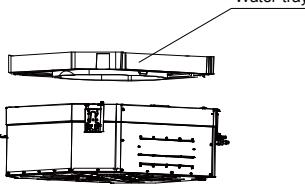
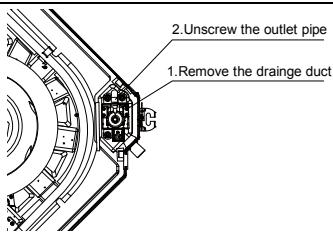
Pump		
Step	Diagram	Operation Procedure
(1) Unscrew the water tray.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the water tray.</li> </ul>
(2) Remove the water tray.		<ul style="list-style-type: none"> <li>Replace the water tray.</li> </ul>
(3) Remove the drainage duct and unscrew the pump.		<ul style="list-style-type: none"> <li>Remove the drainage duct and use a screwdriver to unscrew the pump.</li> </ul>

Pump		
Step	Diagram	Operation Procedure
(4) Replace the pump.		<ul style="list-style-type: none"> <li>● Replace the pump.</li> </ul>
(5) Connect the drainage duct and screw the new pump.		<ul style="list-style-type: none"> <li>● Connect the drainage duct and use a screwdriver to screw the new pump.</li> </ul>
(6) Install and screw the water tray.		<ul style="list-style-type: none"> <li>● Use a screwdriver to screw the water tray.</li> </ul>






#### 4.4 Wall Mounted Type Indoor Unit


Removal of Fan Motor		
Remark: before removing, making sure power is disconnected.		
Step	Diagram	Operation Procedure
(1) Remove the louver.		<ul style="list-style-type: none"> <li>● Take off the axle bush of the louver.</li> <li>● Remove the louver.</li> </ul>
(2) Open the front panel.		<ul style="list-style-type: none"> <li>● Hold the indents on both sides of the panel and pull it out in the direction shown by the arrow.</li> </ul>
(3) Remove the electrical box cover 2.		<ul style="list-style-type: none"> <li>● Unscrew the screws fixing the electrical box cover with a screwdriver. Take off the box cover 2.</li> <li>● Detach the ambient temperature sensor from the conduit.</li> </ul>

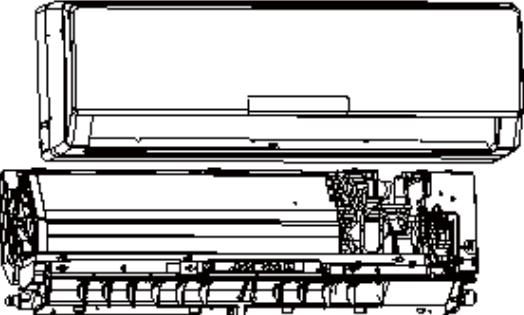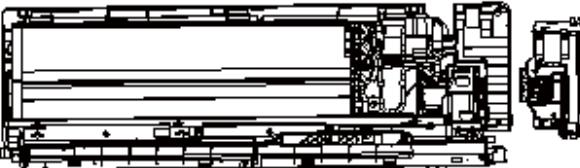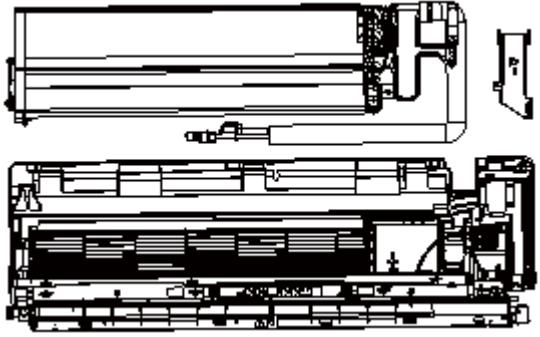Removal of Fan Motor		
Remark: before removing, making sure power is disconnected.		
Step	Diagram	Operation Procedure
(4) Remove the front panel assembly.		<ul style="list-style-type: none"> <li>Unscrew the screws fixing the front panel assembly.</li> <li>Remove the front panel assembly.</li> </ul>
(5) Remove the electrical box cover 1.		<ul style="list-style-type: none"> <li>Press on the buckle of the box cover 1 and then take off the cover.</li> </ul>
(6) Remove the main board.		<ul style="list-style-type: none"> <li>Release the wiring terminals connected to the main board.</li> <li>Remove the main board.</li> </ul>
(7) Remove the electrical box.		<ul style="list-style-type: none"> <li>Unscrew the screws fixing the electrical box with a screwdriver.</li> <li>Remove the electrical box.</li> </ul>
(8) Remove the evaporator.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the screws fixing the press plate of connection pipe on the back of the unit and take off the press plate.</li> <li>Unscrew the screws of evaporator with a screwdriver and then remove the evaporator.</li> </ul>
(9) Remove motor's pressing plate.		<ul style="list-style-type: none"> <li>Unscrew the fixing screws of the pressing plate with a screwdriver and then remove it.</li> </ul>

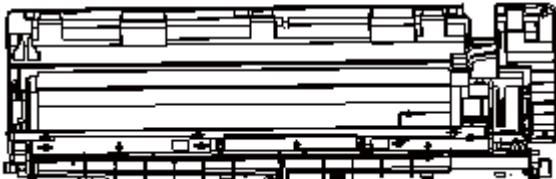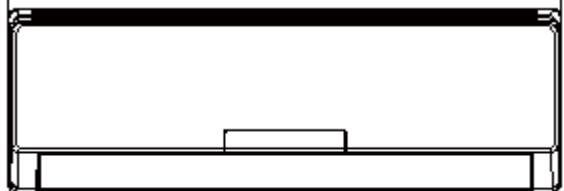Removal of Fan Motor		
Remark: before removing, making sure power is disconnected.		
Step	Diagram	Operation Procedure
(10) Remove the motor and fan.	 	<ul style="list-style-type: none"><li>Take off the motor and fan directly.</li><li>Use a screwdriver to unscrew the screws connecting the motor and the fan.</li></ul>
(11) Install a new motor.		<ul style="list-style-type: none"><li>Assemble units based on the reverse order of this procedure and power on the units for test.</li></ul>




## 4.5 Console Type Indoor Unit

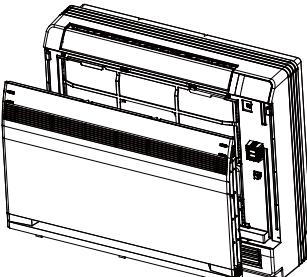

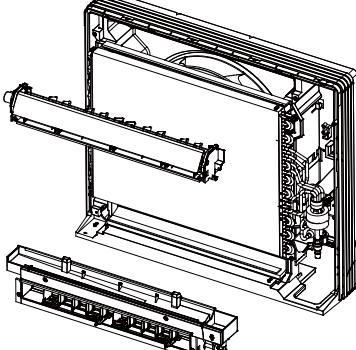
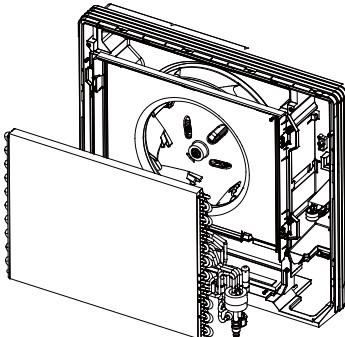
Removal of Fan Motor		
Remark: before removing, making sure power is disconnected.		
Step	Diagram	Operation Procedure
(1) Open the panel.		<ul style="list-style-type: none"> <li>Press clasps at both sides to "OPEN" position.</li> </ul>
(2) Remove filter and front case.		<ul style="list-style-type: none"> <li>Remove 5 screws fixing the front case.</li> </ul>
(3) Remove electric box.		<ul style="list-style-type: none"> <li>Open electric box cover, loosen all connection wires and then remove screws.</li> </ul>
(4) Remove water tray and swing motor.		<ul style="list-style-type: none"> <li>Remove 2 screws fixing water tray and swing motor respectively.</li> </ul>
(5) Remove evaporator.		<ul style="list-style-type: none"> <li>Remove the fixer fixing the evaporator, press 2 clasps at left side and then remove the evaporator.</li> </ul>

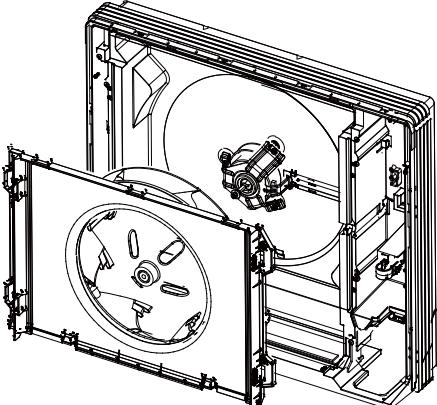Removal of Fan Motor		
Remark: before removing, making sure power is disconnected.		
Step	Diagram	Operation Procedure
(6) Remove reversion loop and centrifugal blade.		<ul style="list-style-type: none"> <li>Remove 4 screws fixing the reversion loop and then remove the reversion loop' remove nuts on blade and then remove the centrifugal blade.</li> </ul>

## 4.6 High Static Pressure Duct Type Indoor Unit







**NOTICE!** The following steps are specific for GMV-ND18PHS/A-T(U) units. For other units, the assembly and disassembly procedure is similar except the specifications of centrifugal fans and motors.

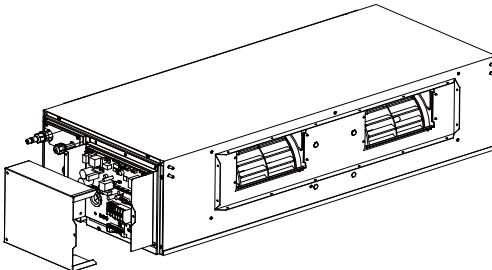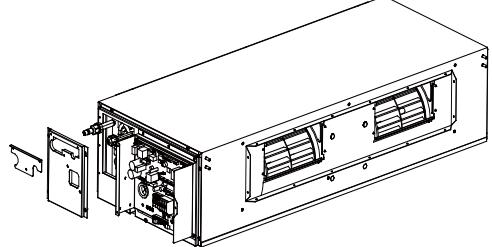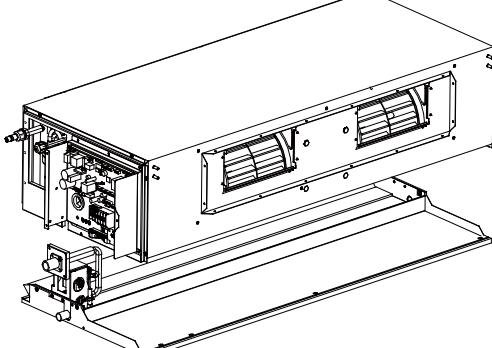Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(1) Remove the line connecting to the motor.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the electric box cover.</li> <li>Remove from the master board the line connecting to the motor and remove the tie.</li> </ul>
(2) Disassemble the seal plate and cover plate.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the seal plate and cover plate and then remove them.</li> </ul>
(3) Remove the cover plate component.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the cover plate component.</li> </ul>

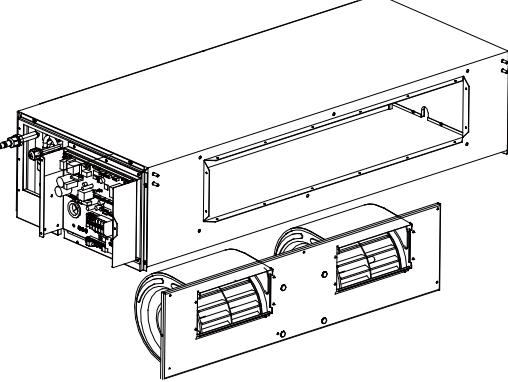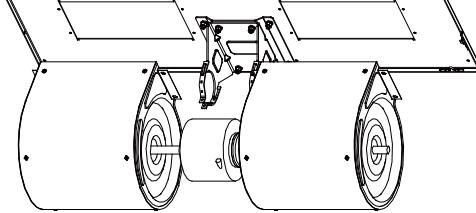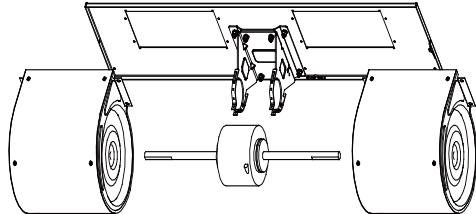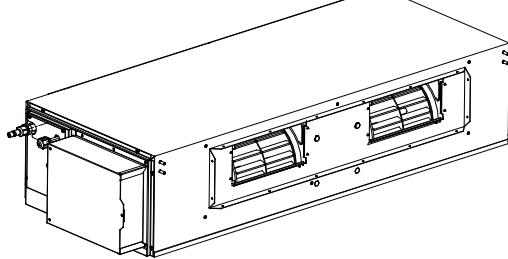Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(4) Disassemble the centrifugal fan.		<ul style="list-style-type: none"> <li>● Use a screwdriver to unscrew the centrifugal fan.</li> </ul>
(5) Remove the motor and centrifugal fan.		<ul style="list-style-type: none"> <li>● Use a screwdriver to unscrew the centrifugal fan.</li> <li>● Loosen the fasteners of the motor and remove the motor from the support.</li> <li>● For motors that are accompanied with supports, the supports need removing as well.</li> </ul>
(6) Remove the centrifugal fan.		<ul style="list-style-type: none"> <li>● Use a hexagon to unscrew the fan and remove the centrifugal fan from the motor axle.</li> </ul>
(7) Install a new motor.		<ul style="list-style-type: none"> <li>● Assemble units based on the reverse order of this procedure and power on the units for test.</li> </ul>







## 4.7 Two-way Cassette Type Indoor Unit





**NOTICE!** The following steps are specific for GMV-ND09TS/A-T(U) units. For other units, the assembly and disassembly procedure is similar except the numbers of centrifugal fans and motors.

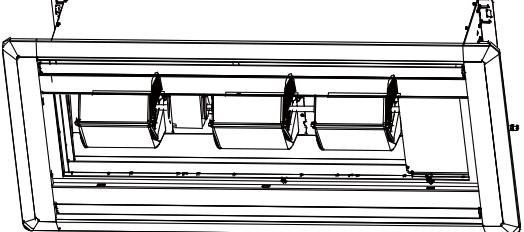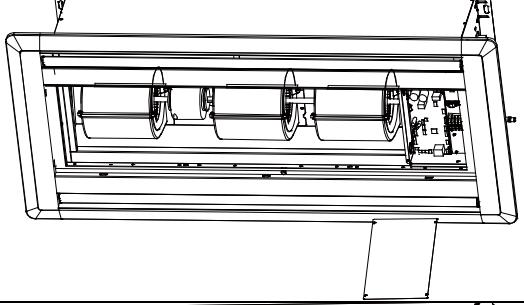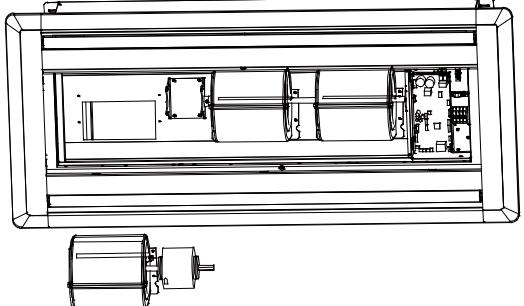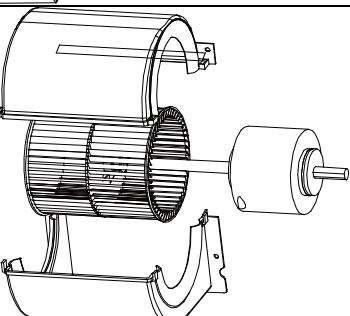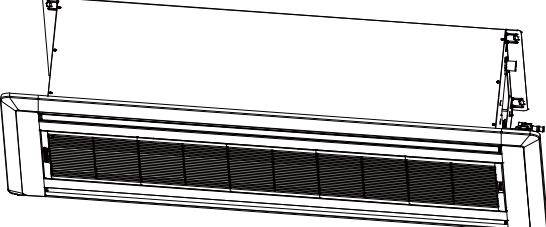Removal of Fan Motor		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(1) Remove the grille	 	<ul style="list-style-type: none"> <li>Slip the fasteners on the panel, open the grille, remove it.</li> </ul>
(2) Remove the line connecting to the motor.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the electric box cover.</li> <li>Remove from the master board the line connecting to the motor and remove the tie.</li> </ul>
(3) Remove the motor/Remove the motor from the support		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the motor/volute casing subassembly and joint slack.</li> <li>Loosen the fasteners of the motor, remove the motor from the support.</li> <li>Remove the volute casing subassembly as well.</li> </ul>
(4) Remove the centrifugal fan		<ul style="list-style-type: none"> <li>Remove the volute casing.</li> <li>Use a hexagon to unscrew the centrifugal fan, remove it from motor axle.</li> </ul>
(5) Replace the motor with a new one.		<ul style="list-style-type: none"> <li>Assemble units based on the reverse order of this procedure and power on the units for test.</li> </ul>

## 4.8 Floor Ceiling Type Indoor Unit



**NOTICE!** The following steps are specific for GMV-ND48ZD/A-T(U) units. For other units, the assembly and disassembly procedure is similar except the numbers of centrifugal fans and motors.

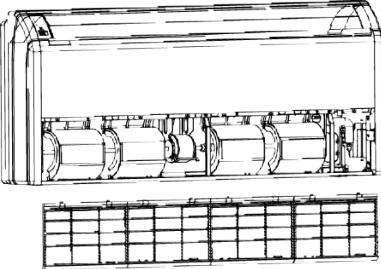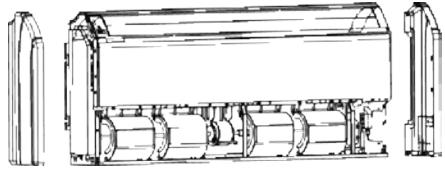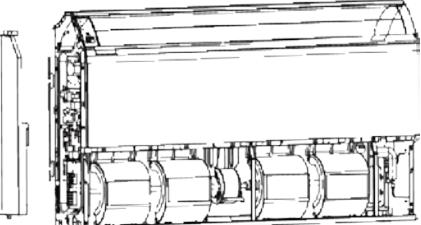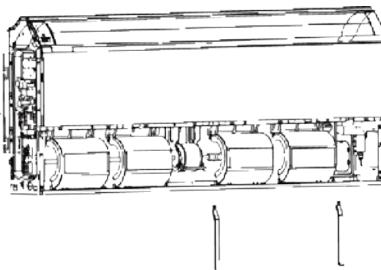
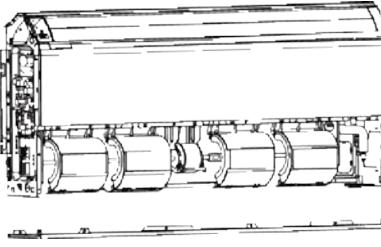
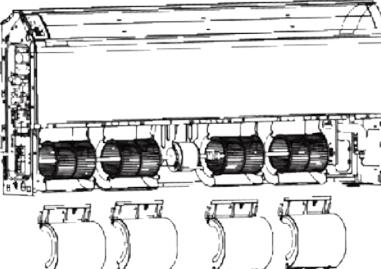
Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(1) Remove the air return grille.		<ul style="list-style-type: none"> <li>Loosen the fasteners of the air return grille and then remove the grille.</li> </ul>
(2) Remove the left and right cover plates.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the left and right cover plates and then remove the cover plates.</li> </ul>
(3) Remove the electric box cover and the line connecting to the motor.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the electric box cover.</li> <li>Remove from the master board the line connecting to the motor and remove the tie.</li> </ul>
(4) Remove the limit board.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the limit board and then remove the board.</li> </ul>
(5) Remove the rear connecting board.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the rear connecting board and then remove the board.</li> </ul>
(6) Remove the rear volute casing.		<ul style="list-style-type: none"> <li>Loosen the fasteners that connect the rear volute casing with the front volute casing and remove the rear volute casing.</li> </ul>

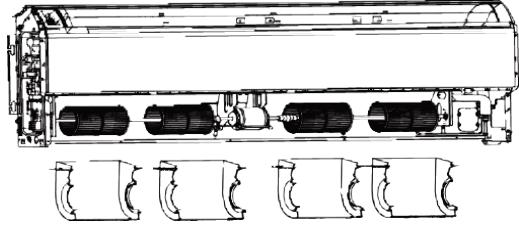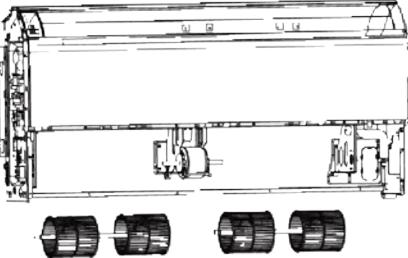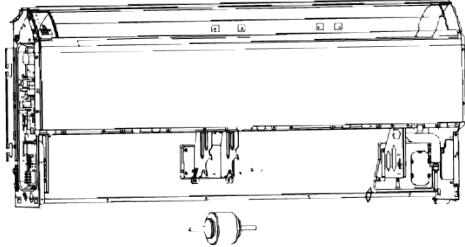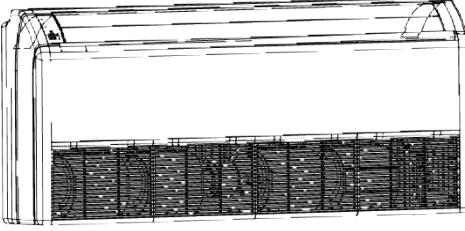Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(7) Remove the front volute casing.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the front volute casing and then remove the volute casing.</li> </ul>
(8) Remove the centrifugal fan.		<ul style="list-style-type: none"> <li>Loosen the fasteners that connect the coupler with the motor axle and remove the centrifugal fan.</li> </ul>
(9) Remove the motor.		<ul style="list-style-type: none"> <li>Remove the motor from the support and remove the centrifugal fan from the motor axle. Then, remove the motor.</li> <li>For motors that are accompanied with supports, the supports need removing as well.</li> </ul>
(10) Install a new motor.		<ul style="list-style-type: none"> <li>Assemble units based on the reverse order of this procedure and power on the units for test.</li> </ul>




## 4.9 Fresh Air Processing Indoor Unit



GMV-NDX42P/A-T(U) / GMV-NDX48P/A-T(U)

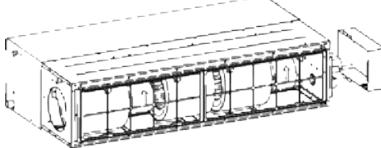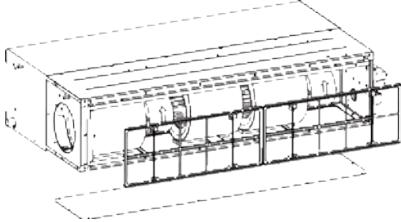Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(1) Remove the line connecting to the motor.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the electric box cover.</li> <li>Remove from the master board the line connecting to the motor and remove the tie.</li> </ul>
(2) Remove the filter. And the air return cover plate.		<ul style="list-style-type: none"> <li>Remove the filter from the air return frame.</li> <li>Use a screwdriver to unscrew the air return cover plate.</li> </ul>

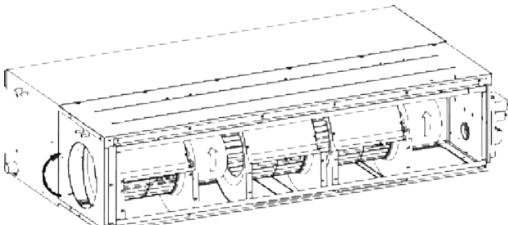
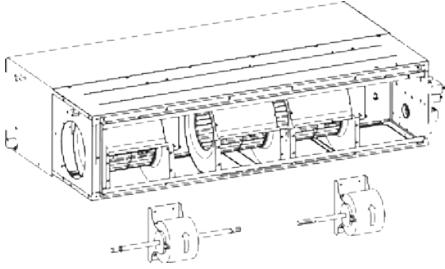
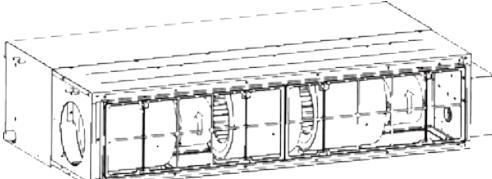
Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(3) Remove the rear volute casing and Remove the front volute casing.		<ul style="list-style-type: none"> <li>Loosen the fasteners that connect the rear volute casing with the front volute casing and remove the rear volute casing.</li> <li>Use a screwdriver to unscrew the front volute casing and then remove the volute casing.</li> </ul>
(4) Remove the motor.		<ul style="list-style-type: none"> <li>Remove the motor from the support and remove the louver from the motor axle. Then, remove the motor.</li> </ul>
(5) Install a new motor.		<ul style="list-style-type: none"> <li>Assemble units based on the reverse order of this procedure and power on the units for test.</li> </ul>






GMV-NDX54P/A-T(U) / GMV-NDX72P/A-T(U) / GMV-NDX96P/A-T(U)

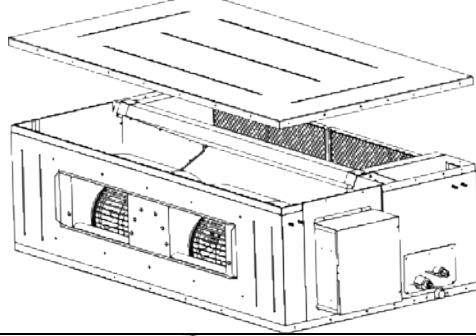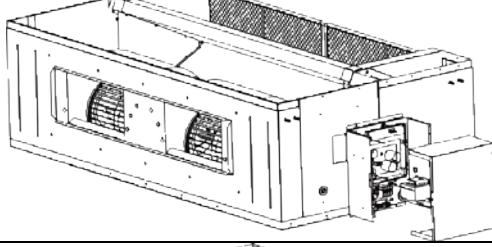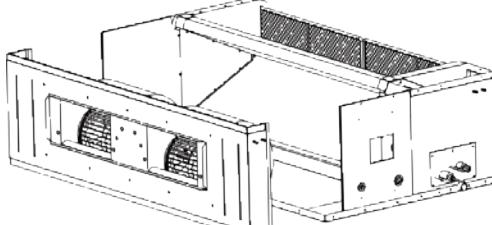
Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(1) Remove the cover plate component.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the cover plate component.</li> </ul>
(2) Remove the line connecting to the motor.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the electric box cover.</li> <li>Remove from the master board the line connecting to the motor and remove the tie.</li> </ul>
(3) Disassemble the centrifugal fan.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the centrifugal fan.</li> </ul>


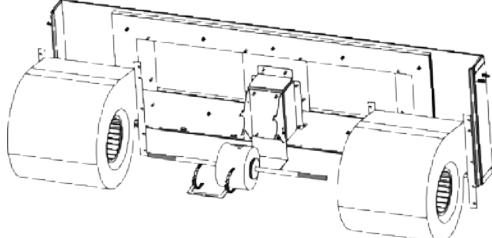
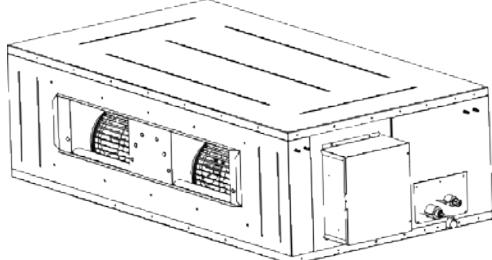
Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(4) Remove the centrifugal fan		<ul style="list-style-type: none"> <li>Use a hexagon to unscrew the centrifugal fan and remove the centrifugal fan from the motor axle.</li> </ul>
(5) Install a new motor.		<ul style="list-style-type: none"> <li>Assemble units based on the reverse order of this procedure and power on the units for test.</li> </ul>

## 4.10 Compact Four-way Cassette Type Indoor Unit

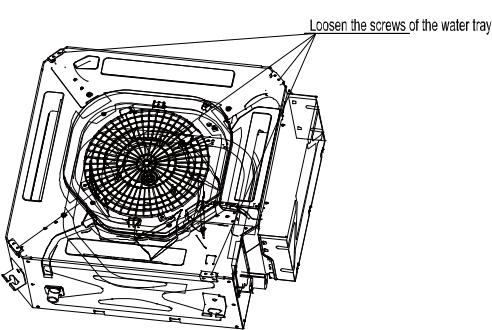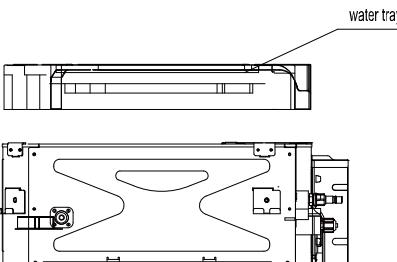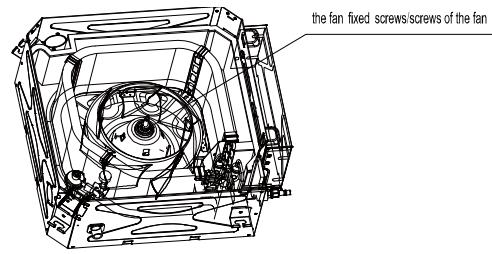Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(1) Unscrew the water tray.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the water tray.</li> </ul>
(2) Remove the water tray.		<ul style="list-style-type: none"> <li>Remove the water tray.</li> </ul>
(3) Unscrew the centrifugal fan.		<ul style="list-style-type: none"> <li>Use a wrench to unscrew the centrifugal fan.</li> </ul>

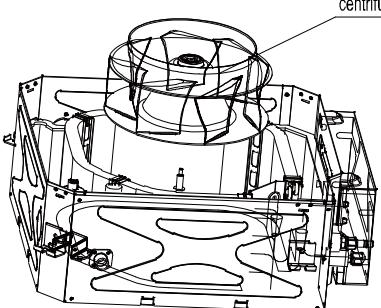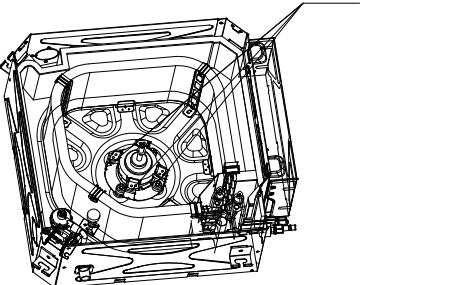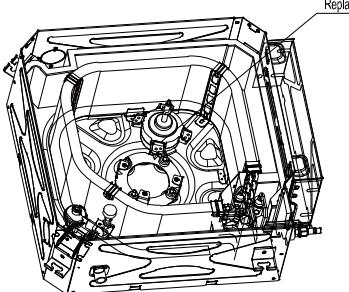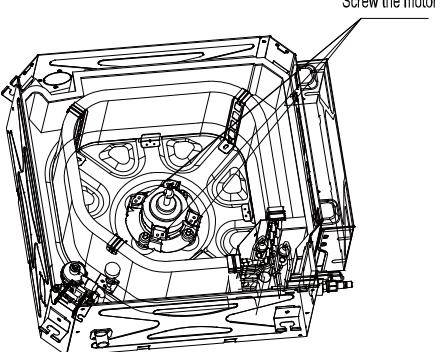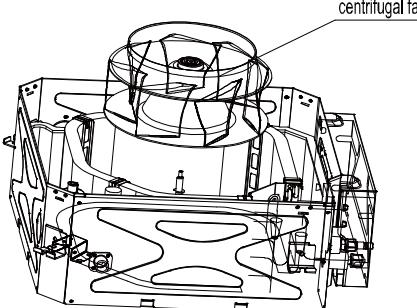Motor and fan		
Step	Diagram	Operation Procedure
(4) Remove the centrifugal fan.	 centrifugal fan	<ul style="list-style-type: none"> <li>Remove the centrifugal fan.</li> </ul>
(5) Unscrew the motor.	 Loosen the screws of the motor	<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the motor.</li> </ul>
(6) Replace the motor with a new one.	 Replace the motor with a new one	<ul style="list-style-type: none"> <li>Replace the motor with a new one.</li> </ul>
(7) Screw the motor.	 Screw the motor	<ul style="list-style-type: none"> <li>Use a screwdriver to screw the motor.</li> </ul>
(8) Install and screw the centrifugal fan.	 centrifugal fan	<ul style="list-style-type: none"> <li>Install the centrifugal fan and use a wrench to screw the centrifugal fan.</li> </ul>

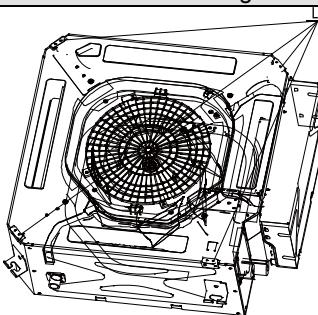Motor and fan		
Step	Diagram	Operation Procedure
(9) Install and screw the water tray.		<ul style="list-style-type: none"> <li>Use a screwdriver to screw the water tray</li> </ul>


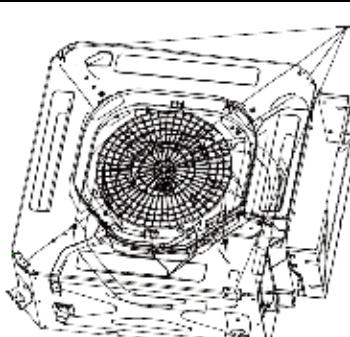
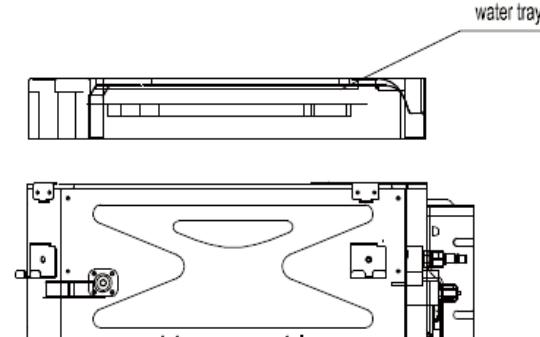
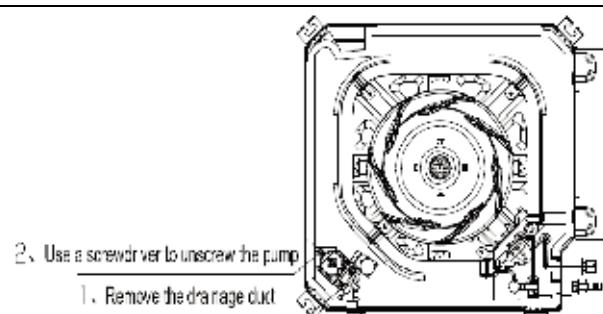
Pump		
Step	Diagram	Operation Procedure
(1) Unscrew the water tray.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the water tray.</li> </ul>
(2) Remove the water tray.		<ul style="list-style-type: none"> <li>Replace the water tray.</li> </ul>
(3) Remove the drainage duct and unscrew the pump.		<ul style="list-style-type: none"> <li>Remove the drainage duct and use a screwdriver to unscrew the pump.</li> </ul>

Pump		
Step	Diagram	Operation Procedure
(4) Replace the pump.		<ul style="list-style-type: none"> <li>Replace the pump.</li> </ul>
(5) Connect the drainage duct and screw the new pump.		<ul style="list-style-type: none"> <li>Connect the drainage duct and use a screwdriver to screw the new pump.</li> </ul>
(6) Install and screw the water tray.		<ul style="list-style-type: none"> <li>Use a screwdriver to screw the water tray.</li> </ul>



## 4.11 Super High Static Pressure Duct Type Indoor Unit




**Note:** The following steps are specific for GMV-ND24PHS/B-T(U) units. For other units, the assembly and disassembly procedure is similar except the specifications of centrifugal fans and motors.

Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(1) Remove the line connecting to the motor.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the electric box cover.</li> <li>Remove from the master board the line connecting to the motor and remove the tie.</li> </ul>
(2) Disassemble the seal plate and cover plate.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the seal plate and cover plate and then remove them.</li> </ul>

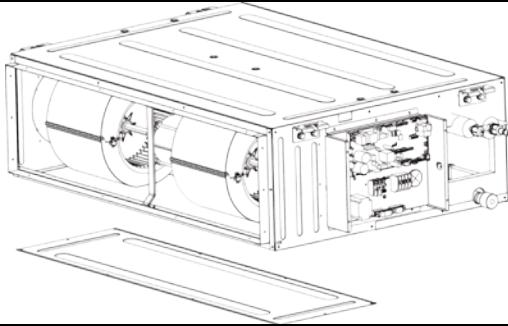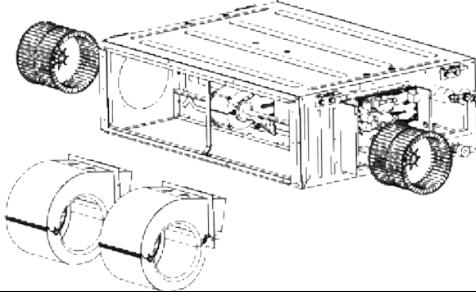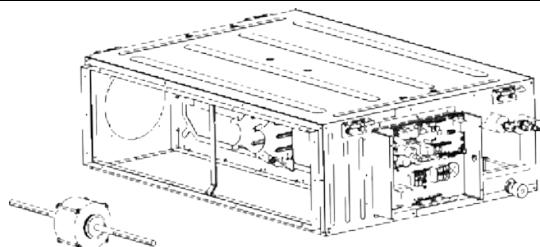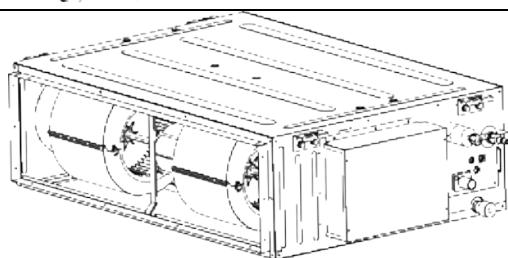
Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(3) Remove the grille.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the cover plate component.</li> </ul>
(4) Remove the centrifugal fan.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the front volute casing and then remove the volute casing.</li> </ul>
(5) Remove the motor.		<ul style="list-style-type: none"> <li>Remove the motor from the support and remove the centrifugal fan from the motor axle. Then, remove the motor.</li> <li>For motors that are accompanied with supports, the supports need removing as well.</li> </ul>
(6) Install a new motor.		<ul style="list-style-type: none"> <li>Assemble units based on the reverse order of this procedure and power on the units for test.</li> </ul>




GMV-ND72PH/B-T(U) / GMV-ND96PH/B-T(U)

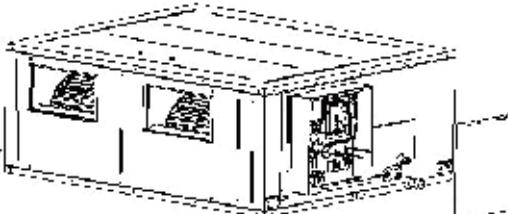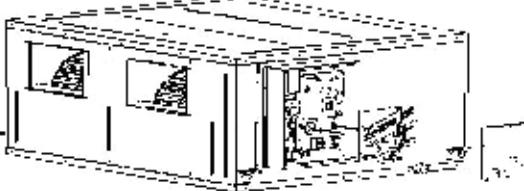Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(1) Remove the line connecting to the motor.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the electric box cover.</li> <li>Remove from the master board the line connecting to the motor and remove the tie.</li> </ul>
(2) Disassemble the seal plate and cover plate.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the seal plate and cover plate and then remove them.</li> </ul>

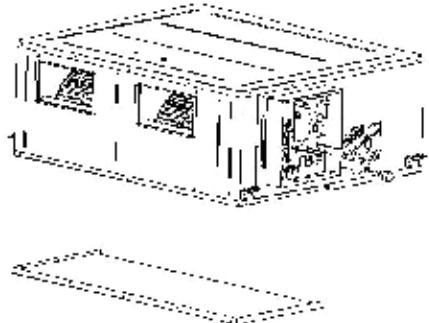
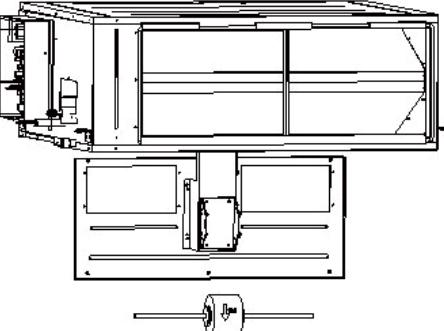
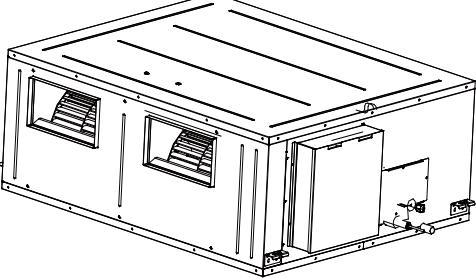
Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
(3) Remove the grille		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the cover plate component.</li> </ul>
(4) Remove the centrifugal fan.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the front volute casing and then remove the volute casing.</li> </ul>
(5) Remove the motor.		<ul style="list-style-type: none"> <li>Remove the motor from the support and remove the centrifugal fan from the motor axle. Then, remove the motor.</li> <li>For motors that are accompanied with supports, the supports need removing as well.</li> </ul>
(6) Install a new motor.		<ul style="list-style-type: none"> <li>Assemble units based on the reverse order of this procedure and power on the units for test.</li> </ul>







## 4.12 Air Handler type Indoor Unit







Motor and fan		
Precondition: The power supply has been disconnected.		
Procedures	Diagrams	Operating Instructions
(1) Remove the upper panel.		<ul style="list-style-type: none"> <li>Loosen screws round the upper panel with a screwdriver.</li> <li>Remove the upper panel from unit.</li> </ul>

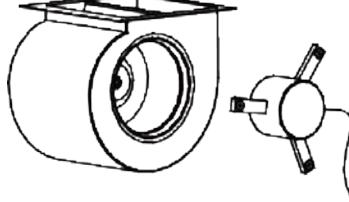Motor and fan		
Precondition: The power supply has been disconnected.		
Procedures	Diagrams	Operating Instructions
(2) Remove the fan.		<ul style="list-style-type: none"> <li>Disconnect the wires of the fan from the wiring terminal and draw them out.</li> <li>Loosen screws located at the front of the fan with a screwdriver.</li> <li>Remove the fan from the unit.</li> </ul>
(3) Remove the motor.		<ul style="list-style-type: none"> <li>Loosen screws fixing the motor and fan blades.</li> <li>Loosen screw bolts fixing the bracket.</li> <li>Remove the motor rightward from the fan.</li> </ul>
(4) Reinstall the fan.		<ul style="list-style-type: none"> <li>Place the motor at the proper position.</li> <li>Tighten screws fixing the motor and fan blades.</li> <li>Tighten screw bolts fixing the motor bracket.</li> <li>After the installation, reassemble the unit as before.</li> </ul>

## 4.13 1-way Cassette Type Indoor Unit






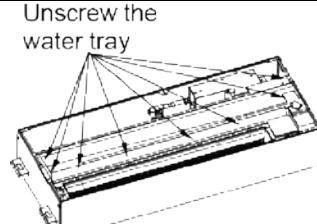
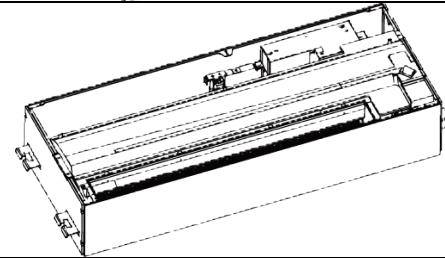
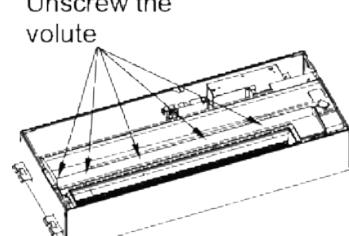
Motor and fan		
Step	Diagram	Operation Procedure
(1) Unscrew the water tray.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the water tray.</li> </ul>
(2) Remove the water tray.		<ul style="list-style-type: none"> <li>Remove the water tray.</li> </ul>
(3) Unscrew the volute tongue.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the volute tongue.</li> </ul>

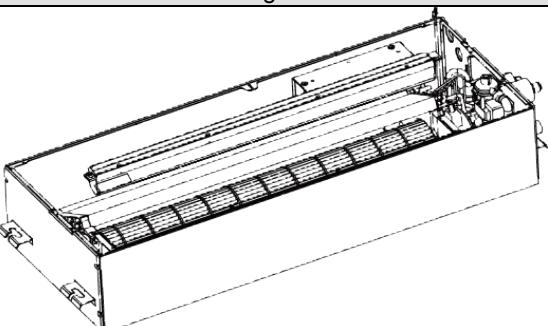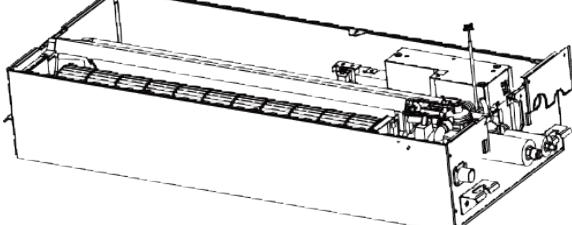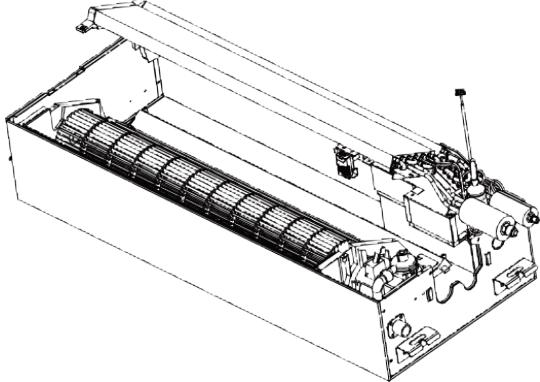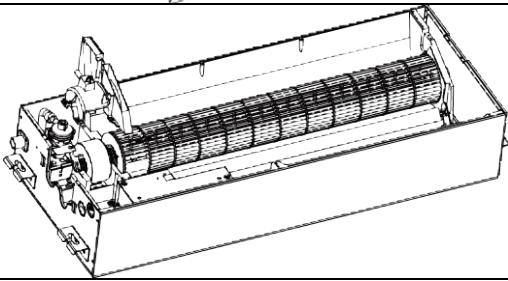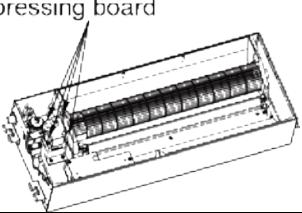Motor and fan		
Step	Diagram	Operation Procedure
(4) Remove the volute tongue.		<ul style="list-style-type: none"> <li>Remove the volute tongue.</li> </ul>
(5) Unscrew the outlet board.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the outlet board and then remove the board.</li> </ul>
(6) Remove the evaporator.		<ul style="list-style-type: none"> <li>Remove the evaporator.</li> </ul>
(7) Unscrew the motor pressing board.		<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the motor pressing board.</li> </ul>
(8) Remove the pressing board and replace the motor.		<ul style="list-style-type: none"> <li>Remove the pressing board and replace the motor.</li> </ul>
(9) Screw the motor pressing board.		<p>Use a screwdriver to screw the motor pressing board.</p>

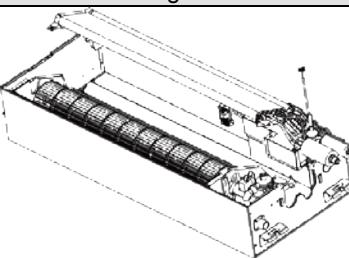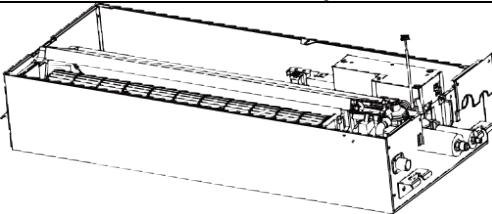
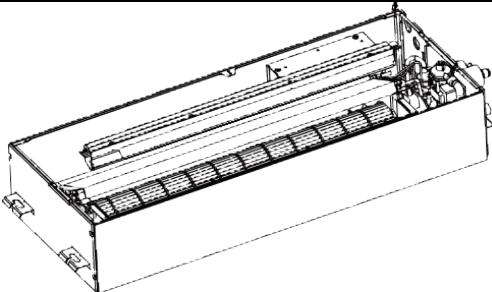

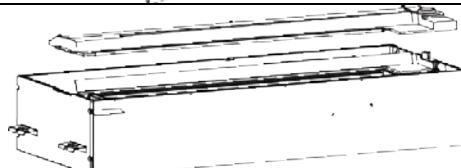

Motor and fan		
Step	Diagram	Operation Procedure
(10) Install the evaporator.		Install the evaporator.
(11) Screw the outlet board.		Use a screwdriver to screw the outlet board.
(12) Put the volute tongue back to position.		Put the volute tongue back to position.
(13) Screw the volute tongue.		Use a screwdriver to screw the volute tongue.
(14) Install the water tray.		Install the water tray.
(15) Screw the water tray.		Use a screwdriver to screw the water tray.






## 4.14 General Static Pressure Duct Type Indoor Unit


**NOTICE!** The following steps are specific for GMV-ND30PLS/C-T(U) ~ GMV-ND48PLS/C-T(U) units, the assembly and disassembly procedure is similar except the numbers of centrifugal fans and motors.

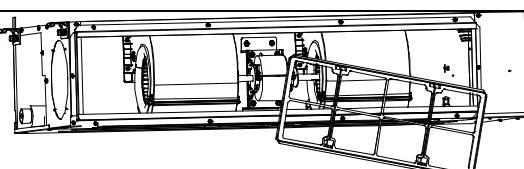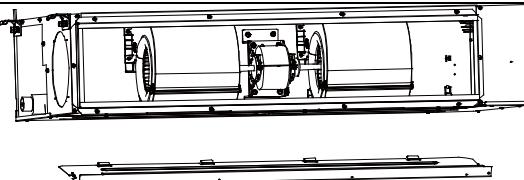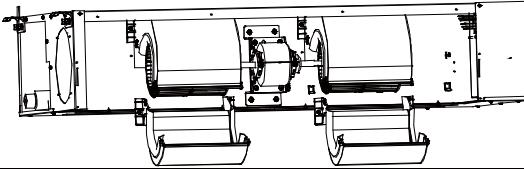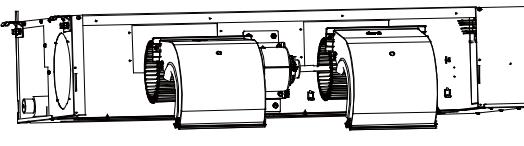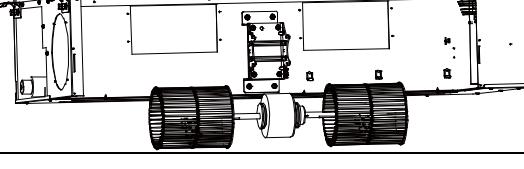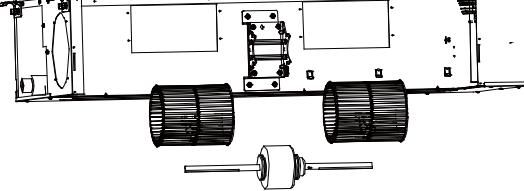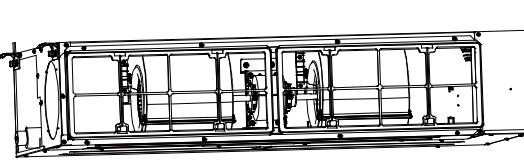Motor and fan		
Precondition: The power supply has been disconnected.		
Step	Diagram	Operation Procedure
1. Remove the line connecting to the motor.		<ul style="list-style-type: none"> <li>• Use a screwdriver to unscrew the electric box cover.</li> <li>• Remove from the master board the line connecting to the motor and remove the tie.</li> </ul>
2. Remove the filter.		<ul style="list-style-type: none"> <li>• Remove the filter from the air return frame.</li> </ul>
3. Remove the air return cover plate.		<ul style="list-style-type: none"> <li>• Use a screwdriver to unscrew the air return cover plate.</li> </ul>
4. Remove the rear volute casing.		<ul style="list-style-type: none"> <li>• Loosen the fasteners that connect the rear volute casing with the front volute casing and remove the rear volute casing.</li> </ul>
5. Remove the front volute casing.		<ul style="list-style-type: none"> <li>• Use a screwdriver to unscrew the front volute casing and then remove the volute casing.</li> </ul>
6. Loosen the centrifugal fan and motor.		<ul style="list-style-type: none"> <li>• Use a hexagon to unscrew the centrifugal fan and loosen the fasteners of the motor.</li> </ul>
7. Remove the motor.		<ul style="list-style-type: none"> <li>• Remove the motor from the support and remove the centrifugal fan from the motor axle. Then, remove the motor.</li> <li>• For motors that are accompanied with supports, the supports need removing as well.</li> </ul>
8. Install a new motor.		<ul style="list-style-type: none"> <li>• Assemble units based on the reverse order of this procedure and power on the units for test.</li> </ul>




## 4.15 360°Air Discharge Compact Cassette Type Indoor Unit

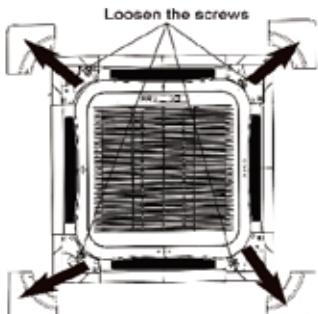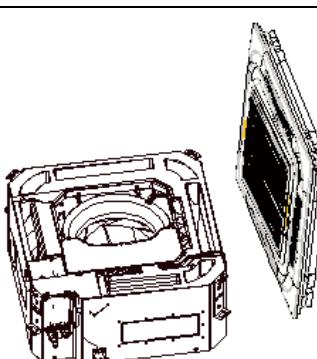
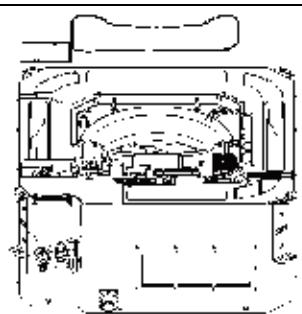
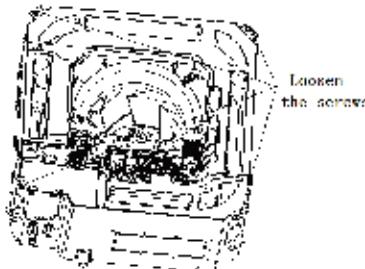
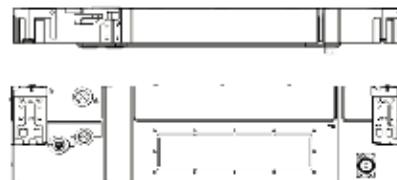
Motor and fan		
Step	Diagram	Operation Procedure
1. Remove the front panel.	 	<ul style="list-style-type: none"> <li>• Turn off the power supply of indoor unit.</li> <li>• Push the 4 corner plates in the directions shown by the arrows.</li> <li>• Loosen the screws and remove the front panel.</li> </ul>
2. Remove the cover of electric box and the clamp of power cord.		<ul style="list-style-type: none"> <li>• Remove the motor wire and water pump of the electric box.</li> </ul>
4. Remove the water tray.	 	<ul style="list-style-type: none"> <li>• Loosen the screws in the 4 corners and then remove the water tray.</li> </ul>

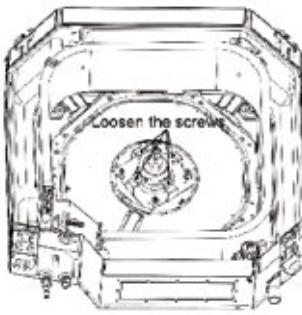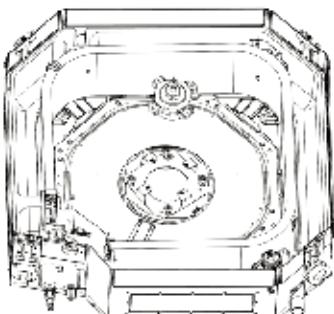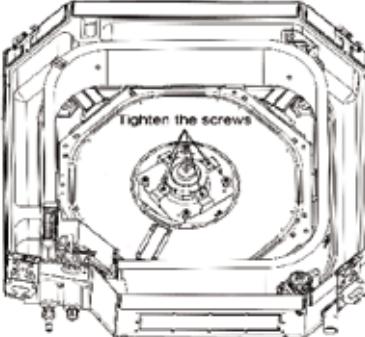
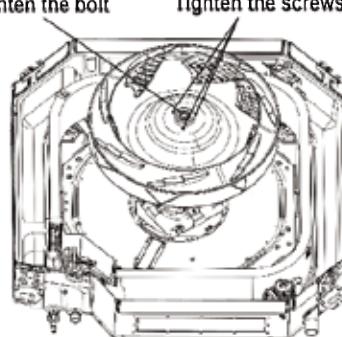
Motor and fan		
Step	Diagram	Operation Procedure
5. Remove the fan.		<ul style="list-style-type: none"> <li>• Use a screwdriver to remove the clamping band of motor. Then remove the fan.</li> </ul>
6. Remove motor.		<ul style="list-style-type: none"> <li>• Use a screwdriver to unscrew the 4 screws of motor. Then remove the motor.</li> </ul>
		
7. Replace and install the motor.		<ul style="list-style-type: none"> <li>• Remove the motor from motor support and then replace with a new motor.</li> <li>• Tighten the 4 screws of motor with a screwdriver.</li> </ul>
8. Install the fan.		<ul style="list-style-type: none"> <li>• Direct the hole of fan to the motor shaft and then mount on the fan.</li> <li>• Tighten the clamping band of motor with a wrench.</li> </ul>

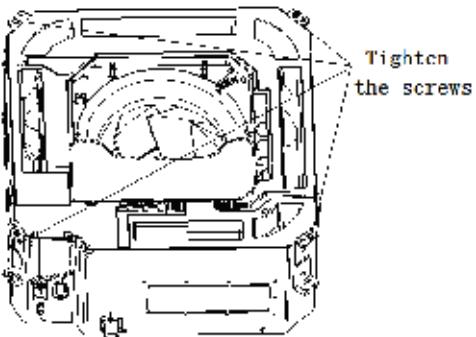Motor and fan		
Step	Diagram	Operation Procedure
9. Install the water tray.		<ul style="list-style-type: none"> <li>• Direct the 4 corners of water tray to the 4 corners of the unit and then press them. Use a screwdriver to tighten the screws in the 4 corners.</li> <li>• Connect the power cord and water pump wire.</li> <li>• Place back the cover of electric box and the clamp of power cord. Then tighten the screws with a screwdriver.</li> </ul>

## 4.17 360°Air Discharge Cassette Type Indoor Unit

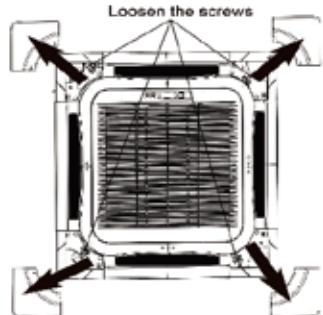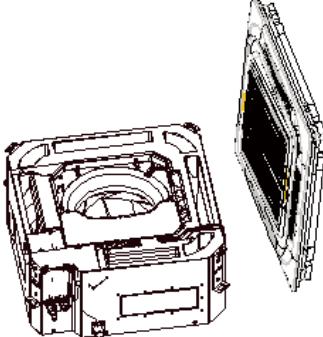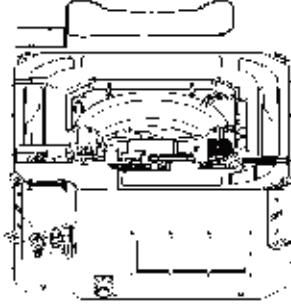Motor and fan		
Step	Diagram	Operation Procedure
1. Remove the front panel.	 	<ul style="list-style-type: none"> <li>• Turn off the power supply of indoor unit.</li> <li>• Push the 4 corner plates in the directions shown by the arrows.</li> <li>• Loosen the screws and remove the front panel.</li> </ul>
2. Remove the cover of electric box and the clamp of power cord.		<ul style="list-style-type: none"> <li>• Remove the motor wire and water pump of the electric box.</li> </ul>

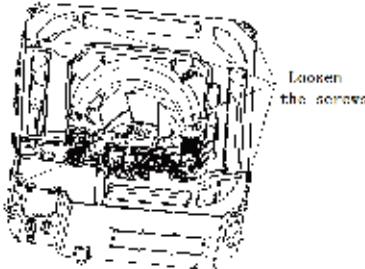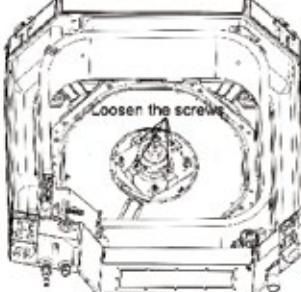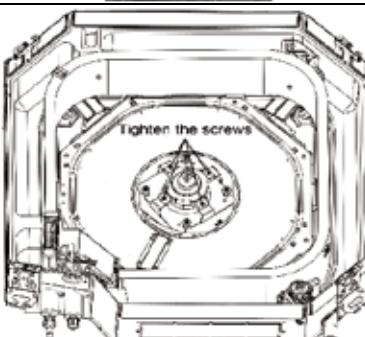
Motor and fan		
Step	Diagram	Operation Procedure
4. Remove the water tray.	  	<ul style="list-style-type: none"> <li>Loosen the screws in the 4 corners and then remove the water tray.</li> </ul>
5. Remove the fan.		<ul style="list-style-type: none"> <li>Use a screwdriver to remove the clamping band of motor. Then remove the fan.</li> </ul>
6. Remove motor.	 	<ul style="list-style-type: none"> <li>Use a screwdriver to unscrew the 4 screws of motor. Then remove the motor.</li> </ul>
7. Replace and install the motor.		<ul style="list-style-type: none"> <li>Remove the motor from motor support and then replace with a new motor.</li> <li>Tighten the 4 screws of motor with a screwdriver.</li> </ul>

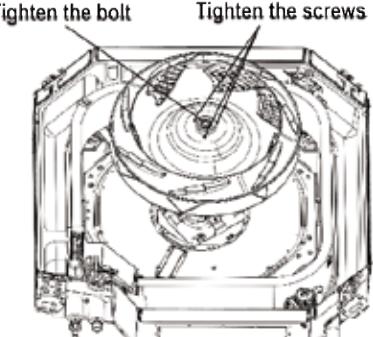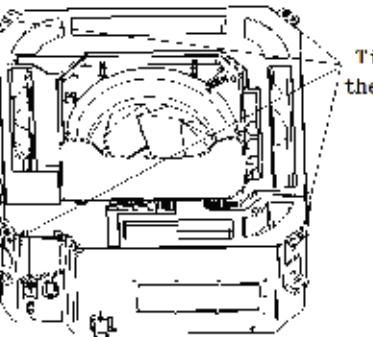Motor and fan		
Step	Diagram	Operation Procedure
8. Install the fan.		<ul style="list-style-type: none"> <li>• Direct the hole of fan to the motor shaft and then mount on the fan.</li> <li>• Tighten the clamping band of motor with a wrench.</li> </ul>
9. Install the water tray.		<ul style="list-style-type: none"> <li>• Direct the 4 corners of water tray to the 4 corners of the unit and then press them. Use a screwdriver to tighten the screws in the 4 corners.</li> <li>• Connect the power cord and water pump wire.</li> <li>• Place back the cover of electric box and the clamp of power cord. Then tighten the screws with a screwdriver.</li> </ul>

## 5 Exploded Views and Part List

### 5.1 Low Static Pressure Duct Type Indoor Unit

Exploded View of GMV-ND07PLS/A-T(U) / GMV-ND09PLS/A-T(U) / GMV-ND12PLS/A-T(U):

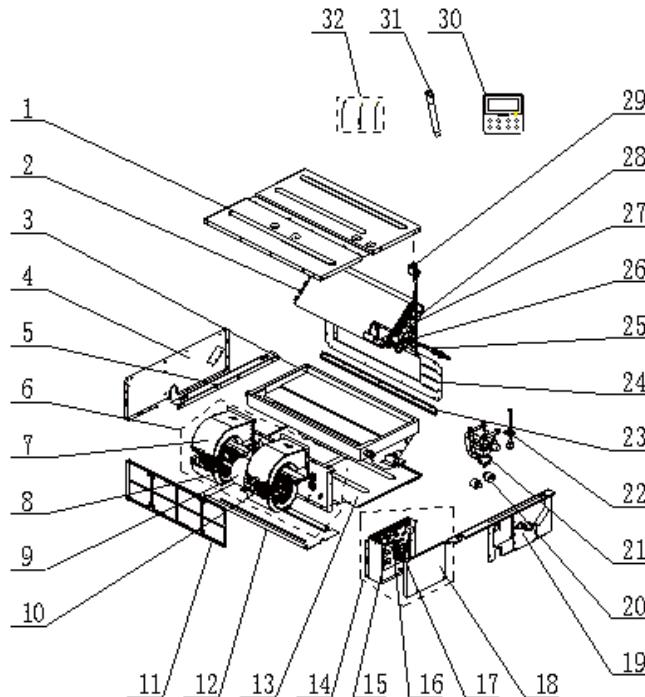


No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND07PLS/A-T(U)	CM810N0080	GMV-ND09PLS/A-T(U)	CM810N0090
		/	/	GMV-ND12PLS/A-T(U)	CM810N0100
		Part code	Quantity	Part code	Quantity
1	Top Cover Board Assy	01265325	1	01265325	1
2	Evaporator Assy	01024100155	1	01024100136	1
3	Water Tray Assy	01285332	1	01285332	1
4	Right Side Plate Assy	01315335	1	01315335	1
5	Supporter	01895225	2	01895225	2
6	Centrifugal fan assy	15404100022	1	15404100022	1
7	Front Volute Casing	26905205	2	26905205	2
8	Rear Volute Casing	26905206	2	26905206	2
9	Fan Motor	15704100001	1	15704100001	1
10	Centrifugal Fan	10425200	2	10425200	2
11	Filter Sub-Assy	11725209	1	11725209	1
12	Cover board (Fan motor)	01265300	1	01265300	1
13	Bottom Cover Plate	01265299	1	01265299	1
14	Electric Box Assy	01394100433	1	01394100433	1
15	Terminal Board	4201115402	1	4201115402	1
16	Main Board	30226000029	1	30226000029	1
17	Terminal Board	4201800002601	1	4201800002601	1

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND07PLS/A-T(U)	CM810N0080	GMV-ND09PLS/A-T(U)	CM810N0090
		/	/	GMV-ND12PLS/A-T(U)	CM810N0100
		Part code	Quantity	Part code	Quantity
18	Electric Box Cover	01424100035	1	01424100035	1
19	Left Side Plate Assy	01315200087	1	01315200087	1
20	Choke Plug of Drain Pipe	76815214	2	76815214	2
21	Water Pump	43130324	1	43130324	1
22	Water Level Switch	45020216	1	45020216	1
23	Cover of air outlet	01265298	1	01265298	1
24	Air Outlet Frame Assy	01374636	1	01374636	1
25	Filter Sub-Assy	/	/	/	/
26	Strainer	0741410000601	1	0741410000601	1
27	Strainer	07414100015	1	07414100015	1
28	Electronic Expansion Valve	07334463	1	07334463	1
29	Electric Expand Valve Fitting	4304413215	1	4304413215	1
30	Display Board	30296000040	1	30296000040	1
31	Drain Hose Sub-Assy	05232050	1	05232050	1
32	Sensor Sub-assy	39004168G	1	39004168G	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-ND14PLS/A-T(U):

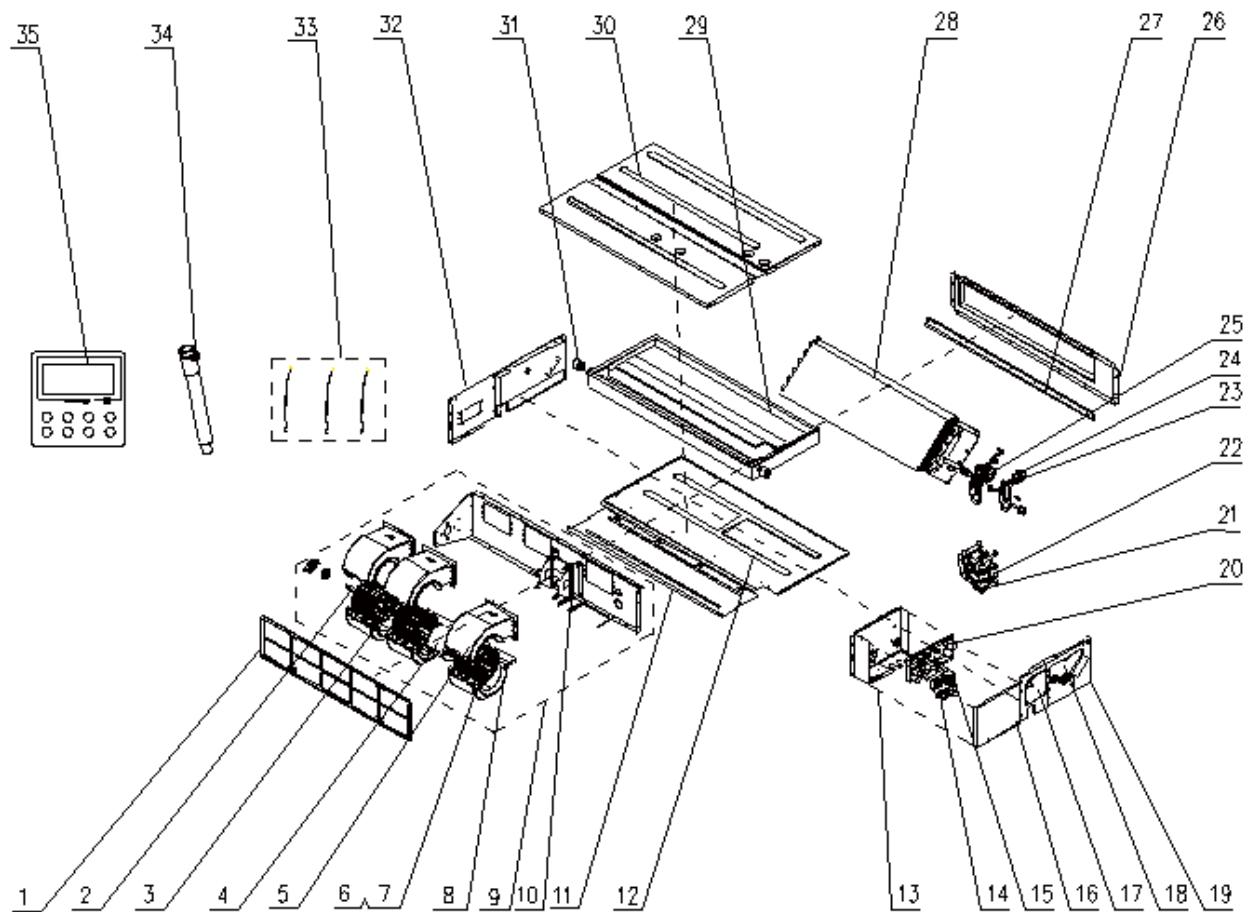


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND14PLS/A-T(U)	CM810N0120
1	Filter Sub-Assy	11725210	1
2	Rotary Axis Sub-Assy	73018020	1
3	Joint Slack	73018731	1
4	Brushless DC Motor	15704100001	1
5	Front Volute Casing	26905205	3
6	Centrifugal Fan	10425200	3
7	Fan Bearing	76512210	1
8	Rear Volute Casing	26905206	3
9	Centrifugal fan assy	15404100023	1
10	Supporter	01804100140	1
11	Cover board (Fan motor)	01265333	1
12	Bottom Cover Plate	01265332	1
13	Electric Box Assy	01394100433	1
14	Terminal Board	4201115402	1
15	Terminal Board	4201800002601	1
16	Electric Box Cover	01424100035	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND14PLS/A-T(U)	CM810N0120
		Part code	Quantity
17	Sealplate sub-assy (drainage)	01495315	1
18	Sealplate sub-assy (outlet)	01495316	1
19	Left Side Plate Assy	01315200087	1
20	Main Board	30226000029	1
21	Water Pump	43130324	1
22	Water Level Switch	45020216	1
23	Electronic Expansion Valve	07334466	1
24	Electric Expand Valve Fitting	4304413215	1
25	Strainer	0741410000601	1
26	Air Outlet Frame Assy	01374637	1
27	Cover of Air Outlet	01265331	1
28	Evaporator Assy	01024100110	1
29	Water Tray Assy	01285333	1
30	Top Cover Board Assy	01265328	1
31	Choke Plug of Drain Pipe	76815214	2
32	Right Side Plate Assy	01305263	1
33	Sensor Sub-assy	39004168G	1
34	Drain Hose Sub-Assy	05232050	1
35	Display Board	30296000040	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-ND18PLS/A-T(U) / GMV-ND22PLS/A-T(U):

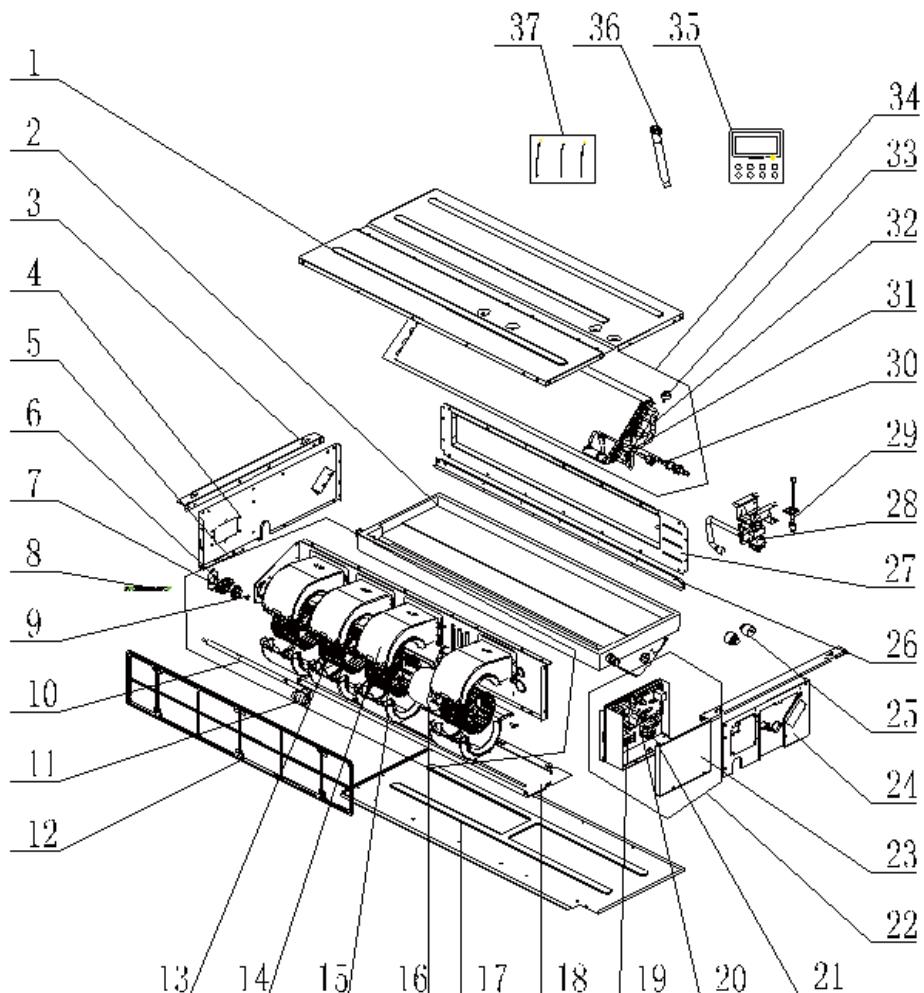


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND18PLS/A-T(U)	CM810N0070
		GMV-ND22PLS/A-T(U)	CM810N0110
Part code		Quantity	
1	Lower Cover Plate Sub-Assy	01265339	1
2	Water Tray Assy	01285334	1
3	Supporter	01895225	2
4	Right Side Plate Assy	01305263	1
5	Centrifugal fan assy	15404100024	1
6	Support Of Motor Bearing	01792408	1
7	O-Gasket of Bearing	76512404	1
8	Corrugated Pipe	05015408	1
9	Fan Bearing	76512210	1
10	Rotary Axis Sub-Assy	73018000029	1
11	Joint Slack	73018731	1
12	Filter Sub-Assy	11725208	1
13	Centrifugal Fan	10425200	4

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND18PLS/A-T(U)	CM810N0070
		GMV-ND22PLS/A-T(U)	CM810N0110
		Part code	Quantity
14	Front Volute Casing	26905205	4
15	Rear Volute Casing	26905206	4
16	Fan Motor	15704100001	1
17	Bottom Cover Plate	01265337	1
18	Cover board (Fan motor)	01265338	1
19	Terminal Board	4201115402	1
20	Main Board	30226000029	1
21	Terminal Board	4201800002601	1
22	Electric Box Assy	01394100433	1
23	Electric Box Cover	01424100035	1
24	Left Side Plate Assy	01315200087	1
25	Choke Plug of Drain Pipe	76815214	2
26	Cover of Air Outlet	01265335	1
27	Air Outlet Frame Assy	01374635	1
28	Water Pump	43130324	1
29	Water Level Switch	45020216	1
30	Filter Sub-Assy	07210028	1
31	Strainer	0741410000601	1
32	Electronic Expansion Valve	07334466	1
33	Electric Expand Valve Fitting	4304413215	1
34	Evaporator Assy	01024100133	1
35	Display Board	30296000040	1
36	Drain Hose Sub-Assy	05232050	1
37	Sensor Sub-assy	39004168G	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-ND05PLS/B1-T(U)

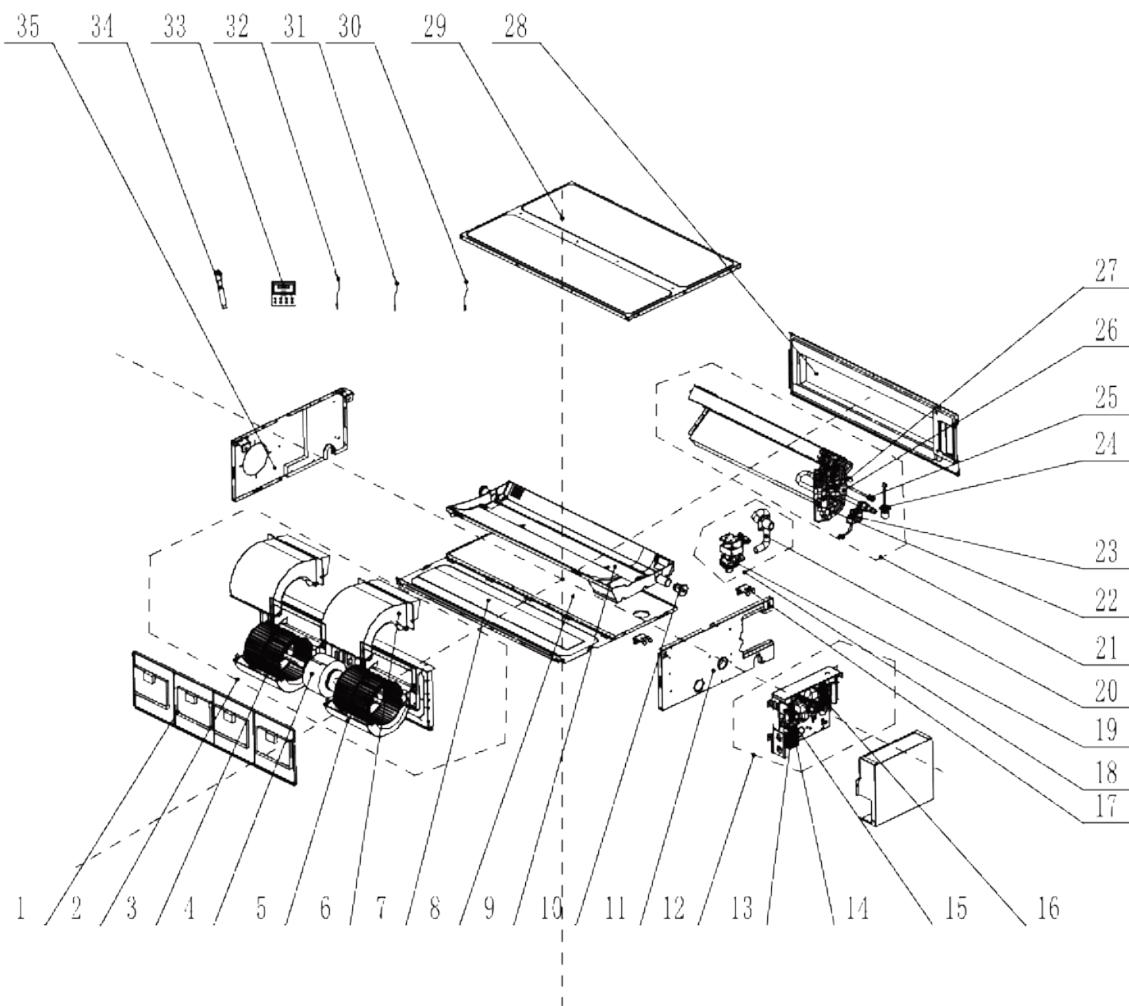

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND05PLS/B1-T(U)	CM810N2170
		GMV-ND07PLS/B1-T(U)	CM810N2170
		GMV-ND09PLS/B1-T(U)	CM810N2170
		Part code	Quantity
1	Filter Sub-Assy	111001000082	1
2	Centrifugal fan assy	000052060087	1
3	Centrifugal Fan	10425200003	2
4	Brushless DC Motor	150104060010	1
5	Propeller Housing(Lower)	26905200019	2
6	Propeller Housing(Upper)	26905200018	2
7	Cover Plate(Air return)	01265200057	1
8	Bottom Cover Plate Assy	01265200065	1
9	Water Tray	26905200023	1
10	Rubber Plug	76815200002	2
11	Left Side Plate	012055000011	1
12	Electric Box Assy	100002069979	2
13	Terminal Board	4201110602	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND05PLS/B1-T(U)	CM810N2170
		GMV-ND07PLS/B1-T(U)	CM810N2170
		GMV-ND09PLS/B1-T(U)	CM810N2170
Part code		Quantity	
14	Terminal Board	42200006000401	1
15	Main Board	300002060297	1
16	Main Board	300002060966	1
17	Hook 2	01344100034	2
18	Water Pump Assy	000104060009	1
19	Water Pump	812007060016	1
20	Drainage Pipe(Rubber)	760022000001	1
21	Evaporator Assy	011001060787	1
22	Strainer	0721200102	1
23	Electric Expand Valve Fitting	4304000111	1
24	Water Level Switch	430024060005	1
25	Sealing Cap(Pressure Warning)	26112192	1
26	Strainer	07213050	1
27	Electronic Expansion Valve	072009000006	1
28	Air Outlet Frame Assy	01374100057	1
29	Top Cover Board Sub-assy	01265200067	1
30	Temperature Sensor	390000595	1
31	Temperature Sensor	3900005910	1
32	Temperature Sensor	390000456	1
33	Display Board	30296000040	1
34	Drain Hose Sub-Assy	007008000001	1
35	Right Side Plate	01315200042	1


Above data is subject to change without notice, pls refer the SP in global service website.

#### Exploded View of GMV-ND12PLS/B1-T(U)

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND12PLS/B1-T(U)	CM810N2220
		Part code	Quantity
1	Top Cover Board Assy	111001000082	1
2	Top Cover Board Sub-assy	000052060087	1
3	Centrifugal fan assy	10425200003	2
4	Blower Mounting Plate Sub-Assy	150104060010	1
5	Motor Support	26905200019	2
6	Brushless DC Motor	26905200018	2
7	Hoop	01265200057	1
8	Bar Clasp	01265200065	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND12PLS/B1-T(U)	CM810N2220
		Part code	Quantity
9	Centrifugal Fan	26905200023	1
10	Fan Nesting	76815200002	2
11	Propeller Housing(Upper)	012055000011	1
12	Propeller Housing(Lower)	100002069979	2
13	Right Side Plate Assy	4201110602	1
14	Right Side Plate Sub-Assy	42200006000401	1
15	Right Side Plate	300002060297	1
16	Left Side Plate Assy	300002060966	1
17	Left Side Plate	01344100034	2
18	Cable Cross Loop	000104060009	1
19	Water Level Switch	812007060016	1
20	Cable Cross Loop	760022000001	1
21	Electric Expand Valve Fitting	011001060787	1
22	Temp Sensor Sleeving	0721200102	1
23	Temp Sensor Sleeving	4304000111	1
24	Sealing Cap(Pressure Warning)	430024060005	1
25	Strainer	26112192	1
26	Electronic Expansion Valve	07213050	1
27	Strainer	072009000006	1
28	Temperature Sensor	01374100057	1
29	Temperature Sensor	01265200067	1
30	Water Pump Assy	390000595	1
31	Water Pump	3900005910	1
32	Drainage Pipe(Rubber)	390000456	1
33	Water Tray Assy	30296000040	1
34	Water Tray	007008000001	1
35	Rubber Plug	01315200042	1

Above data is subject to change without notice, pls refer the SP in global service website.

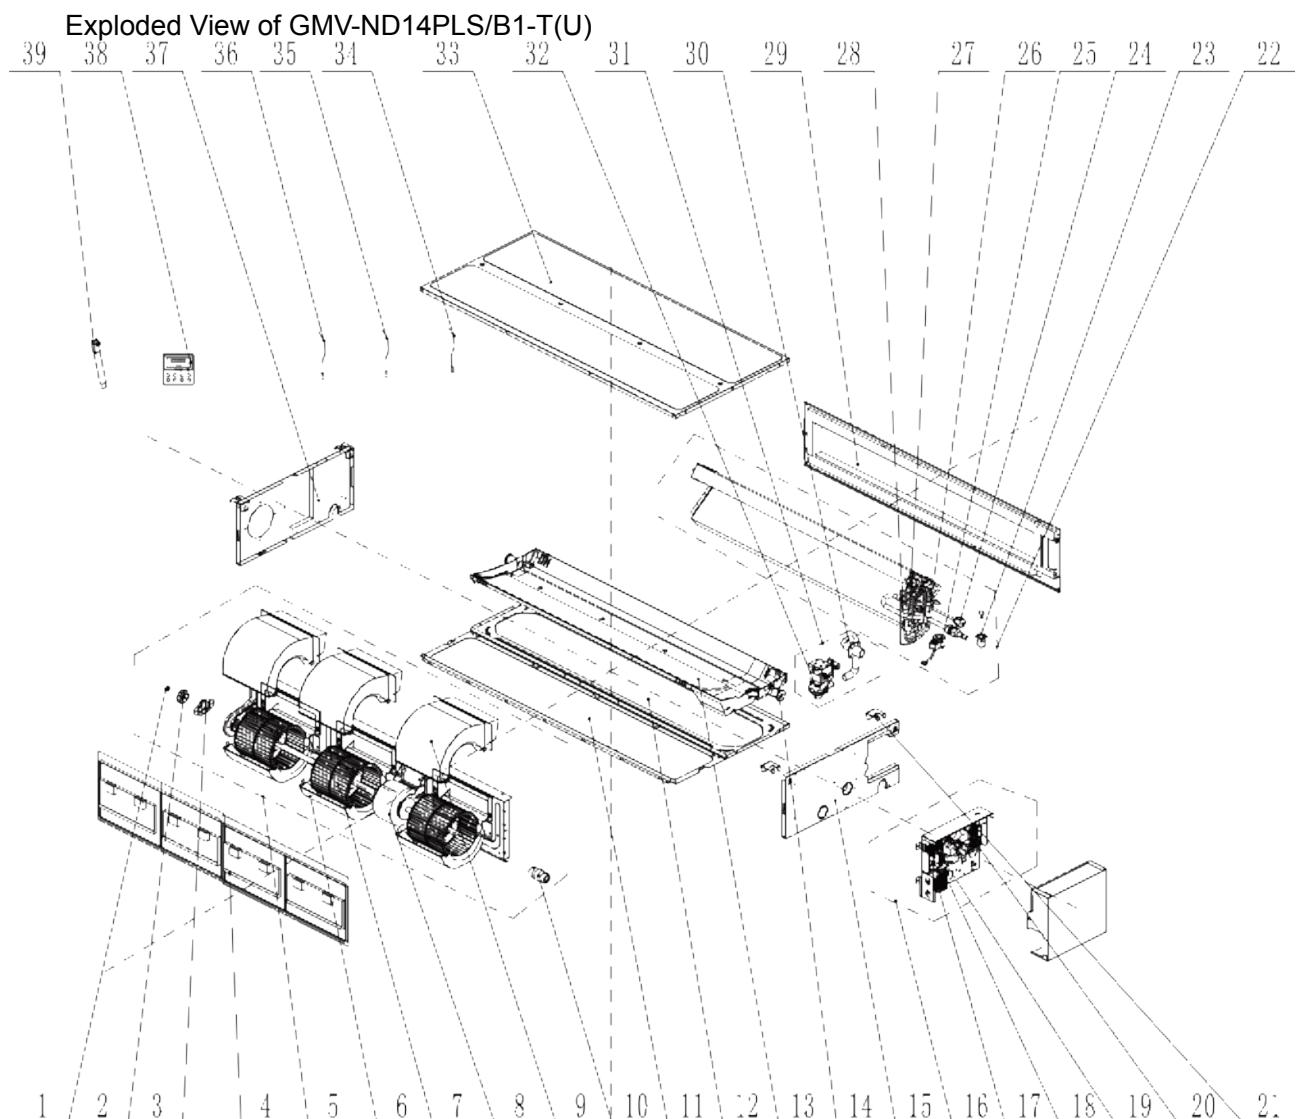

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND14PLS/B1-T(U)	CM810N2200
		Part code	Quantity
1	Top Cover Board Assy	7651221001	1
2	Top Cover Board Sub-assy	26151138	1
3	Top Cover	02285200001	1
4	Blower Mounting Plate Sub-Assy	111001000082	1
5	Brushless DC Motor	000052060087	1
6	Hoop	26905200019	2
7	Bar Clasp	10425200003	2
8	Motor Support	150104060009	1
9	Centrifugal Fan	26905200018	2
10	Fan Nesting	73018731	1
11	Propeller Housing(Upper)	01265200057	1
12	Propeller Housing(Lower)	01265200065	1
13	Joint Slack	26905200023	1
14	Rotary Axis Sub-Assy	76815200002	2
15	Bearing Holder Sub-assy	012055000011	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND14PLS/B1-T(U)	CM810N2200
		Part code	Quantity
16	Bearing Holder	100002069979	2
17	Fan Bearing	42200006000401	1
18	Support Of Motor Bearing	4201110602	1
19	Support (shaft)	300002060299	1
20	Right Side Plate Assy	300002060966	1
21	Right Side Plate Sub-Assy	01344100034	2
22	Right Side Plate	011001060790	1
23	Left Side Plate Assy	430024060005	1
24	Left Side Plate	2611219201	1
25	Cable Cross Loop	4304000111	1
26	Electronic Expansion Valve	07213050	1
27	Sealing Cap(Pressure Warning)	072009000005	1
28	Strainer	0721200102 1	1
29	Temp Sensor Sleeving	01374100058	1
30	Strainer	760022000001	1
31	Temp Sensor Sleeving	000104060009	1
32	Electric Expand Valve Fitting	812007060016	1
33	Cable Cross Loop	01265200070	1
34	Airproof Sealant	390000595	1
35	Water Level Switch	3900005910	1
36	Temperature Sensor	390000456	1
37	Temperature Sensor	01315200042	1
38	Water Pump Assy	30296000040	1
39	Water Pump	007008000001	1

Above data is subject to change without notice, pls refer the SP in global service website.


#### Exploded View of GMV-ND18PLS/B1-T(U)

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND18PLS/B1-T(U)	CM810N2210
		Part code	Quantity
1	Top Cover Board Assy	7651221001	1
2	Top Cover Board Sub-assy	26151138	1
3	Top Cover	02285200001	1
4	Centrifugal fan assy	111001000082	1
5	Blower Mounting Plate Sub-Assy	000052060087	1
6	Brushless DC Motor	26905200019	2
7	Hoop	10425200003	2
8	Bar Clasp	150104060009	1
9	Motor Support	26905200018	2
10	Centrifugal Fan	73018731	1
11	Fan Nesting	01265200057	1
12	Propeller Housing(Upper)	01265200065	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND18PLS/B1-T(U)	CM810N2210
		Part code	Quantity
13	Propeller Housing(Lower)	26905200023	1
14	Joint Slack	76815200002	2
15	Rotary Axis Sub-Assy	012055000011	1
16	Bearing Holder Sub-assy	100002069979	2
17	Bearing Holder	42200006000401	1
18	Fan Bearing	4201110602	1
19	Support Of Motor Bearing	300002060299	1
20	Support (shaft)	300002060966	1
21	Right Side Plate Assy	01344100034	2
22	Right Side Plate Sub-Assy	011001060790	1
23	Right Side Plate	430024060005	1
24	Left Side Plate Assy	2611219201	1
25	Left Side Plate	4304000111	1
26	Cable Cross Loop	07213050	1
27	Water Level Switch	072009000005	1
28	Evaporator Assy	0721200102 1	1
29	Temp Sensor Sleeving	01374100058	1
30	Temp Sensor Sleeving	760022000001	1
31	Electronic Expansion Valve	000104060009	1
32	Strainer	812007060016	1
33	Sealing Cap(Pressure Warning)	01265200070	1
34	Strainer	390000595	1
35	Electric Expand Valve Fitting	3900005910	1
36	Cable Cross Loop	390000456	1
37	Airproof Sealant	01315200042	1
38	Temperature Sensor	30296000040	1
39	Temperature Sensor	007008000001	1

Above data is subject to change without notice, pls refer the SP in global service website.

## Exploded View of GMV-ND24PLS/B1-T(U)

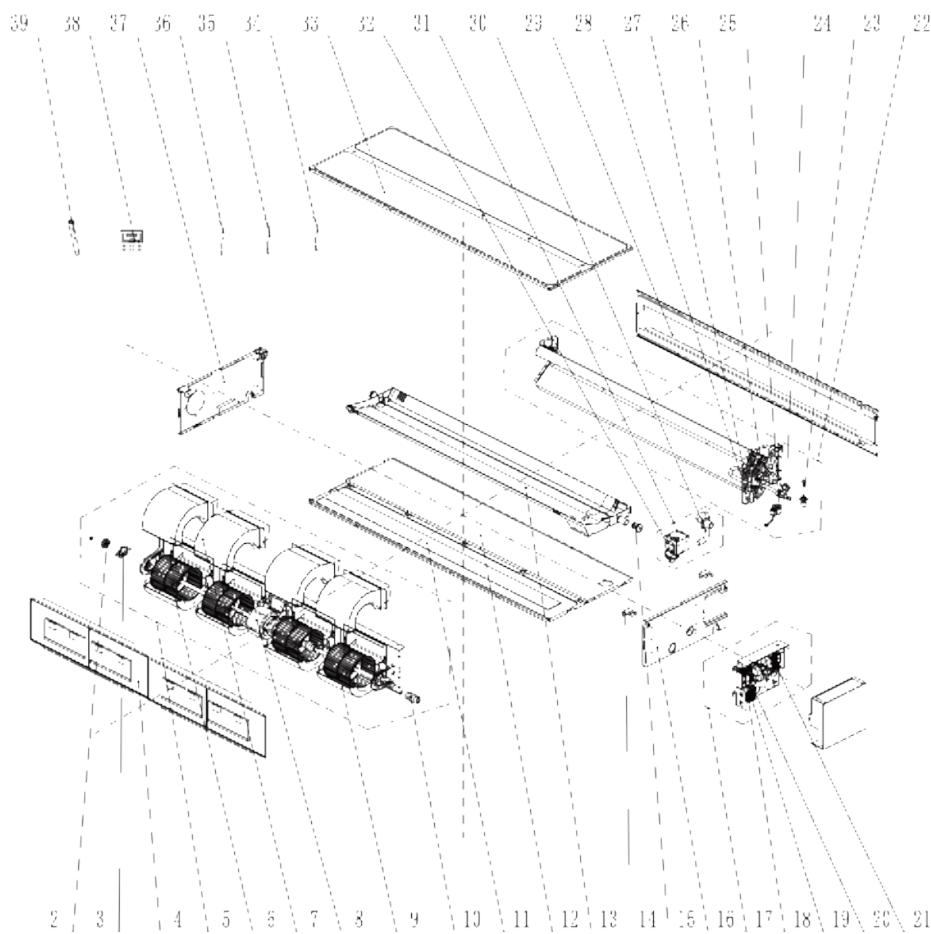


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND24PLS/B1-T(U)	CM810N2230
		Part code	Quantity
1	Top Cover Board Assy	7651221001	1
2	Top Cover Board Sub-assy	26151138	1
3	Top Cover	02285200001	1
4	Centrifugal fan assy	111001000082	1
5	Blower Mounting Plate Sub-Assy	000052060087	1
6	Brushless DC Motor	10425200003	2
7	Hoop	26905200018	2
8	Bar Clasp	150104060011	1
9	Motor Support	26905200019	2
10	Centrifugal Fan	73018731	1
11	Fan Nesting	01265200057	1
12	Propeller Housing(Upper)	01265200065	1
13	Propeller Housing(Lower)	26905200023	1
14	Joint Slack	01344100034	2
15	Rotary Axis Sub-Assy	76815200002	2
16	Bearing Holder Sub-assy	012055000011	1
17	Bearing Holder	100002069979	2
18	Fan Bearing	300002060966	1
19	Support Of Motor Bearing	42200006000401	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND24PLS/B1-T(U)	CM810N2230
		Part code	Quantity
20	Support (shaft)	4201110602	1
21	Right Side Plate Assy	300002060300	1
22	Right Side Plate Sub-Assy	011001060790	1
23	Right Side Plate	430024060005	1
24	Left Side Plate Assy	2611219201	1
25	Left Side Plate	4304000111	1
26	Cable Cross Loop	07213050	1
27	Water Level Switch	072009000005	1
28	Evaporator Assy	0721200102 1	1
29	Temp Sensor Sleeving	01374100058	1
30	Temp Sensor Sleeving	760022000001	1
31	Strainer	000104060009	1
32	Sealing Cap(Pressure Warning)	812007060016	1
33	Strainer	01265200070	1
34	Electronic Expansion Valve	390000595	1
35	Capillary tube	3900005910	1
36	Cable Cross Loop	390000456	1
37	Electric Expand Valve Fitting	01315200042	1
38	Temperature Sensor	30296000040	1
39	Temperature Sensor	007008000001	1

## 5.2 Slim Duct Type Indoor Unit

Exploded View of GMV-ND06PLS/B-T(U) / GMV-ND07PLS/B-T(U) / GMV-ND09PLS/B-T(U) / GMV-ND12PLS/B-T(U):

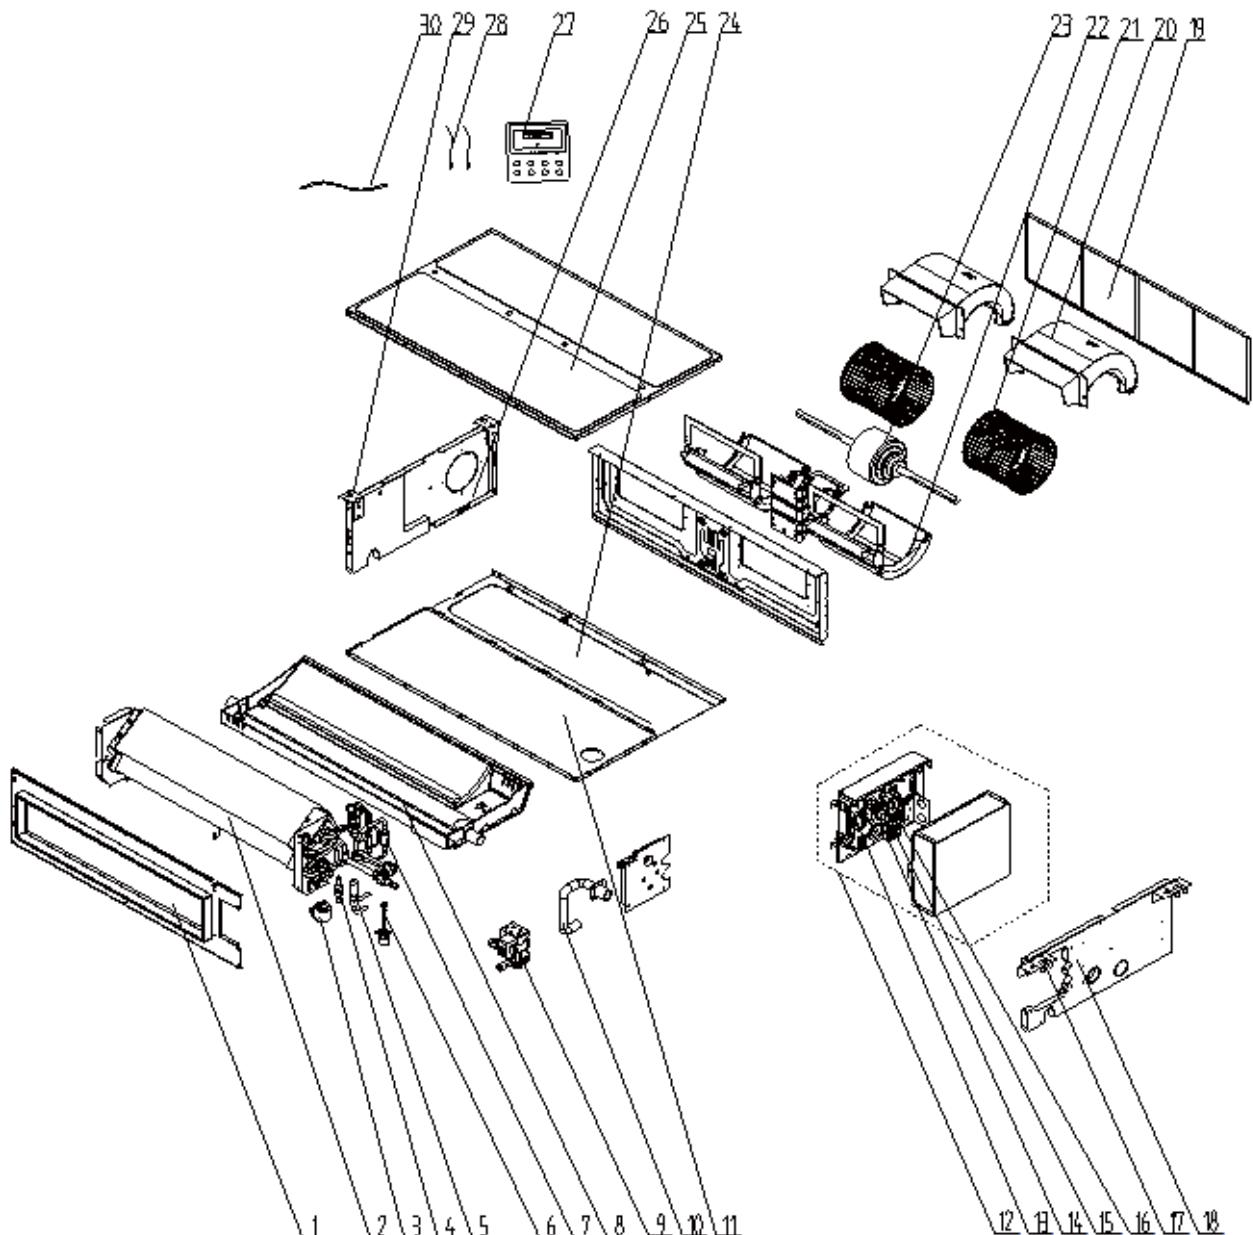


No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
	GMV-ND06PLS/B-T(U)	CM810N1980		GMV-ND12PLS/B-T(U)	CM810N1700
	GMV-ND07PLS/B-T(U)	CM810N1720			
	GMV-ND09PLS/B-T(U)	CM810N1710			
Part code		Quantity	Part code		Quantity
1	Air Outlet Frame Assy	000141000012	1	000141000012	1
2	Evaporator Assy	011001000363	1	011001000360	1
3	Electric Expand Valve Fitting	4304413266	1	4304413266	1
4	Strainer	0721200102	1	0721200102	1
5	Electronic Expansion Valve	07334463	1	07334463	1
6	Liquid Level Switch	430024000005	1	430024000005	1

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND06PLS/B-T(U)	CM810N1980	GMV-ND12PLS/B-T(U)	CM810N1700
		GMV-ND07PLS/B-T(U)	CM810N1720		
		GMV-ND09PLS/B-T(U)	CM810N1710		
Part code		Quantity		Part code	
7	Strainer	07213050	1	07213050	1
8	Water Tray Assy	000069000060	1	000069000060	1
9	Water Pump	812007060016	1	812007060016	1
10	Pump Drainpipe	200070000005	1	200070000005	/
11	Bottom Cover Plate Assy	000133000012	1	000133000012	1
12	Electric Box Assy	100002062875	1	100002062875	1
13	Main Board	300002060297	1	300002060297	1
14	Main Board	300002060289	1	300002060289	1
15	Terminal Board	42200006000401	1	42200006000401	1
16	Terminal Board	4201110602	1	4201110602	1
17	Hook 2	01344100034	2	01344100034	2
18	Left Side Plate Assy	000080060035	1	000080060035	1
19	Filter Sub-Assy	111001000082	2	111001000082	1
20	Propeller Housing(Upper)	26905200018	2	26905200018	2
21	Centrifugal Fan	10425200003	2	10425200003	2
22	Propeller Housing(Lower)	26905200019	2	26905200019	2
23	Brushless DC Motor	150104060010	1	150104060010	1
24	Cover Plate(Air return)	01265200057	1	01265200057	1
25	Top Cover Board Assy	000132060037	1	000132060037	1
26	Right Side Plate Assy	01314100115	1	01314100115	1
27	Display Board	30296000040	1	30296000040	1
28	Sensor Sub-assy	390002000005	1	390002000005	1
29	Hook	02112446	2	02112446	2
30	Drain Hose Sub-Assy	05232050	1	4202021905	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-ND14PLS/B-T(U) / GMV-ND18PLS/B-T(U)

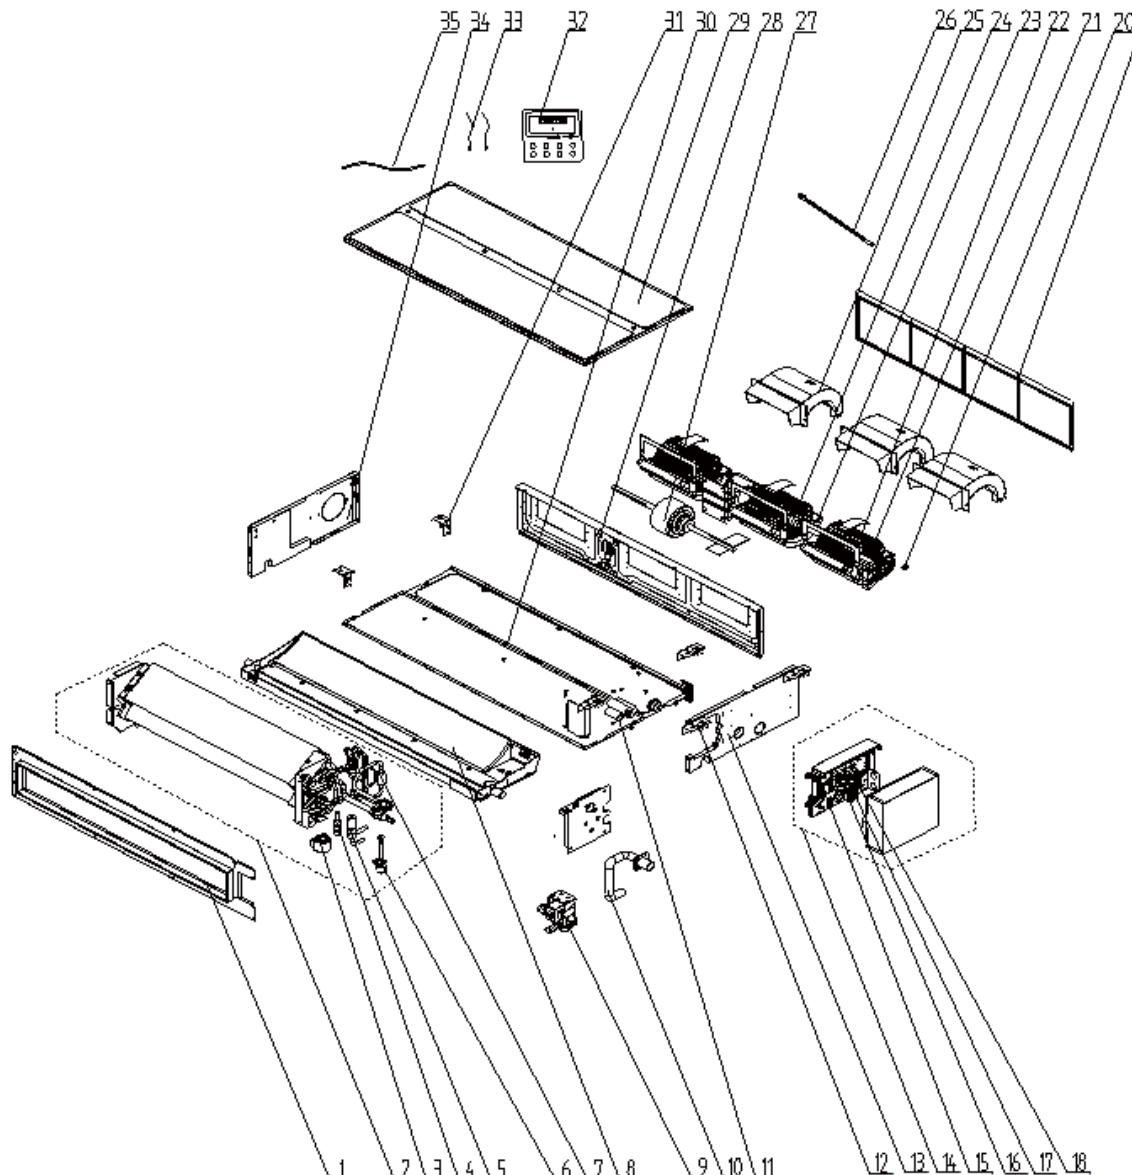

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND14PLS/B-T(U)	CM810N1690
1	Air Outlet Frame Assy	000141000011	1
2	Evaporator Assy	01100100036201	1
3	Electric Expand Valve Fitting	4304413215	1
4	Strainer	0721200102	1
5	Electronic Expansion Valve	07334466	1
6	Liquid Level Switch	430024000005	1
7	Strainer	07213050	1
8	Water Tray Assy	000069000059	1
9	Water Pump	812007060016	1
10	Pump Drainpipe	200070000005	1
11	Bottom Cover Plate Assy	000133000011	1
12	Hook 2	01344100034	2
13	Left Side Plate Assy	000080060035	1


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND14PLS/B-T(U)	CM810N1690
14	Electric Box Assy	100002062875	1
15	Main Board	300002060297	1
16	Main Board	300002060289	1
17	Terminal Board	42200006000401	1
18	Terminal Board	4201110602	1
19	Filter Sub-Assy	111253038	2
20	Fan Bearing	76512210	1
21	Rotary Axis Sub-Assy	73018761	1
22	Centrifugal Fan	10425200003	3
23	Propeller Housing(Lower)	26905200019	3
24	Joint Slack	73018731	1
25	Propeller Housing(Upper)	26905200018	3
26	Corrugated Pipe	05015408	0
27	Brushless DC Motor	15010406001001	1
28	Blower Mounting Plate Sub-Assy	01325200035	1
29	Top Cover Board Assy	000132060036	1
30	Cover Of Air-In	01265200073	1
31	Hook	02112446	2
32	Display Board	30296000040	1
33	Sensor Sub-assy	390002000005	1
34	Right Side Plate Assy	01314100115	1
35	Drain Hose Sub-Assy	007008000001	1

Above data is subject to change without notice, please refer the SP in global service website.

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND18PLS/B-T(U)	CM810N1680
1	Air Outlet Frame Assy	000141000011	1
2	Evaporator Assy	011001000362	1
3	Electric Expand Valve Fitting	4304413266	1
4	Strainer	0721200102	1
5	Electronic Expansion Valve	07334466	1
6	Liquid Level Switch	430024000005	1
7	Strainer	07213050	1
8	Water Tray Assy	000069000059	1
9	Water Pump	812007060016	1
10	Pump Drainpipe	200070000005	1
11	Bottom Cover Plate Assy	000133000011	1
12	Hook 2	01344100034	2
13	Left Side Plate Assy	000080060035	1
14	Electric Box Assy	100002063017	1
15	Main Board	300002060299	1
16	Main Board	300002060289	1
17	Terminal Board	42200006000401	1
18	Terminal Board	4201110602	1
19	Filter Sub-Assy	111253038	2
20	Fan Bearing	76512210	1
21	Rotary Axis Sub-Assy	73018761	1
22	Centrifugal Fan	10425200003	3
23	Propeller Housing(Lower)	26905200019	3
24	Joint Slack	73018731	1
25	Propeller Housing(Upper)	26905200018	3
26	Corrugated Pipe	05015408	1
27	Brushless DC Motor	15010406000901	1
28	Blower Mounting Plate Sub-Assy	01325200035	1
29	Top Cover Board Assy	000132060036	1
30	Cover Of Air-In	01265200073	1
31	Hook	02112446	2
32	Display Board	30296000040	1
33	Sensor Sub-assy	390002000005	1
34	Right Side Plate Assy	01314100115	1
35	Drain Hose Sub-Assy	007008000001	1

Above data is subject to change without notice, please refer the SP in global service website

## Exploded View of GMV-ND24PLS/B-T(U)

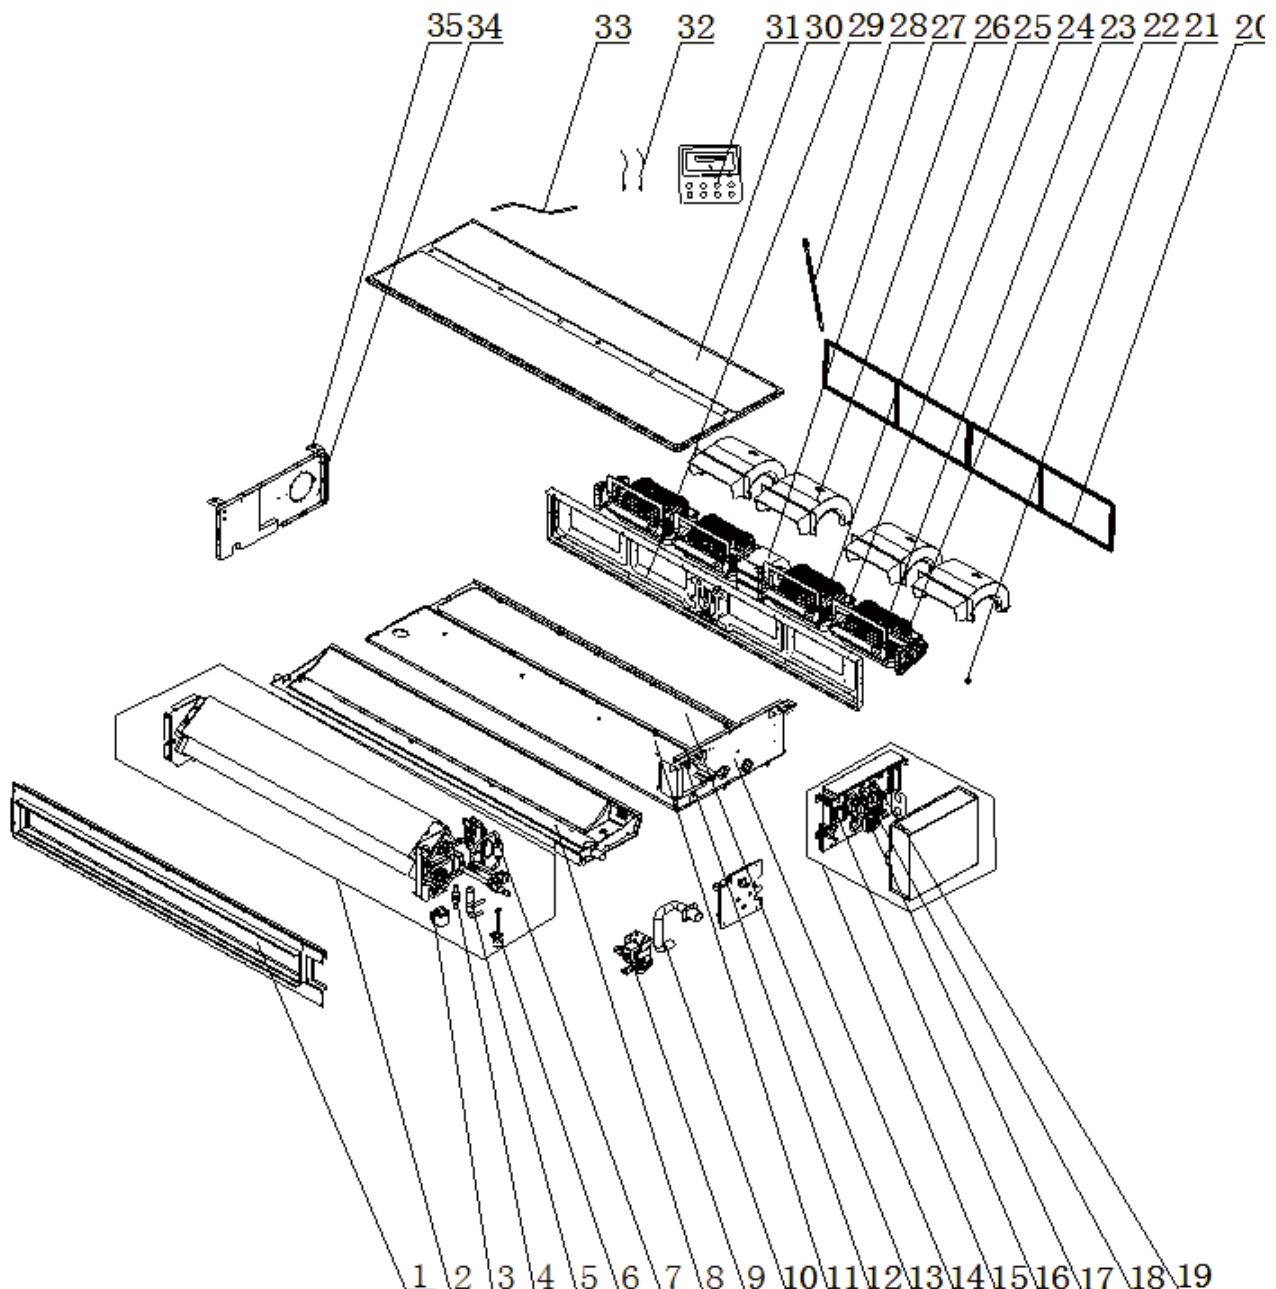


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND24PLS/B-T(U)	CM810N1670
1	Air Outlet Frame Assy	000141000013	1
2	Evaporator Assy	011001000402	1
3	Electric Expand Valve Fitting	4304413215	1
4	Strainer	0721200102	1
5	Electronic Expansion Valve	07334466	1
6	Liquid Level Switch	430024000005	1
7	Strainer	07213050	1
8	Water Tray Assy	000069000069	1
9	Water Pump	812007060016	1
10	Pump Drainpipe	200070000005	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND24PLS/B-T(U)	CM810N1670
11	Bottom Cover Plate Assy	000133000013	1
12	Hook 2	01344100034	2
13	Cover Of Air-In	01265200085	1
14	Left Side Plate Assy	000080060035	1
15	Electric Box Assy	100002063018	1
16	Main Board	300002060300	1
17	Terminal Board	42200006000401	1
18	Terminal Board	4201110602	1
19	Main Board	300002060289	1
20	Filter Sub-Assy	111253039	2
21	Fan Bearing	76512210	1
22	Rotary Axis Sub-Assy	73018761	2
23	Centrifugal Fan	10425200003	4
24	Propeller Housing(Lower)	26905200019	4
25	Joint Slack	73018731	2
26	Propeller Housing(Upper)	26905200018	4
27	Brushless DC Motor	150104060011	1
28	Corrugated Pipe	05015408	1
29	Blower Mounting Plate Sub-Assy	01325200053	1
30	Top Cover Board Assy	00013206003501	1
31	Display Board	30296000040	1
32	Sensor Sub-assy	390002000005	1
33	Drain Hose Sub-Assy	05232050	1
34	Right Side Plate Assy	01314100115	1
35	Hook	02112446	2

Above data is subject to change without notice, please refer the SP in global service website

## 5.3 Four-way Cassette Type Indoor Unit

Exploded View of GMV-ND07T/A-T(U):

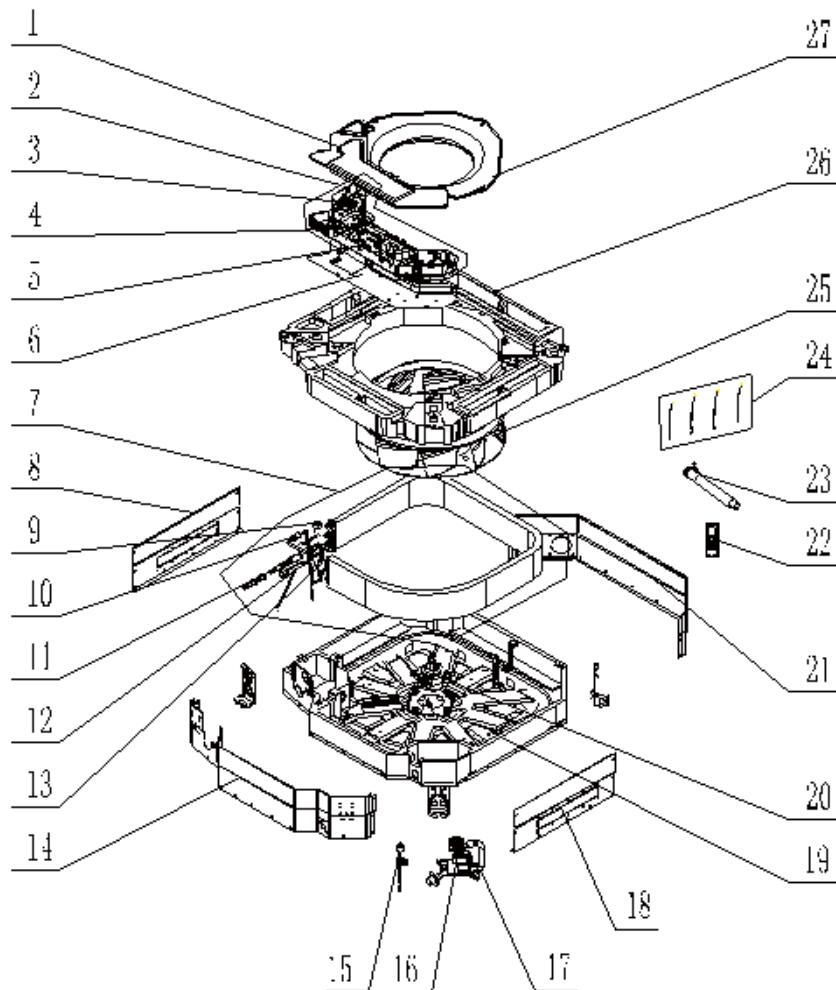


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND07T/A-T(U)	CM500N0520
1	Electric Box cover	0142410004801	1
2	Electric Box Assy	01394100434	1
3	Terminal Board	42011222	1
4	Terminal Board	4201800002601	1
5	Main Board	30226000029	1
6	Electric base plate	01412721	1
7	Evaporator Assy	01024100135	1
8	Left Side Plate	01302733	1
9	Electric Expand Valve Fitting	4304413215	1
10	Strainer	07415200002	1
11	Filter Sub-Assy	/	/

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND07T/A-T(U)	CM500N0520
		Part code	Quantity
12	Electronic Expansion Valve	07334463	1
13	Strainer	07414100006	1
14	Front Side Plate	01302731	1
15	Water Level Switch	45020216	1
16	Water Pump	43138000068	1
17	Pump Drainpipe	05232721	1
18	Right Side Plate	01302734	1
19	Base Plate Assy	01222701	1
20	Brushless DC Motor	15704100007	1
21	Rear Side Plate	01302732	1
22	Remote Controller	30510589	1
23	Drain Hose Sub-Assy	05232050	1
24	Sensor Sub-assy	39008000013G	1
25	Centrifugal Fan	10312721	1
26	Water Tray Assy	01289400013	1
27	Diversion Circle	10372701	1

Above data is subject to change without notice, please refer the SP in global service website.

Exploded View of GMV-ND09T/A-T(U) / GMV-ND12T/A-T(U) / GMV-ND15T/A-T(U) / GMV-ND18T/A-T(U) / GMV-ND24T/A-T(U) / GMV-ND30T/A-T(U) / GMV-ND36T/A-T(U) / GMV-ND42T/A-T(U) / GMV-ND48T/A-T(U):

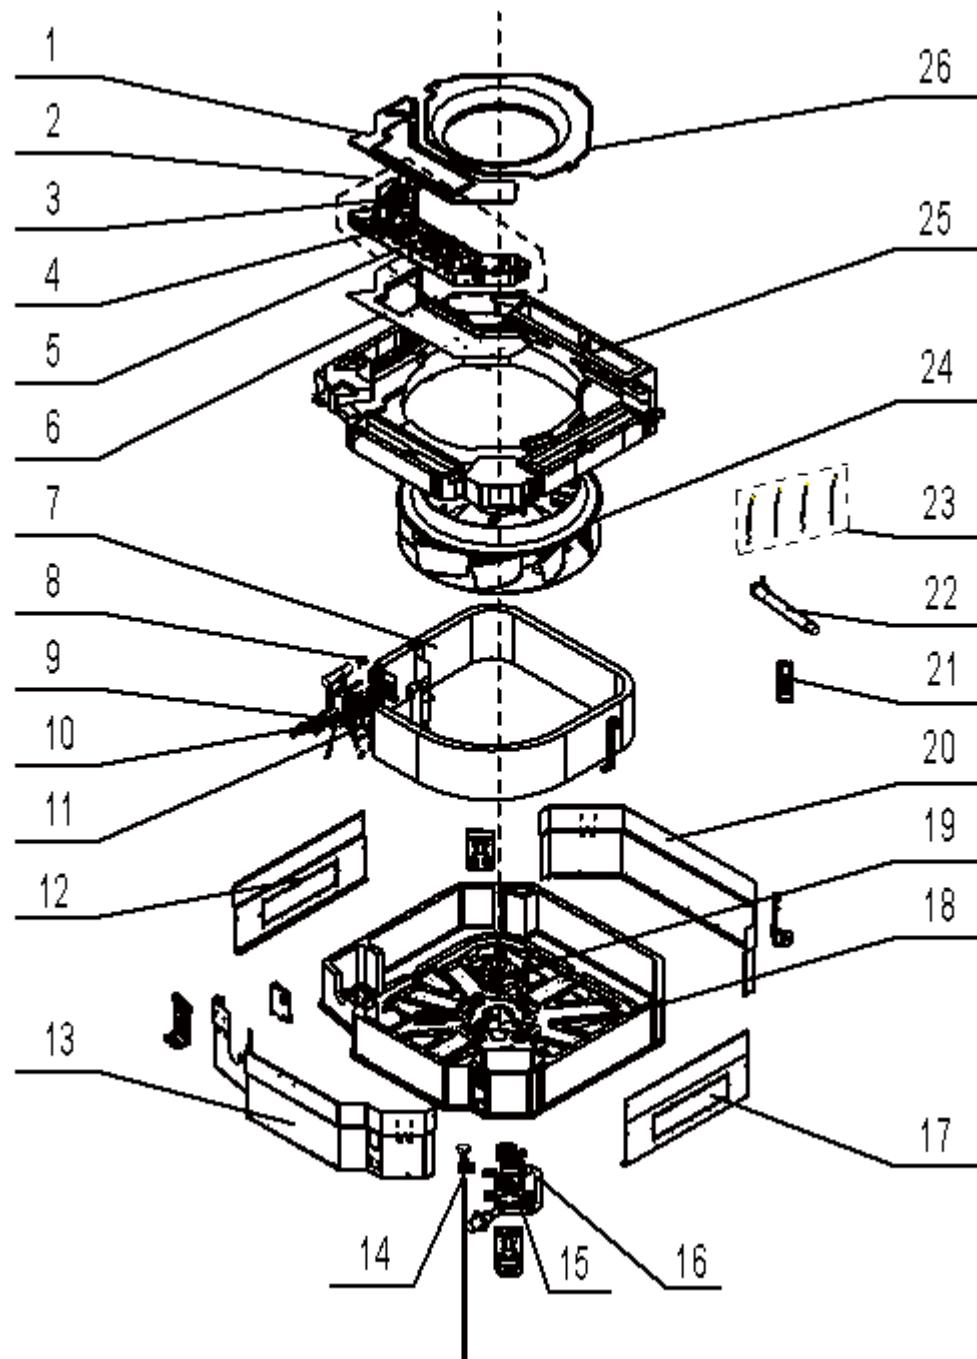

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
	GMV-ND09T/A-T(U)	CM500N0530		GMV-ND15T/A-T(U)	CM500N0670
	GMV-ND12T/A-T(U)	CM500N0540		GMV-ND18T/A-T(U)	CM500N0510
	/	/		GMV-ND24T/A-T(U)	CM500N0550
Part code		Quantity		Part code	Quantity
1	Electric Box Cover	0142410004801	1	0142410004801	1
2	Electric Box Assy	01394100434	1	01394100434	1

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND09T/A-T(U)	CM500N0530	GMV-ND15T/A-T(U)	CM500N0670
		GMV-ND12T/A-T(U)	CM500N0540	GMV-ND18T/A-T(U)	CM500N0510
		/	/	GMV-ND24T/A-T(U)	CM500N0550
		Part code	Quantity	Part code	Quantity
3	Terminal Board	42011222	1	42011222	1
4	Terminal Board	4201800002601	1	4201800002601	1
5	Main Board	30226000029	1	30226000029	1
6	Electric Base Plate	01412721	1	01412721	1
7	Evaporator Assy	0102410013401	1	01024100134	1
8	Electric Expand Valve Fitting	4304413215	1	4304413215	1
9	Corrugated Pipe	05025134	1	05015408	1
10	Strainer	0741410000601	1	0741410000601	1
11	Electronic Expansion Valve	07334466	1	07334466	1
12	Left Side Plate	01302705	1	01302705	1
13	Front Side Plate	01302701	1	01302701	1
14	Water Level Switch	45020216	1	45020216	1
15	Water Pump	43138000068	1	43138000068	1
16	Pump Drainpipe	05230026	1	05230026	1
17	Right Side Plate	01302707	1	01302707	1
18	Base Plate Assy	01222701	1	01222701	1
19	Brushless DC Motor	15709400004	1	15709400004	1
20	Rear Side Plate	01302703	1	01302703	1
21	Remote Controller	30510589	1	30510589	1
22	Drain Hose Sub-Assy	05232702	1	05232702	1
23	Sensor Sub-assy	39008000013G	1	39008000013G	1
24	Centrifugal Fan	10312705	1	10312705	1
25	Water Tray Assy	01289400013	1	01289400013	1
26	Diversion Circle	10372701	1	10372701	1


Above data is subject to change without notice, please refer the SP in global service website.

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND30T/A-T(U)	CM500N0560
		GMV-ND36T/A-T(U)	CM500N0570
		GMV-ND42T/A-T(U)	CM500N0580
		GMV-ND48T/A-T(U)	CM500N0590
Part code		Quantity	
1	Electric Box Cover	0142410004801	1
2	Electric Box Assy	01394100434	1
3	Terminal Board	42011222	1
4	Terminal Board	4201800002601	1
5	Main Board	30226000029	1
6	Electric Base Plate	01412721	1
7	Evaporator Assy	01024100116	1
8	Electric Expand Valve Fitting	01302733	1
9	Corrugated Pipe	4304413215	1
10	Strainer	0741410000601	1
11	Electronic Expansion Valve	07334468	1
12	Left Side Plate	01302725	1
13	Front Side Plate	01302721	1
14	Water Level Switch	45020216	1
15	Water Pump	43138000068	1
16	Pump Drainpipe	05230026	1
17	Right Side Plate	01302727	1
18	Base Plate Assy	01222701	1
19	Brushless DC Motor	15709400003	1
20	Rear Side Plate	01302723	1
21	Remote Controller	30510589	1
22	Drain Hose Sub-Assy	05232702	1
23	Sensor Sub-assy	39008000013G	1
24	Centrifugal Fan	10310101	1
25	Water Tray Assy	01289400013	1
26	Diversion Circle	10372722	1

Above data is subject to change without notice, please refer the SP in global service website.

## 5.4 High Static Pressure Duct Type Indoor Unit

Exploded View of GMV-ND18PHS/A-T(U) / GMV-ND24PHS/A-T(U):

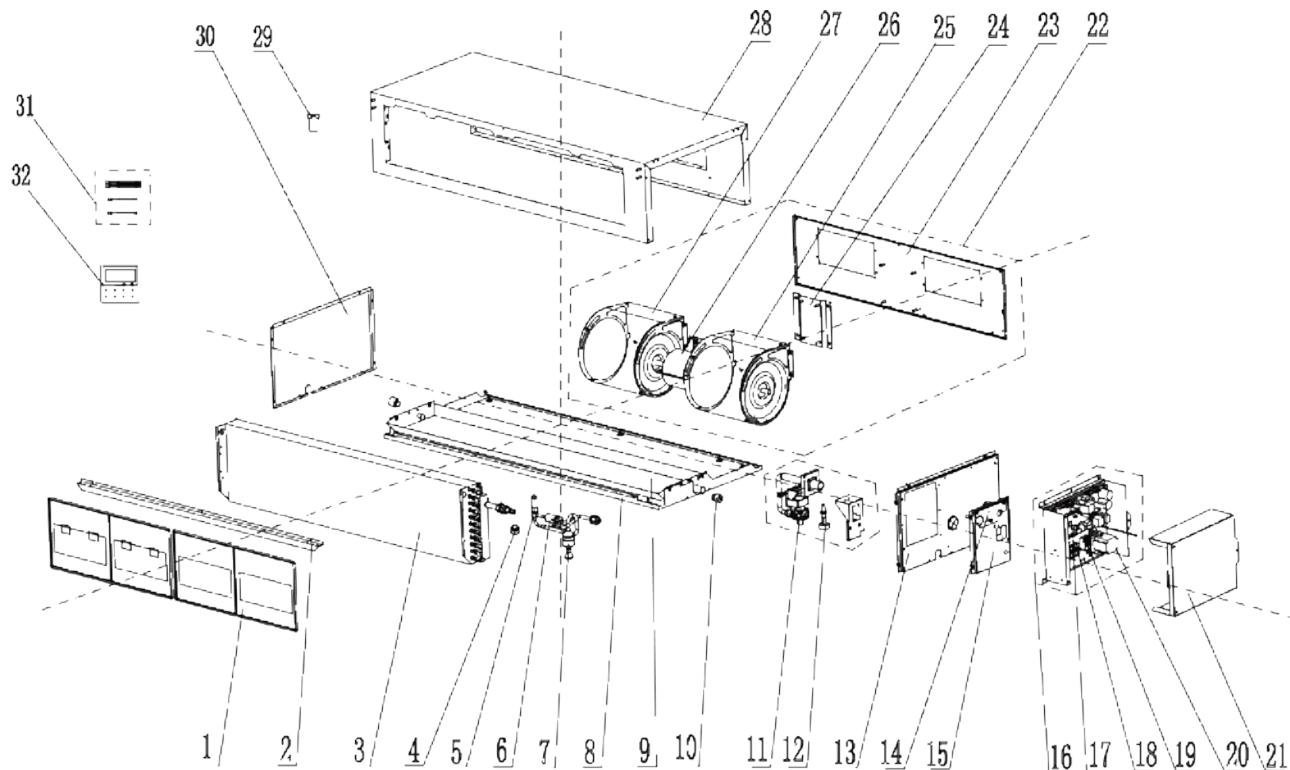


No.	Name of part	For the following unit	
		Unit	Product Code
	GMV-ND18PHS/A-T(U)	CM810N0140	
	GMV-ND24PHS/A-T(U)	CM810N0150	
Part code		Quantity	
1	Filter Sub-Assy	11125303	2
2	Guide groove of the filter screen	02285301	1
3	Evaporator Assy	01024100090	1
4	Electric Expand Valve Fitting	4304413215	1
5	Electronic Expansion Valve	07334466	1
6	Strainer	0741410000601	1
7	Filter	07415210	1
8	Lower Cover Plate Sub-Assy	01265304	1
9	Water Tray Assy	01285317	1
10	Choke Plug of Drain Pipe	76712455	2
11	Water Pump	4313822001	1
12	Water Level Switch	450127011	1
13	Right Side Plate	01314100063	1
14	Seal plate'	01494100008	1
15	Cover Plate	01264100036	1
16	Electric Box Assy	01394100501	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND18PHS/A-T(U)	CM810N0140
		GMV-ND24PHS/A-T(U)	CM810N0150
Part code		Quantity	
17	Main Board	30226000027	1
18	Terminal Board	4201800002601	1
19	Terminal Board	4201115402	1
20	Inductance	43128000014	1
21	Electric Box Cover	01424100132	1
22	Centrifugal fan assy	15405200029	1
23	Blower Mounting Plate Sub-Assy	01325200039	1
24	Supporter	01804100140	1
25	Blower	15012454	1
26	Brushless DC Motor	15705200006	1
27	Blower	15012458	1
28	Top Cover Board Assy	01265226	1
29	Hook	02112446	4
30	Left Side Plate Assy	01314155	1
31	Sensor Sub-assy	39004169G	1
32	Display Board	30296000040	1

Above data is subject to change without notice, please refer the SP in global service website.

Exploded View of GMV-ND30PHS/A-T(U) / GMV-ND36PHS/A-T(U) / GMV-ND42PHS/A-T(U) /  
GMV-ND48PHS/A-T(U):

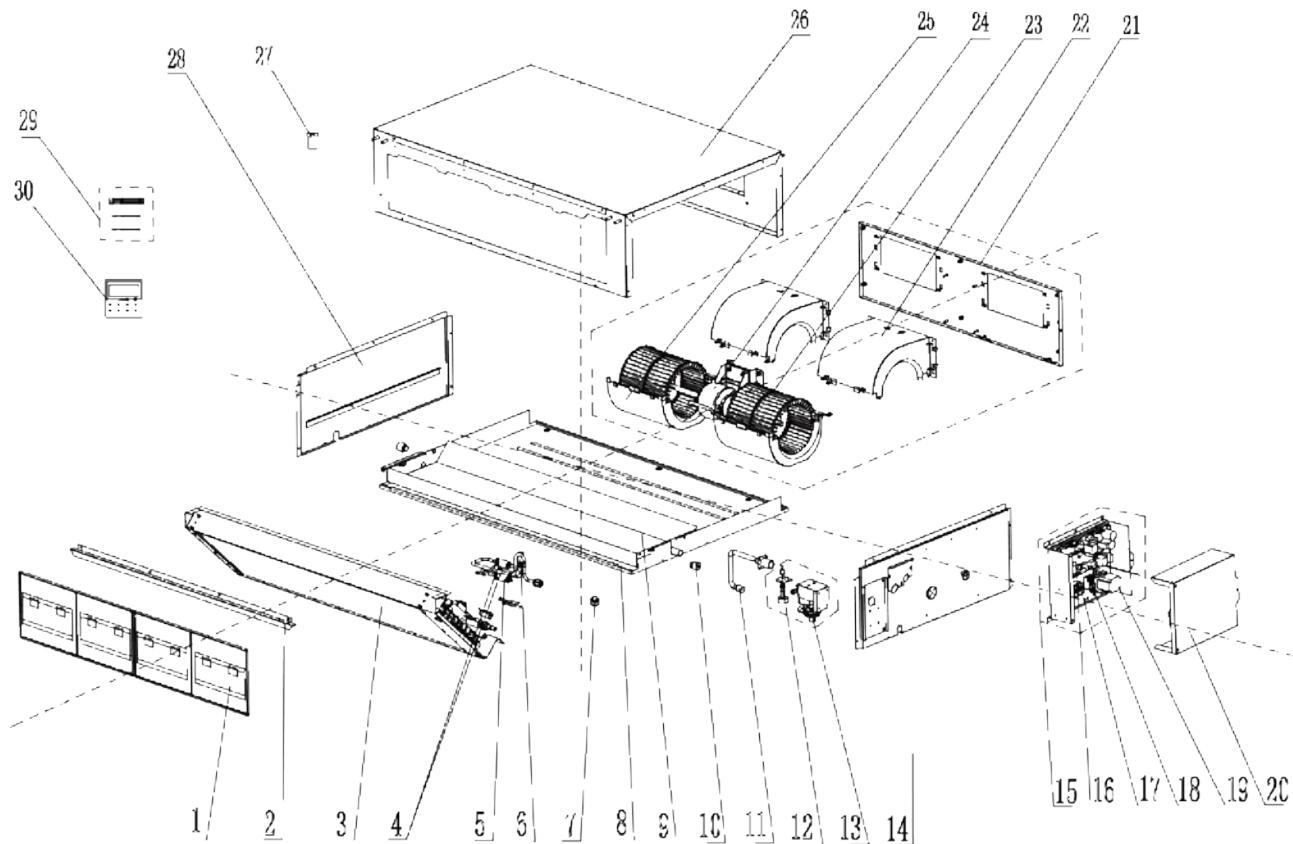


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND30PHS/A-T(U)	CM810N0160
		GMV-ND36PHS/A-T(U)	CM810N0170
		GMV-ND42PHS/A-T(U)	CM810N0180
		GMV-ND48PHS/A-T(U)	CM810N0190
1	Part code	Quantity	
	Filter Sub-Assy	111253031	2
	Side Plate of Air intake	01375301	1
	Evaporator Assy	01024100077	1
	Strainer	0741410000601	2
	Strainer	07220005	1
	Electronic Expansion Valve	07334468	1
	Electric Expand Valve Fitting	4304413215	1
	Lower Cover Plate Sub-Assy	15265301	1
	Water Tray Assy	01285323	1
	Choke Plug of Drain Pipe	76712455	2
	Pump Drainpipe	05235301	1
	Water Level Switch	45018012	1
	Water Pump	43138220	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND30PHS/A-T(U)	CM810N0160
		GMV-ND36PHS/A-T(U)	CM810N0170
		GMV-ND42PHS/A-T(U)	CM810N0180
		GMV-ND48PHS/A-T(U)	CM810N0190
Part code		Quantity	
14	Right Side Plate Sub-Assy	01315200100	1
15	Electric Box Assy	01394100501	1
16	Main Board	30226000027	1
17	Terminal Board	4201800002601	1
18	Terminal Board	4201115402	1
19	Inductance	43128000014	1
20	Electric Box Cover	01424100132	1
21	Blower Mounting Plate Sub-Assy	01325200044	1
22	Propeller Housing(Upper)	26904100051	2
23	Centrifugal Fan	10424100001	2
24	Brushless DC Motor	15709400006	1
25	Propeller Housing(Lower)	26904100052	2
26	Top Cover Board Assy	01264100039	1
27	Hook	02112466	4
28	Left Side Plate Assy	01315306	1
29	Sensor Sub-assy	39004169G	1
30	Display Board	30296000040	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-ND72PH/A-T(U) / GMV-ND96PH/A-T(U):

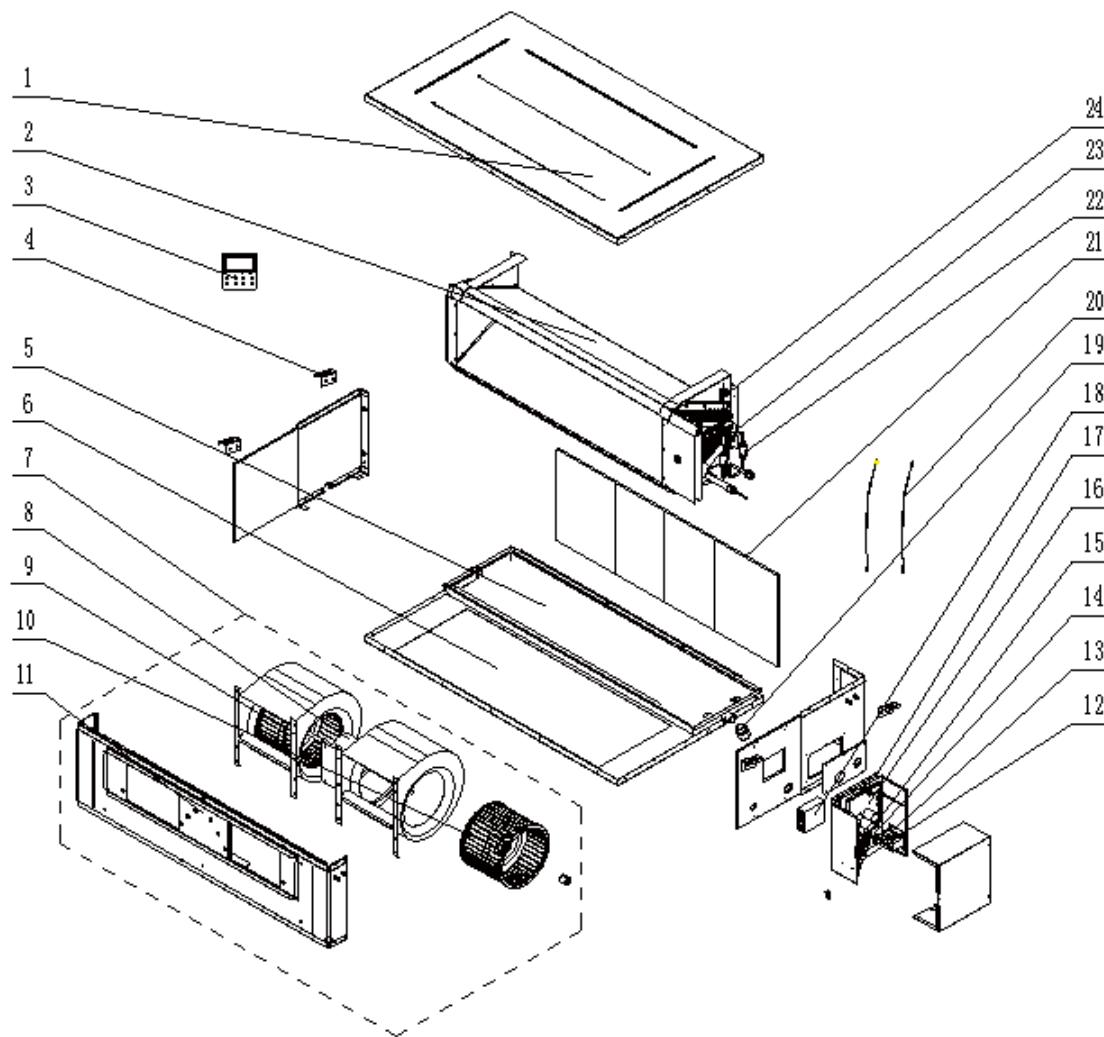


No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND72PH/A-T(U)	CM810N0280	GMV-ND96PH/A-T(U)	CM810N0290
		Part code	Quantity	Part code	Quantity
1	Top Cover Board Assy	01264100086	1	01264100090	1
2	Evaporator Assy	01024100119	1	01024100124	1
3	Display Board	30296000040	1	30296000040	1
4	Hook	02112466	4	02112466	4
5	Water Tray Assy	01284620	1	01284305	1
6	Bottom Cover Plate Assy	01264100087	1	01264100089	1
7	Centrifugal fan assy	15404100078	1	15404100079	1
8	Brushless DC Motor	15704100009	1	15704100009	1
9	Motor	15705306	1	15704118	1
10	Motor	15705307	1	1570411801	1
11	Front Side Plate assy	01315374	1	01314100128	1
12	Main Board	30226000064	1	30226000064	1
13	Reactor	43130189	1	43130189	1

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND72PH/A-T(U)	CM810N0280	GMV-ND96PH/A-T(U)	CM810N0290
		Part code	Quantity	Part code	Quantity
14	Terminal Board	4201800002601	1	4201800002601	1
15	Terminal Board	42010259	1	42010259	1
16	Main Board	30221000023	1	30221000023	1
17	Electric Box Assy	01394100584	1	01394100584	1
18	Radiator	49018000068	1	49018000068	1
19	Choke Plug of Water Pipe	76712454	2	76712454	2
20	Sensor Sub-assy	39008000103G	1	39008000103G	1
21	Filter Sub-Assy	11725211	2	11724102	2
22	Strainer	0741410000601	1	0741410000601	1
23	Electronic Expansion Valve	07331139	1	07331139	1
24	Electric Expand Valve Fitting	4304413205	1	4304413205	1

Above data is subject to change without notice, please refer the SP in global service website.

## 5.5 Two-way Cassette Type Indoor Unit

Exploded View of GMV-ND09TS/A-T(U) / GMV-ND12TS/A-T(U) / GMV-ND15TS/A-T(U) / GMV-ND18TS/A-T(U) / GMV-ND24TS/A-T(U):

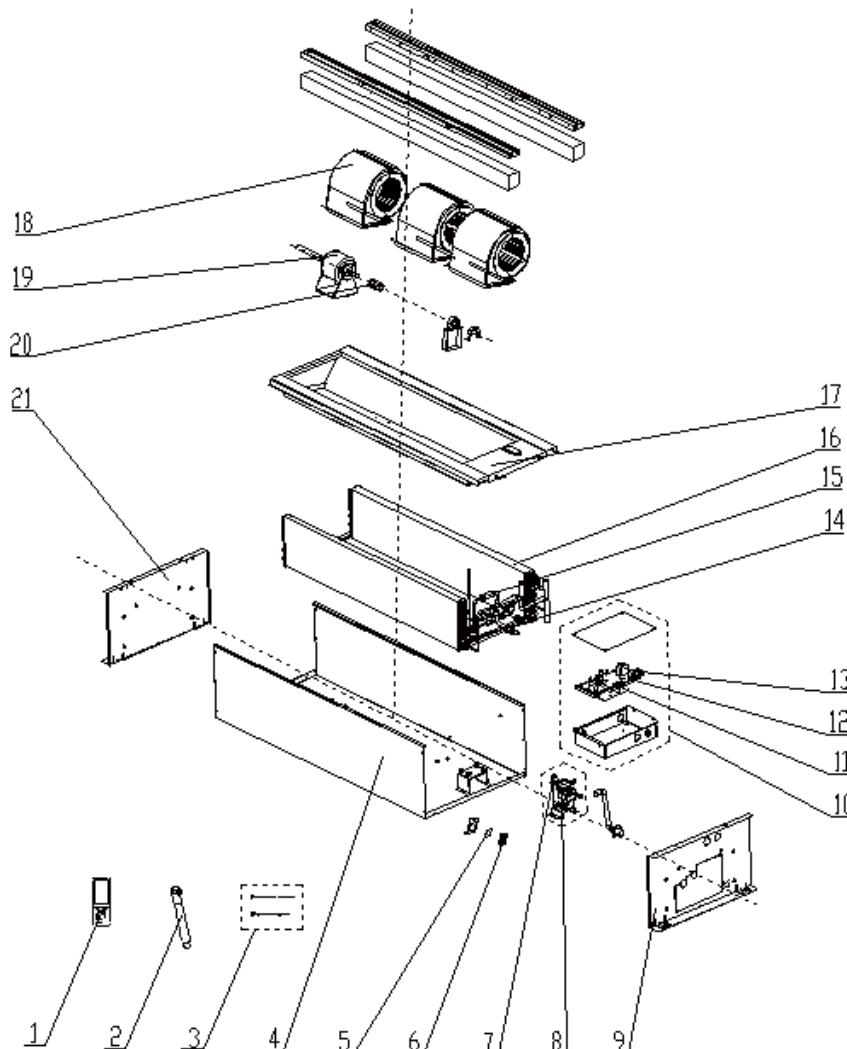

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND09TS/A-T(U)	CM500N0890	GMV-ND24TS/A-T(U)	CM500N0930
	Part code	Quantity		Part code	Quantity
1	Remote Controller	30510589	1	30510589	1
2	Drain Hose Sub-Assy	05232050	1	05232050	1
3	Sensor Sub-assy	39008000013G	1	39008000013G	1
4	Seat Board Sub-Assy	02224100024	1	02224100024	1
5	Humidity Sensor	—	—	—	—
6	Humidity Sensor Cover	—	—	—	—
7	Water Level Switch	4501270301	1	4501270301	1
8	Water Pump	43138220	1	43138220	1
9	Right Side Plate Sub-Assy	0131410008001	1	0131410008001	1
10	Electric Box Assy	01394100582	1	01394100582	1
11	Terminal Board	4201800002601	1	4201800002601	1

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND09TS/A-T(U)	CM500N0890	GMV-ND24TS/A-T(U)	CM500N0930
		Part code	Quantity	Part code	Quantity
12	Main Board	30226000029	1	30226000029	1
13	Terminal Board	4201115402	1	4201115402	1
14	Electronic Expansion Valve	07334494	1	07334494	1
15	Strainer	0741410000601	2	0741410000601	2
16	Evaporator Assy	0102410009401	1	01024100094	1
17	Water Tray Sub-Assy	01284100137P	1	01284100137P	1
18	Propeller Housing Sub-assy	22202030	3	22202030	3
		22202029	3	22202029	3
19	Brushless DC Motor	15704100003	1	15704100003	1
20	Joint Slack	73018731	1	73018731	1
21	Left Side Plate Sub-Assy	01314100104	1	01314100104	1


Above data is subject to change without notice, please refer the SP in global service website.

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND18TS/A-T(U)	CM500N0920	GMV-ND24TS/A-T(U)	CM500N0930
		Part code	Quantity	Part code	Quantity
1	Remote Controller	30510589	1	30510589	1
2	Drain Hose Sub-Assy	05232050	1	05232050	1
3	Sensor Sub-assy	39008000013G	1	39008000013G	1
4	Seat Board Sub-Assy	02224100024	1	02224100024	1
5	Humidity Sensor	—	—	—	—
6	Humidity Sensor Cover	—	—	—	—
7	Water Level Switch	4501270301	1	4501270301	1
8	Water Pump	43138220	1	43138220	1
9	Right Side Plate Sub-Assy	0131410008001	1	0131410008001	1
10	Electric Box Assy	01394100582	1	01394100582	1
11	Terminal Board	4201800002601	1	4201800002601	1
12	Main Board	30226000029	1	30226000029	1
13	Terminal Board	4201115402	1	4201115402	1
14	Electronic Expansion Valve	07334494	1	07334494	1
15	Strainer	0741410000601	2	0741410000601	2
16	Evaporator Assy	0102410009402	1	01024100093	1
17	Water Tray Sub-Assy	01284100137P	1	01284100137P	1
18	Propeller Housing Sub-assy	22202030	3	22202030	3
		22202029	3	22202029	3
19	Brushless DC Motor	15704100003	1	15704100003	1
20	Joint Slack	73018731	1	73018731	1
21	Left Side Plate Sub-Assy	01314100104	1	01314100104	1

Above data is subject to change without notice, please refer the SP in global service website.

## 5.6 Floor Ceiling Type Indoor Unit

Exploded View of GMV-ND09ZD/A-T(U) / GMV-ND12ZD/A-T(U) / GMV-ND18ZD/A-T(U):

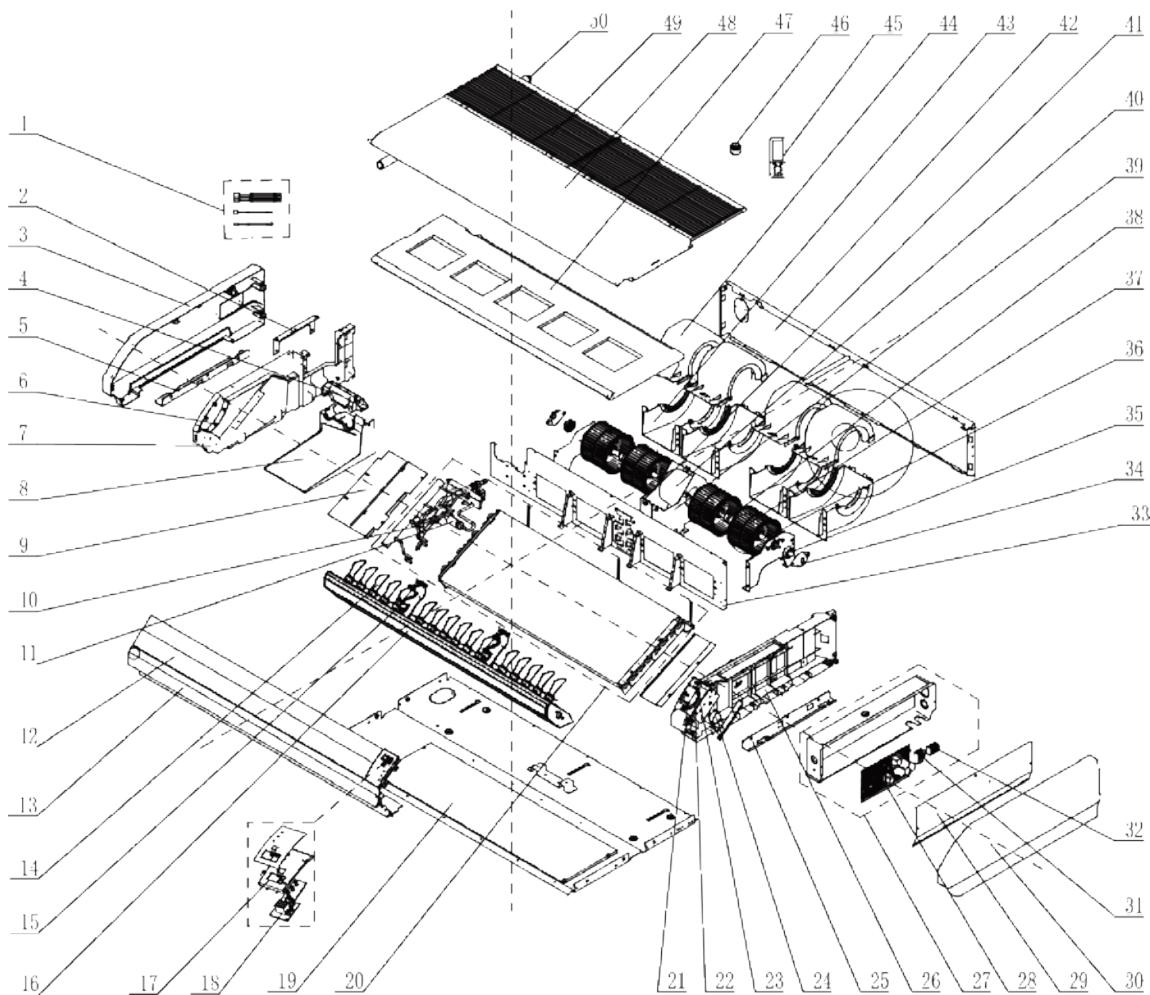

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND09ZD/A-T(U)	CM600N0420	GMV-ND12ZD/A-T(U)	CM600N0430
		Part code	Quantity	Part code	Quantity
1	Sensor Sub-assy	39008000101G	1	39008000101G	1
2	Connection Board	02229406	1	02229406	1
3	Right Cover Plate	26909444	1	26909444	1
4	Plate Board of Water Releasing Flume	26909442	1	26909442	1
5	Installation Supporting Frame	01809402	1	01809402	1
6	Axile Bush	10542704	2	10542704	2
7	Right Side Plate Sub-Assy	01319429	1	01319429	1
8	Water Releasing Flume	02284106P	1	02284106P	1
9	Connection Board	01344115	1	01344115	1
10	Electronic Expansion Valve	07334463	1	07334463	1
11	Strainer	0741410000601	2	0741410000601	2
12	Guide Louver	10619403	2	10619403	2
13	Front Connection Board	01349414P	1	01349414P	1
14	Air Louver	10619404	16	10619404	16
15	Rotating Shaft	26909430	4	26909430	4

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND09ZD/A-T(U)	CM600N0420	GMV-ND12ZD/A-T(U)	CM600N0430
		Part code	Quantity	Part code	Quantity
16	Guide Louver Supporter Sub-Assy	0180941601	1	0180941601	1
17	Fixed Mount	26909426R	1	26909426R	1
18	Display Board	30294000009	1	30294000009	1
19	Rear Side Plate Assy	01319400008	1	01319400008	1
20	Evaporator Assy	01024100126	1	01024100096	1
21	Rotating Shaft	26909413	1	26909413	1
22	Connecting Rod	26909411	1	26909411	1
23	Rotating Shaft	26909412	1	26909412	1
24	Stepping Motor	1521240206	1	1521240206	1
25	Installation Supporting Frame	01809401	1	01809401	1
26	Left Side Plate Sub-Assy	01319428	1	01319428	1
27	Electric Box Assy	01394100587	1	01394100587	1
28	Main Board	30226000029	1	30226000029	1
29	Electric Box Cover	01429420	1	01429420	1
30	Left Cover Plate	2690944302	1	2690944302	1
31	Terminal Board	42011106	1	42011106	1
32	Terminal Board	4201800002601	1	4201800002601	1
33	Mid-clapboard sub-assy	01249400004	1	01249400004	1
34	Support Of Motor Bearing	01792408	2	01792408	2
35	O-Gasket of Bearing	76512404	2	76512404	2
36	Rotary Axis Sub-Assy	73018000037	2	73018000037	2
37	Centrifugal Fan	10425200	4	10425200	4
38	Joint Slack	73018731	2	73018731	2
39	Supporter	01809400002	1	01809400002	1
40	Fan Motor	15704100001	1	15704100001	1
41	Supporter	01809400001	1	01809400001	1
42	Rear Connection board	01349422	1	01349422	1
43	Front Volute Casing	26905205	4	26905205	4
44	Rear Volute Casing	26905206	4	26905206	4
45	Remote Controller	30510589	1	30510589	1
46	Electric expand valve fitting	4304413203	1	4304413203	1
47	Water Tray Assy	01289404	1	01289404	1
48	Top Cover Board Sub-Assy	01269409	1	01269409	1
49	Front Grill sub-assy	01579403	2	01579403	2
50	Drainage Pipe Sub-assy	05235434	1	05235434	1


Above data is subject to change without notice, please refer the SP in global service website.

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND18ZD/A-T(U)	CM600N0440
		Part code	Quantity
1	Sensor Sub-assy	39008000101G	1
2	Connection Board	02229406	1
3	Right Cover Plate	26909444	1
4	Plate Board of Water Releasing Flume	26909442	1
5	Installation Supporting Frame	01809402	1
6	Axile Bush	10542704	2
7	Right Side Plate Sub-Assy	01319429	1
8	Water Releasing Flume	02284106P	1
9	Connection Board	01344115	1
10	Electronic Expansion Valve	07334463	1
11	Strainer	0741410000601	2
12	Guide Louver	10619403	2
13	Front Connection Board	01349414P	1
14	Air Louver	10619404	16
15	Rotating Shaft	26909430	4
16	Guide Louver Supporter Sub-Assy	0180941601	1
17	Fixed Mount	26909426R	1
18	Display Board	30294000009	1
19	Rear Side Plate Assy	01319400008	1
20	Evaporator Assy	01029400066	1
21	Rotating Shaft	26909413	1
22	Connecting Rod	26909411	1
23	Rotating Shaft	26909412	1
24	Stepping Motor	1521240206	1
25	Installation Supporting Frame	01809401	1
26	Left Side Plate Sub-Assy	01319428	1
27	Electric Box Assy	01394100587	1
28	Main Board	30226000029	1
29	Electric Box Cover	01429420	1
30	Left Cover Plate	2690944302	1
31	Terminal Board	42011106	1
32	Terminal Board	4201800002601	1
33	Mid-clapboard sub-assy	01249400004	1
34	Support Of Motor Bearing	01792408	2
35	O-Gasket of Bearing	76512404	2

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND18ZD/A-T(U)	CM600N0440
		Part code	Quantity
36	Rotary Axis Sub-Assy	73018000037	2
37	Centrifugal Fan	10425200	4
38	Joint Slack	73018731	2
39	Supporter	01809400002	1
40	Fan Motor	15704100001	1
41	Supporter	01809400001	1
42	Rear Connection board	01349422	1
43	Front Volute Casing	26905205	4
44	Rear Volute Casing	26905206	4
45	Remote Controller	30510589	1
46	Electric expand valve fitting	4304413203	1
47	Water Tray Assy	01289404	1
48	Top Cover Board Sub-Assy	01269409	1
49	Front Grill sub-assy	01579403	2
50	Drainage Pipe Sub-assy	05235434	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-ND24ZD/A-T(U) / GMV-ND30ZD/A-T(U):

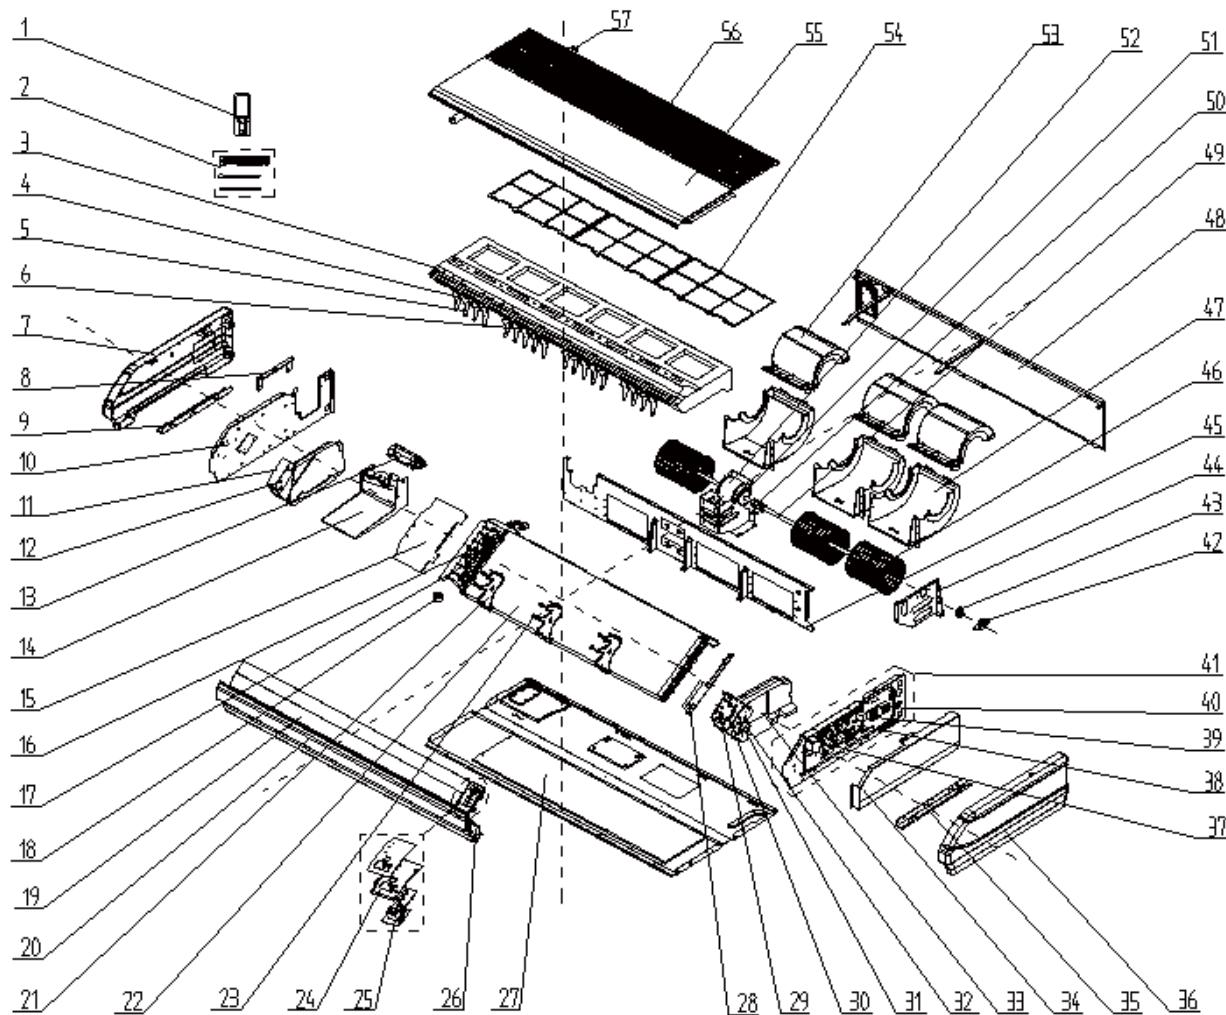


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND24ZD/A-T(U)	CM600N0450
Part code		Quantity	
1	Remote Controller	30510589	1
2	Sensor Sub-assy	39008000100G	1
3	Water Tray Assy	01289405	1
4	Swing Lever	10582008	2
5	Air Louver	26909418	18
6	Swing Lever	10582009	2
7	Right Cover Plate	2690942201	1
8	Connection Board	02229406	1
9	Installation Supporting Frame	01809402	1
10	Right Side Plate Sub-Assy	01319408	1
11	Right Foam Assy	12509425	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND24ZD/A-T(U)	CM600N0450
		GMV-ND30ZD/A-T(U)	CM600N0460
Part code		Quantity	
12	Axile Bush	10542704	2
13	Plate Board of Water Releasing Flume	26909442	1
14	Water Releasing Flume	26909441	1
15	connected board (evaporator)	01344108	1
16	Strainer	0741410000601	2
17	Electronic Expansion Valve	07334466	1
18	Electric expand valve fitting	4304413203	1
19	Guide Louver	26909432	2
20	Front Connection Board	01349408P	1
21	Supporter	26909409	3
22	Evaporator Assy	01024100104	1
23	Rotating Shaft	26909430	6
24	Fixed Mount	26909426R	1
25	Display Board	30294000009	1
26	Front Connection Board Foam Assy	12509424	1
27	Rear Side Plate Assy	01319400005	1
28	Water Releasing Flume	02289402P	1
29	Rotating Shaft	26909413	1
30	Connecting Rod	26909411	1
31	Rotating Shaft	26909412	1
32	Stepping Motor	1521240206	1
33	Left Foam Assy	12509408	1
34	Electric Box Cover	01429410P	1
35	Installation Supporting Frame	01809401	1
36	Left Cover Plate	26909416	1
37	Inductance	43128000014	1
38	Main Board	30226000027	1
39	Terminal Board	42011106	1
40	Terminal Board	4201800002601	1
41	Electric Box Assy	01394100586	1
42	Support Of Motor Bearing	01792408	1
43	O-Gasket of Bearing	76512404	1
44	Bracket 1	01809404	1
45	Clapboard Sub-Assy	01249400002	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND24ZD/A-T(U)	CM600N0450
		GMV-ND30ZD/A-T(U)	CM600N0460
Part code		Quantity	
46	Centrifugal fan	1041410101	3
47	Front volute casing	26905208	3
48	Rear Connection board	01349418	1
49	Rotary Axis Sub-Assy	73018052	1
50	Joint Slack	73018731	1
51	Motor Support Sub-Assy	01809400029	1
52	Brushless DC Motor	15705200005	1
53	Rear volute casing	26909419	3
54	Filter	11126002	1
55	Top Cover Board Sub-Assy	01269405	1
56	Front Grill sub-assy	01579402	3
57	Drainage Pipe Sub-assy	05235434	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-ND36ZD/A-T(U) / GMV-ND42ZD/A-T(U) / GMV-ND48ZD/A-T(U):

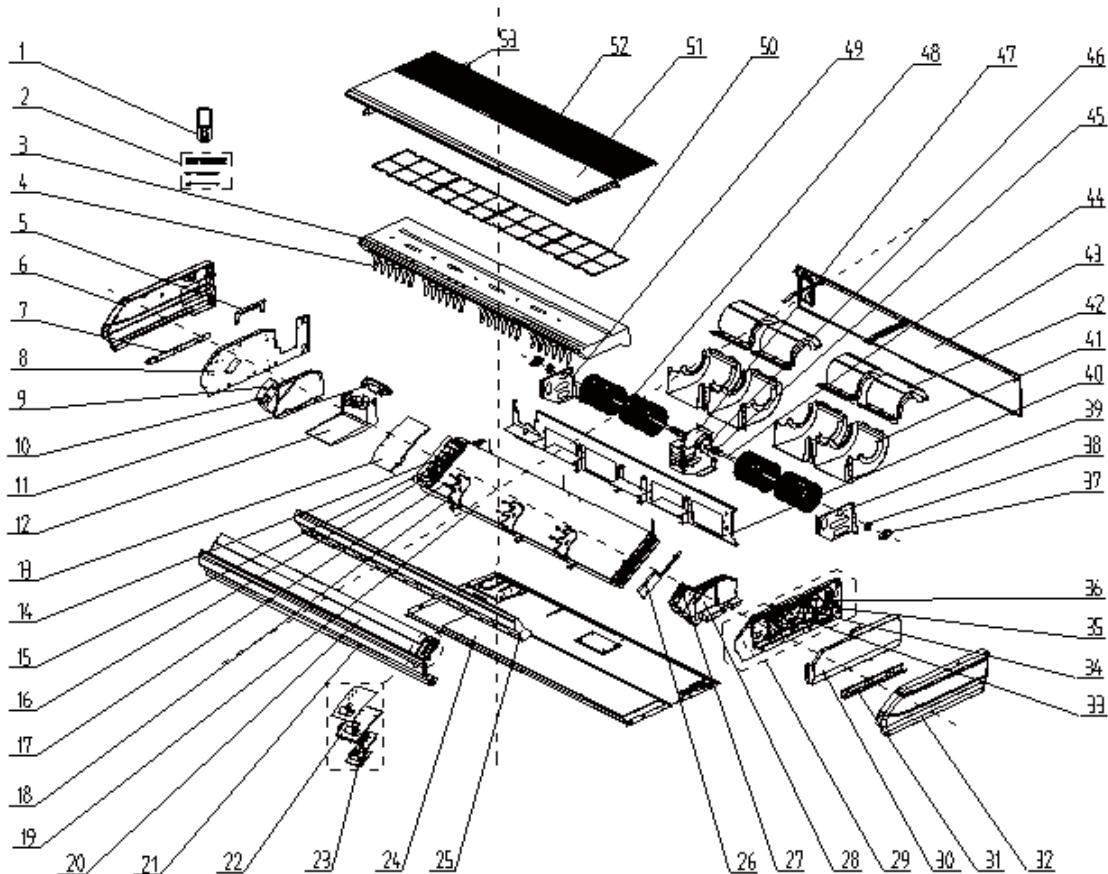

No.	Name of part	For the following unit	
		Unit	Product Code
	GMV-ND36ZD/A-T(U)	CM600N0470	
	GMV-ND42ZD/A-T(U)	CM600N0480	
	GMV-ND48ZD/A-T(U)	CM600N0490	
Part code		Quantity	
1	Remote Controller	30510589	1
2	Sensor Sub-assy	39008000100G	1
3	Water Tray Assy	01289401	1
4	Air Louver	26909418	24
5	Connection Board	02229406	1
6	Right Cover Plate	26909422	1
7	Installation Supporting Frame	01809402	1
8	Right Side Plate Sub-Assy	01319408	1
9	Right Foam Assy	12509425	1
10	Axile Bush	10542704	2
11	Plate Board of Water Releasing Flume	26909442	1
12	Water Releasing Flume	26909441	1
13	connected board (evaporator)	01344108	1


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND36ZD/A-T(U)	CM600N0470
		GMV-ND42ZD/A-T(U)	CM600N0480
		GMV-ND48ZD/A-T(U)	CM600N0490
		Part code	Quantity
14	Strainer	0741410000601	2
15	Electronic Expansion Valve	07334468	1
16	Electric expand valve fitting	4304413203	1
17	Rotating Shaft	26909430	6
18	Supporter	26909409	3
19	Evaporator Assy	01024100105	1
20	Guide Louver	10619405	2
21	Front Connection Board	01349404P	1
22	Fixed Mount	26909426R	1
23	Display Board	30294000009	1
24	Rear Side Plate Sub-Assy	01319442	1
25	Front Connection Board Foam Assy	12509434	1
26	Water Releasing Flume	02289402P	1
27	Stepping Motor	1521240206	2
28	Left Foam Assy	12509437	1
29	Electric Box Assy	01394100586	1
30	Electric Box Cover	01429410P	1
31	Installation Supporting Frame	01809421	1
32	Left Cover Plate	2690941601	1
33	Main Board	30226000027	1
34	Terminal Board	42011106	1
35	Terminal Board	4201800002601	1
36	Inductance	43128000014	1
37	Support Of Motor Bearing	01792408	2
38	O-Gasket of Bearing	76512404	2
39	Bracket 1	01809404	1
40	Clapboard Sub-Assy	01249400006	1
41	Front volute casing	26905208	4
42	Rear volute casing	26909419	4
43	Rear Connection board	01349419	1
44	Rotary Axis Sub-Assy	73018052	2
45	Joint Slack	73018731	2
46	Motor Support Sub-Assy	0180940002901	1
47	Brushless DC Motor	15709400005	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND36ZD/A-T(U)	CM600N0470
		GMV-ND42ZD/A-T(U)	CM600N0480
		GMV-ND48ZD/A-T(U)	CM600N0490
Part code		Quantity	
48	Centrifugal fan	1041410101	4
49	Supporter	01809403	1
50	Filter	11126002	1
51	Top Cover Board Sub-Assy	01269400002	1
52	Front Grill sub-assy	01579401	4
53	Drainage Pipe Sub-assy	05235434	1

Above data is subject to change without notice, please refer the SP in global service website.

## 5.7 Fresh Air Processing Type Indoor Unit

Exploded View of GMV-NDX42P/A-T(U) / GMV-NDX48P/A-T(U)

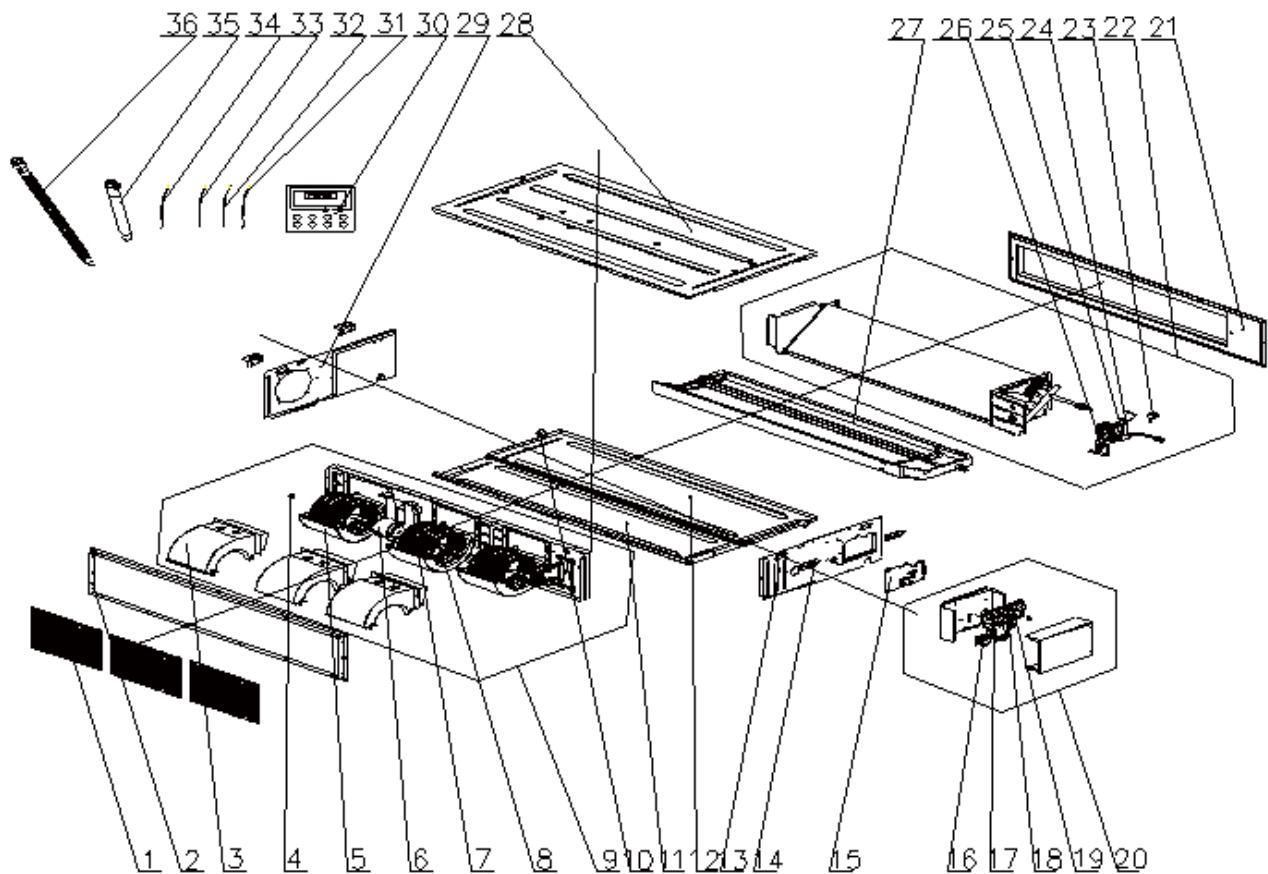


No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-NDX42P/A-T(U)	CM810N1250	GMV-NDX48P/A-T(U)	CM810N1030
1	Filter Sub-Assy	111001000052	3	111001000052	3
2	Return Air Frame Sub-Assy	017026000003	1	017026000003	1
3	Propeller Housing(Upper)	26905200078	3	26905200078	3
4	Fan Bearing	76512210	1	76512210	1
5	Propeller Housing(Lower)	26905200079	3	26905200079	3
6	Brushless DC Motor	1570940000601	1	1570940000601	1
7	Centrifugal Fan	10455200003	3	10455200003	3
8	Joint Slack	73018731	1	73018731	1
9	Centrifugal Fan Assy	000052000028	1	000052000028	1
10	Choke plug of Drain pipe	76815214	2	76815214	2
11	Cover plate (Air Return)	01265200123	1	01265200123	1
12	Bottom Cover Plate	01265200125	1	01265200125	1
13	Left Side Plate Assy	01315200147	1	01315200147	1
14	Hook	02112466	4	02112466	4
15	Seal Plate	01495200043	1	01495200043	1
16	Reactor	43138000047	1	43138000047	1
17	Terminal Board	4201115404	1	4201115404	1

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-NDX42P/A-T(U)	CM810N1250	GMV-NDX48P/A-T(U)	CM810N1030
		Part code	Quantity	Part code	Quantity
18	Terminal Board	4201800002601	1	4201800002601	1
19	Main Board	300002000686	2	300002000686	2
20	Electric Box Assy	100002003006	1	100002003006	1
21	Air Outlet Frame Assy	01375200023	1	01375200023	1
22	Evaporator Assy	011001000471	1	011001000471	1
23	Electric Expand Valve Fitting	4304413215	1	4304413215	1
24	Strainer	0741410000601	1	0741410000601	1
25	Electronic Expansion Valve	07334468	1	07334468	1
26	Strainer	7415210	1	7415210	1
27	Foam Sub-Assy(Water Tray)	12505200021	1	12505200021	1
28	Top Cover Board Assy	01264100105	1	01264100105	1
29	Right Side Plate Assy	01315200148	1	01315200148	1
30	Display Board	30296000040	1	30296000040	1
31	Temperature Sensor	3900005910	1	3900005910	1
32	Temperature Sensor	390000592	1	390000592	1
33	Temperature Sensor	390000454	1	390000454	1
34	Temperature Sensor	390002072	1	390002072	1
35	Drain Hose Sub-Assy	05232050	1	05232050	1
36	Corrugated Pipe	05015408	1	05015408	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-NDX54P/A-T(U) / GMV-NDX72P/A-T(U) / GMV-NDX96P/A-T(U):

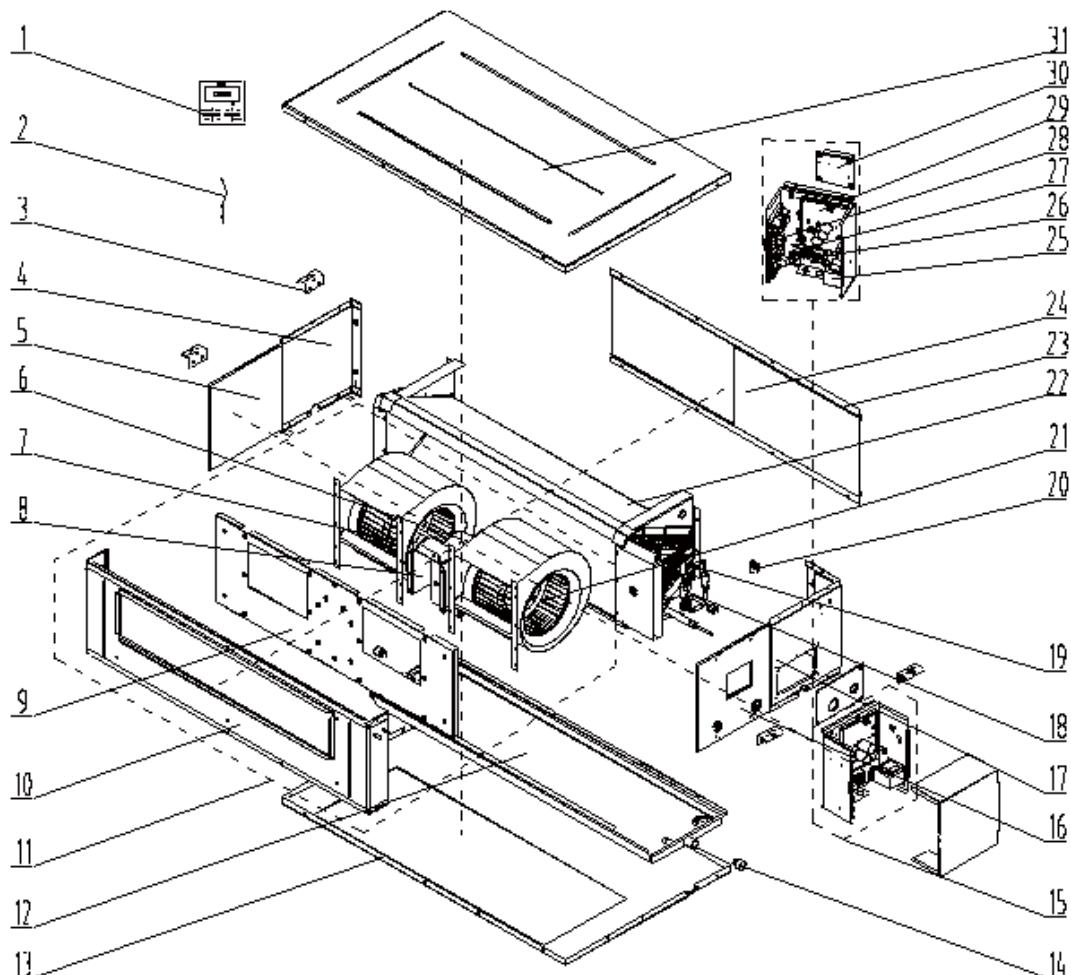


No.	Name of part	For the following unit		For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code	Unit	Product Code
		GMV-NDX 54P/A-T(U)	CM810N 1240	GMV-ND X72P/A-T(U)	CM810N 0480	GMV-ND X96P/A-T(U)	CM810N 0470
		Part Code	Quantity	Part Code	Quantity	Part Code	Quantity
1	Display Board	30296000040	1	30296000040	1	30296000040	1
2	Sensor Sub-Assy	39004165G	1	39004165G	1	39004165G	1
3	Hook	02112466	4	02112466	4	02112466	4
4	Left Side Plate Assy	01315367	1	01315367	1	01315367	1
5	Left Side Plate Sub-Assy 1	01314100127	1	01314100127	1	01314100127	1
6	Brushless DC Motor	15704100009	1	15704100009	1	15704100009	1
7	Motor for Centrifugal Fan	1570530601	1	1570530601	1	1570530601	1
8	Motor Support	01805200228	1	01805200228	1	01805200228	1
9	Blower Mounting Plate Sub-Assy	01324100064	1	01324100064	1	01324100064	1
10	Front Side Plate Sub-Assy	01315374	1	01315374	1	01315374	1
11	Centrifugal Fan Assy	15404100088	1	15404100088	1	15404100088	1
12	Water Tray Assy	01284620	1	01284620	1	01284620	1
13	Bottom Cover Plate Assy	01264100087	1	01264100087	1	01264100087	1
14	Choke Plug of Water Pipe	76712454	2	76712454	2	76712454	2
15	Electric Box Assy	01394100619	1	01394100619	1	01394100619	1
16	Right Side Plate Sub-Assy 1	01314100125	1	01314100125	1	01314100125	1

No.	Name of part	For the following unit		For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code	Unit	Product Code
		GMV-NDX 54P/A-T(U)	CM810N 1240	GMV-ND X72P/A-T(U)	CM810N 0480	GMV-ND X96P/A-T(U)	CM810N 0470
		Part Code	Quantity	Part Code	Quantity	Part Code	Quantity
17	Right Side Plate Assy	01314100124	1	01314100124	1	01314100124	1
18	Strainer	0741410000601	2	0741410000601	2	0741410000601	2
19	Electronic Expansion Valve	07331139	1	07331139	1	07331139	1
20	Electric Expand Valve Fitting	4304413205	1	4304413205	1	4304413205	1
21	Evaporator Assy	01024100120	1	01024100120	1	01024100120	1
22	Filter Guide Groove	02284107	2	02284107	2	02284107	2
23	Filter Sub-Assy	11725211	2	11725211	2	11725211	2
24	Blower(Right)	15705307	1	15705307	1	15705307	1
25	Reactor	43130189	1	43130189	1	43130189	1
26	Terminal Board	4201800002601	1	4201800002601	1	4201800002601	1
27	Terminal Board	42010259	1	42010259	1	42010259	1
28	Main Board	30226000090	1	30226000090	1	30226000090	1
29	Main Board	30221000023	1	30221000023	1	30221000023	1
30	Radiator	49018000068	1	49018000068	1	49018000068	1
31	Top Cover Board Assy	01264100086	1	01264100086	1	01264100086	1

Above data is subject to change without notice, please refer the SP in global service website.

## 5.8 Console Type Indoor Unit

Exploded View of GMV-ND07C/A-T(U) / GMV-ND09C/A-T(U) / GMV-ND12C/A-T(U) / GMV-ND18C/A-T(U)

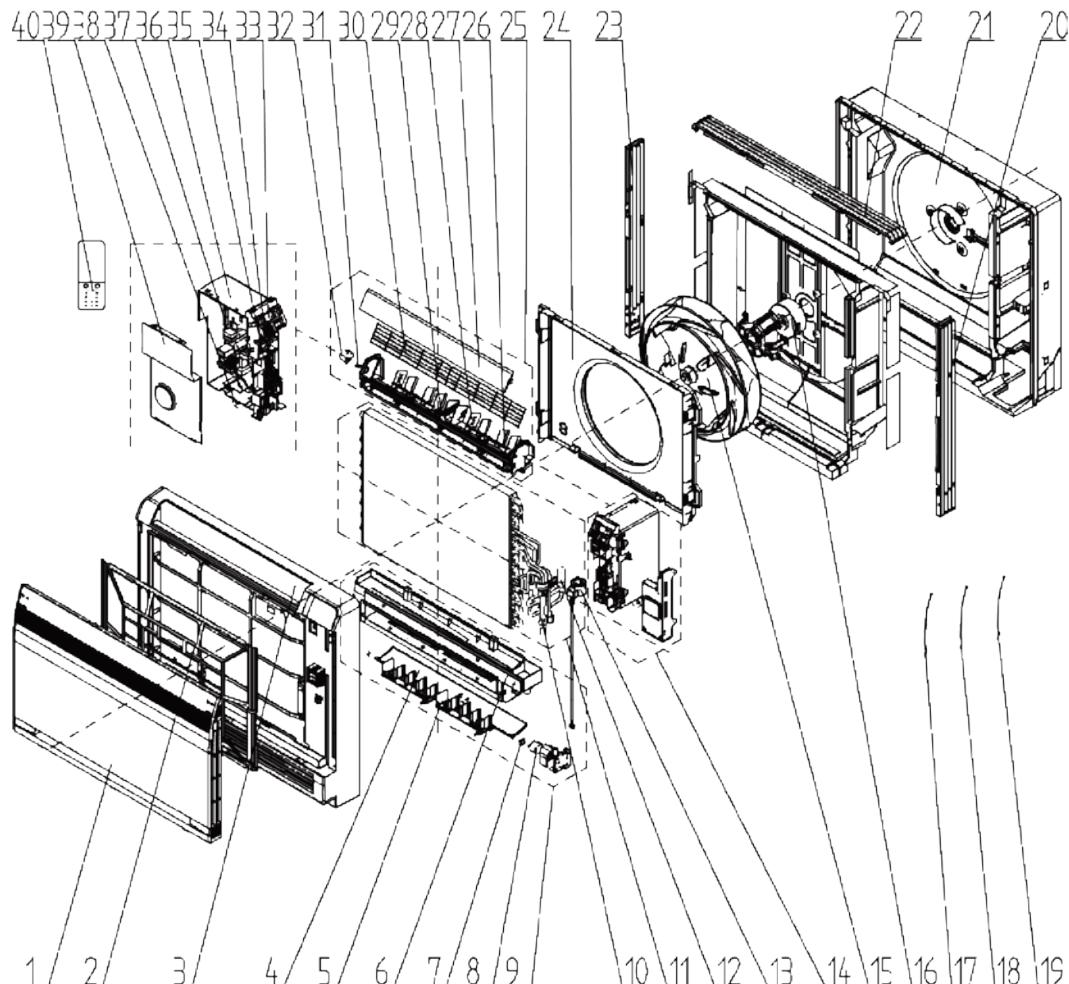


No.	Name of part	For the following unit	
		Unit	Product Code
	GMV-ND07C/A-T(U)	CM400N0110	
	GMV-ND09C/A-T(U)	CM400N0120	
	GMV-ND12C/A-T(U)	CM400N0100	
	GMV-ND18C/A-T(U)	CM400N0130	
Part code		Quantity	
1	Front Panel Assy	20012756	1
2	Filter Sub-Assy	11122139	1
3	Front Case Assy	20012601	1
4	Air Louver(lower)	10512146	1
5	Air Louver(lower)	10512144	2
6	Water Tray	20182140	1
7	Axis(lower step motor)	10542034	1
8	Stepping Motor	1521210101	1
9	Water Tray Assy	20182141	1
10	Strainer	07213029	1
11	Evaporator Assy	01024100143	1
12	Electronic Expansion Valve	07334282	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND07C/A-T(U)	CM400N0110
		GMV-ND09C/A-T(U)	CM400N0120
		GMV-ND12C/A-T(U)	CM400N0100
		GMV-ND18C/A-T(U)	CM400N0130
Part code		Quantity	
13	Electric Expand Valve Fitting	4304000102	1
14	Electric Box Assy	01394100489	1
15	Centrifugal Fan	01394100489	1
16	Brushless DC Motor	15704100012	1
17	Temperature Sensor	3900005910	1
18	Temperature Sensor	390000597	1
19	Temperature Sensor	3900019824	1
20	Let Side Plate	20052011	1
21	Rear Case	22202461	1
22	Top Side Plate	20052013	1
23	Right Side Plate	20052012	1
24	Diversion Circle	10371212	1
25	Louver Motor Sub-assy	00021100001	1
26	Swing Lever	10582096	2
27	Guide Louver (upper)	10512145	1
28	Air Louver(upper)	10512143	2
29	Shaft of Guide Louver	10542020	2
30	Rear Grill	01472024	1
31	Crank	73012005	1
32	Stepping Motor	1521210101	1
33	Display Board	30568131	1
34	Pinboard	30278000001	1
35	Terminal Board	42010268	1
36	Electric Board	20112116	1
37	Main Board	30226000080	1
38	Magnetic Ring	49010104	1
39	Shield Cover of Electric Box Sub-Assy	01592169	1
40	Remote Controller	30510589	1

Above data is subject to change without notice, please refer the SP in global service website.

## 5.9 Wall Mounted type Indoor Unit

Exploded View of G GMV-N07G/A3A-D(U) / GMV-N09G/A3A-D(U)

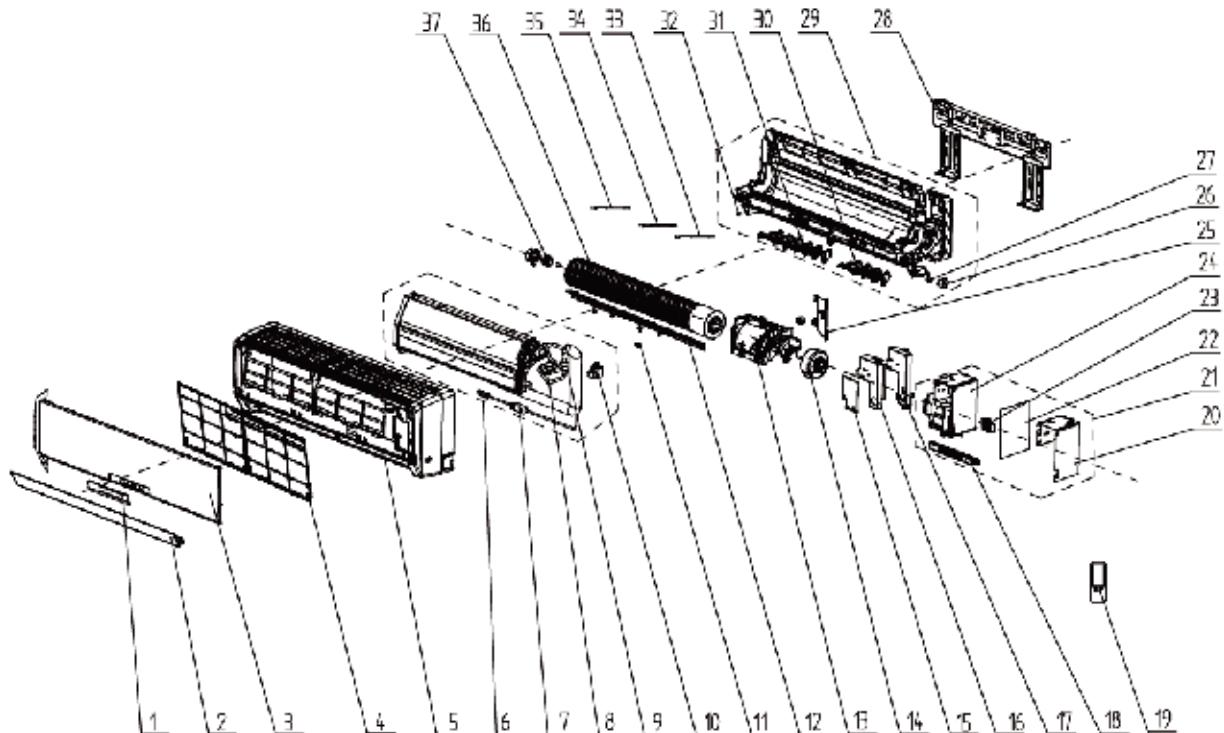


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-N07G/A3A-D(U)	CM100N1480
		GMV-N09G/A3A-D(U)	CM100N1490
No.	Name of part	Part code	Quantity
		22432230	1
		10512157	1
		20012122S	1
		1112220403	1
		2001213931	1
		01024100102	1
		07414100006	4
		07213050	4
		07334463	4
		4304413217	1
		10542036	1
		01472013	1
		26904100117	1
		1501208905	1
		2012207504	1
		01592073	1
		2224213502	1
		30565007	1
		30510589	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-N07G/A3A-D(U)	CM100N1480
		GMV-N09G/A3A-D(U)	CM100N1490
Part code		Quantity	
20	Lower Shield Sub-Assy of Electric Box	01592072	1
21	Electric Box Assy	01394100451	1
22	Main Board	30226000061	1
23	Terminal Board	42010268	1
24	Electric Box	2011216702	1
25	Connecting pipe clamp	26112164	1
26	Stepping Motor	1521212901	1
27	Crank	10582070	1
28	Wall Mounting Frame	01252021	1
29	Rear Case Sub-Assy	2220294712	1
30	Air Louver 1	10512164	1
31	Air Louver 2	10512165	1
32	Left Axile Bush	10512037	1
33	Temperature Sensor	390000454	1
34	Temperature Sensor	39000076G	1
35	Temperature Sensor	390002072G	1
36	Cross Flow Fan	10454101	1
37	O-Gasket of Cross Fan Bearing	76512203	3

Above data is subject to change without notice, please refer the SP in global service website.

## GMV-N12G/A3A-D(U) / GMV-N18G/A3A-D(U)

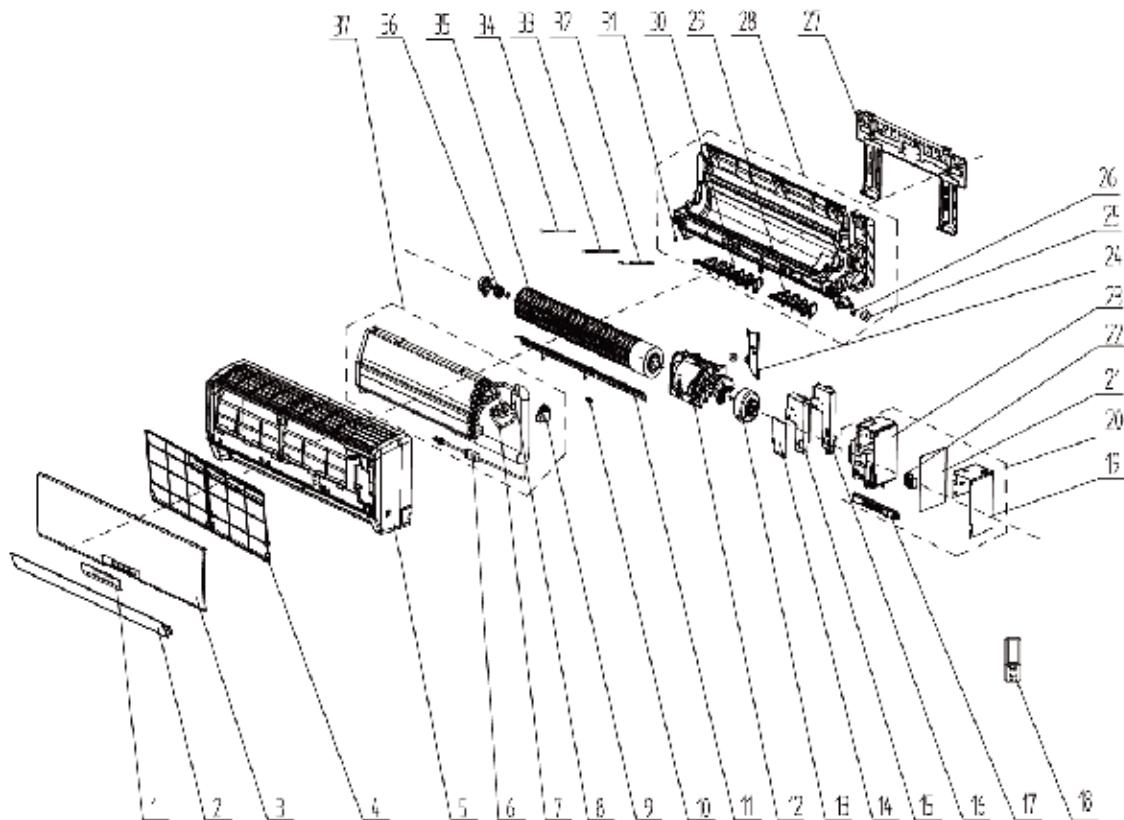


No.	Name of part	For the following unit	
		Unit	Product Code
		Part code	Quantity
1	Receiver Window	22432173	1
2	Guide Louver	10512115	1
3	Front Panel Assy	20012260	1
4	Filter Sub-Assy	1112208901	2
5	Front Case Sub-assy	20022172	1
6	Strainer	07414100006	1
7	Strainer	07213050	1
8	Electronic Expansion Valve	07334466	1
9	Electric Expand Valve Fitting	4304413217	1
10	Axile Bush	10542036	1
11	Mesh Enclosure(Air Outlet)	01472015	1
12	Motor Press Plate	26904264	1
13	Fan Motor	1501214601	1
14	Electric Box Cover	2011208112	1
15	Shield Cover of Electric Box	01592092	1
16	Electric Box Cover1	2012215401	1
17	Display Board	30565038	1
18	Remote Controller	30510589	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-N12G/A3A-D(U)	CM100N1500
		GMV-N18G/A3A-D(U)	CM100N1510
Part code		Quantity	
19	Lower Shield of Electric Box	01592091	1
20	Electric Box Assy	01394100453	1
21	Main Board	30226000062	1
22	Terminal Board	42010268	1
23	Electric Box	2011210802	1
24	Connecting pipe clamp	26112164	1
25	SteppingMotor	15012086	1
26	Crank	10582070	1
27	Wall Mounting Frame	01252218	1
28	Rear Case Sub-Assy	2220294108	1
29	Air Louver 1	10512708	1
30	Air Louver 2	10512709	1
31	Left Axile Bush	10512037	1
32	Temperature Sensor	39000076G	1
33	Temperature Sensor	390000456	1
34	Temperature Sensor	390002072G	1
35	Cross Flow Fan	10454102	1
36	O-Gasket of Cross Fan Bearing	76512203	1
37	Evaporator Assy	01024100101	1

Above data is subject to change without notice, please refer the SP in global service website.

## GMV-N24G/A3A-D(U)

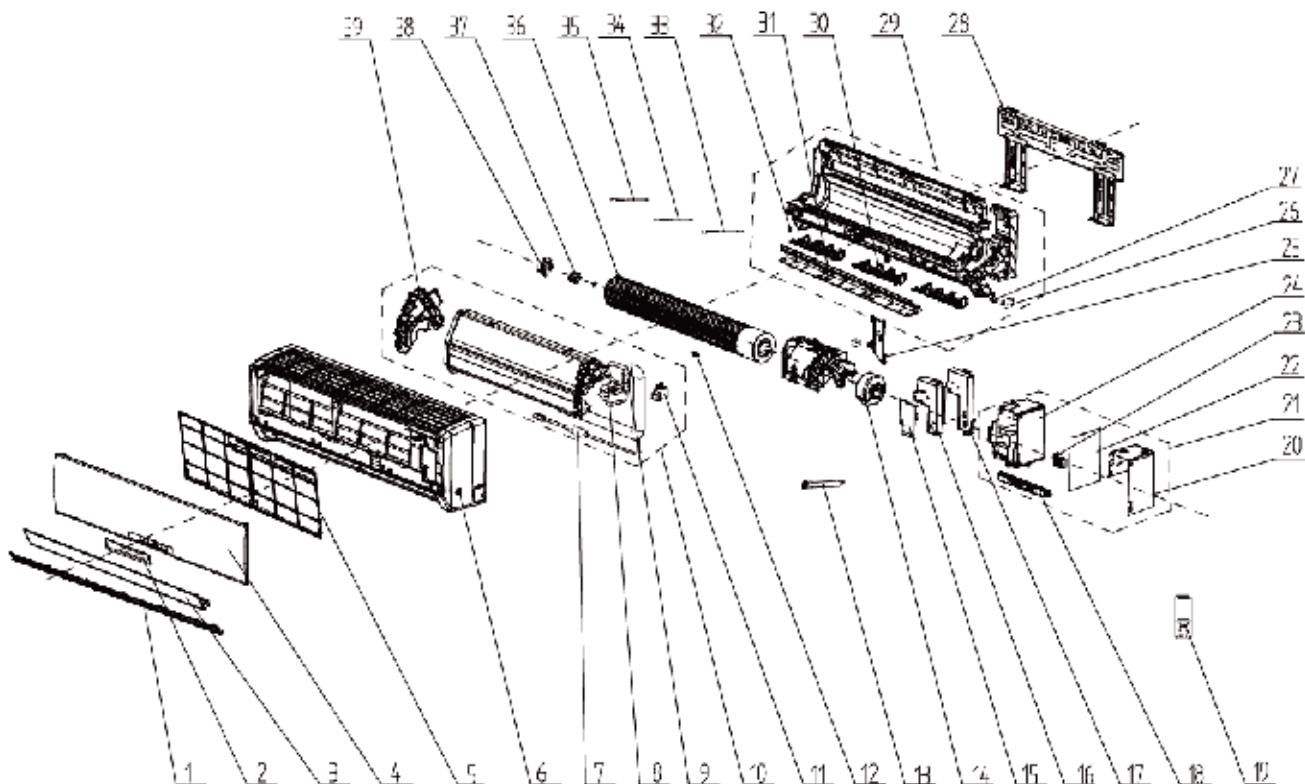


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-N24G/A3A-D(U)	CM100N1520
1	Receiver Window	22432230	1
2	Guide Louver	10512157	1
3	Front Panel B1	20012122S	1
4	Filter Sub-Assy	1112220403	1
5	Front Case Sub-assy	2001213931	1
6	Evaporator Assy	01024100097	2
7	Strainer	07414100006	4
8	Strainer	07213050	4
9	Electronic Expansion Valve	07334463	4
10	Electric Expand Valve Fitting	4304413217	2
11	Axile Bush	10542036	1
12	Rear Grill	01472013	1
13	Motor Press Plate	26904100117	1
14	Fan Motor	1501208905	1
15	Electric Box Cover2	2012207504	1
16	Shield Cover of Electric Box Sub-Assy	01592073	1
17	Electric Box Cover1	2224213502	1
18	Display Board	30565007	2

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-N24G/A3A-D(U)	CM100N1520
		Part code	Quantity
19	Remote Controller	30510589	1
20	Lower Shield Sub-Assy of Electric Box	01592072	2
21	Electric Box Assy	01394100451	1
22	Main Board	30226000061	2
23	Terminal Board	42010268	2
24	Electric Box	2011216702	2
25	Connecting pipe clamp	26112164	1
26	Stepping Motor	1521212901	2
27	Crank	10582070	2
28	Wall Mounting Frame	01252021	1
29	Rear Case Sub-Assy	2220294712	2
30	Air Louver 1	10512164	2
31	Air Louver 2	10512165	2
32	Left Axile Bush	10512037	2
33	Temperature Sensor	390000454	1
34	Temperature Sensor	39000076G	1
35	Temperature Sensor	390002072G	1
36	Cross Flow Fan	10454101	1
37	O-Gasket of Cross Fan Bearing	76512203	3
38	Ring of Bearing	26152025	1
39	Evaporator Support	24212103	1

Above data is subject to change without notice, please refer the SP in global service website.

GMV-ND06G/B4B-T(U), GMV-ND07G/B4B-T(U), GMV-ND09G/B4B-T(U), GMV-ND12G/B4B-T(U),  
GMV-ND14G/B4B-T(U), GMV-ND18G/B4B-T(U), GMV-ND24G/B4B-T

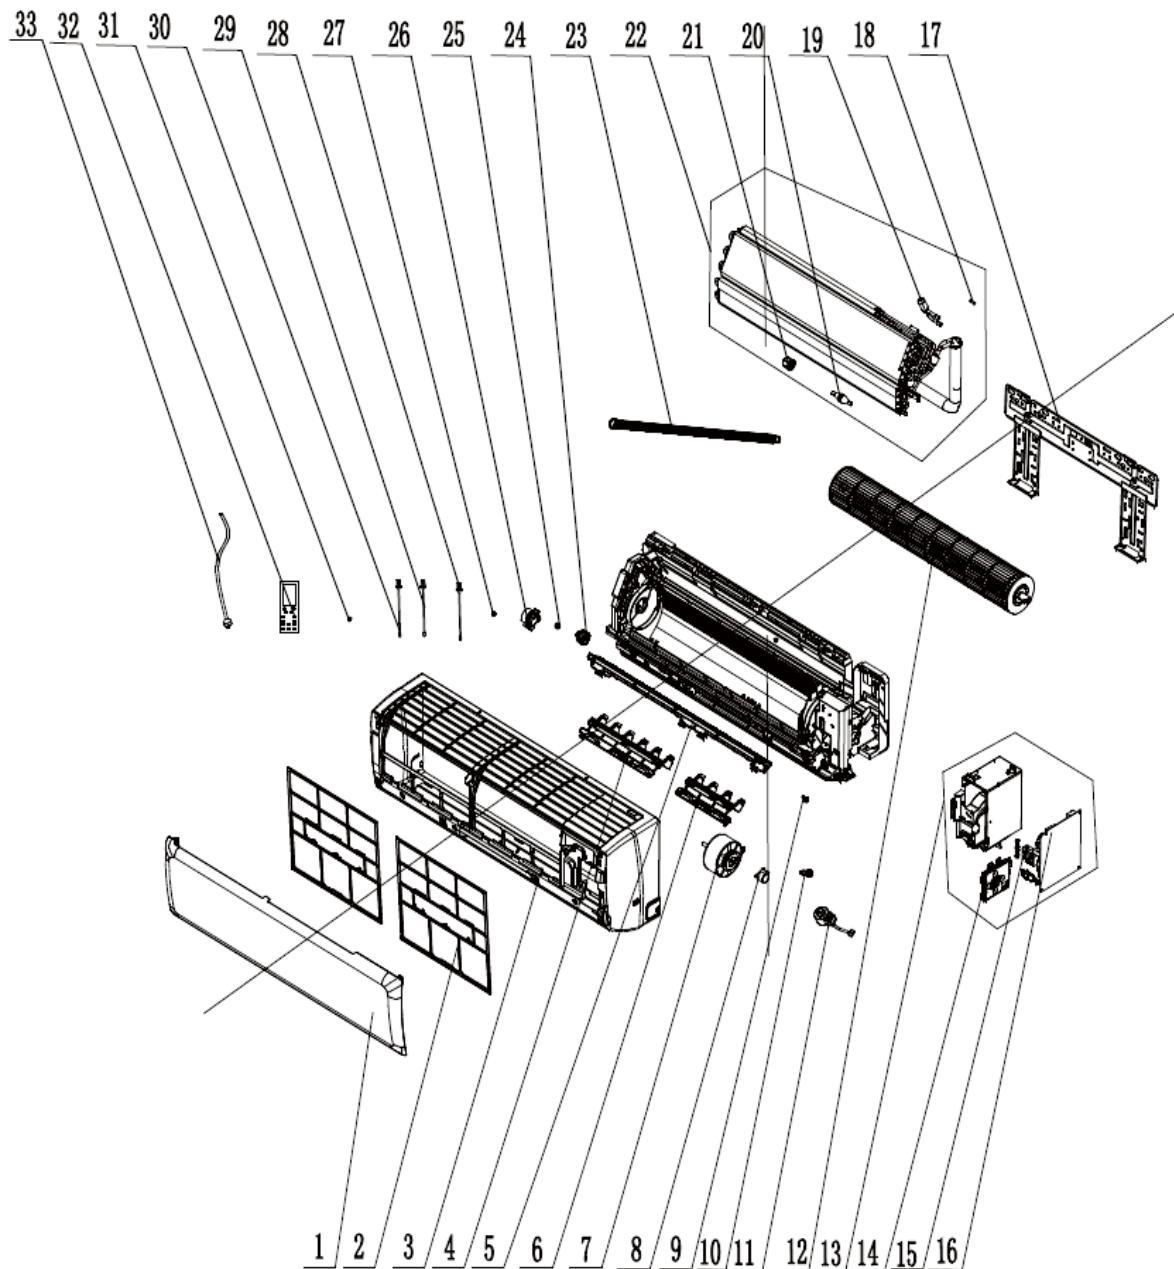

No.	Name of part	For the following unit	
		Unit	Product Code
	GMV-ND06G/B4B-T(U)	CM100N2950	
	GMV-ND07G/B4B-T(U)	CM100N2960	
	GMV-ND09G/B4B-T(U)	CM100N2970	
	GMV-ND12G/B4B-T(U)	CM100N2980	
Part code		Quantity	
1	Front Panel	20000300027T	1
2	Filter Sub-Assy	11122468	2
3	Front CaseAssy	00000200045	1
4	Air Louver1	10512723	1
5	Helicoid Tongue	26112436	1
6	Air Louver2	10512724	1
7	Fan Motor	1501246601	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND06G/B4B-T(U)	CM100N2950
		GMV-ND07G/B4B-T(U)	CM100N2960
		GMV-ND09G/B4B-T(U)	CM100N2970
		GMV-ND12G/B4B-T(U)	CM100N2980
Part code		Quantity	
8	Stepping Motor	1521210710	1
9	Crank	73012005	1
10	Rubber Plug(WaterTray)	76712012	1
11	Electric Expand Valve Fitting	4304413216	1
12	Cross Flow Fan	10352056	1
13	Electric Box Assy	100002063998	1
14	Display Board	30565260	1
15	Termina IBoard	4201026805	1
16	Main Board	300002060244	1
17	Wall Mounting Frame	01252484	1
18	Filter Sub-Assy	11120011	1
19	Electronic Expansion Valve	07334463	1
20	Strainer A	0721002201	1
21	Sealing Cap(PressureWarning)	2611219201	1
22	Evaporator Assy	011001060163	1
23	Drainage Hose	05230014	1
24	O-Gasket of Cross Fan Bearing	76512203	1
25	Fan Bearing	7651221001	1
26	Ring of Bearing	26152022	1
27	Left Axile Bush	10512037	1
28	Temperature Sensor	390000454	1
29	Temperature Sensor	39000076G	1
30	Temperature Sensor	390002072	1
31	Axile Bush	10542036	1
32	Remote Controller	30510589	1
33	Power Cord	4002046417	1

Above data is subject to change without notice, please reference the SP in global service website.


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND14G/B4B-T(U)	CM100N2990
1	Front Panel	20000300028T	1
2	Filter Sub-Assy	1112208906	2
3	Front CaseAssy	200042	1
4	Air Louver1	10512732	1
5	Helicoid Tongue	26112512	1
6	Air Louver2	10512724	0
7	Fan Motor	15012136	1
8	Stepping Motor	1521240212	1
9	Crank	73012005	1
10	Rubber Plug(WaterTray)	76712012	1
11	Electric Expand ValveFitting	4304413216	1
12	Cross Flow Fan	10352060	1
13	Electric Box Assy	100002061356	1
14	Display Board	30565260	1
15	Termina IBoard	4201026805	1
16	Main Board	300002060244	1
17	Wall Mounting Frame	1362026	1
18	Filter Sub-Assy	30209060001	1
19	Electronic Expansion Valve	7334466	1
20	Strainer A	721002201	1
21	Sealing Cap(PressureWarning)	2611219202	1
22	Evaporator Assy	11001060216	1
23	Drainage Hose	05230014	1
24	O-Gasket of Cross Fan Bearing	76512203	1
25	Fan Bearing	7651221001	1
26	Ring of Bearing	26152025	1
27	Left Axile Bush	10512037	1
28	Temperature Sensor	390000454	1
29	Temperature Sensor	39000076G	1
30	Temperature Sensor	390002072	1
31	Axile Bush	10542036	1
32	Remote Controller	30510589	1
33	Power Cord	4002046417	1

Above data is subject to change without notice, please reference the SP in global service website.

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND18G/B4B-T(U)	CM100N3000
		GMV-ND24G/B4B-T(U)	CM100N3010
		Part code	Quantity
1	Front Panel	20000300029T	1
2	Filter Sub-Assy	1101200703	2
3	Front CaseAssy	200043	1
4	Air Louver 1	10512737	3
5	Helicoid Tongue	26112513	1
6	Air Louver 2	10512724	0
7	Fan Motor	15012136	1
8	Stepping Motor	1521240212	1
9	Crank	73012005	1
10	Rubber Plug(WaterTray)	76712012	1
11	Electric Expand ValveFitting	4304413216	1
12	Cross Flow Fan	10352057	1
13	Electric Box Assy	100002061356	1
14	Display Board	30565260	1
15	Termina IBoard	4201026805	1
16	Main Board	300002060244	1
17	Wall Mounting Frame	1252229	1
18	Filter Sub-Assy	30209060001	1
19	Electronic Expansion Valve	7334466	1
20	Strainer A	721002201	1
21	Sealing Cap(PressureWarning)	2611219202	1
22	Evaporator Assy	11001060225	1
23	Drainage Hose	05230014	1
24	O-Gasket of Cross Fan Bearing	76512203	1
25	Fan Bearing	7651221001	1
26	Ring of Bearing	26152025	1
27	Left Axile Bush	10512037	1
28	Temperature Sensor	390000454	1
29	Temperature Sensor	39000076G	1
30	Temperature Sensor	390002072	1
31	Axile Bush	10542036	1
32	Remote Controller	30510589	1
33	Power Cord	4002046417	1

Above data is subject to change without notice, please reference the SP in global service website.

GMV-ND30G/B4B-T(U)、GMV-ND36G/B4B-T(U)

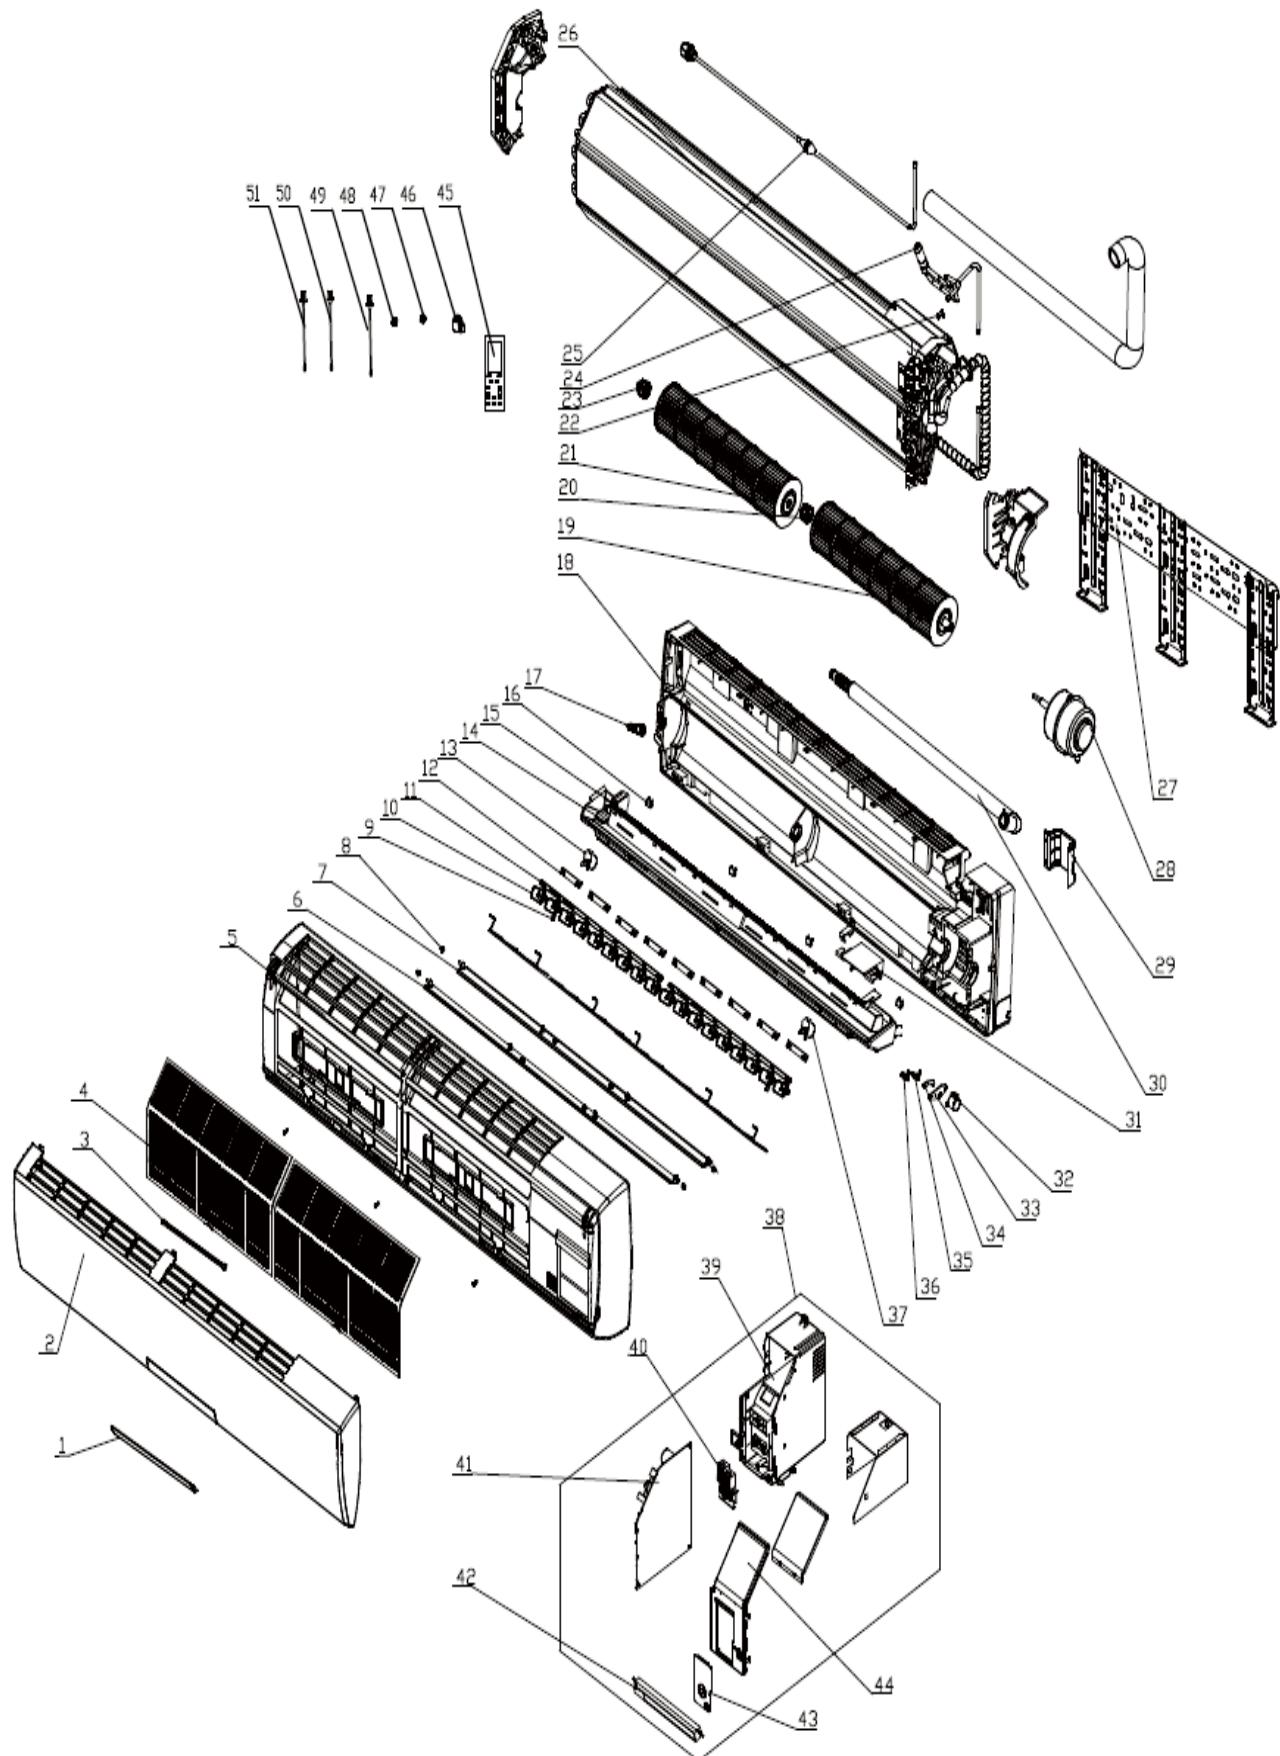


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND30G/B4B-T(U)	CM100N3020
		GMV-ND36G/B4B-T(U)	CM100N3030
		Part code	Quantity
1	Receiver Window	22432164	0
2	Front Panel	209007060019	1
3	Stand Bar	2421212001	1
4	Filter Sub-Assy	1112210601	2
5	Front Case Sub-assy	209007060019	1
6	Upper Guide Louver	10512166	1
7	Lower Guide Louver	10512167	1
8	Axile Bush	10542704	6
9	Air Louver 2	10512169	2
10	Air Louver 1	10512168	16
11	Connecting Rod	10582086	2
12	Louver Clamp	26112127	9
13	SteppingMotor	1521210701	1
14	Water Tray	20182138	1
15	Air Guider System in Water Tray Assy	10102040	1
16	Screw Cover	242520053	4
17	Rubber Plug (Water Tray)	76712012	1
18	Rear Case Sub-Assy	22202703	1
19	Cross Flow Fan 1	10352039	1
20	Bearing Holder Sub-assy	26152028	1
21	Cross Flow Fan 2	10352040	1
22	Filter Sub-Assy	11120012	1
23	O-Gasket sub-Assy of Bearing	76512051	1
24	Strainer A	0721002201	1
25	Electronic Expansion Valve	07334468	1
26	Evaporator Assy	011001000608	1
27	Wall Mounting Frame	01252398	1
28	Fan Motor	1501213401	1
29	Pipe Clamp	26112071	1
30	Drainage Hose	0523001404	1
31	Cover Plate	2012212402	1
32	SteppingMotor	1501207902	1
33	Press Plate(Crank)	26112070	1
34	Crank-guide	10582041	1
35	Upper Crank	10562004	1
36	Lower crank	10562005	1
37	SteppingMotor	15012122	1
38	Electric Box Assy	100002063782	1
39	Electric Box	201022502	1
40	Terminal Board	42010268	1
41	Main Board	300002000701	1
42	Display Board	30565260	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND30G/B4B-T(U)	CM100N3020
		GMV-ND36G/B4B-T(U)	CM100N3030
Part code		Quantity	
43	Electric Box Cover	201022523	1
44	Electric Box Cover	2011204404S	1
45	Remote Controller	30510589	1
46	Electric Expand Valve Fitting	4304413217	1
47	Fan Bearing	7651221001	1
48	Fan Bearing	76512210	1
49	Temperature Sensor	390002072	1
50	Temperature Sensor	39000076G	1
51	Temperature Sensor	390000454	1

Above data is subject to change without notice, please reference the SP in global service website.

## 5.10 Compact Four-way Cassette Type Indoor Unit

Exploded View of GMV-ND07T/B-T(U) / GMV-ND09T/B-T(U) / GMV-ND12T/B-T(U) / GMV-ND15T/B-T(U) / GMV-ND18T/B-T(U)

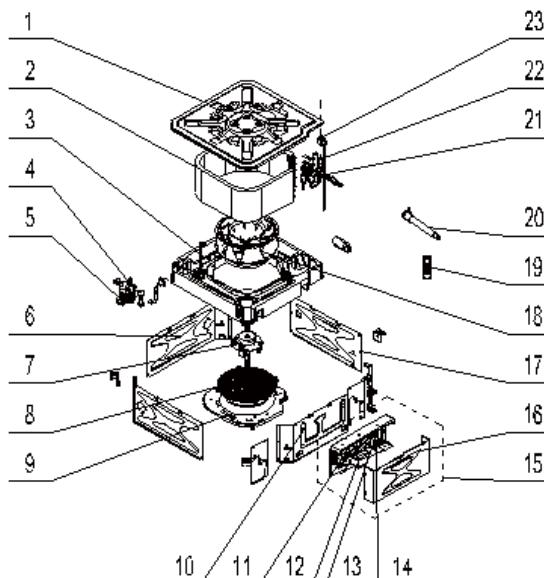

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
	GMV-ND07T/B-T(U)	CM500N0940		GMV-ND12T/B-T(U)	CM500N0960
	GMV-ND09T/B-T(U)	CM500N0950		GMV-ND15T/B-T(U)	CM500N0970
Part code		Quantity	Part code	Quantity	
1	Base Plate Assy	02229400007	1	02229400007	1
2	Evaporator Assy	01024100149	1	01024100137	1
3	Water Tray Assy	01289400004	1	01289400004	1
4	Liquid Level Switch	450102013	1	450102013	1
5	Water Pump	43138000024	1	43138000024	1
6	Right Side Plate Sub-Assy	01319400013	2	01319400013	2
7	Brushless DC Motor	15709400004	1	15709400004	1
8	Rear Grill	26909400007	1	26909400007	1
9	Diversion Circle	10479400001	1	10479400001	1
10	Front Side Plate Sub-Assy	01319400014	1	01319400014	1
11	Main Board	30226000029	1	30226000029	1
12	Transformer	43118000015	1	43118000015	1
13	Terminal Board	42011106	1	42011106	1
14	Terminal Board	4201800002601	1	4201800002601	1
15	Electric Box Assy	100002001831	1	100002001831	1
16	Electric Box Cover	01429400002	1	01429400002	1
17	Left Side Plate Sub-Assy	01319400012	1	01319400012	1
18	Centrifugal Fan	10429400001	1	10429400001	1
19	Remote Controller	30510589	1	30510589	1

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND07T/B-T(U)	CM500N0940	GMV-ND12T/B-T(U)	CM500N0960
		GMV-ND09T/B-T(U)	CM500N0950	GMV-ND15T/B-T(U)	CM500N0970
		Part code	Quantity	Part code	Quantity
20	Drain Hose Sub-Assy	05232050	1	05232050	1
21	Strainer	0741410000601	2	0741410000601	2
22	Electronic Expansion Valve	07334463	1	07334463	1
23	Electric Expand Valve Fitting	4304413215	1	4304413215	1


Above data is subject to change without notice, please refer the SP in global service website.

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND18T/B-T(U)	CM500N0980
		Part code	Quantity
1	Base Plate Assy	02229400007	1
2	Evaporator Assy	01024100152	1
3	Water Tray Assy	01289400004	1
4	Liquid Level Switch	450102013	1
5	Water Pump	43138000024	1
6	Right Side Plate Sub-Assy	01319400013	2
7	Brushless DC Motor	15709400004	1
8	Rear Grill	26909400007	1
9	Diversion Circle	10479400001	1
10	Front Side Plate Sub-Assy	01319400014	1
11	Main Board	30226000029	1
12	Transformer	43118000015	1
13	Terminal Board	42011106	1
14	Terminal Board	4201800002601	1
15	Electric Box Assy	100002001831	1
16	Electric Box Cover	01429400002	1
17	Left Side Plate Sub-Assy	01319400012	1
18	Centrifugal Fan	10429400001	1
19	Remote Controller	30510589	1
20	Drain Hose Sub-Assy	05232050	1
21	Strainer	0741410000601	2
22	Electronic Expansion Valve	07334463	1
23	Electric Expand Valve Fitting	4304413215	1

Above data is subject to change without notice, please refer the SP in global service website.

## 5.11 Super High Static Pressure Duct Type Indoor Unit

Exploded View of GMV-ND07PHS/B-T(U) / GMV-ND09PHS/B-T(U):

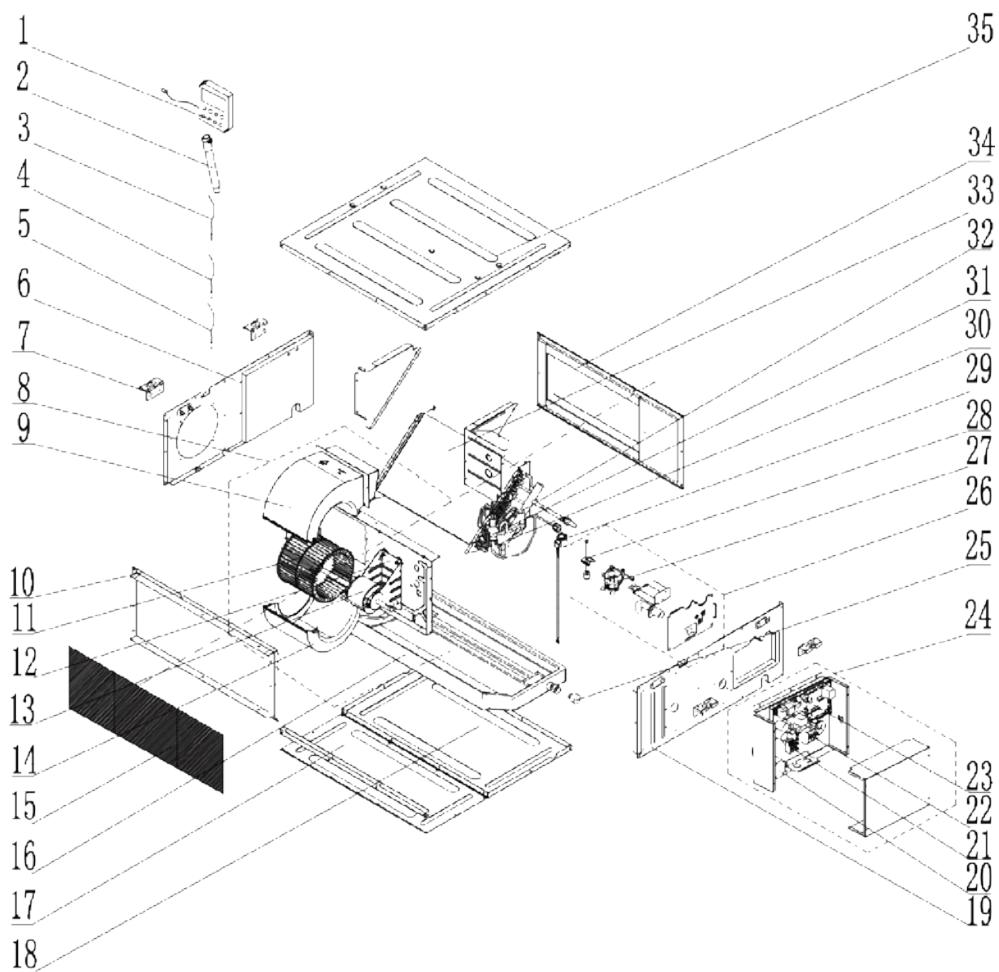


No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND07PHS/B-T(U)	CM810N0830	GMV-ND09PHS/B-T(U)	CM810N0790
		Part code	Quantity	Part code	Quantity
1	Display Board	30296000040	1	30296000040	1
2	Drain Hose Sub-Assy	05232050	1	05232050	1
3	Temperature Sensor	390000454	1	390000454	1
4	Temperature Sensor	390000592	1	390000592	1
5	Temperature Sensor	3900005910	1	3900005910	1
6	Right Side Plate Assy	01315200148	1	01315200148	1
7	Hook	02112466	4	02112466	4
8	Centrifugal Fan Assy	15404100074	1	15404100074	1
9	Propeller Housing(Upper)	26905200078	1	26905200078	1
10	Return Air Frame Sub-Assy	01702600004	1	01702600004	1
11	Centrifugal Fan	10455200003	1	10455200003	1
12	Supporter(Fan motor)	0180520027201	1	0180520027201	1
13	Brushless DC Motor	1570520000501	1	1570520000501	1
14	Propeller Housing(Lower)	26905200079	1	26905200079	1
15	Filter Sub-Assy	111001000055	1	111001000055	1
16	Foam Sub-assy	12505200038	1	12505200038	1

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND07PHS/B-T(U) )	CM810N0830	GMV-ND09PHS/B-T(U)	CM810N0790
		Part code	Quantity	Part code	Quantity
17	Cover Of Air-In	01265200182	1	01265200182	1
18	Bottom Cover Plate	01265200181	1	01265200181	1
19	Left Side Plate Assy	01315200147	1	01315200147	1
20	Inductance	43128000014	1	43128000014	1
21	Terminal Board	4201115402	1	4201115402	1
22	Terminal Board	4201800002601	1	4201800002601	1
23	Main Board	30226000089	1	30226000089	1
24	Electric Box Assy	100002000985	1	100002000985	1
25	Choke Plug Of Drain Pipe	76815214	2	76815214	2
26	Seal Plate Assy	01495200079	1	01495200079	1
27	Water Pump	43138000058	1	43138000058	1
28	Water Level Switch	45020216	1	45020216	1
29	Electric Expand Valve Fitting	4304413215	1	4304413215	1
30	Strainer	07415210	1	07415210	1
31	Strainer	0741410000601	1	0741410000601	1
32	Electronic Expansion Valve	07334466	1	07334466	1
33	Evaporator Assy	011001000293	1	011001000293	1
34	Air Outlet Frame Assy	01374100070	1	01374100070	1
35	Top Cover Board Assy	01264100081	1	01264100081	1

Above data is subject to change without notice, please refer the SP in global service website.

Exploded View of GMV-ND12PHS/B-T(U) / GMV-ND15PHS/B-T(U) / GMV-ND18PHS/B-T(U) / GMV-ND22PHS/B-T(U) / GMV-ND24PHS/B-T(U):

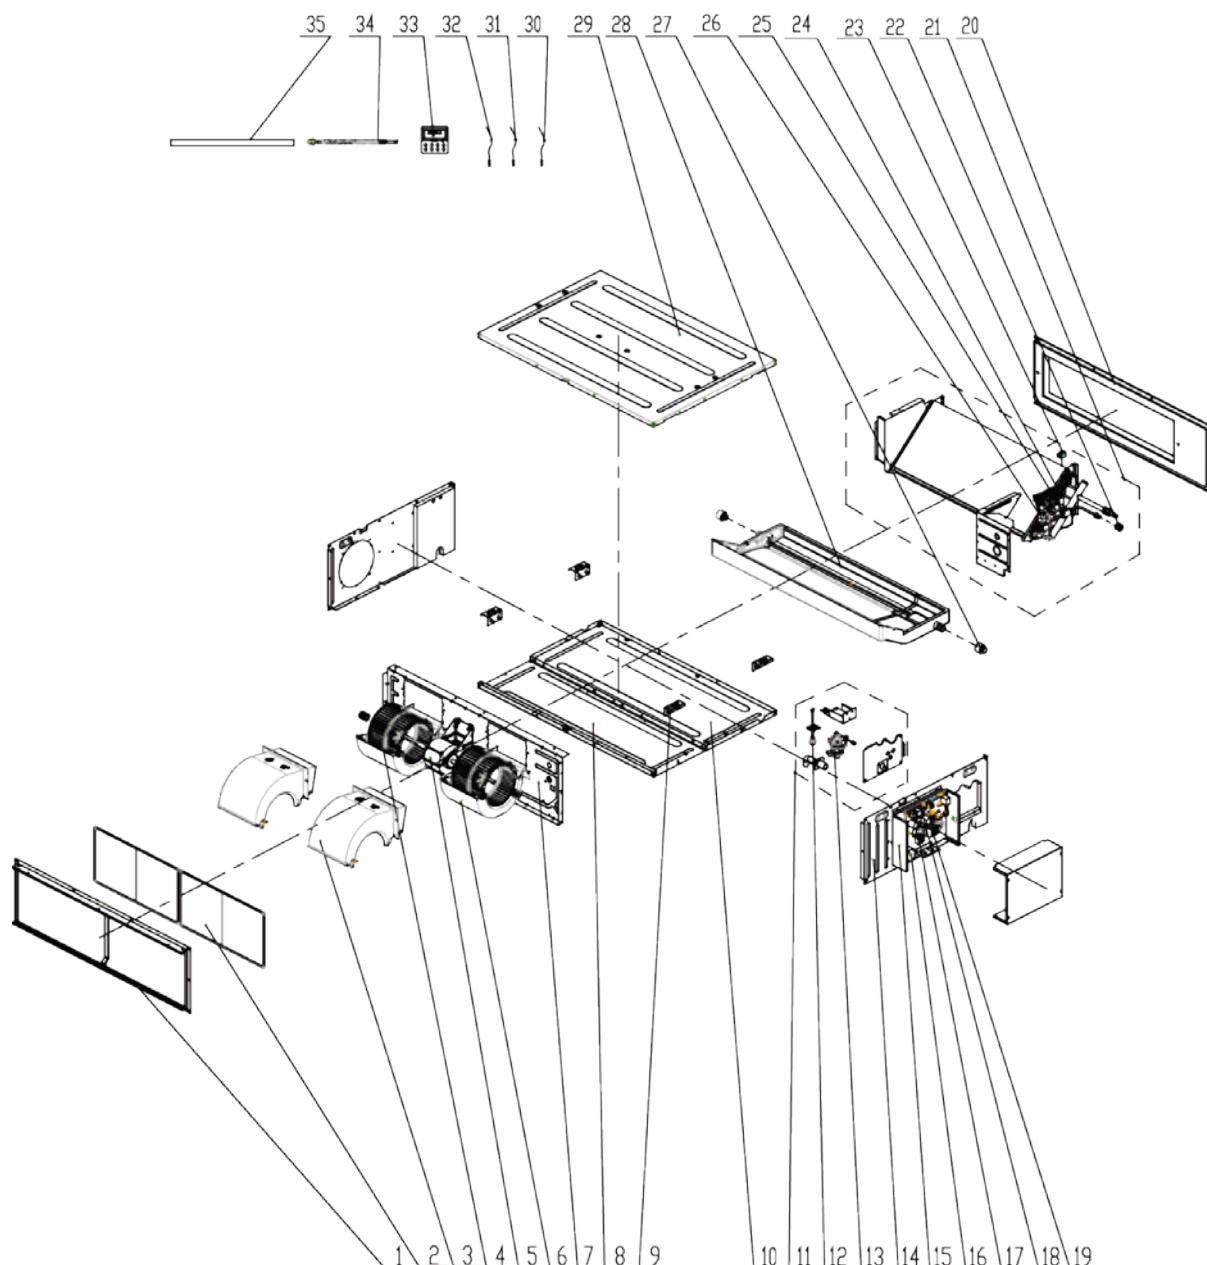


NO.	Model	GMV-ND12PHS/B-T(U) / GMV-ND15PHS/B-T(U) / GMV-ND18PHS/B-T(U) / GMV-ND22PHS/B-T(U) / GMV-ND24PHS/B-T(U)	Qty.
	Product Code	CM810N0800/CM810N0770/CM810N0810/CM810N0720/CM810N0730	
	Part Name	Part Code	
1	Centrifugal Fan Assy	017026000002	1
2	Filter Sub-Assy	111001000045	2
3	Propeller Housing(Upper)	26905200078	2
4	Centrifugal Fan	10455200003	2
5	Brushless DC Motor	15705200016	1
6	Propeller Housing(Lower)	26905200079	2
7	Blower Mounting Plate Sub-Assy	01325200079	1
8	Cover Of Air-In	01265200132	1
9	Hook	02112466	4

NO.	Model	GMV-ND12PHS/B-T(U) / GMV-ND15PHS/B-T(U) / GMV-ND18PHS/B-T(U) / GMV-ND22PHS/B-T(U) / GMV-ND24PHS/B-T(U)	Qty.
	Product Code	CM810N0800/CM810N0770/CM810N0810/CM810N0720/CM810 N0730	
	Part Name	Part Code	
10	Bottom Cover Plate	01265200131	1
11	Seal plate Assy	01495200079	1
12	Water Level Switch	45020216	1
13	Water Pump	43138000058	1
14	Left Side Plate Assy	01315200147	1
15	Electric Box Assy	100002000985	1
16	Inductance	43128000014	1
17	Terminal Board	4201115402	1
18	Main Board	30226000089	1
19	Terminal Board	4201800002601	1
20	Air Outlet Frame Assy	01375200026	1
21	Evaporator Assy	01024100173 0102410017301	1
22	Sealing Cap(Pressure Warning)	2611219201	1
23	Electric Expand Valve Fitting	4304413215	1
24	Electronic Expansion Valve	07334466	1
25	Strainer	0741410000601	1
26	Strainer	07415210	1
27	Choke Plug of Drain Pipe	76815214	2
28	Foam Sub-assy	12505200025	1
29	Top Cover Board Assy	01265200130	1
30	Temperature Sensor	3900005910	1
31	Temperature Sensor	390000592	1
32	Temperature Sensor	390000454	1
33	Display Board	30296000040	1
34	Corrugated Pipe	05015408	1
35	Drain Hose Sub-Assy	05232050	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-ND30PHS/B-T(U) / GMV-ND36PHS/B-T(U) / GMV-ND42PHS/B-T(U):

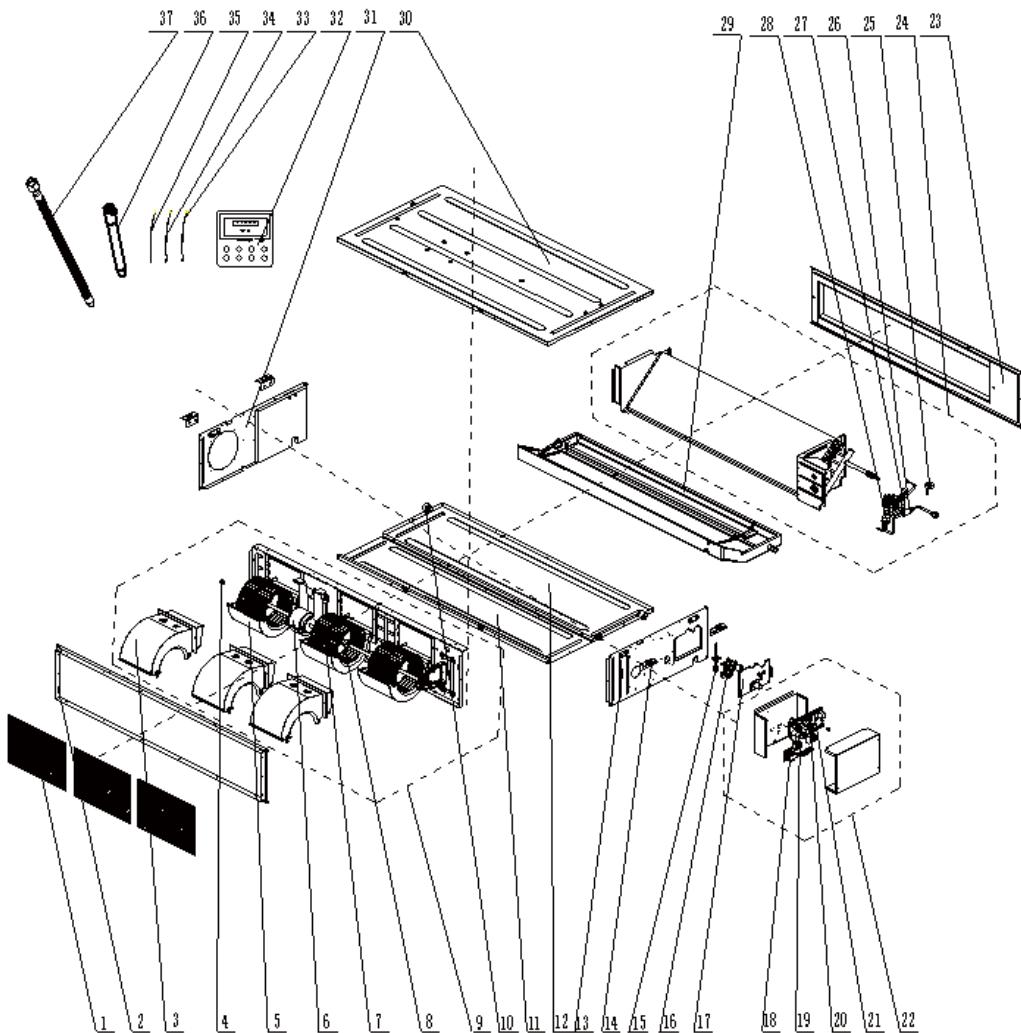


NO.	Model	GMV-ND30PHS/B-T(U) / GMV-ND36PHS/B-T(U) / GMV-N42PHS/B-T(U)	Qty.
	Product Code	CM810N0780/CM810N0740/CM810N0750	
	Part Name	Part Code	
1	Filter Sub-Assy	111001000052	3
2	Return Air Frame Sub-Assy	017026000003	1
3	Propeller Housing(Upper)	26905200078	3
4	Fan Bearing	76512210	1
5	Propeller Housing(Lower)	26905200079	3
6	Brushless DC Motor	1570940000601	1
7	Centrifugal Fan	10455200003	3
8	Joint Slack	73018731	1
9	Centrifugal Fan Assy	000052000028	1
10	Choke Plug Of Drain Pipe	76815214	2
11	Cover Plate(Air Return)	01265200123	1
12	Bottom Cover Plate	01265200125	1
13	Left Side Plate Assy	01315200147	1
14	Hook	02112466	4
15	Water Level Switch	45020216	1
16	Water Pump	43138000058	1

NO.	Model	GMV-ND30PHS/B-T(U) / GMV-ND36PHS/B-T(U) / GMV-N42PHS/B-T(U)	Qty.
	Product Code	CM810N0780/CM810N0740/CM810N0750	
	Part Name	Part Code	
17	Seal Plate	01495200078	1
18	Reactor	43138000047	1
19	Terminal board	4201115402	1
20	Terminal Board	4201800002601	1
21	Main Board	300002000009	1
22	Electric Box Assy	100002000984	1
23	Air Outlet Frame Assy	01375200023	1
24	Evaporator Assy	011001000070	1
25	Electric Expand Valve Fitting	4304413215	1
26	Strainer	0741410000601	1
27	Electronic Expansion Valve	07334468	1
28	Strainer	07415210	1
29	Foam Sub-Assy	12505200021	1
30	Top Cover Board Assy	01264100105	1
31	Right Side Plate Assy	01315200148	1
32	Display Board	30296000040	1
33	Temperature Sensor	3900005910	1
34	Temperature Sensor	390000592	1
35	Temperature Sensor	390000454	1
36	Drain Hose Sub-Assy	05232050	1
37	Corrugated Pipe	05015408	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-ND48PHS/B-T(U) / GMV-ND54PHS/B-T(U):

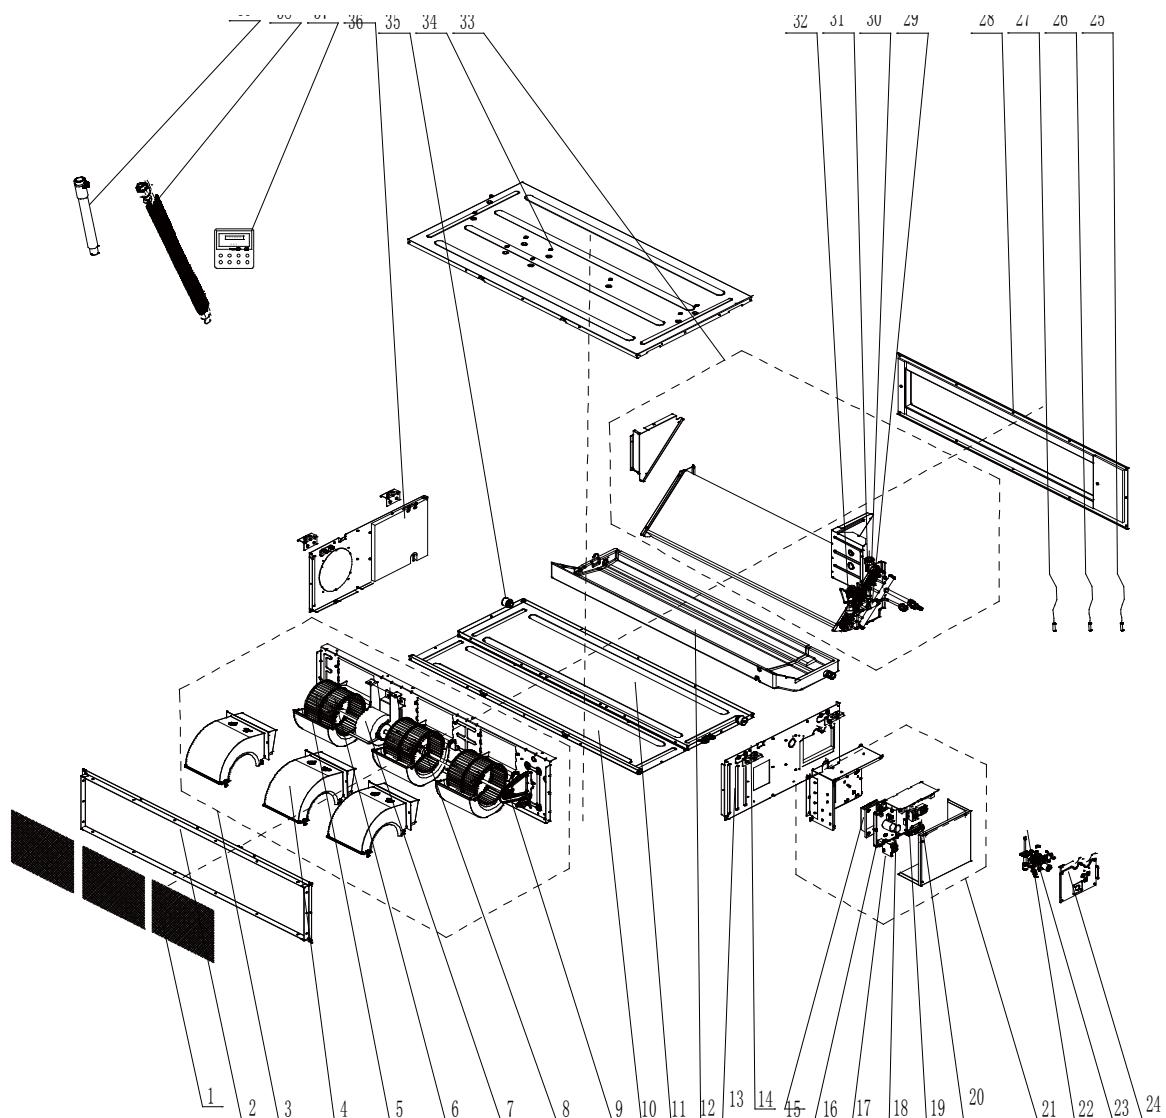


NO.	Model	GMV-ND48PHS/B-T(U) / GMV-ND54PHS/B-T(U)	Qty.
	Product Code	CM810N0820/CM810N0760	
	Part Name	Part Code	
1	Filter Sub-Assy	111001000052	3
2	Return Air Frame Sub-Assy	017026000003	1
3	Centrifugal Fan Assy	000052000029	1
4	Propeller Housing(Upper)	26905200078	3
5	Propeller Housing(Lower)	26905200079	3
6	Centrifugal Fan	10455200003	3
7	Brushless DC Motor	1570940000801	1
8	Joint Slack	73018731	1
9	Fan Bearing	76512210	1
10	Cover Plate(Air return)	01265200123	1
11	Bottom Cover Plate	01265200125	1
12	Foam Sub-Assy(Water Tray)	12505200021	1
13	Left Side Plate Assy	01314100118	1
14	Hook	02112466	4
15	Radiator	49018000068	1
16	Main Board	30221000033	1

NO.	Model	GMV-ND48PHS/B-T(U) / GMV-ND54PHS/B-T(U)	Qty.
	Product Code	CM810N0820/CM810N0760	
	Part Name	Part Code	
17	Reactor	43138000047	1
18	Main Board	30226000092	1
19	Terminal board	4201115402	1
20	Terminal Board	4201800002601	1
21	Electric Box Assy	100002001512	1
22	Water Level Switch	45020216	1
23	Water Pump	43138000058	1
24	Seal Plate	01495200078	1
25	Temperature Sensor	3900005910	1
26	Temperature Sensor	390000592	1
27	Temperature Sensor	390000454	1
28	Air Outlet Frame Assy	01375200023	1
29	Strainer	0741410000601	1
30	Electric Expand Valve Fitting	4304413215	1
31	Electronic Expansion Valve	07334468	1
32	Strainer	07415210	1
33	Evaporator Assy	011001000070 011001000238	1
34	Top Cover Board Assy	01264100105	1
35	Choke Plug Of Drain Pipe	76815214	2
36	Right Side Plate Assy	01315200148	1
37	Display Board	30296000040	1
38	Corrugated Pipe	05015408	1
39	Drain Hose Sub-Assy	05232050	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-ND72PH/B-T(U) / GMV-ND96PH/B-T(U):

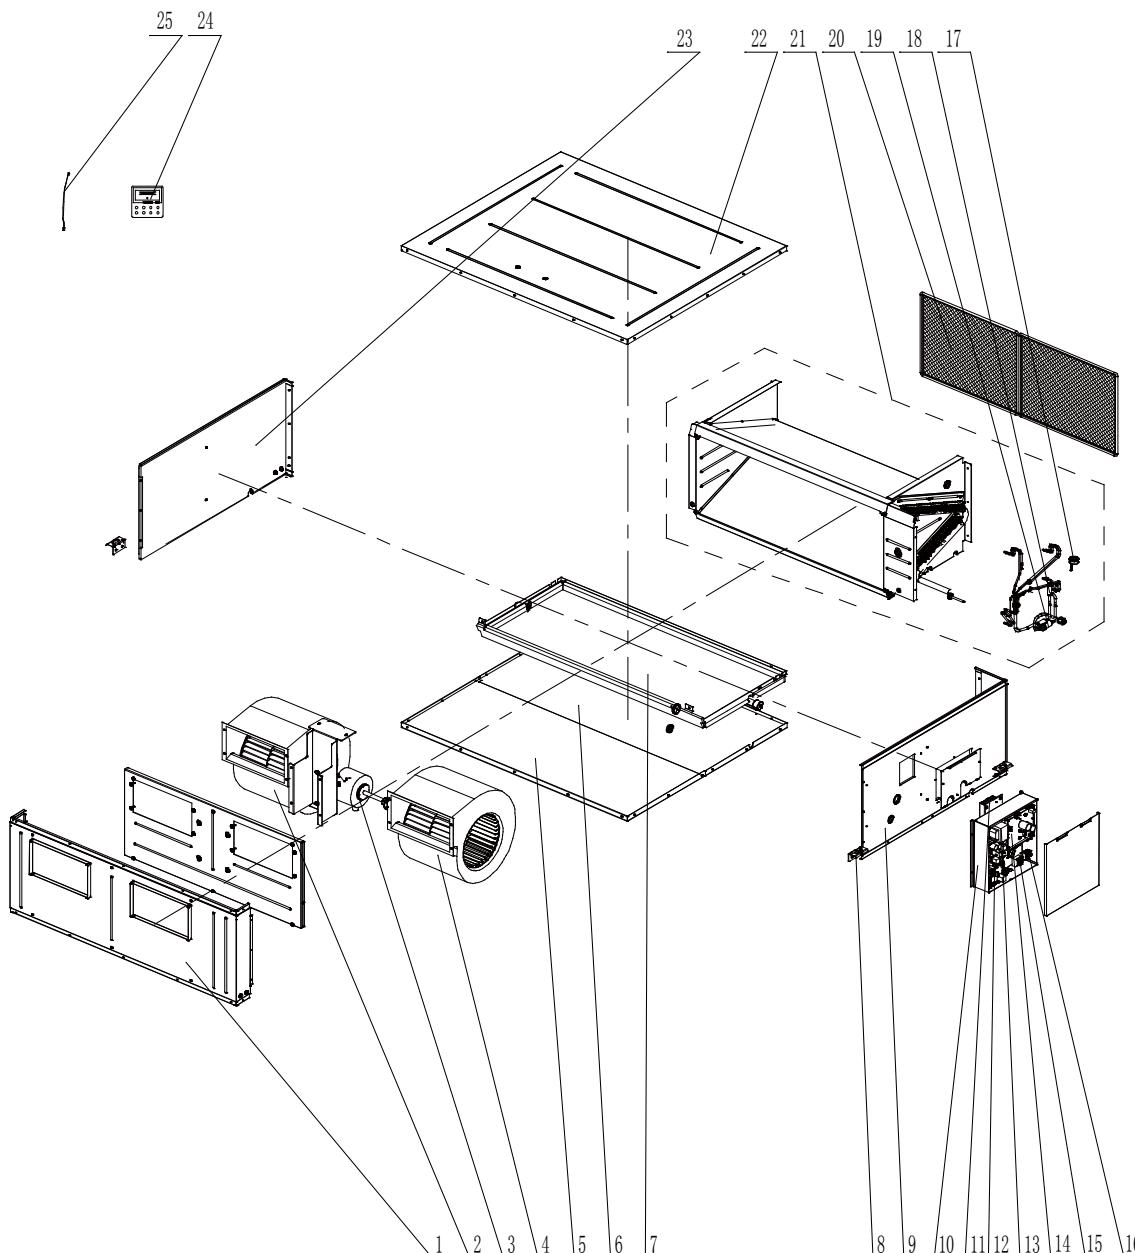

No.	Model	GMV-ND72PH/B-T(U)	Qty.
	Product Code	CM810N1600	
	Part Name	Part Code	
1	Front Side Plate Sub-Assy	017101060001	1
2	Motor for Centrifugal Fan	103004000106	1
3	Brushless DC Motor	15704100009	1
4	Motor for Centrifugal Fan	103004000105	1
5	Bottom Cover Plate	012147060003	2
6	Bottom Cover Plate	012147060002	1
7	Water Tray Assy	000069060003	1
8	Hook	02112466	4
9	Right Side Plate	012056060002	1
10	Electric Box Assy	100002060073	1
11	Radiator	49018000068	1
12	Main Board	30226000092	1


No.	Model	GMV-ND72PH/B-T(U)	Qty.
	Product Code	CM810N1600	
	Part Name	Part Code	
13	Reactor	43130189	1
14	Main Board	30221000023	1
15	Terminal Board	4201800002601	1
16	Terminal Board	420001000002	1
17	Electric Expand Valve Fitting	4304413205	1
18	Electronic Expansion Valve	43044100190	2
19	Strainer	074141000601	2
20	Filter Sub-Assy	111001060005	1
21	Evaporator Assy	011001060038	1
22	Top Cover	012148060002	1
23	Left Side Plate	012055060002	1
24	Display Board	30296000040	1
25	Sensor Sub-assy	39008000103G	1

Above data is subject to change without notice, please refer the SP in global service website.

No.	Model	GMV-ND96PH/B-T(U)	Qty.
	Product Code	CM810N1590	
	Part Name	Part Code	
1	Front Side Plate Sub-Assy	017101060001	1
2	Motor for Centrifugal Fan	103004000106	1
3	Brushless DC Motor	15704100009	1
4	Motor for Centrifugal Fan	103004000105	1
5	Bottom Cover Plate	012147060003	2
6	Bottom Cover Plate	012147060002	1
7	Water Tray Assy	000069060003	1
8	Hook	02112466	4
9	Right Side Plate	012056060002	1
10	Electric Box Assy	100002060073	1
11	Radiator	49018000068	1
12	Main Board	30226000092	1
13	Reactor	43130189	1
14	Main Board	30221000023	1
15	Terminal Board	4201800002601	1
16	Terminal Board	420001000002	1
17	Electric Expand Valve Fitting	4304413205	1
18	Electronic Expansion Valve	43044100190	2
19	Strainer	0741410000601	2
20	Filter Sub-Assy	111001060005	1
21	Evaporator Assy	011001060013	1
22	Top Cover	012148060002	1
23	Left Side Plate	012055060002	1
24	Display Board	30296000040	1
25	Sensor Sub-assy	39008000103G	1

Above data is subject to change without notice, please refer the SP in global service website.

## 5.12 Air Handler type Indoor Unit

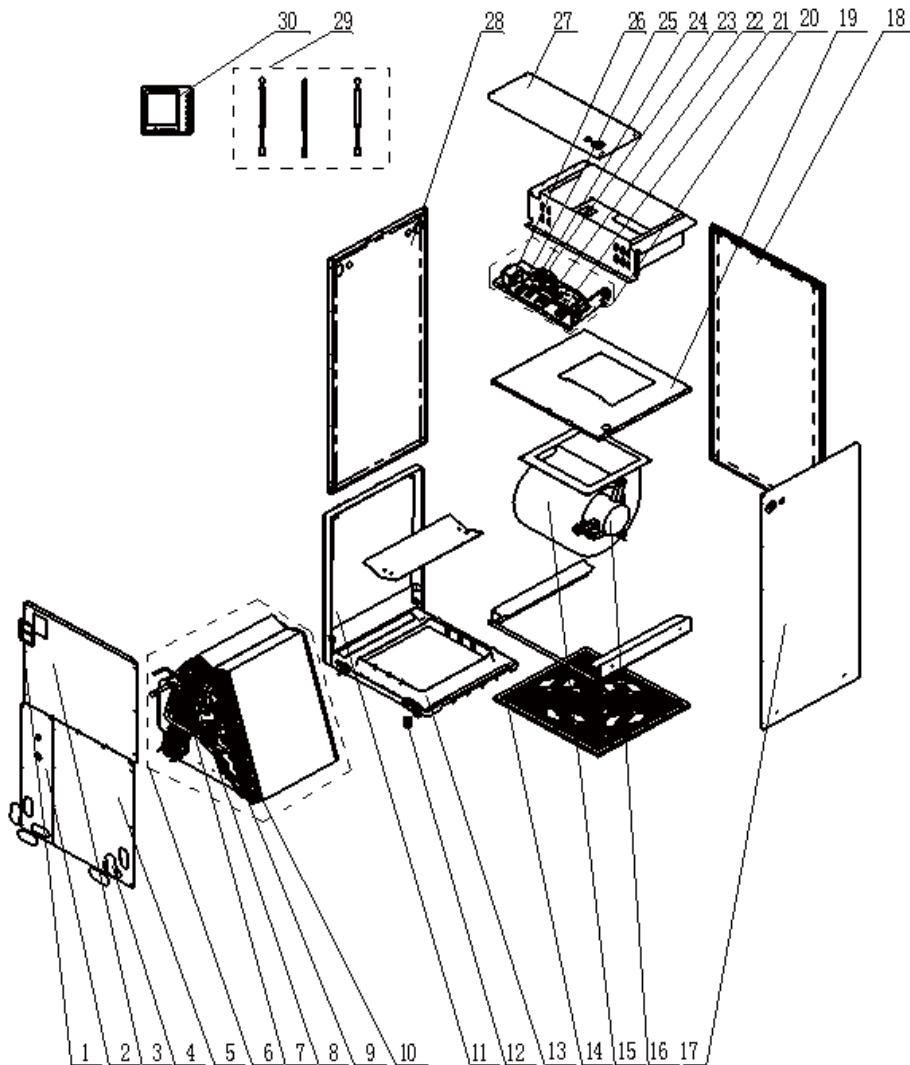

Exploded View of GMV-ND09A/A-T(U) / GMV-ND12A/A-T(U)

NO.	Model	GMV-ND09A/A-T(U) GMV-ND12A/A-T(U)	Qty.
	Product Code	CM810N1900 CM810N1910	
	Part Name	Part Code	
1	insulating board	75142201	1
2	Lower cover plate 1	01264100070	1
3	Top Cover Board Sub-assy	01262200007	1
4	Plastic Cover	26902209	4
5	Lower cover plate sub-assy 2	01262200009	1
6	Evaporator Assy	011001060571	1
7	Current Divider	035032060003	1
8	Strainer	0721304401 0721200102	1 1
9	Electronic Expansion Valve	07334463	1
10	Electric Expand Valve Fitting	4304413219	1
12	Choke Plug	76718209	8

NO.	Model	GMV-ND09A/A-T(U) GMV-ND12A/A-T(U)	Qty.
	Product Code	CM810N1900 CM810N1910	
	Part Name	Part Code	
13	Main water Tray	2690220000101	1
14	Filter Sub-Assy	1172220202	1
15	Motor for Centrifugal Fan	1570220101	1
16	Fan Motor	150104000014	1
17	Right Side Plate Sub-Assy	01312200007	1
18	Rear Side Plate Sub-Assy	01312200009	1
19	Blower Mounting Plate	012046060016	1
20	Electric cabinet board	100003060687	1
21	Terminal Board	42000100000102	1
22	Terminal Board	42200006000401	1
23	Terminal Board	42011147	1
24	Main Board	300002000321	1
25	Terminal Board	42011103	1
26	Transformer	43110286	1
27	Top Cover Plate Sub-Assy	01262200010	1
28	Left Side Plate Sub-Assy	01312200005	1
29	Sensor Sub-Assy	39008000103G	1
30	Display Board	30296000040	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-ND18A/A-T(U) / GMV-ND24A/A-T(U) / GMV-ND30A/A-T(U)

NO.	Model	GMV-ND18A/A-T(U) GMV-ND24A/A-T(U) GMV-ND30A/A-T(U)	Qty.
	Product Code	CM810N1890 CM810N0660 CM810N0670	
	Part Name	Part Code	
1	insulating board	75142201	1
2	Lower cover plate 1	01264100070	1
3	Top Cover Board Sub-Assy	01262200007	1
4	Plastic Cover	26902209	4
5	Lower cover plate sub-assy 2	01262200009	1
6	Evaporator Assy	01024100162	1
7	Current Divider	072241303	1
8	Strainer	0721200101	2
9	Electronic Expansion Valve	07334466	1
10	Electric Expand Valve Fitting	4304413205	1
11	Secondary Water Tray	2690220000201	1
12	Choke Plug	76718209	8
13	Main water Tray	2690220000101	1
14	Filter Sub-Assy	1172220202	1
15	Motor for Centrifugal Fan	1570220101	1
16	Fan Motor	150104000014	1
17	Right Side Plate Sub-Assy	01312200007	1
18	Rear Side Plate Sub-Assy	01312200009	1
19	Blower Mounting Plate	0132220000801	1
20	Electric cabinet board	100003000225	1
21	Terminal Board	42000100000102	1
22	Terminal Board	4201800002601	1
23	Terminal Board	42011147	1
24	Main Board	300002000321	1
25	Terminal Board	42011103	1
26	Transformer	43110286	1
27	Top Cover Plate Sub-assy	01262200010	1
28	Left Side Plate Sub-assy	01312200005	1
29	Sensor Sub-assy	39008000103G	1
30	Display Board	30296000040	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-ND36A/A-T(U) / GMV-ND42A/A-T(U)

NO.	Model	GMV-ND36A/A-T(U) GMV-ND42A/A-T(U)	Qty.
		CM810N0700 CM810N0690	
	Part Name	Part Code	
1	insulating board	75142201	1
2	Lower cover plate 1	01264100069	1
3	Top Cover Board Sub-assy	01262200019	1
4	Plastic Cover	26902209	4
5	Lower cover plate sub-assy 2	01262200017	1
6	Evaporator Assy	01024100166	1
7	Current Divider	0722443501	1
8	Strainer	0721200101	2
9	Electronic Expansion Valve	07334468	1
10	Electric Expand Valve Fitting	4304413205	1
11	Secondary Water Tray	26902205	1
12	Choke Plug	76718209	8
13	Main water Tray	26902204	1
14	Filter Sub-Assy	1172220201	1
15	Motor for Centrifugal Fan	1570220201	1
16	Fan Motor	150104000014	1
17	Right Side Plate Sub-Assy	01312200017	1
18	Rear Side Plate Sub-Assy	01312200019	1
19	Blower Mounting Plate	0132220000601	1
20	Electric cabinet board	100003000225	1
21	Terminal Board	4201115402	1
22	Terminal Board	4201800002601	1
23	Terminal Board	42011147	1
24	Main Board	300002000321	1
25	Terminal Board	42011103	1
26	Transformer	43110286	1
27	Top Cover Plate Sub-assy	01262200013	1
28	Left Side Plate Sub-assy	01312200015	1
29	Sensor Sub-assy	39008000103G	1
30	Display Board	30296000040	1


Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-ND48A/A-T(U) / GMV-ND54A/A-T(U)

NO.	Model	GMV-ND48A/A-T(U) GMV-ND54A/A-T(U)	Qty.
	Product Code	CM810N0680 CM810N0710	
	Part Name	Part Code	
1	insulating board	75142201	1
2	Lower cover plate 1	01264100065	1
3	Top Cover Board Sub-assy	01262200024	1
4	Plastic Cover	26902209	4
5	Lower cover plate sub-assy 2	01262200026	1
6	Evaporator Assy	01024100159	1
7	Current Divider	0722443501	1
8	Strainer	0721200101	2
9	Electronic Expansion Valve	07334468	1
10	Electric Expand Valve Fitting	4304413205	1
11	Secondary Water Tray	26902205	1
12	Choke Plug	76718209	8
13	Main water Tray	26902206	1
14	Filter Sub-Assy	11722202	1
15	Motor for Centrifugal Fan	1570220301	1
16	Fan Motor	150104000013	1
17	Right Side Plate Sub-Assy	01312200026	1
18	Rear Side Plate Sub-Assy	01312200028	1
19	Blower Mounting Plate	0132220001401	1
20	Electric cabinet board	100003000224	1
21	Terminal Board	4201115402	1
22	Terminal Board	4201800002601	1
23	Terminal Board	42011147	1
24	Main Board	300002000321	1
25	Terminal Board	42011103	1
26	Transformer	43110286	1
27	Top Cover Plate Sub-assy	01262200028	1
28	Left Side Plate Sub-assy	01312200030	1
29	Sensor Sub-assy	39008000103G	1
30	Display Board	30296000040	1

Above data is subject to change without notice, please refer the SP in global service website.

## 5.13 AHU-KIT

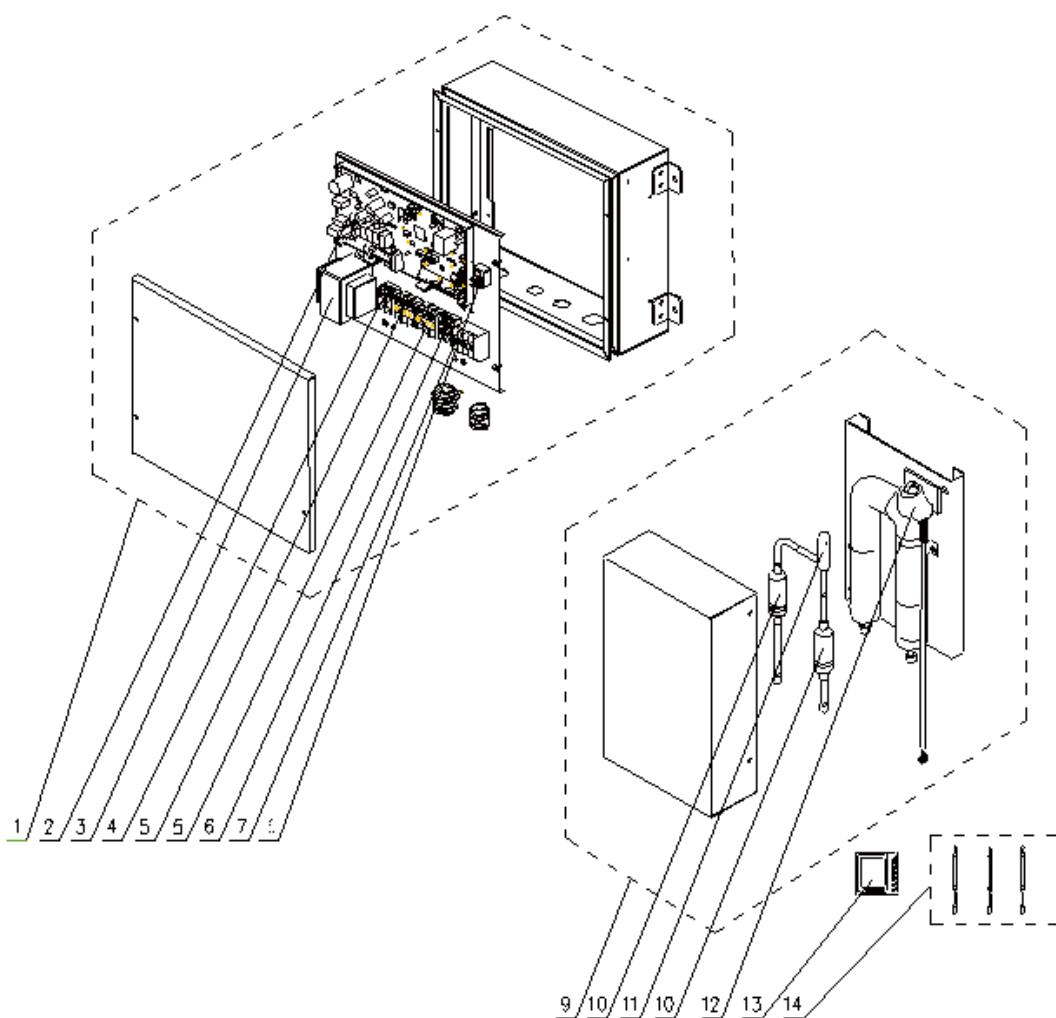

Exploded View of GMV-N12U/A-T(U)

NO.	Model	GMV-N12U/A-T(U)	Qty.
	Product Code	CN750N0101	
	Part Name	Part Code	
1	Electric Box Assy	100002002825	1
2	Main Board	30226000081	1
3	Transformer	43110286	1
4	Terminal Board	4201115402	1
5	Terminal Board	4201025901	1
6	Terminal Board	42011154	1
7	Terminal Board	4201800002601	1
8	Terminal Board	42011147	1
9	Electronic Expansion Valve assy	030174000026	1
10	Strainer	0741410000601	2
11	Electronic Expansion Valve	07334463	1
12	Electric Expand Valve Fitting	4304413239	1
13	Display Board	30296000040	1
14	Sensor Sub-assy	39008000130G	1

Above data is subject to change without notice, please refer the SP in global service website.

Exploded View of GMV-N24U/A-T(U)

NO.	Model	GMV-N24U/A-T(U)	Qty.
	Product Code	CN750N0061	
	Part Name	Part Code	
1	Electric Box Assy	100002002825	1
2	Main Board	30226000081	1
3	Transformer	43110286	1
4	Terminal Board	4201115402	1
5	Terminal Board	4201025901	1
6	Terminal Board	42011154	1
7	Terminal Board	4201800002601	1
8	Terminal Board	42011147	1
9	Electronic Expansion Valve assy	030174000027	1
10	Strainer	0741410000601	2
11	Electronic Expansion Valve	07334466	1
12	Electric Expand Valve Fitting	4304413239	1
13	Display Board	30296000040	1
14	Sensor Sub-assy	39008000130G	1

Above data is subject to change without notice, please refer the SP in global service website.

Exploded View of GMV-N48U/A-T(U)


NO.	Model	GMV-N48U/A-T(U)	Qty.
	Product Code	CN750N0071	
	Part Name	Part Code	
1	Electric Box Assy	100002002825	1
2	Main Board	30226000081	1
3	Transformer	43110286	1
4	Terminal Board	4201115402	1
5	Terminal Board	4201025901	1
6	Terminal Board	42011154	1
7	Terminal Board	4201800002601	1
8	Terminal Board	42011147	1
9	Electronic Expansion Valve assy	43044100226	1
10	Strainer	0741410000601	2
11	Electronic Expansion Valve	07334412	1
12	Electric Expand Valve Fitting	4304413239	1
13	Display Board	30296000040	1
14	Sensor Sub-assy	39008000130G	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-N96U/A-T(U)

NO.	Model	GMV-N96U/A-T(U)	Qty.
	Product Code	CN750N0081	
	Part Name	Part Code	
1	Electric Box Assy	100002002825	1
2	Main Board	30226000081	1
3	Transformer	43110286	1
4	Terminal Board	4201115402	1
5	Terminal Board	4201025901	1
6	Terminal Board	42011154	1
7	Terminal Board	4201800002601	1
8	Terminal Board	42011147	1
9	Electronic Expansion Valve assy	43044100215	1
10	Strainer	0741410000601	2
11	Electronic Expansion Valve	07331139	1
12	Electric Expand Valve Fitting	4304413239	1
13	Display Board	30296000040	1
14	Sensor Sub-assy	39008000130G	1


Above data is subject to change without notice, please refer the SP in global service website.

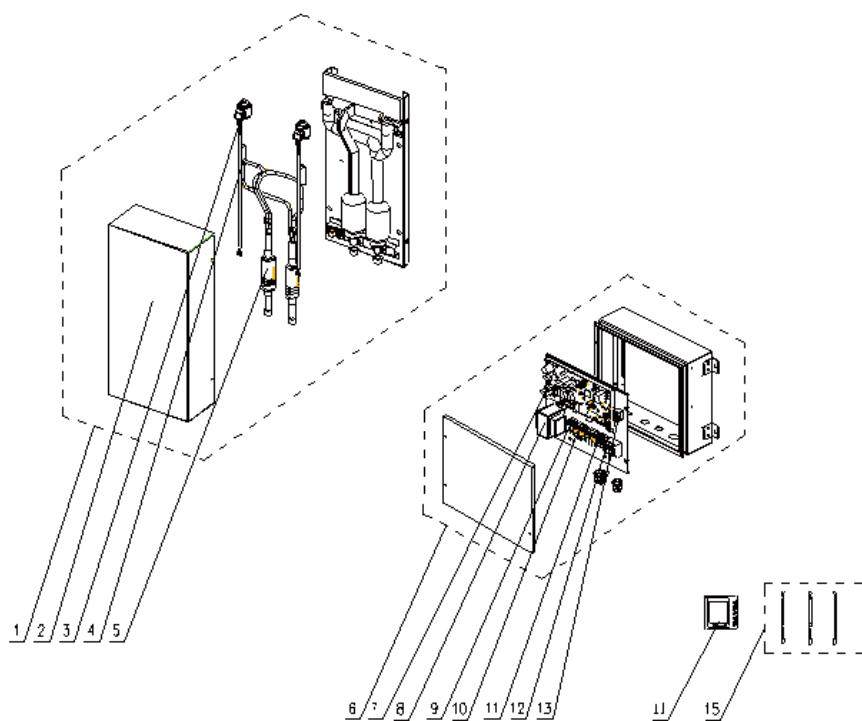

Exploded View of GMV-N192U/A-T(U)

NO.	Model	GMV-N192U/A-T(U)	Qty.
	Product Code	CN750N0091	
	Part Name	Part Code	
1	Electronic Expansion Valve assy	43044100220	1
2	Cover Plate	01264100063P	1
3	Electric Expand Valve Fitting	4304413239	2
4	Electronic Expansion Valve	07331139	2
5	Bidirection Strainer	0721004401	2
6	Electric Box Assy	100002002825	1
7	Main Board	30226000081	1
8	Transformer	43110286	1
9	Terminal Board	4201115402	1
10	Terminal Board	4201025901	2
11	Terminal Board	42011154	1
12	Terminal Board	4201800002601	1
13	Terminal Board	42011147	1
14	Display Board	30296000040	1
15	Sensor Sub-assy	39008000130G	1


Above data is subject to change without notice, please refer the SP in global service website.

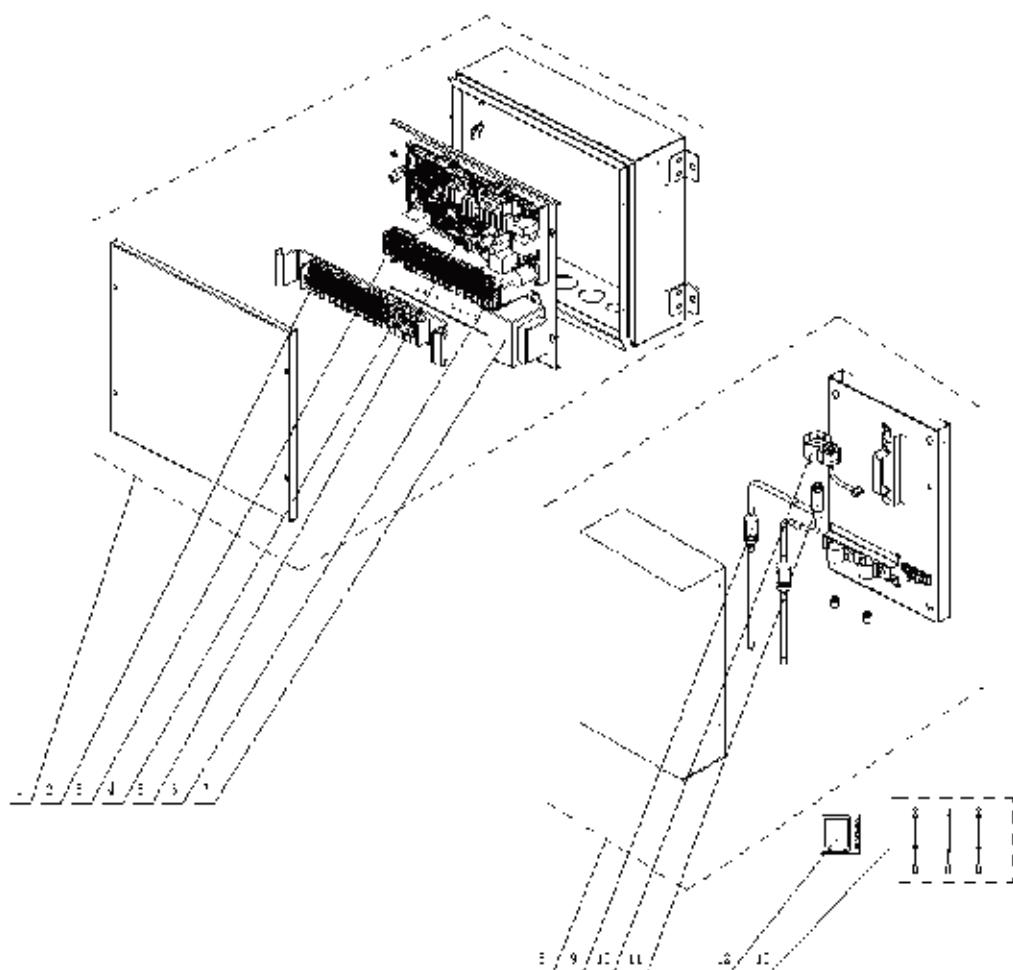

Exploded View of GMV-N12U/C-T(U)

NO.	Model	GMV-N12U/C-T(U)	Qty.
	Product Code	CN750N0250	
	Part Name	Part Code	
1	Electric Box Assy	100002070138	1
2	Terminal Board	422000000009	2
3	Terminal Board	42200006000401	1
4	Terminal Board	42200006000901	1
5	Main Board	300002060941	1
6	Terminal Board	42000100000102	1
7	Transformer	450002060013	1
8	Electronic Expansion Valve assy	030174060015	1
9	Strainer	07415200002	2
10	Electric Expand Valve Fitting	4304000112	1
11	Electronic Expansion Valve	072009000006	1
12	Display Board	30296000040	1
13	Sensor Sub-assy	390002060021	1

Above data is subject to change without notice, please refer the SP in global service website.

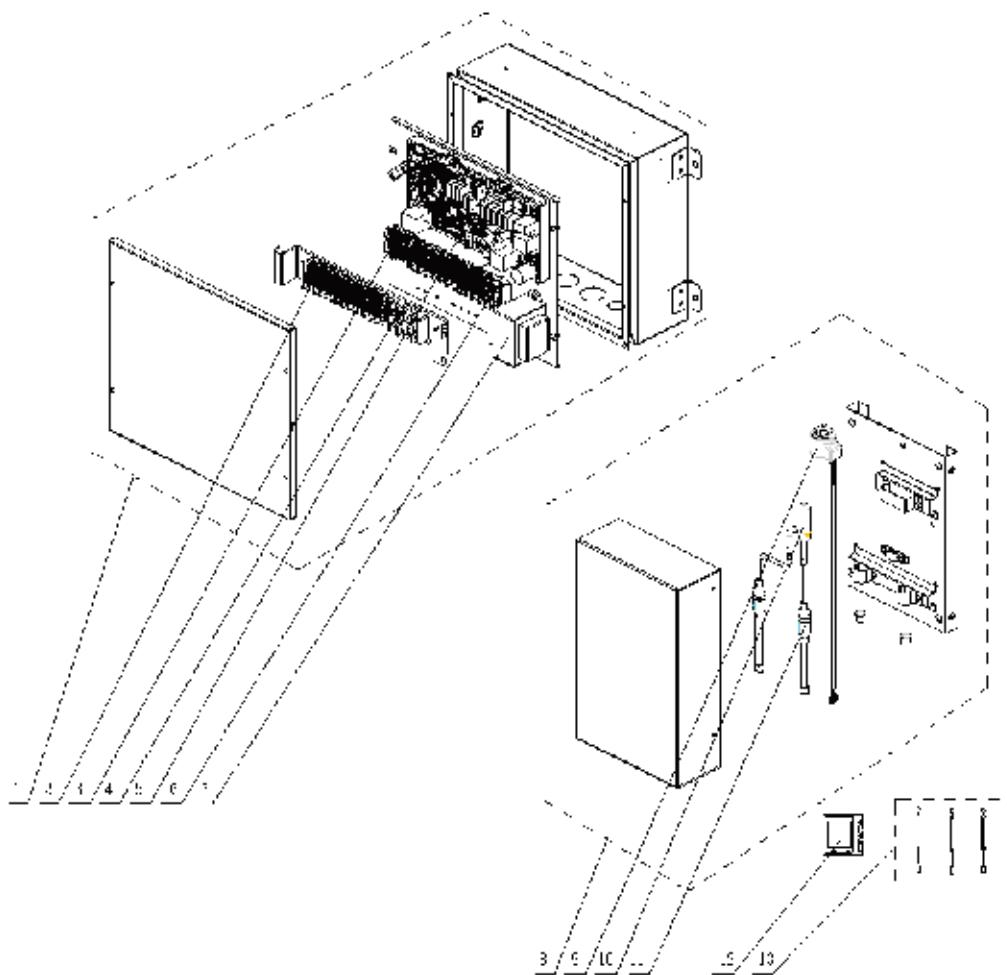

Exploded View of GMV-N24U/C-T(U)

NO.	Model	GMV-N24U/C-T(U)	Qty.
	Product Code	CN750N0230	
	Part Name	Part Code	
1	Electric Box Assy	100002070138	1
2	Terminal Board	422000000009	2
3	Terminal Board	42200006000401	1
4	Terminal Board	42200006000901	1
5	Main Board	300002060941	1
6	Terminal Board	42000100000102	1
7	Transformer	450002060013	1
8	Electronic Expansion Valve assy	030174060014	1
9	Electric Expand Valve Fitting	4304413239	1
10	Electronic Expansion Valve	072009000001	1
11	Strainer	0741520000201	2
12	Display Board	30296000040	1
13	Sensor Sub-assy	390002060021	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-N48U/C-T(U)


NO.	Model	GMV-N48U/C-T(U)	Qty.
	Product Code	CN750N0240	
	Part Name	Part Code	
1	Electric Box Assy	100002070138	1
2	Terminal Board	422000000009	2
3	Terminal Board	42200006000401	1
4	Terminal Board	42200006000901	1
5	Main Board	300002060941	1
6	Terminal Board	42000100000102	1
7	Transformer	450002060013	1
8	Electronic Expansion Valve assy	030174060012	1
9	Electric Expand Valve Fitting	4304413239	1
10	Electronic Expansion Valve	43044100172	1
11	Strainer	0741520000201	2
12	Display Board	30296000040	1
13	Sensor Sub-assy	390002060021	1

Above data is subject to change without notice, please refer the SP in global service website.

## Exploded View of GMV-N96U/C-T(U)

NO.	Model	GMV-N96U/C-T(U)	Qty.
	Product Code	CN750N0210	
	Part Name	Part Code	
1	Electric Box Assy	100002070138	1
2	Terminal Board	422000000009	2
3	Terminal Board	42200006000401	1
4	Terminal Board	42200006000901	1
5	Main Board	300002060941	1
6	Terminal Board	42000100000102	1
7	Transformer	450002060013	1
8	Electronic Expansion Valve assy	030174060013	1
9	Electric Expand Valve Fitting	4304413239	1
10	Electronic Expansion Valve	43044100190	1
11	Strainer	0741520000201	2
12	Display Board	30296000040	1
13	Sensor Sub-assy	390002060021	1

Above data is subject to change without notice, please refer the SP in global service website.

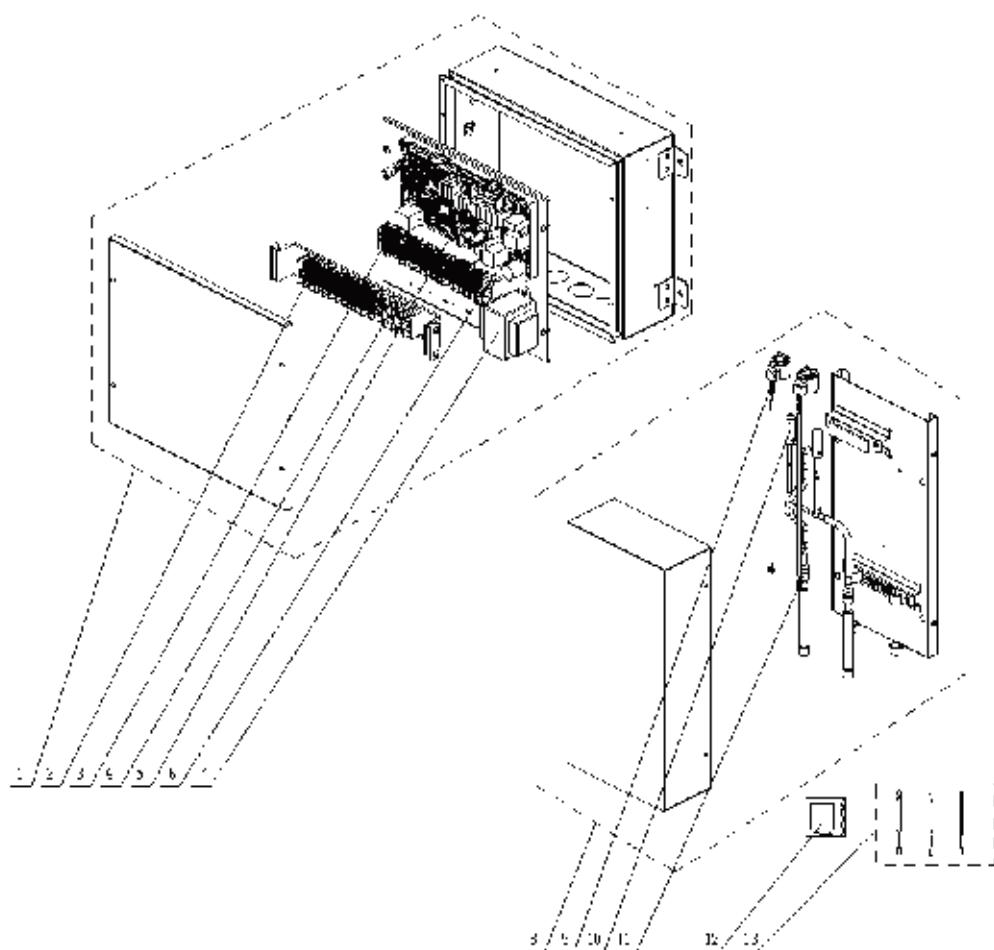


Exploded View of GMV-N192U/C-T(U)

NO.	Model	GMV-N192U/C-T(U)	Qty.
	Product Code	CN750N0220	
	Part Name	Part Code	
1	Electric Box Assy	100002070138	1
2	Terminal Board	422000000009	2
3	Terminal Board	42200006000401	1
4	Terminal Board	42200006000901	1
5	Main Board	300002060941	1
6	Terminal Board	42000100000102	1
7	Transformer	450002060013	1
8	Electronic Expansion Valve assy	030174060011	1
9	Electric Expand Valve Fitting	4304413239	2
10	Electronic Expansion Valve	43044100190	2
11	Strainer	0721212101	2
12	Display Board	30296000040	1
13	Sensor Sub-assy	390002060021	1

Above data is subject to change without notice, please refer the SP in global service website.

## 5.14 1-way Cassette Type Indoor Unit

Exploded View of GMV-ND07TD/A-T(U) / GMV-ND09TD/A-T(U) / GMV-ND12TD/A-T(U)

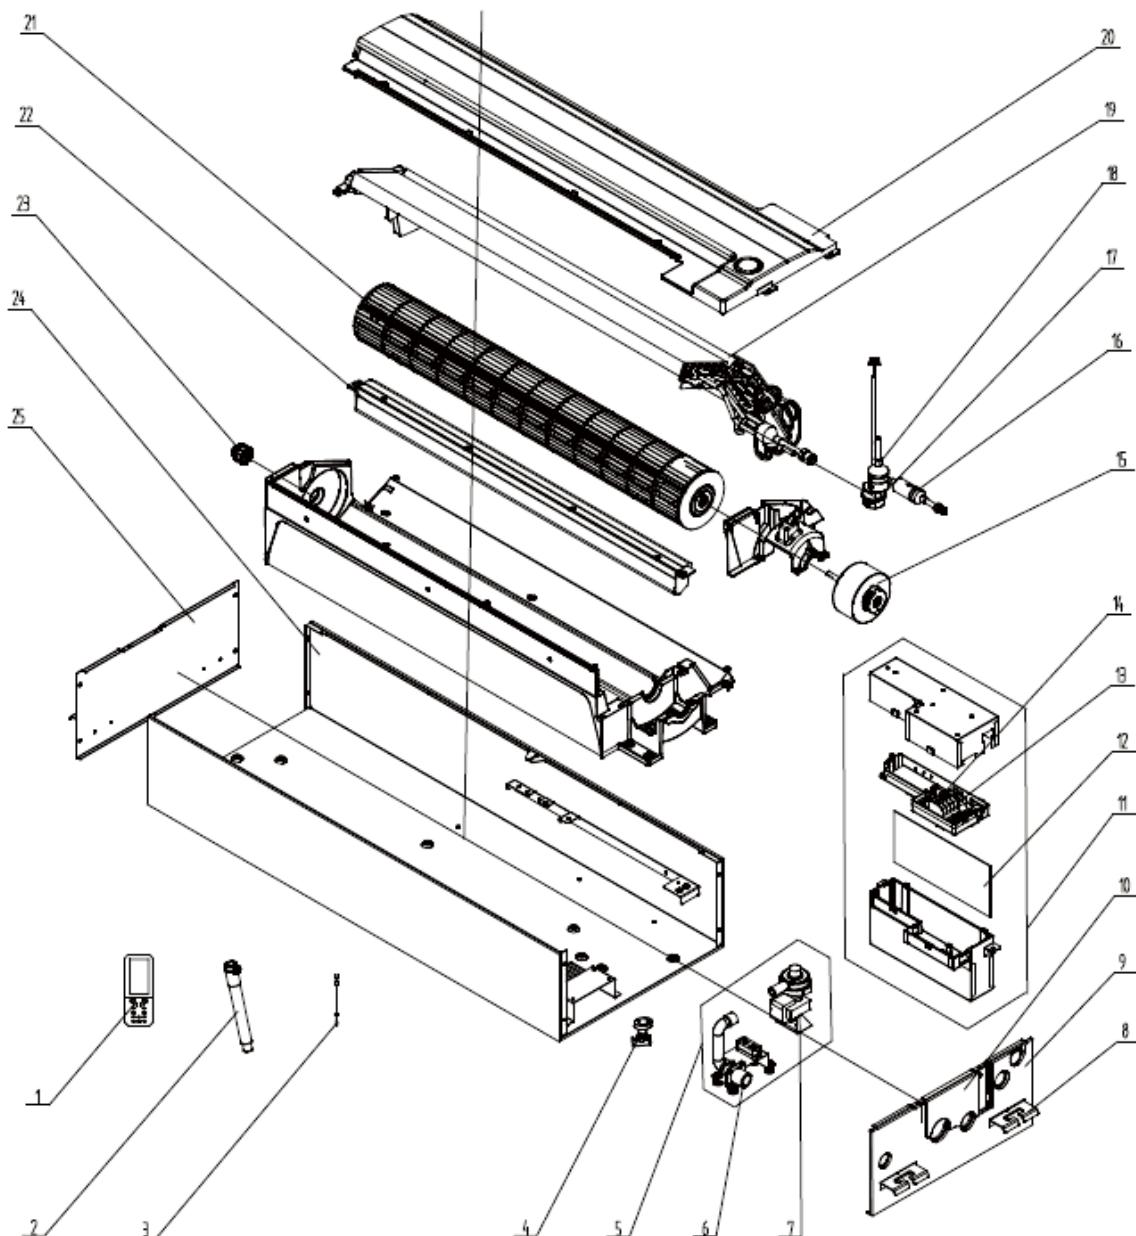

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND07TD/A-T(U)	CM502N0151	GMV-ND09TD/A-T(U)	CM502N0161
		Part code	Quantity	Part code	Quantity
1	Remote Controller	30510589	1	30510589	1
2	Drain Hose Sub-Assy	05232050	1	05232050	1
3	Temperature Sensor	39008000079G	1	39008000079G	1
4	Water Level Switch	4501270301	1	4501270301	1
5	Water Pump Assy	15404100005	1	15404100005	1
6	Pump Drainpipe	26905288	1	26905288	1
7	Water Pump	4313822001	1	4313822001	1
8	Hook	02112466	4	02112466	4
9	Right Side Plate Sub-Assy	01314100023	1	01314100023	1

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND07TD/A-T(U)	CM502N0151	GMV-ND09TD/A-T(U)	CM502N0161
		Part code	Quantity	Part code	Quantity
10	Tube Exit Plate Assy	01344100020	1	01344100020	1
11	Electric Box Assy	01394100396	1	01394100396	1
12	Main Board	30226000029	1	30226000029	1
13	Terminal Board	4201026603	1	4201026603	1
14	Terminal Board	4201800002601	1	4201800002601	1
15	Brushless DC Motor	1501214301	1	1501214301	1
16	Strainer	0741410002501	1	0741410002501	1
17	Electronic Expansion Valve	07334492	1	07334492	1
18	Filter	07415210	1	07415210	1
19	Evaporator Assy	0102410009501	1	01024100095	1
20	Water Tray Sub-Assy	01284100011	1	01284100011	1
21	Cross Flow Fan	10454100001	1	10454100001	1
22	Helicoid Tongue sub-assy	02224100007	1	02224100007	1
23	O-Gasket of Cross Fan Bearing	76512203	1	76512203	1
24	Chassis Assy	01194100007	1	01194100007	1
25	Left Side Plate Sub-Assy	01314100022	1	01314100022	1


Above data is subject to change without notice, please reference the SP in global service website.

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND12TD/A-T(U)	CM502N0181
		Part code	Quantity
1	Remote Controller	30510589	1
2	Drain Hose Sub-Assy	05232050	1
3	Temperature Sensor	39008000079G	1
4	Water Level Switch	4501270301	1
5	Water Pump Assy	15404100005	1
6	Pump Drainpipe	26905288	1
7	Water Pump	4313822001	1
8	Hook	02112466	4
9	Right Side Plate Sub-Assy	01314100023	1
10	Tube Exit Plate Assy	01344100020	1
11	Electric Box Assy	01394100396	1
12	Main Board	30226000029	1
13	Terminal Board	4201026603	1
14	Terminal Board	4201800002601	1
15	Brushless DC Motor	1501214301	1
16	Strainer	0741410002501	1
17	Electronic Expansion Valve	07334494	1
18	Filter	07415210	1
19	Evaporator Assy	01024100014	1
20	Water Tray Sub-Assy	01284100011	1
21	Cross Flow Fan	10454100001	1

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND12TD/A-T(U)	CM502N0181
22	Helicoid Tongue sub-assy	02224100007	1
23	O-Gasket of Cross Fan Bearing	76512203	1
24	Chassis Assy	01194100007	1
25	Left Side Plate Sub-Assy	01314100022	1

Above data is subject to change without notice, please reference the SP in global service website.

## 5.15 General Static Pressure Duct Type Indoor Unit

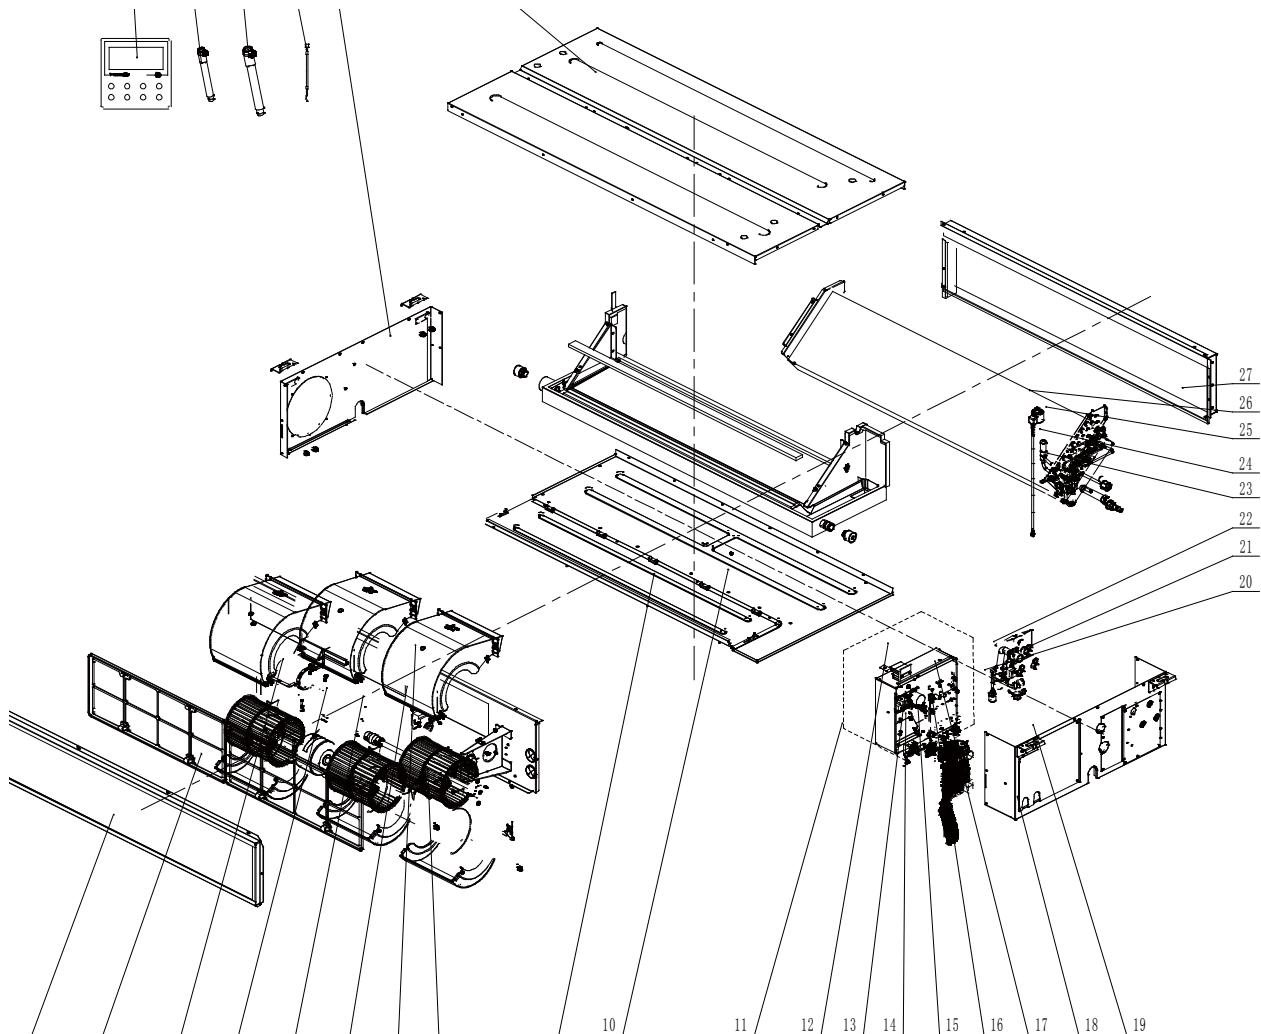


1      2      3      4      5      6      7      8      9

No.	Name of part	For the following unit		For the following unit	
		Unit	Product Code	Unit	Product Code
		GMV-ND30PLS/C-T(U)	CM810N2020	GMV-ND42PLS/C-T(U)	CM810N2000
		GMV-ND36PLS/C-T(U)	CM810N2010	GMV-ND48PLS/C-T(U)	CM810N1990
Part code		Quantity	Part code		Quantity
1	Filter Sub-Assy	11725206	2	11725206	2
2	Air Intake Side Board Sub-Assy	02225261	1	02225261	1
3	Brushless DC Motor	150104060015	1	150104060015	1
4	Centrifugal Fan	103003060003	3	103003060003	3
5	Joint Slack	73018731	1	73018731	1
6	Inductance	4312800001403	1	4312800001403	1
7	Volute Casing	200230060004	3	200230060004	3
8	Volute Casing	200230060003	3	200230060003	3
9	Cover Of Air-In	01265344	1	01265344	1
10	Bottom Cover Plate	01265343	1	01265343	1
11	Electric Box Assy	100002068420	1	100002068420	1
12	Radiator	430034060043	1	430034060043	1
13	Filter Board	300020060016	1	300020060016	1
14	Terminal Board	4201110602	1	4201110602	1
15	Terminal Board	42200006000401	1	42200006000401	1
16	Main Board	300002060459	1	300002060459	1
17	Main Board	300002060399	1	300002060399	1
18	Right Side Plate Assy	01315298	1	01315298	1
19	Hook	02112466	4	02112466	4
20	Water Pump	81200706001601	1	81200706001601	1
21	Water Level Switch	43002400000502	1	43002400000502	1
22	Pump Drainpipe	04615487	1	04615487	1
23	Strainer	0721304401	2	0721304401	2
24	Electronic Expansion Valve	07334468	1	07334468	1
25	Evaporator Assy	011001060443	1	011001060443	1
26	Electric Expand Valve Fitting	4304413215	1	4304413215	1
27	Air Outlet Side Board Assy	02225270	1	02225270	1
28	Top Cover Board Assy	0126534901	1	0126534901	1
29	Left Side Plate Assy	01315299	1	01315299	1
30	Sensor Sub-Assy	39004169G	1	39004169G	1
31	Drain Hose Sub-Assy	05232050	1	05232050	1
32	Corrugated Pipe	05015408	1	05015408	1
33	Display Board	30296000040	1	30296000040	1

Above data is subject to change without notice, please reference the SP in global service website.

## 5.16 360°Air Discharge Compact Cassette Type Indoor Unit

Exploded View of GMV-ND05T/E-T(U) / GMV-ND07T/E-T(U) / GMV-ND09T/E-T(U) /  
GMV-ND12T/E-T(U) / GMV-ND15T/E-T(U) / GMV-ND18T/E-T(U)

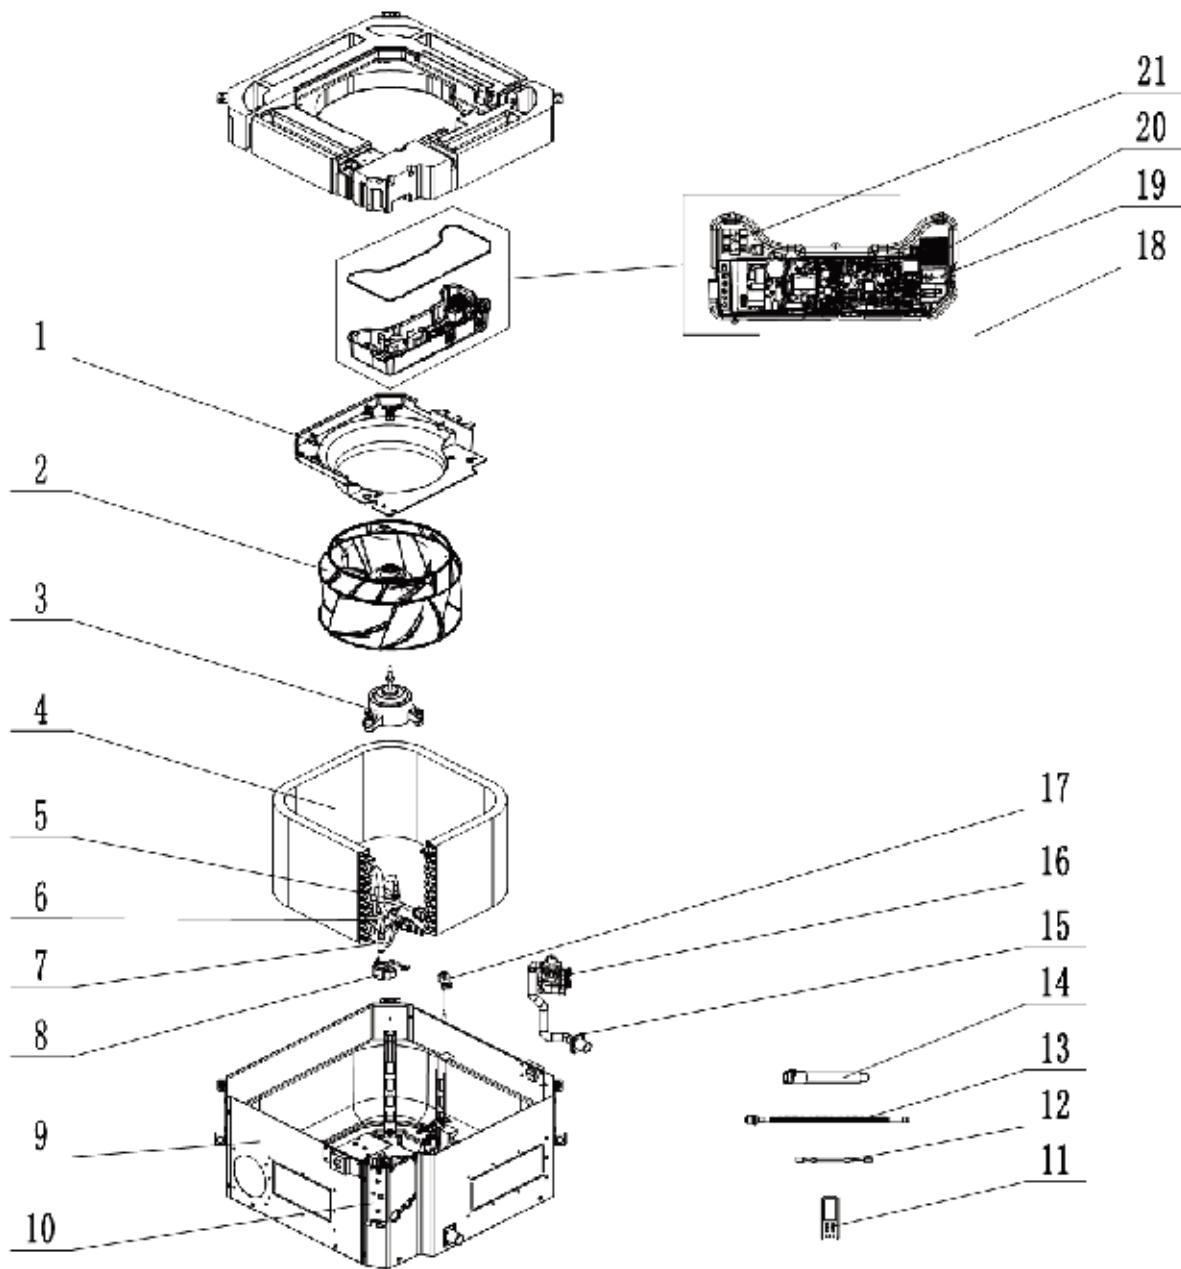


No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND05T/E-T(U)	CM500N1600
		GMV-ND07T/E-T(U)	CM500N1590
		GMV-ND09T/E-T(U)	CM500N1620
		GMV-ND12T/E-T(U)	CM500N1580
		GMV-ND15T/E-T(U)	CM500N1610
		GMV-ND18T/E-T(U)	CM500N1570
Part code		Quantity	
1	Flow Guide Loop	200150060003	1
2	Centrifugal Fan	103003060008	1
3	Brushless DC Motor	150104060012	1
4	Evaporator Assy	011001060373	1
5	Strainer	07213032	1
6	Strainer	07216221	1
7	Electronic Expansion Valve	072009000006	1
8	Electric Expand Valve Fitting	43040001	1
9	Shell Assy	011633060005	1
10	Mounting Rack Sub-Assy	017044060011	4
11	Remote Controller	30510589	1
12	Sensor Sub-Assy	39008000115G	1
13	Corrugated Pipe	05015408	1
14	Drain Hose Sub-Assy	007008000001	1
15	Drain Pipe	200070060005	1
16	Water Pump	430024000005	1
17	Liquid Level Switch	4313800005802	1
18	Electric Box Assy	100002068378	1
19	Main Board	300002000782	1
20	Terminal Board	42200006000401	1
21	Terminal Board	4201110602	1

Above data is subject to change without notice, please reference the SP in global service website.

## 5.17 360°Air Discharge Cassette Type Indoor Unit

Exploded View of GMV-ND07T/C-T(U) / GMV-ND09T/C-T(U) / GMV-ND12T/C-T(U) / GMV-ND15T/C-T(U) / GMV-ND18T/C-T(U) / GMV-ND22T/C-T(U) / GMV-ND24T/C-T(U) / GMV-ND30T/C-T(U) GMV-ND36T/C-T(U) / GMV-ND42T/C-T(U) / GMV-ND48T/C-T(U)

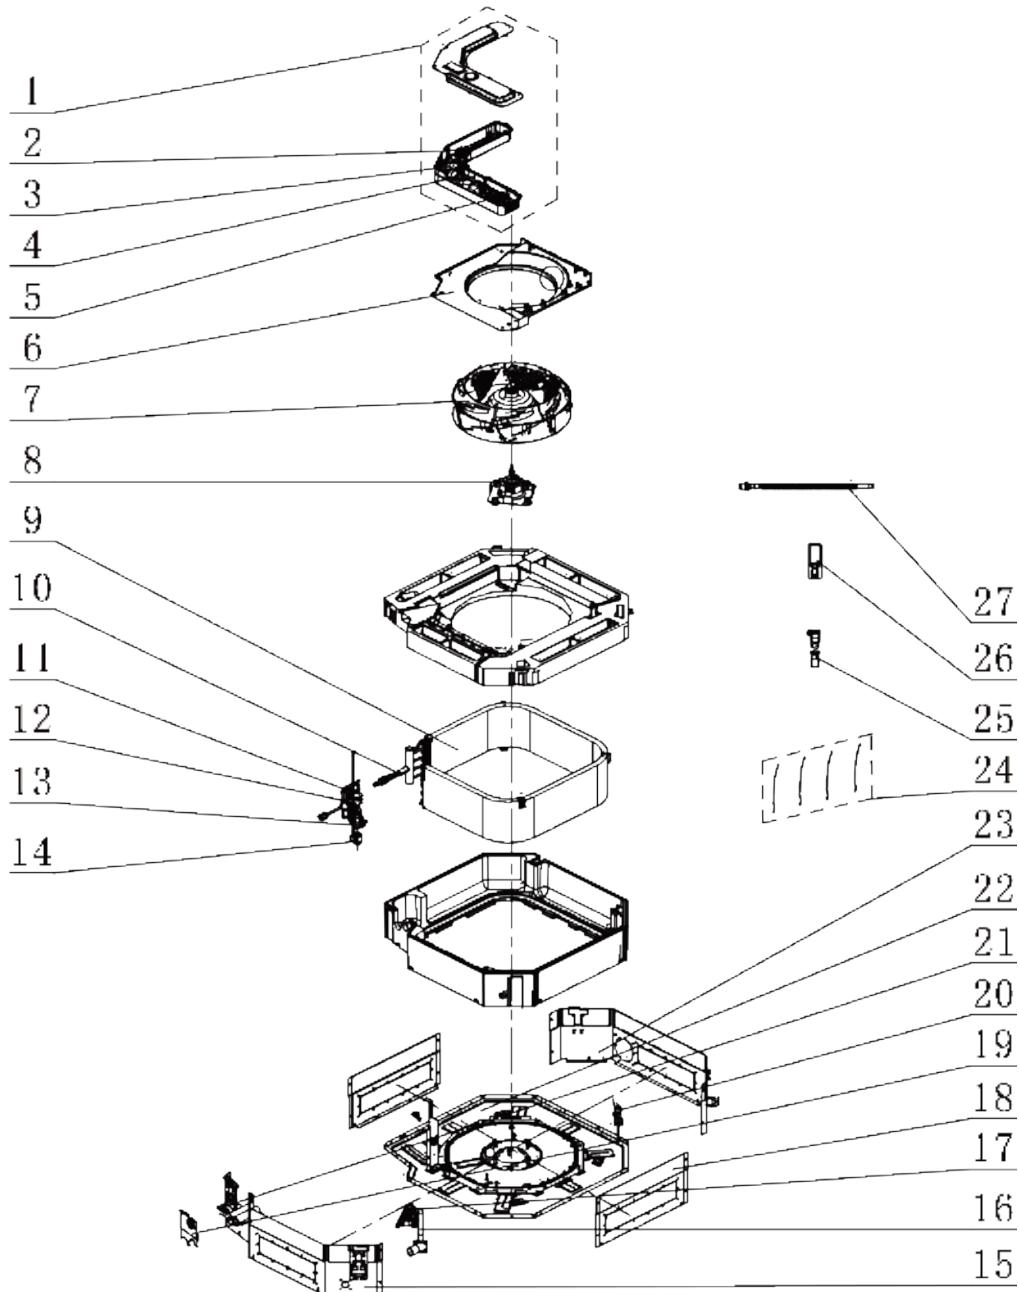

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND07T/C-T(U)	CM500N1560
		GMV-ND09T/C-T(U)	CM500N1480
		GMV-ND12T/C-T(U)	CM500N1530
		GMV-ND15T/C-T(U)	CM500N1460
		GMV-ND18T/C-T(U)	CM500N1470
		GMV-ND22T/C-T(U)	CM500N1520
		GMV-ND24T/C-T(U)	CM500N1490
Part code		Quantity	
1	Electric Box Assy	100002068346	1
2	Terminal Board	42200006000401	1
3	Terminal Board	4201110602	1
4	Filter Board	30221000021	1
5	Main Board	300002060274	1
6	Diversion Circle	26909400067	1
7	Centrifugal Fan	10429400004	1
8	Brushless DC Motor	1570410000702	1
9	Evaporator Assy	011001000236	1
10	Corrugated Pipe	035030000007	4
11	Strainer	07415210	1
12	Strainer	07213050	1
13	Electronic Expansion Valve	07334466	1
14	Electric Expand Valve Fitting	4304413252	1
15	Side Plate 2	01319400050	1
16	Drainage Pipe Sub-Assy	26909400055	1
17	Water Pump	43138000058	1
18	Side Plate 3	01319400051	2
19	Seal Plate	0149940000202	1
20	Liquid Level Switch	4502021601	1
21	Body Installing Plate	01332701	4
22	Seat Board Sub-Assy	02229400011	1
23	Side Plate 1	01319400049	1
24	Sensor Sub-Assy	390002000032	1
25	Drain Hose	05232044	1
26	Remote Controller	30510589	1
27	Corrugated Pipe	05015408	1

Above data is subject to change without notice, please refer the SP in global service website.

No.	Name of part	For the following unit	
		Unit	Product Code
		GMV-ND30T/C-T(U)	CM500N1550
		GMV-ND36T/C-T(U)	CM500N1500
		GMV-ND42T/C-T(U)	CM500N1450
		GMV-ND48T/C-T(U)	CM500N1540
Part code		Quantity	
1	Electric Box Assy	100002068346	1
2	Terminal Board	42200006000401	1
3	Terminal Board	4201110602	1
4	Filter Board	30221000021	1
5	Main Board	300002060274	1
6	Diversion Circle	10479400002	1
7	Centrifugal Fan	10429400003	1
8	Brushless DC Motor	15709400009	1
9	Evaporator Assy	011001000405	1
10	Corrugated Pipe	035030000007	4
11	Strainer	07415210	1
12	Strainer	07213050	1
13	Electronic Expansion Valve	07334468	1
14	Electric Expand Valve Fitting	4304413252	1
15	Side Plate 2	01319400026	1
16	Drainage Pipe Sub-Assy	26909400055	1
17	Water Pump	43138000058	1
18	Side Plate 3	01319400036	2
19	Seal Plate	0149940000202	1
20	Liquid Level Switch	4502021601	1
21	Body Installing Plate	01332701	4
22	Seat Board Sub-Assy	02229400011	1
23	Side Plate 1	01319400025	1
24	Sensor Sub-Assy	390002000032	1
25	Drain Hose	05232044	1
26	Remote Controller	30510589	1
27	Corrugated Pipe	05015408	1

Above data is subject to change without notice, please refer the SP in global service website.



GREE ELECTRIC APPLIANCES, INC. OF ZHUHAI 519070

Add: West Jinji Rd, Qianshan Zhuhai, Guangdong, China

Tel: (+86-756)8522218

Fax: (+86-756)8669426

E-mail: gree@cn.gree.com www.gree.com

JF00302921